

Drainage Reports

Abbreviated Water & Sewer Need Reports

Water Study

Wastewater Study

Stormwater Waiver Application



Water Basis of Design

Prepared: September 2016

STORYROCK Phase 1C

Prepared for:

Switzenberg Companies



Prepared by:

Kimley-Horn and Associates, Inc.

7740 N. 16th Street, Suite 300
Phoenix, Arizona 85020
(602) 944-5500

191069020

© Kimley-Horn and Associates, Inc.
September, 2016.

Kimley»Horn

5-PP-2016#3

TABLE OF CONTENTS

1.0	INTRODUCTION	2
1.1	PROJECT DESCRIPTION.....	2
1.2	PROJECT LOCATION.....	2
1.3	SCOPE OF WATER PLAN.....	2
2.0	EXISTING SITE CONDITIONS AND WATER SYSTEMS	4
2.1	SITE CONDITIONS.....	4
2.2	ADJACENT WATER SYSTEMS.....	4
2.3	EXISTING PRESSURE ZONES.....	4
2.4	PHASING AND EXISTING STORYROCK DEVELOPMENT.....	4
3.0	PROPOSED WATER SYSTEM	6
3.1	GENERAL DISCUSSION.....	6
3.2	PHASE 1C PROPOSED DISTRIBUTION SYSTEM.....	6
4.0	METHODOLOGY AND CALCULATIONS	8
4.1	GENERAL DISCUSSION.....	8
4.2	WATER DEMANDS, FIRE FLOWS, PRESSURES.....	8
4.3	HYDRAULIC MODEL.....	8
4.5	RESULTS.....	9

LIST OF APPENDICES

APPENDIX A – FIRE FLOW TEST RESULTS AND PS-145 PUMP CURVES

APPENDIX B – WATERCAD MODEL RESULTS

LIST OF FIGURES

FIGURE 1: VICINITY MAP.....	3
FIGURE 2: WATER SYSTEM LAYOUT.....	7



1.0 INTRODUCTION

1.1 Project Description

The purpose of this water report is to support the proposed StoryRock Phase 1C residential development. StoryRock Phase 1C (Phase 1C) is part of the StoryRock Master Planned Community (formerly named Cavalliere Ranch), a development consisting of 462-acres of single family residential construction. A Conceptual Water Master Plan was approved October 2014 with the project Zoning Case (13-ZN-2014) and amended October 2016.

StoryRock Phase 1C is a proposed 80-acre single family residential subdivision consisting of 96 single family residential units. Phase 1C is zoned for R1-18 and R1-43 development.

1.2 Project Location

StoryRock is located within Section 12 of Township 4 North, Range 5 East of the Gila and Salt River Base and Meridian, Maricopa County, Arizona. The site is bound to the north by the Happy Valley Road Alignment and to the west by 128th Street. The Pinnacle Peak Road Alignment borders the site to the south. The McDowell Sonoran Preserve borders the site to the east and portions of the site to the north and south. Phase 1C is located on the eastern half of the project, north of Alameda Road. See **Figure 1: Vicinity Map.**

1.3 Scope of Water Plan

The Conceptual Master Water Plan for StoryRock established water distribution design parameters, criteria and a general plan for water distribution. The report presented a conceptual layout of transmission and distribution mains. It also established pressure zones and pressure reducing valve (PRV) locations. Water demands have been calculated based on proposed zoning and a preliminary development layout.

This report presents the basis of design criteria that will be used for the engineering design of the proposed Phase 1C development. Furthermore, this report will establish the water system demands and the proposed water system infrastructure required to serve the development. Finally, the report will show the development of Phase 1C is in conformance with the approved master plan.

All design criteria that is presented in this report will conform to the City of Scottsdale Design Standards & Polices Manual (DS&PM):

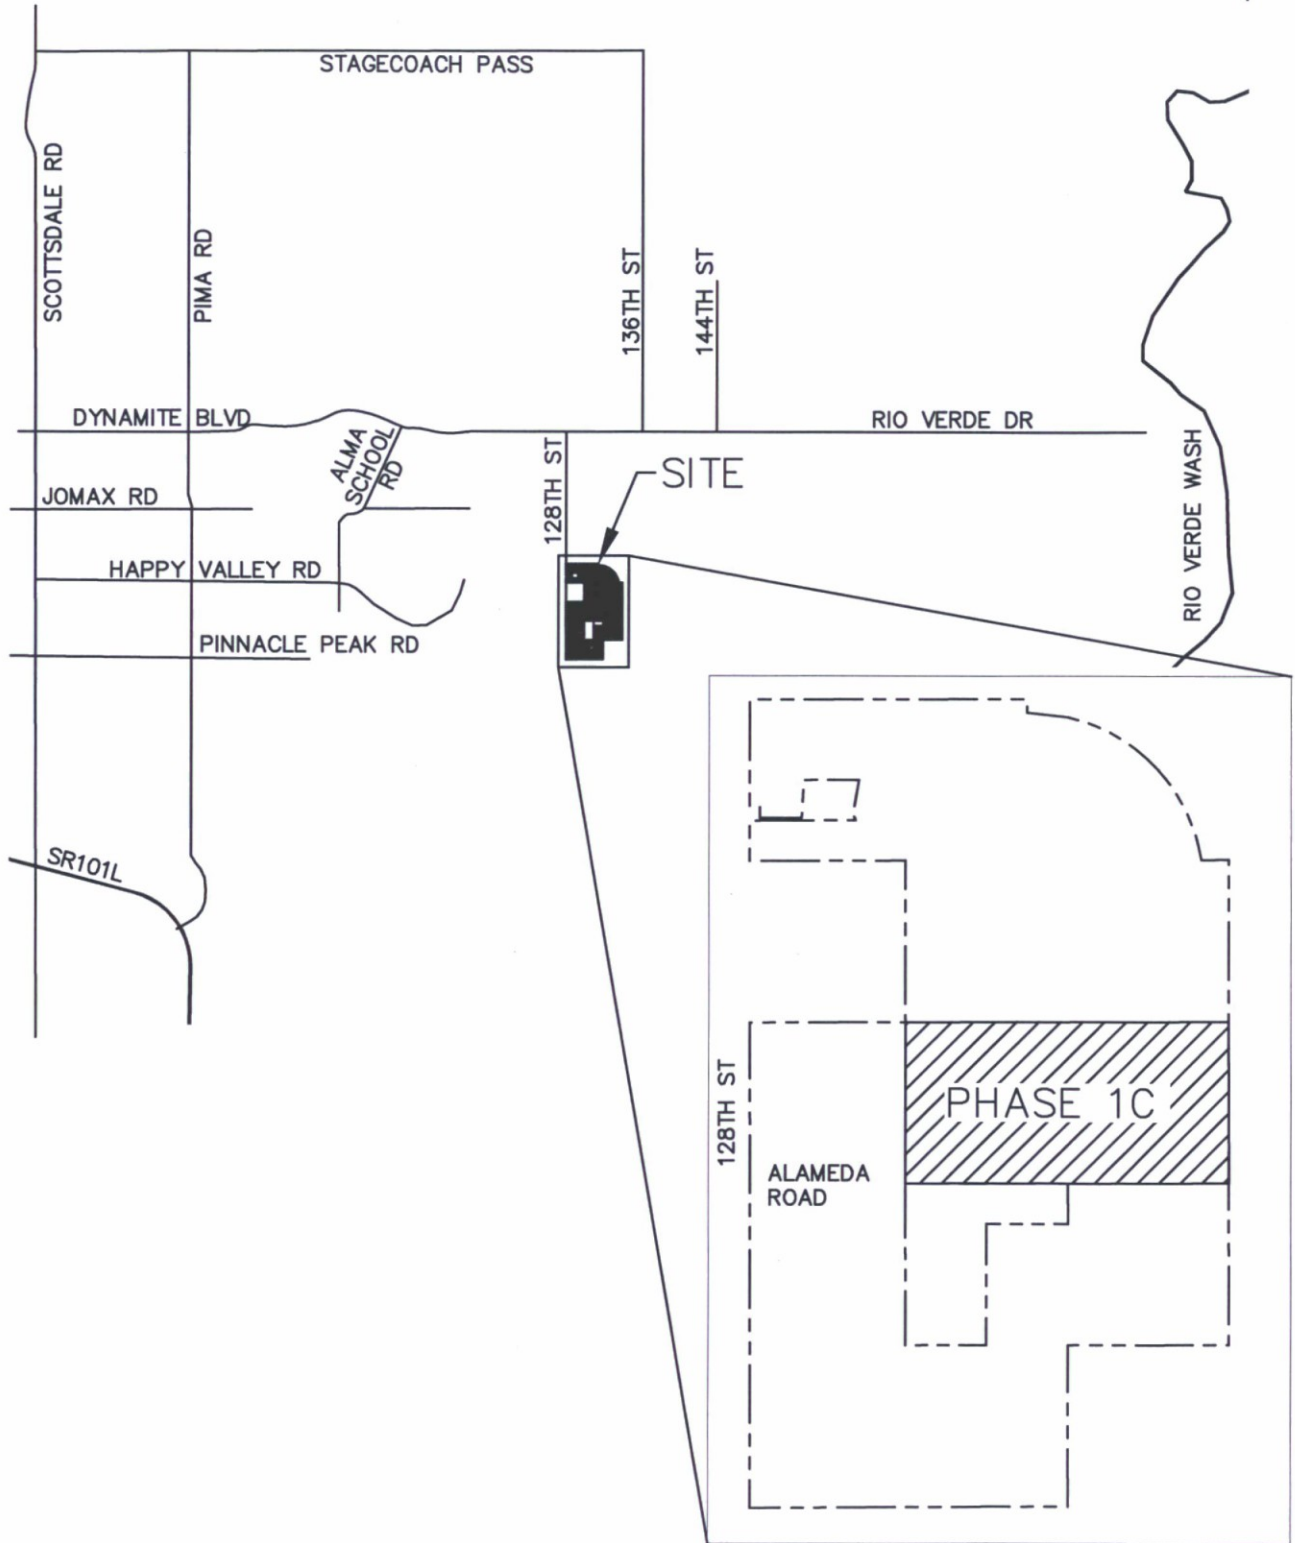


FIGURE 1
VICINITY MAP
STORYROCK



2.0 EXISTING SITE CONDITIONS AND WATER SYSTEMS

2.1 Site Conditions

The majority of the project is undeveloped natural desert with the exception of a single dwelling unit located near the center of the project. The dwelling unit consists of a few small scattered structures and fences, but no substantial improvements or pavement. Based on a review of City Quarter Section maps; no city water infrastructure exists on-site. A public records request with ADWR indicates an existing well on site, which has been capped. As the dwelling unit is not a primary residence, water was likely transported on-site.

The site is characterized by many washes and rock features of varying sizes. The on-site washes vary in size and depth, but generally flow from the southwest to the northeast or east through the site. Phase 1C is bordered to the east by The McDowell Sonoran Preserve. Other Storyrock development phases bound the site to the north, west and south. Multiple ridgelines run through the site, in the general direction of southwest to northeast. Elevations range from approximately 2660' in the southwest to 2540' in the northeast.

2.2 Adjacent Water Systems

Directly to the west of the project is the development of Sereno Canyon. A majority of the project infrastructure has been constructed, though none of the lots have been developed. An existing zone 13 booster pump station (PS 145) is located at Alameda Road and the 122th Street alignment, near the west edge of Sereno Canyon. The booster pump is proposed to serve the area. PS 145 is comprised of three 500 gpm pumps and a 1,750 gpm fire flow booster pump, connected to a 12,000-gallon tank. One of the pumps is required to be kept as a redundant pump. Additionally, there is space for a 4th domestic pump.

An existing 8-inch DIP waterline is located in Ranch Gate Road west of the site. This line connects to an existing 12-inch DIP waterline at 128th Street. The line in 128th Street extends north approximately 430 feet and is stubbed to the south. There is also an existing 6-inch DIP waterline in Buckskin Trail providing service to properties along the frontage. No other waterlines are located adjacent to the project.

2.3 Existing Pressure Zones

Based on elevations, the existing Phase 1C site falls within two (2) City of Scottsdale pressure zones: 11 and 12. Sereno Canyon to the west primarily operates in pressure zone 13. There is an existing pressure reducing valve (PRV) on the 8-inch line in Ranch Gate east of 125th Place, which reduces the line to pressure zone 12. Phase 1C will operate entirely in zone 12.

2.4 Phasing and Existing StoryRock Development

3.0 Proposed Water System

3.1 General Discussion

Per the approved master plan, the water system for StoryRock consists of an extension of the 12-inch transmission line within 128th Street and 8-inch distribution lines internal to the development. PRV's divide the project into pressure zones 12 and 13. Waterline looping is provided for redundancy and water quality. The proposed StoryRock system connects to the zone 13 water system in Sereno Canyon along the Alameda alignment west of 128th Street, and to the zone 12 system at the intersection of Ranch Gate Road and 128th Street.

3.2 Phase 1C Proposed Distribution System

The Phase 1C proposed on-site distribution system will consist of an 8" Class 350 DIP water line that will provide potable water and fire protection. Phase 1C will operate entirely in pressure zone 12.

The off-site waterlines needed to serve Phase 1C includes an 8-inch line within Alameda Road, a 12-inch line within 128th Street from Ranch Gate Road to Alameda Road and the 12-inch connection line to Sereno Canyon. Additionally, two PRVs are required to produce pressure zone 12, one along 128th Street and one along Alameda Road.

At full buildout of the StoryRock development, waterline looping is provided through the multiple phases to ensure redundancy and cycling of water for water quality. A connection to the Phase 1B distribution system is required to loop the Phase 1C distribution system. In the event Phase 1C is developed prior to Phase 1B, an off-site waterline will need to be constructed along the proposed Phase 1B alignment in Ranch Gate Road. The off-site waterline will provide the second connection point to the 12-inch line in 128th Street, at the intersection of 128th Street and Ranch Gate Road. In addition to providing redundancy, the two connections prevent long dead-end lines. All proposed dead-end distribution lines are less than 1,200 feet, satisfying the requirements of the DS&PM.

See **Figure 2: Water System Layout** for waterline and PRV locations.

4.0 METHODOLOGY AND CALCULATIONS

4.1 General Discussion

The proposed water distribution system for Phase 1C has been designed to provide the calculated domestic and fire flow demands for the project, while maintaining required operating pressures. The design criterion conforms to the approved Conceptual Water Master Plan and is based on requirements described with in the City of Scottsdale Design Standards and Policies Manual (DS&PM).

4.2 Water Demands, Fire Flows, Pressures

The proposed water distribution system for the project is modeled under 4 design scenarios: Average Day, Max Day, Peak Hour and Max Day plus Fire Flow. Average Day Demands are based on Figure 6.1-2 in the DS&PM, with peaking factors per section 6-1.404. A fire flow of 1,000 gpm per section 6-1.501 of the DS&PM was used. See **Table 1** below for a summary of water demands. According to Section 6-1.407 of the DSPM, distribution systems shall be designed with a minimum residual pressure of 50 psi and a maximum static pressure of 120 psi. For fire flow scenarios, a minimum design pressure of 30 psi is required.

Table 1: Water Demands

Land Use	Dwelling units (du)	Average Daily Demand (gpd/du)	Average Daily Flow (gpd)	ADF (gpm)	Max Day Flow (gpd)	MDF (gpm)	Peak Hour Flow (gpd)	PHF (gpm)
<2 du/ac	96	485.6	46,618	32	93,235	65	163,162	113

4.3 Hydraulic Model

The WaterCAD v8i water system modeling software distributed by Haestad Methods, Inc. was used to model the proposed water network. The model is calibrated with provided existing system information and tested fire flow conditions. A fire flow test was performed to determine the residual and static pressure of the existing system. The test was performed along Ranch Gate Road near 125th Place. The static hydrant is located to the west of the existing PRV in pressure zone 13. Based on the fire flow test a pump curve is generated. Within the model a pump connected to a reservoir is attached to the model at the static hydrant.

Pump information was also provided for the existing Sereno Canyon booster pump station. This allows a schematic representation of the pump station to be included within the model, including the reservoir tank and the 4 existing pumps.

Refer to **Appendix A** for fire flow test results and the PS-145 pump curves.

Four scenarios are analyzed within the hydraulic models: Average Day Demands, Max Day Demands, Peak Hour Demands, and Max Day plus Fire Flow Demands. Demands are applied at each on-site junction based on the number of adjacent proposed units.

The approved master plan details further analysis of the pump station and build-out scenarios for StoryRock and the surrounding area. For this analysis, only the reservoir and pump correlating to the fire flow test were activate for the average day, max-day, and peak hour scenarios, leaving the booster station inactive. With this configuration, fire flow demands are not satisfied. Thus, the fire pump is exclusively turned on in the fire flow scenario, leaving the fire flow test reservoir and pump inactive. All fire flow is provided from the Sereno Canyon booster station.

The waterline loop through Phase 1B is not included in the hydraulic model. This allows the modelling results to prove the system can provide required flows and pressures without the waterline loop. This allows more flexibility in how the waterline looping is provided at final design.

4.5 Results

Based on the results of the hydraulic modeling, the proposed water distribution system can provide the required domestic and fire flow water demands to the project while maintaining required operating pressures. The 8-inch distribution system with a 12-inch line located in 128th street provides adequate flow for both domestic and fire flow scenarios. The proposed pressure zones maintain system pressure on-site in an adequate range of 50-120 psi. Booster station PS 145 does not need to be active for Phase 1C to satisfy domestic water demands as a standalone development. Fire flow water demands, however, require the booster station fire pump.

See **Appendix B** for complete results of the hydraulic models.



ALLIANCE FIRE PROTECTION CO.

Phone: (480) 966-9178 Fax: (480) 967-9191

2114 East Cedar Street • Tempe, Arizona 85281

E-mail Address: afpc@afpc.com

AZ Lic. C-16 58130

AZ Lic. L-16 74007

NV Lic. C-41a 30135

FIRE HYDRANT FLOW TEST

Name: Kimley-Horn
Senora Canyon
Alameda & 124th Street
Scottsdale Arizona

Date: 03/28/14
Time: 9:00 AM
Report # _____
Tech: R.Pfeiff

Static Hydrant: NWC Alameda & 124th St. Flowing Hydrant: NWC 121st St & Alameda

Elevation: 2766
Dist. Between Hydrants: 500 yards
Diameter of Main: 8"
Static Pressure:

A	72.0	B
---	------	---

Residual Pressure:


A	14.0	B
---	------	---

Pump Present: NO
Tank Present: NO
Req. GPM: _____ Req. PSI: _____

Elevation: 2712
Type of Supply: CITY MAIN

Hydrant:	A	A	B	B
Outlet Diameter:	4.0			
Pitot Reading:	12.0			
Coeff:	0.90			
Discharge GPM:	1488	0	0	0

	Flow A			Flow B		
Static pressure of	72	psi @	0 gpm	0	psi @	0 gpm
Residual pressure of	14	psi @	1488 gpm	0	psi @	0 gpm
Available flow @	20	psi @	1403 gpm	20	psi @	gpm

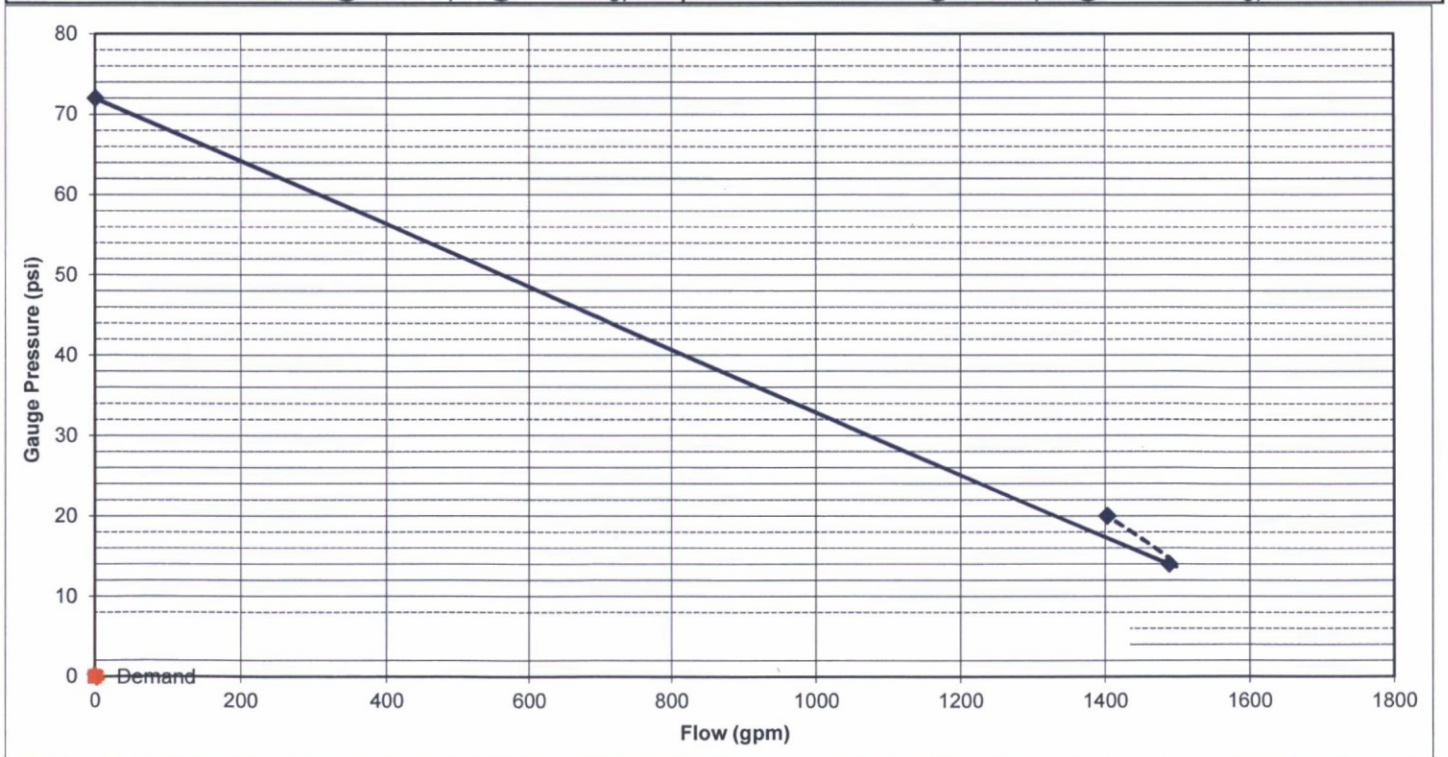

Comments: Elevations are approximate


NOTES:

1. Flowing hydrant is assumed to be on a circulating main or downstream of the pressure test hydrant on a dead-end system.
2. Flow analysis assumes a gravity flow system with no distribution pumps and having no demand, other than the test

S-145

P 1-3

HYDRAULIC PERFORMANCE WARRANTY GUARANTEED AT DESIGNED POINT ONLY AND IS CONTINGENT ON: 1. PROPER NPSH OR SUBMERGENCE AVAILABLE. 2. PROPER AND ADEQUATE FLOW TO PUMP SUCTION. 3. FLUID FREE OF GAS, AIR, AND ABRASIVE MATTER. 4. IMPELLER WITH PROPER LATERAL ADJUSTMENT (VERTICAL PUMP ONLY).	PEERLESS PUMPS		PUMP: 10MA	Rated GPM: 500.00
	TEST SITE: Lubbock TX BY: TH DATE: 9/15/2008 CUSTOMER: P.E.C. PUMP	IMP. NO.: T84363 SHOP ORDER: 747272B-2 STAGES: 8 IMP. DIA1: 1 @ 6.75 X 6.75 IMP. DIA2: 2-5 @ 6.88 X 8.88 IMP. DIA3: 0	Rated Hd(ft): 246.00 Rated RPM: 1782 Rated HP: 38.87 Rated Eff %: 81.40 Spec. Gravity: 1.000	

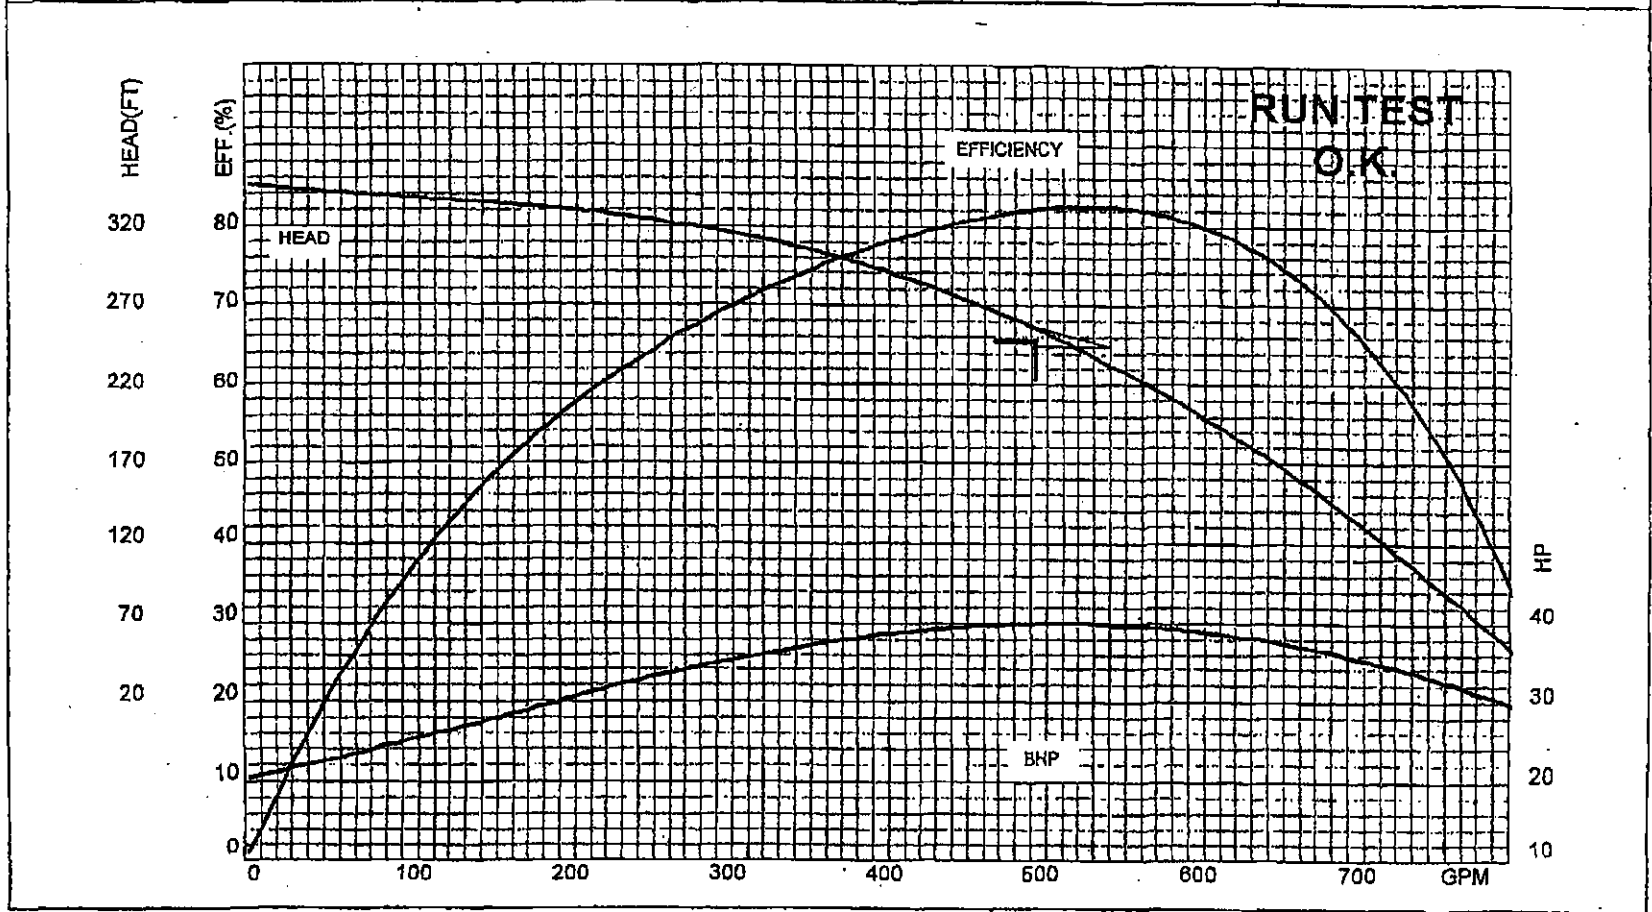


CERTIFIED BOWL PERFORMANCE TEST CURVE

S-145

P-5

<p>HYDRAULIC PERFORMANCE WARRANTY GUARANTEED AT DESIGNED POINT ONLY AND IS CONTINGENT ON: 1. PROPER NPSH OR SUBMERGENCE AVAILABLE. 2. PROPER AND ADEQUATE FLOW TO PUMP SUCTION. 3. FLUID FREE OF GAS, AIR, AND ABRASIVE MATTER. 4. IMPELLER WITH PROPER LATERAL ADJUSTMENT (VERTICAL PUMP ONLY).</p>	PEERLESS PUMPS		<p>PUMP: M14HXB</p>	<p>Rated GPM: 1750.00</p>
	<p>TEST SITE: Lubbock TX</p> <p>BY: TH</p> <p>DATE: 9/18/2008</p> <p>CUSTOMER: P.E.C. PUMP</p>	<p>IMP. NO.: V4389</p> <p>SHOP ORDER: 747310A-1</p> <p>STAGES: 4</p> <p>IMP. DIA1: 1-3 @ 9.16 X 10.4</p> <p>IMP. DIA2: 4 @ 8.66 X 9.94</p> <p>IMP. DIA3: 0</p>	<p>Rated Hd(ft): 245.00</p> <p>Rated RPM: 1782</p> <p>Rated HP: 134.90</p> <p>Rated Eff %: 82.30</p> <p>Spec. Gravity: 1.000</p>	

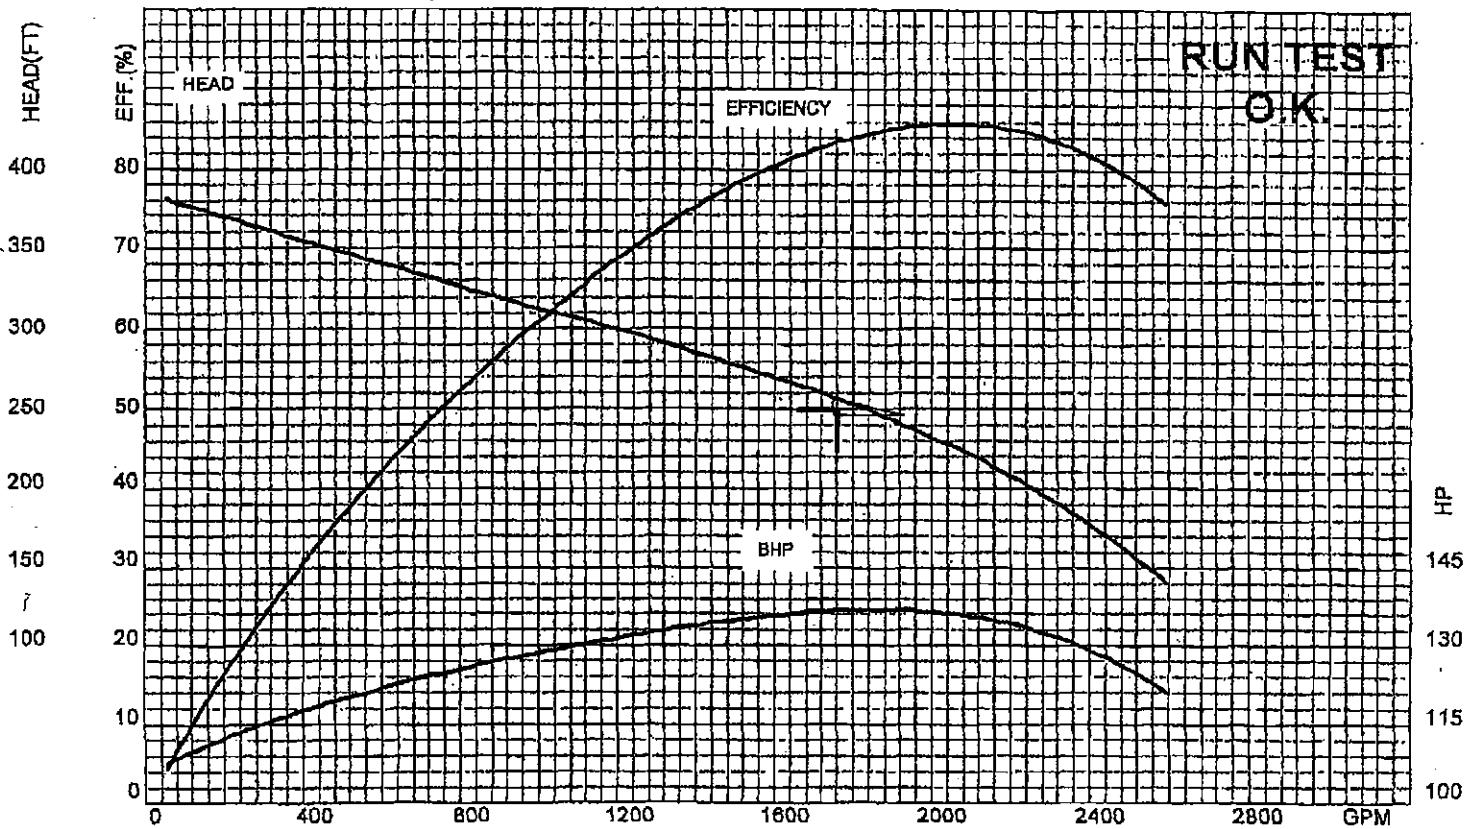

CERTIFIED BOWL PERFORMANCE TEST CURVE

Appendix B— WaterCAD Model Results

FlexTable: Junction Table
Storyrock Phase 1C.wtg
Active Scenario: Average Day

Label	Elevation (ft)	Demand (gpm)	Hydraulic Grade (ft)	Pressure (psi)	Zone
J-1	2,640.00	0	2,810.05	73.6	Zone 12
J-2	2,695.00	0	2,920.73	97.7	Zone 13
J-3	2,680.00	0	2,810.02	56.3	Zone 12
J-4	2,650.00	1	2,810.02	69.2	Zone 12
J-5	2,613.00	4	2,810.01	85.2	Zone 12
J-6	2,602.00	8	2,810.01	90.0	Zone 12
J-7	2,590.61	1	2,810.01	94.9	Zone 12
J-8	2,580.00	3	2,810.01	99.5	Zone 12
J-9	2,637.00	2	2,810.02	74.9	Zone 12
J-10	2,631.02	4	2,810.01	77.4	Zone 12
J-11	2,630.00	4	2,810.01	77.9	Zone 12
J-12	2,622.00	3	2,810.01	81.3	Zone 12
J-13	2,595.00	2	2,810.01	93.0	Zone 12
SC-1	2,735.00	0	2,920.75	80.4	Zone 13
SC-2	2,755.00	0	2,920.76	71.7	Zone 13
SC-3	2,767.00	0	2,920.74	66.5	Zone 13
SC-4	2,780.00	0	2,920.74	60.9	Zone 13
SC-5	2,762.00	0	2,920.74	68.7	Zone 13
SC-6	2,725.00	0	2,920.74	84.7	Zone 13
SC-7	2,600.00	0	2,726.00	54.5	Zone 13
SC-8	2,693.50	0	2,920.79	98.3	Zone 13
SC-9	2,744.68	0	2,920.73	76.2	Zone 13

FlexTable: Pipe Table
Storyrock Phase 1C.wtg
Active Scenario: Average Day

Label	Length (Scaled) (ft)	Start Node	Stop Node	Diameter (in)	Hazen- Williams C	Flow (gpm)	Velocity (ft/s)	Headloss Gradient (ft/1000ft)
FH-1	260	R-FH	FF TEST 1	48.0	130.0	32	0.01	0.000
FH-2	345	FF TEST 1	SC-8	36.0	130.0	32	0.01	0.000
P-1	301	T-1	SC-7	24.0	130.0	0	0.00	0.000
P-1	272	SC-7	PUMP 1	12.0	130.0	(N/A)	(N/A)	(N/A)
P-2	257	SC-7	PUMP 2	12.0	130.0	(N/A)	(N/A)	(N/A)
P-3	267	SC-7	PUMP 3	12.0	130.0	(N/A)	(N/A)	(N/A)
P-4	292	SC-7	PUMP 5	12.0	130.0	(N/A)	(N/A)	(N/A)
P-5	263	PUMP 1	SC-6	12.0	130.0	(N/A)	(N/A)	(N/A)
P-6	273	PUMP 2	SC-6	12.0	130.0	(N/A)	(N/A)	(N/A)
P-7	280	PUMP 3	SC-6	12.0	130.0	(N/A)	(N/A)	(N/A)
P-8	304	PUMP 5	SC-6	12.0	130.0	(N/A)	(N/A)	(N/A)
P-9	1,049	SC-6	SC-3	12.0	130.0	0	0.00	0.000
P-10	725	SC-3	SC-4	12.0	130.0	14	0.04	0.001
P-11	985	SC-4	SC-5	12.0	130.0	14	0.04	0.001
P-12	2,393	SC-1	SC-3	8.0	130.0	14	0.09	0.007
P-13	1,027	SC-1	SC-2	8.0	130.0	-14	0.09	0.007
P-14	782	SC-2	SC-8	8.0	130.0	-32	0.21	0.032
P-15	227	SC-8	PRV-1	8.0	130.0	0	0.00	0.000
P-16	1,460	PRV-1	J-1	8.0	130.0	0	0.00	0.000
P-17	2,375	J-1	PRV-2	12.0	130.0	0	0.00	0.000
P-18	2,399	SC-2	SC-5	8.0	130.0	18	0.12	0.011
P-19	446	SC-5	SC-9	12.0	130.0	32	0.09	0.004
P-20	1,343	SC-9	J-2	12.0	130.0	32	0.09	0.005
P-21	286	J-2	PRV-2	12.0	130.0	0	0.00	0.000
P-22	638	J-2	PRV-3	8.0	130.0	32	0.21	0.032
P-23	724	PRV-3	J-3	8.0	130.0	32	0.21	0.032
P-24	602	J-3	J-4	8.0	130.0	16	0.10	0.008
P-25	650	J-4	J-5	8.0	130.0	14	0.09	0.007
P-26	580	J-6	J-5	8.0	130.0	-8	0.05	0.003
P-27	878	J-7	J-6	8.0	130.0	-2	0.01	0.000
P-28	675	J-8	J-7	8.0	130.0	-1	0.01	0.000
P-29	1,300	J-6	J-8	8.0	130.0	2	0.01	0.000
P-30	294	J-9	J-3	8.0	130.0	-17	0.11	0.009
P-31	872	J-9	J-10	8.0	130.0	15	0.09	0.007
P-32	659	J-11	J-10	8.0	130.0	-4	0.03	0.001
P-33	366	J-10	J-12	8.0	130.0	7	0.04	0.002
P-34	611	J-12	J-5	8.0	130.0	-2	0.01	0.000
P-35	792	J-12	J-13	8.0	130.0	6	0.04	0.001
P-36	474	J-13	J-6	8.0	130.0	4	0.03	0.001

FlexTable: PRV Table
Storyrock Phase 1C.wtg
Active Scenario: Average Day

Label	Elevation (ft)	Flow (gpm)	Hydraulic Grade (From) (ft)	Hydraulic Grade (To) (ft)	Headloss (ft)	Zone
PRV-1	2,675.56	0	2,920.79	2,810.05	110.74	Zone 12
PRV-2	2,685.00	0	2,920.73	2,810.05	0.00	Zone 12
PRV-3	2,690.00	32	2,920.71	2,810.04	110.66	Zone 12

FlexTable: Pump Table
Storyrock Phase 1C.wtg
Active Scenario: Average Day

Label	Elevation (ft)	Hydraulic Grade (Suction) (ft)	Hydraulic Grade (Discharge) (ft)	Flow (Total) (gpm)	Flow (Design) (gpm)	Pump Head (ft)	Head (Design) (ft)	Zone
FF TEST 1	2,690.00	2,690.00	2,920.79	32	(N/A)	230.79	(N/A)	Zone 13
PUMP 1	2,717.00	(N/A)	(N/A)	(N/A)	500	(N/A)	245.00	Zone 13
PUMP 2	2,717.00	(N/A)	(N/A)	(N/A)	500	(N/A)	245.00	Zone 13
PUMP 3	2,717.00	(N/A)	(N/A)	(N/A)	500	(N/A)	245.00	Zone 13
PUMP 5	2,717.00	(N/A)	(N/A)	(N/A)	1,750	(N/A)	245.00	Zone 13

FlexTable: Reservoir Table
Storyrock Phase 1C.wtg
Active Scenario: Average Day

Label	Elevation (ft)	Flow (Out net) (gpm)	Hydraulic Grade (ft)	Zone	Hydraulic Grade (ft)	Zone
R:FH	2,690.00	32	2,690.00	Zone 13		

FlexTable: Reservoir Table
Storyrock Phase 1C.wtg
Active Scenario: Max Day

Label	Elevation (ft)	Flow (Out net) (gpm)	Hydraulic Grade (ft)	Zone
R-FH	2,690.00	65	2,690.00	Zone 13

FlexTable: Tank Table
Storyrock Phase 1C.wtg
Active Scenario: Max Day

Label	Elevation (Base) (ft)	Elevation (Minimum) (ft)	Elevation (Initial) (ft)	Elevation (Maximum) (ft)	Diameter (ft)	Flow (Out net) (gpm)	Hydraulic Grade (ft)	Zone
T-1	2,720.00	2,720.00	2,726.00	2,727.00	20.00	0	2,726.00	Zone 12

FlexTable: Junction Table
Storyrock Phase 1C.wtg
Active Scenario: Peak Hour

Label	Elevation (ft)	Demand (gpm)	Hydraulic Grade (ft)	Pressure (psi)	Zone
J-1	2,640.00	0	2,810.05	73.6	Zone 12
J-2	2,695.00	0	2,918.23	96.6	Zone 13
J-3	2,680.00	0	2,809.81	56.2	Zone 12
J-4	2,650.00	5	2,809.76	69.1	Zone 12
J-5	2,613.00	15	2,809.71	85.1	Zone 12
J-6	2,602.00	30	2,809.70	89.9	Zone 12
J-7	2,590.61	4	2,809.69	94.8	Zone 12
J-8	2,580.00	9	2,809.69	99.4	Zone 12
J-9	2,637.00	7	2,809.78	74.8	Zone 12
J-10	2,631.02	14	2,809.72	77.3	Zone 12
J-11	2,630.00	14	2,809.71	77.8	Zone 12
J-12	2,622.00	9	2,809.71	81.2	Zone 12
J-13	2,595.00	6	2,809.70	92.9	Zone 12
SC-1	2,735.00	0	2,918.50	79.4	Zone 13
SC-2	2,755.00	0	2,918.57	70.8	Zone 13
SC-3	2,767.00	0	2,918.33	65.5	Zone 13
SC-4	2,780.00	0	2,918.32	59.8	Zone 13
SC-5	2,762.00	0	2,918.31	67.6	Zone 13
SC-6	2,725.00	0	2,918.33	83.6	Zone 13
SC-7	2,600.00	0	2,726.00	54.5	Zone 13
SC-8	2,693.50	0	2,918.83	97.5	Zone 13
SC-9	2,744.68	0	2,918.29	75.1	Zone 13

FlexTable: Pipe Table
Storyrock Phase 1C.wtg
Active Scenario: Peak Hour

Label	Length (Scaled) (ft)	Start Node	Stop Node	Diameter (in)	Hazen- Williams' C	Flow (gpm)	Velocity (ft/s)	Headloss Gradient (ft/1000ft)
FH-1	260	R-FH	FF TEST 1	48.0	130.0	113	0.02	0.000
FH-2	345	FF TEST 1	SC-8	36.0	130.0	113	0.04	0.000
P-1	301	T-1	SC-7	24.0	130.0	0	0.00	0.000
P-1	272	SC-7	PUMP 1	12.0	130.0	(N/A)	(N/A)	(N/A)
P-2	257	SC-7	PUMP 2	12.0	130.0	(N/A)	(N/A)	(N/A)
P-3	267	SC-7	PUMP 3	12.0	130.0	(N/A)	(N/A)	(N/A)
P-4	292	SC-7	PUMP 5	12.0	130.0	(N/A)	(N/A)	(N/A)
P-5	263	PUMP 1	SC-6	12.0	130.0	(N/A)	(N/A)	(N/A)
P-6	273	PUMP 2	SC-6	12.0	130.0	(N/A)	(N/A)	(N/A)
P-7	280	PUMP 3	SC-6	12.0	130.0	(N/A)	(N/A)	(N/A)
P-8	304	PUMP 5	SC-6	12.0	130.0	(N/A)	(N/A)	(N/A)
P-9	1,049	SC-6	SC-3	12.0	130.0	0	0.00	0.000
P-10	725	SC-3	SC-4	12.0	130.0	50	0.14	0.010
P-11	985	SC-4	SC-5	12.0	130.0	50	0.14	0.010
P-12	2,393	SC-1	SC-3	8.0	130.0	50	0.32	0.072
P-13	1,027	SC-1	SC-2	8.0	130.0	-50	0.32	0.072
P-14	782	SC-2	SC-8	8.0	130.0	-113	0.72	0.324
P-15	227	SC-8	PRV-1	8.0	130.0	0	0.00	0.000
P-16	1,460	PRV-1	J-1	8.0	130.0	0	0.00	0.000
P-17	2,375	J-1	PRV-2	12.0	130.0	0	0.00	0.000
P-18	2,399	SC-2	SC-5	8.0	130.0	63	0.40	0.109
P-19	446	SC-5	SC-9	12.0	130.0	113	0.32	0.045
P-20	1,343	SC-9	J-2	12.0	130.0	113	0.32	0.045
P-21	286	J-2	PRV-2	12.0	130.0	0	0.00	0.000
P-22	638	J-2	PRV-3	8.0	130.0	113	0.72	0.324
P-23	724	PRV-3	J-3	8.0	130.0	113	0.72	0.324
P-24	602	J-3	J-4	8.0	130.0	55	0.35	0.085
P-25	650	J-4	J-5	8.0	130.0	50	0.32	0.072
P-26	580	J-6	J-5	8.0	130.0	-28	0.18	0.025
P-27	878	J-7	J-6	8.0	130.0	-7	0.04	0.002
P-28	675	J-8	J-7	8.0	130.0	-3	0.02	0.001
P-29	1,300	J-6	J-8	8.0	130.0	6	0.04	0.002
P-30	294	J-9	J-3	8.0	130.0	-58	0.37	0.095
P-31	872	J-9	J-10	8.0	130.0	51	0.33	0.074
P-32	659	J-11	J-10	8.0	130.0	-14	0.09	0.007
P-33	366	J-10	J-12	8.0	130.0	23	0.15	0.017
P-34	611	J-12	J-5	8.0	130.0	-7	0.04	0.002
P-35	792	J-12	J-13	8.0	130.0	20	0.13	0.013
P-36	474	J-13	J-6	8.0	130.0	14	0.09	0.007

Fire Flow Node FlexTable: Fire Flow Report

Storyrock Phase 1C.wtg

Active Scenario: Max Day + FF

Label	Elevation (ft)	Fire Flow (Needed) (gpm)	Flow (Total Available) (gpm)	Pressure (Calculated Residual) (psi)	Zone	Satisfies Fire Flow Constraints?
J-1	2,640.00	1,000	3,000	63.5	Zone 12	True
J-2	2,695.00	1,000	3,000	49.6	Zone 13	True
J-3	2,680.00	1,000	2,213	30.0	Zone 12	True
J-4	2,650.00	1,000	2,215	32.5	Zone 12	True
J-5	2,613.00	1,000	2,221	44.2	Zone 12	True
J-6	2,602.00	1,000	2,229	41.9	Zone 12	True
J-7	2,590.61	1,000	2,215	34.8	Zone 12	True
J-8	2,580.00	1,000	2,218	37.9	Zone 12	True
J-9	2,637.00	1,000	2,217	42.2	Zone 12	True
J-10	2,631.02	1,000	2,221	36.7	Zone 12	True
J-11	2,630.00	1,000	1,901	30.0	Zone 12	True
J-12	2,622.00	1,000	2,218	39.9	Zone 12	True
J-13	2,595.00	1,000	2,216	44.2	Zone 12	True
SC-1	2,735.00	1,000	2,981	30.0	Zone 13	True
SC-2	2,755.00	1,000	3,000	32.6	Zone 13	True
SC-3	2,767.00	1,000	3,000	42.2	Zone 13	True
SC-4	2,780.00	1,000	3,000	32.9	Zone 13	True
SC-5	2,762.00	1,000	3,000	36.2	Zone 13	True
SC-6	2,725.00	1,000	3,000	63.7	Zone 13	True
SC-7	2,600.00	1,000	3,000	54.5	Zone 13	True
SC-8	2,693.50	1,000	3,000	49.3	Zone 13	True
SC-9	2,744.68	1,000	3,000	39.8	Zone 13	True