

**WOOD
PATEL**

**FINAL DRAINAGE REPORT
FOR
AXON PROJECT**

September 10, 2020
WP# 205133



Expires 6/30/2023

TABLE OF CONTENTS

1.0	INTRODUCTION.....	1
2.0	EXISTING DRAINAGE CONDITIONS AND CHARACTERISTICS	2
2.4	Crossroads East Drainage Infrastructure Improvements	3
3.0	PROPOSED DRAINAGE PLAN	4
3.1	On-Site Drainage Conditions (Post Development)	4
3.2	Off-Site Drainage Conditions (Post Development)	4
3.3	Retention and Dissipation	4
3.4	Lowest Floor Elevation.....	5
3.5	Operation and Maintenance	5
4.0	SPECIAL CONDITIONS.....	6
5.0	DATA ANALYSIS	7
5.1	Hydrologic Analysis.....	7
5.2	Hydraulic Analysis.....	7
6.0	CONCLUSIONS.....	8
7.0	REFERENCES.....	9

APPENDICES

APPENDIX A	Hydrology
	<ul style="list-style-type: none">• IDF Data from FCDMC NOAA Atlas 14 Precipitation Data• Table 1 – Rational Method Summary• Table 2 – Retention Volumes Required• Table 3 – Retention Volumes Provided
APPENDIX B	Hydraulics
	<ul style="list-style-type: none">• Pipe Analysis Summary• Hydraflow Output Report
APPENDIX C	Cross Roads East Traffic Impact Mitigation Analysis
APPENDIX D	Logan Simpson Clean Water Act Section 404 Technical Memorandum
APPENDIX E	Michael Baker International Crossroads East Drainage Infrastructure Phase 1 Project No. 169678
APPENDIX F	TY Lin International HEC-1 Schematic Phase 1

EXHIBITS

EXHIBIT 1	Vicinity Map
EXHIBIT 2	FEMA FIRM
EXHIBIT 3	Existing Drainage Map
EXHIBIT 4	Proposed Drainage Map
EXHIBIT 5	Catch Basin Inlet Map

km

Y:\WP\Reports\Commercial\205133 Axon Project Preliminary Drainage Report.docx



Expires 6/30/2023

1.0 INTRODUCTION

The Axon Campus (Site) is currently on an undeveloped parcel. The parcel, Tract 14A of State Plat No. 16-B Core South, consists of a portion of the northern half of Section 36, Township 4 North, Range 4 East, in the City of Scottsdale, Arizona. The parcel is approximately 74.44 acres in size, and is located northeast of the intersection of Hayden Road and Union Hills Drive in the City of Scottsdale, Arizona. The parcel's western boundary has frontage along the east side of Hayden Road, and the parcel's southern boundary has frontage along the north side of Union Hills Drive. Additionally, the north side of the parcel parallels a portion of Arizona Department of Transportation (ADOT) State Route 101.

Phase I of the development is to include a one-story warehouse and five-story office building with associated parking, roadways, hardscape and landscape. The Site is approximately 34.03 acres on the east side of the 74.44-acre parcel. The west side of the parcel is to remain undeveloped for future uses, except for proposed access roadways to the Site.

The purpose of this report is to document the drainage design criteria utilized for the Axon project, and is intended to support the Construction Documents submittal for the project. This Preliminary Drainage Report has been prepared in accordance with Wood, Patel & Associates, Inc.'s (WOODPATEL) understanding of the City of Scottsdale's technical requirements for drainage (Ref. 1), as applicable for the Site.

2.0 EXISTING DRAINAGE CONDITIONS AND CHARACTERISTICS

2.1 On-Site Drainage Conditions (Pre-Development)

The Site is vacant of surface structures, with the exception of the improvements covered in Section 2.4, and significant portions of the parcel have been cleared and covered with recycled asphalt millings to provide dust control. Reportedly, the parcel has previously served as overflow parking. Portions of the parcel that have not been cleared or disturbed display native desert terrain, common to the area. The parcel slopes to the southwest at an average slope of 1.5%. As displayed in Exhibit 3 – *Existing Drainage Map*, contour elevations range from approximately 1,605 feet to 1,583 feet.

The parcel is subject to a 100-year floodplain, as determined by the Federal Emergency Management Agency (FEMA). Section 3.0 further expands on this matter.

2.2 Off-Site Drainage Conditions

The Site is located downstream of Crossroads East Basin 53R, which is a regional flood control basin. This basin stops the majority of the historic off-site runoff from impacting the Site. However, there are several existing ADOT culverts along the north frontage of the right-of-way to collect storm water runoff from the AZ Loop 101, and carry the water south through the parcel.

Public roadway infrastructure improvements for Mayo Boulevard and Union Hills Drive are expected to include the associated storm drainage infrastructure. These storm drain systems will be capable of handling the storm water runoff generated from the associated road right-of-way.

2.2 FEMA Floodplain

ASLD Parcel Tract 14A is located within a Federal Emergency Management Agency (FEMA) floodplain designation, Zone "AO-Depth 1 Foot, Velocity 3 FPS", per *Flood Insurance Rate Map (FIRM) Map number 04013C1320L* (refer to Exhibit 2 – *FEMA FIRM*). The current FEMA floodplain is commonly referred to as the Reata Wash Floodplain.

Zone "AO-Depth 1 Foot" is defined by FEMA as follows:

"Special flood hazard area inundated by 100-year flood depths 1 to 3 feet (usually sheet flow on sloping terrain); average depths determined. For areas of alluvial fan flooding, velocities also determined."

The City of Scottsdale regulates development in FEMA-designated floodplains under its floodplain ordinance. Generally, proposed development in the floodplain is allowed if the lowest floor elevations are at or above the FEMA 100-year water surface elevations, or elevated at least two feet above the highest adjacent grade, and/or the proposed development meets protection criteria. The City of Scottsdale also considers whether the proposed development addresses

additional requirements, like conveyance corridors, and seeks to ensure the proposed development does not penalize upstream or downstream properties.

FEMA has previously refused to remove any land from this published Alluvial Fan Special Flood Hazard Area (Zone AO) unless a regional structural solution is constructed.

2.4 Crossroads East Drainage Infrastructure Improvements

There is a City owned and maintained floodwater conveyance system running through the parcel, referenced as *Crossroads East Drainage Infrastructure Phase 1*. A drainage report supporting the Crossroads East Drainage Infrastructure Phase 1 design was completed by Michael Baker International and has been included in Appendix E. The conveyance system is designed to carry storm water runoff, generated north of Arizona SR 101, through the parcel, south, to its ultimate outfall location. Improvements within Tract 14A include two 60-inch-diameter corrugated metal pipes (CMP), running in parallel, that convey storm water to an open channel. The open channel runs parallel to Union Hills Drive, and is approximately 62 feet wide, with a depth of 4.5 feet. The storm water in the channel exits the parcel through an existing box culvert, located under Union Hills Drive, near the southwest corner of the parcel, and continues south. The conveyance system is part of the *Crossroads East Drainage Infrastructure Plan* (City of Scottsdale Project No. 400-FB53B-56047). Construction of the improvements is underway, and has an estimated completion date of August 4, 2020. Excerpts from the *Crossroads East Drainage Infrastructure Plan* can be found in Appendix C.

3.0 PROPOSED DRAINAGE PLAN

3.1 On-Site Drainage Conditions (Post Development)

The proposed grading for the project is designed to direct storm water runoff away from the proposed building and into proposed retention basins. Proposed roof drains, catch basins, and storm drains will collect the majority of the runoff to store in above-ground retention basins. A majority of the Site drains to the southwest. If the catch basins become clogged, or if the on-site storm water storage system is exceeded, overland overflow routes have been incorporated into the grading and drainage design. The ultimate outfall for the project will be at the southeast corner of the Site, at an elevation of 1,582.00.

3.2 Off-Site Drainage Conditions (Post Development)

The Site will accept runoff from the north through four culverts, and convey this water through the Site and outfall at the southwest corner of the Site, as previously mentioned above. The 100-year rainfall events for the off-site flows were determined using the Rational Method for the areas located downstream of Basin 53R. The proposed access road to the Site is impacted by off-site flows that are currently not being directed to Basin 53R. Flow rates for this area were determined by using the District Online Flo-2D viewer (refer to Appendices E and F for off-site flows). The storm drain system has been designed to accommodate the 100-year off-site and on-site flows through the Site to where they outfall. On-site and off-site flows were routed through using AutoCAD's Hydraflow Hydrographs (refer to Section 5.2 for more Hydraulic Analysis).

3.3 Retention and Dissipation

It is WOODPATEL's understanding, through correspondence with the City of Scottsdale's Stormwater Management Department, there are two conditions the applicant for development will be required to satisfy regarding on-site stormwater runoff and retention.

1. Interim Condition: Until the referenced Crossroads East Drainage Infrastructure Phase 1 improvements have been completed, on-site retention will be required for 100% of the volume generated by first flush or pre vs post calculations, whichever is greater. The collected runoff is required to be disposed of within 36 hours, as required by the City of Scottsdale *Design Standards & Policies Manual*, Section 4-1.201.

2. Ultimate Condition: The City is currently sponsoring drainage improvements that may be sufficient to support a storm water waiver for on-site retention, normally required for parcel development. First flush requirements will still be required for development of the parcel. Should the applicant desire to pursue a storm water retention waiver, a separate technical drainage submittal is required for review and approval by the City of Scottsdale. The drainage submittal needs to demonstrate there is a drainage corridor sufficient to convey runoff to the Central Arizona Project's approved impoundment area for upstream drainage volumes.

In accordance with the current City of Scottsdale *Design Standards & Policies Manual*, the following required first flush retention volume equation was used for this project's ultimate condition with the current precipitation depth of 0.5 inches:

$$\text{Vol}_{\text{req}} = P/12 \times A \times C$$

P = Precipitation Depth: 0.5 inches

A = Total Area (sq. ft.)

C = Post-Development Runoff Coefficient: Varies (1.0)

Estimated first flush treatment and retention volumes, located in Appendix A: Tables 2 and 3, were calculated following the City of Scottsdale *Design Standards & Policies Manual* Section 4-1.201.C.2 and Section 4-1.201.C.1.b, respectively. Only the on-site first flush storm drain event will be retained. Basins B-3 and B-7 are capable of retaining the entire 100-year, 2-hour storm event.

3.4 Lowest Floor Elevation

The Preliminary Grading and Drainage Plan is designed to comply with the City of Scottsdale's floodplain ordinance in a Zone "AO-Depth 1 Foot, Velocity 3 FPS" floodplain. The proposed building has a finished floor elevation of 1607.70, which is 2.0 feet above the H.A.G. elevation of 1605.70, located along the northern frontage of the building.

3.5 Operation and Maintenance

The property owner shall be solely responsible for the operation and maintenance of the storm water drainage system. In accordance with the City of Scottsdale's *Design Specifications & Policies Manual*, the owner will dedicate a public drainage easement for the storm water retention facilities. Operation and maintenance reference material will be provided within the Final Drainage Report.

4.0 SPECIAL CONDITIONS

The development of the parcel must comply with Federal, State, County, and City regulations.

This section is limited to the application of the Federal Government's *Section 404 Permit – Clean Water Act*. The local office of the U.S. Army Corps of Engineers (USACOE) is the agency that determines if a watercourse or desert wash meets the criteria to be designated as "Waters of the U.S.", or commonly referred to as "jurisdictional delineation". The purpose of the *Section 404 Permit – Clean Water Act* is to restore and maintain the chemical, physical, and biological integrity of the Nation's waters.

The parcel's current status with the USACOE regarding the *Section 404 Permit - Clean Water Act* is explained in the technical memorandum prepared by Logan Simpson, entitled *Clean Water Act Section 404 Technical Memorandum*, dated April 6, 2020, project name *Hayden Road/Loop 101*. A copy of this technical memorandum is provided in Appendix K. The memorandum states the USACOE identified no Waters of the U.S. under jurisdiction of the Clean Water Act within the parcel limits. Unless new information or events warrant a revision, this determination by the USACOE is valid for 5 years from the date of August 15, 2018.

Therefore, under the current 2015 definition of Waters of the U.S., if the development of the parcel occurs prior to August 15, 2023, a preparation of a Preliminary Jurisdictional Delineation (PJD) or a Section 404 permit would not be required for submission to the local USACOE.

U.S. Army Corps of Engineers
Regulatory Branch
3636 North Central Avenue, Suite 760
Phoenix, AZ 85012-1936
602.640.5385

5.0 DATA ANALYSIS

5.1 Hydrologic Analysis

The drainage improvements will be developed consistent with Chapter 4 of the City of Scottsdale's *Design Standards & Policies Manual*, 2018. The Rational Method will be used to quantify peak discharge values for on-site concentration points for the full-buildout scenario during the 100-year, 2-hour storm event. Weighted "C" coefficients will be referenced from Chapter 4 of the City of Scottsdale's *Design Standards & Policies Manual*, 2018. Refer to Appendix A for rational calculation printouts, and Exhibit 5 – *Catch Basin Map* for drainage basin tributary areas and concentration point locations.

5.2 Hydraulic Analysis

The on-site storm drain system has been designed to accommodate the 100-year, 2-hour storm event. Bentley StormCAD Version 8i was utilized to analyze the proposed storm sewer system. StormCAD printouts and storm drain profiles, as well as Hydraflow outputs, are located within Appendix B.

6.0 CONCLUSIONS

Based on our analysis of the Site, the following conclusions can be made:

1. The Drainage Report has been prepared in accordance with Wood, Patel & Associates, Inc.'s (Wood/Patel's) understanding of the City of Scottsdale's technical drainage requirements and the *Drainage Design Manuals for Maricopa County Hydrology and Hydraulics* (2013), as applicable to the SEC Hayden-Loop 101 Project.
2. The proposed improvements lie within a Federal Emergency Management Agency (FEMA) floodplain designation, Zone "AO-Depth 1 Foot, Velocity 3 FPS" per *Flood Insurance Rate Map (FIRM) Map number 04013C1320L* (refer to Appendix A, *Figure 7 – FEMA FIRM Map*). The current FEMA floodplain is commonly referred to as the Reata Wash floodplain.
3. On-site storm water storage of the first flush storm event occurs in on-site surface retention basins.
4. All storm water runoff not retained will ultimately outfall along the Site's southern property boundary.
5. Finished floor elevations have been designed to be two feet above the highest adjacent grade, and to be free from inundation during a 100-year, 2-hour storm event.
6. Ongoing maintenance is required for all drainage systems in order to assure design performance. Maintenance is the responsibility of the private parties involved.

7.0 REFERENCES

1. *Drainage Design Manual for Maricopa County, Arizona; Volume I-Hydrology*, Flood Control District of Maricopa County, August 15, 2013.
2. *Drainage Design Manual for Maricopa County, Arizona; Volume II- Hydraulics*, Flood Control District of Maricopa County, August 15, 2013.
3. *Flood Insurance Rate Map, Maricopa County, Arizona, and Incorporated Areas Panel 1320*, Federal Emergency Management Agency, Effective October 16, 2013.
4. *Design Standards & Policies Manual, Chapter 4: Grading and Drainage*, City of Scottsdale, January 2018.

APPENDIX A – HYDROLOGY

IDF Data from FCDMC NOAA Atlas 14 Precipitation Data



NOAA Atlas 14, Volume 1, Version 5
Location name: Scottsdale, Arizona, USA*
Latitude: 33.6519°, Longitude: -111.9038°
Elevation: 1596.05 ft**

* source: ESRI Maps

** source: USGS



POINT PRECIPITATION FREQUENCY ESTIMATES

Sanja Perica, Sarah Dietz, Sarah Heim, Lillian Hiner, Kazungu Maitaria, Deborah Martin, Sandra Pavlovic, Ishani Roy, Carl Trypaluk, Dale Unruh, Fenglin Yan, Michael Yekta, Tan Zhao, Geoffrey Bonnin, Daniel Brewer, Li-Chuan Chen, Tye Parzybok, John Yarchoan

NOAA, National Weather Service, Silver Spring, Maryland

[PF tabular](#) | [PF graphical](#) | [Maps & aerials](#)

PF tabular

Duration	Average recurrence interval (years)									
	1	2	5	10	25	50	100	200	500	1000
5-min	0.197 (0.164-0.242)	0.258 (0.216-0.316)	0.348 (0.288-0.425)	0.417 (0.343-0.508)	0.510 (0.413-0.618)	0.580 (0.465-0.699)	0.653 (0.514-0.785)	0.726 (0.562-0.871)	0.824 (0.621-0.991)	0.899 (0.664-1.08)
10-min	0.300 (0.250-0.368)	0.393 (0.328-0.481)	0.529 (0.438-0.647)	0.634 (0.522-0.772)	0.776 (0.629-0.941)	0.884 (0.707-1.06)	0.994 (0.782-1.20)	1.11 (0.855-1.33)	1.25 (0.946-1.51)	1.37 (1.01-1.65)
15-min	0.372 (0.309-0.457)	0.487 (0.407-0.597)	0.656 (0.543-0.802)	0.786 (0.648-0.958)	0.962 (0.779-1.17)	1.10 (0.877-1.32)	1.23 (0.969-1.48)	1.37 (1.06-1.64)	1.56 (1.17-1.87)	1.70 (1.25-2.04)
30-min	0.501 (0.416-0.615)	0.655 (0.547-0.803)	0.883 (0.731-1.08)	1.06 (0.872-1.29)	1.30 (1.05-1.57)	1.48 (1.18-1.78)	1.66 (1.31-2.00)	1.84 (1.43-2.21)	2.09 (1.58-2.52)	2.28 (1.69-2.75)
60-min	0.620 (0.515-0.761)	0.811 (0.677-0.994)	1.09 (0.905-1.34)	1.31 (1.08-1.60)	1.60 (1.30-1.94)	1.83 (1.46-2.20)	2.05 (1.62-2.47)	2.28 (1.77-2.74)	2.59 (1.95-3.12)	2.83 (2.09-3.40)
2-hr	0.724 (0.609-0.868)	0.936 (0.791-1.13)	1.25 (1.05-1.49)	1.48 (1.23-1.77)	1.81 (1.49-2.15)	2.05 (1.66-2.43)	2.31 (1.84-2.72)	2.56 (2.01-3.02)	2.90 (2.22-3.42)	3.16 (2.37-3.75)
3-hr	0.798 (0.672-0.978)	1.02 (0.865-1.26)	1.34 (1.12-1.63)	1.59 (1.32-1.93)	1.93 (1.58-2.33)	2.21 (1.78-2.65)	2.49 (1.98-2.99)	2.80 (2.18-3.34)	3.20 (2.42-3.84)	3.54 (2.61-4.23)
6-hr	0.961 (0.826-1.14)	1.21 (1.04-1.44)	1.55 (1.32-1.83)	1.82 (1.54-2.14)	2.18 (1.82-2.55)	2.46 (2.03-2.88)	2.76 (2.24-3.21)	3.06 (2.44-3.57)	3.46 (2.69-4.04)	3.79 (2.87-4.42)
12-hr	1.09 (0.939-1.28)	1.37 (1.18-1.61)	1.73 (1.49-2.03)	2.01 (1.72-2.35)	2.39 (2.02-2.79)	2.68 (2.24-3.12)	2.99 (2.45-3.47)	3.29 (2.67-3.82)	3.70 (2.92-4.31)	4.01 (3.11-4.70)
24-hr	1.28 (1.12-1.48)	1.62 (1.42-1.88)	2.09 (1.83-2.42)	2.47 (2.15-2.86)	3.00 (2.59-3.46)	3.42 (2.92-3.93)	3.85 (3.26-4.44)	4.31 (3.61-4.96)	4.94 (4.06-5.71)	5.45 (4.42-6.32)
2-day	1.39 (1.21-1.60)	1.77 (1.54-2.04)	2.32 (2.01-2.67)	2.76 (2.38-3.17)	3.37 (2.89-3.87)	3.85 (3.27-4.43)	4.37 (3.68-5.03)	4.90 (4.09-5.67)	5.65 (4.63-6.56)	6.25 (5.05-7.29)
3-day	1.49 (1.31-1.71)	1.91 (1.67-2.19)	2.51 (2.20-2.88)	3.01 (2.62-3.43)	3.70 (3.20-4.22)	4.26 (3.65-4.86)	4.85 (4.13-5.56)	5.48 (4.61-6.30)	6.37 (5.28-7.34)	7.09 (5.80-8.21)
4-day	1.60 (1.41-1.82)	2.04 (1.80-2.33)	2.71 (2.39-3.09)	3.25 (2.85-3.70)	4.03 (3.51-4.58)	4.66 (4.03-5.30)	5.34 (4.58-6.08)	6.06 (5.14-6.93)	7.09 (5.92-8.13)	7.93 (6.55-9.14)
7-day	1.81 (1.58-2.07)	2.31 (2.03-2.65)	3.07 (2.69-3.51)	3.69 (3.22-4.22)	4.58 (3.97-5.22)	5.30 (4.56-6.05)	6.07 (5.18-6.94)	6.90 (5.83-7.93)	8.08 (6.72-9.31)	9.05 (7.43-10.5)
10-day	1.96 (1.73-2.25)	2.52 (2.22-2.88)	3.34 (2.93-3.81)	4.01 (3.50-4.56)	4.95 (4.30-5.62)	5.71 (4.93-6.49)	6.53 (5.58-7.44)	7.40 (6.27-8.45)	8.63 (7.20-9.90)	9.63 (7.94-11.1)
20-day	2.44 (2.15-2.78)	3.15 (2.77-3.57)	4.16 (3.66-4.72)	4.94 (4.33-5.60)	6.00 (5.24-6.80)	6.82 (5.93-7.74)	7.67 (6.62-8.72)	8.54 (7.32-9.74)	9.73 (8.25-11.2)	10.7 (8.95-12.3)
30-day	2.87 (2.52-3.26)	3.69 (3.26-4.20)	4.89 (4.30-5.53)	5.80 (5.09-6.55)	7.03 (6.14-7.95)	7.99 (6.94-9.03)	8.97 (7.75-10.2)	9.98 (8.57-11.3)	11.4 (9.64-12.9)	12.4 (10.5-14.2)
45-day	3.35 (2.97-3.80)	4.33 (3.84-4.90)	5.73 (5.06-6.47)	6.77 (5.97-7.66)	8.17 (7.16-9.23)	9.23 (8.06-10.5)	10.3 (8.95-11.7)	11.4 (9.85-13.0)	12.9 (11.0-14.8)	14.1 (11.9-16.2)
60-day	3.74 (3.32-4.22)	4.84 (4.29-5.45)	6.38 (5.65-7.19)	7.51 (6.63-8.46)	9.00 (7.92-10.1)	10.1 (8.86-11.4)	11.3 (9.80-12.7)	12.4 (10.7-14.0)	13.9 (11.9-15.8)	15.0 (12.8-17.2)

¹ Precipitation frequency (PF) estimates in this table are based on frequency analysis of partial duration series (PDS).


Numbers in parenthesis are PF estimates at lower and upper bounds of the 90% confidence interval. The probability that precipitation frequency estimates (for a given duration and average recurrence interval) will be greater than the upper bound (or less than the lower bound) is 5%. Estimates at upper bounds are not checked against probable maximum precipitation (PMP) estimates and may be higher than currently valid PMP values.

Please refer to NOAA Atlas 14 document for more information.


[Back to Top](#)

PF graphical

PDS-based depth-duration-frequency (DDF) curves
Latitude: 33.6519°, Longitude: -111.9038°

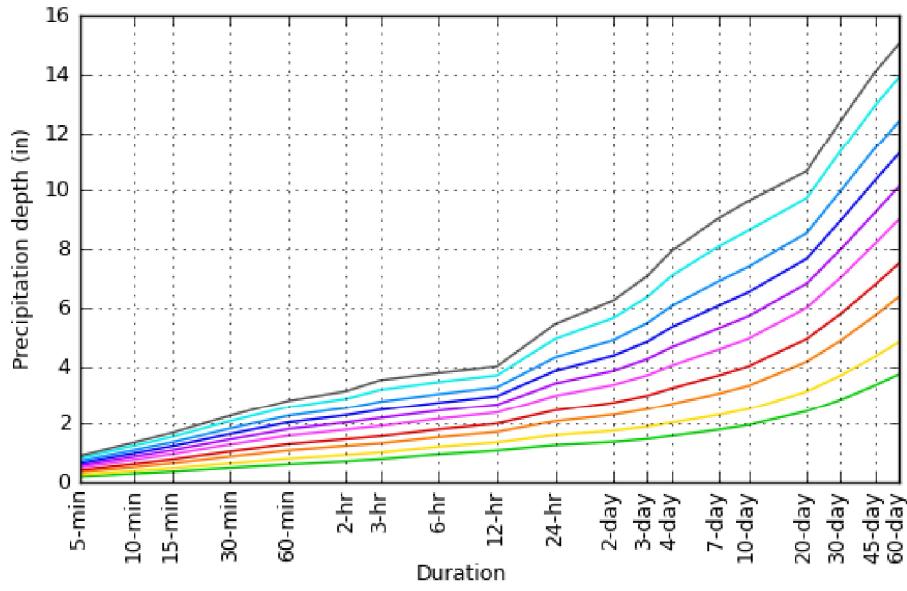


Average recurrence interval (years)
1
2
5
10
25
50
100
200
500
1000

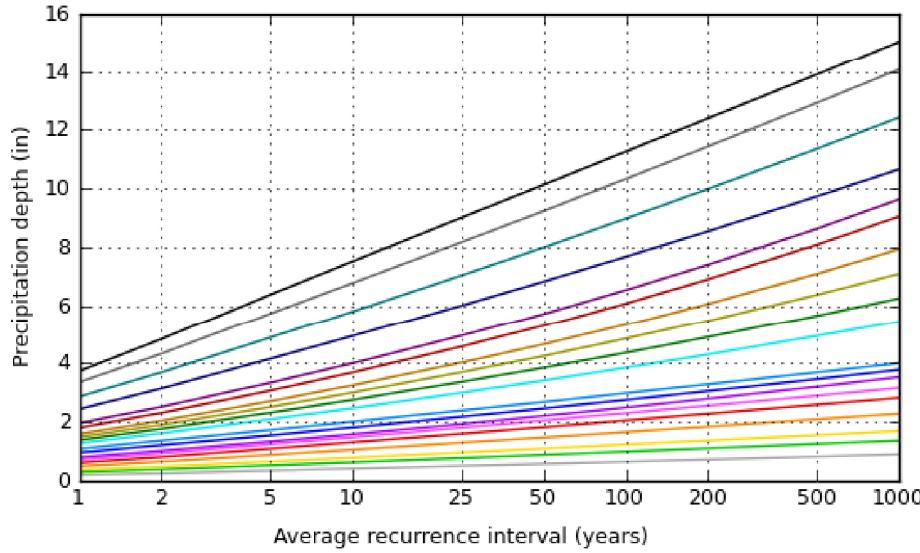

Duration
5-min
10-min
15-min
30-min
60-min
2-hr
3-hr
6-hr
12-hr
24-hr
2-day
3-day
4-day
7-day
10-day
20-day
30-day
60-day
45-day

Maps & aerials

Small scale terrain

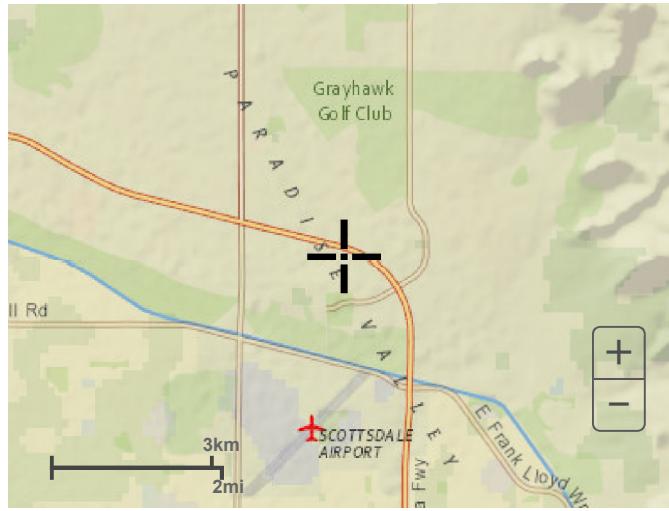


Large scale terrain



Large scale map



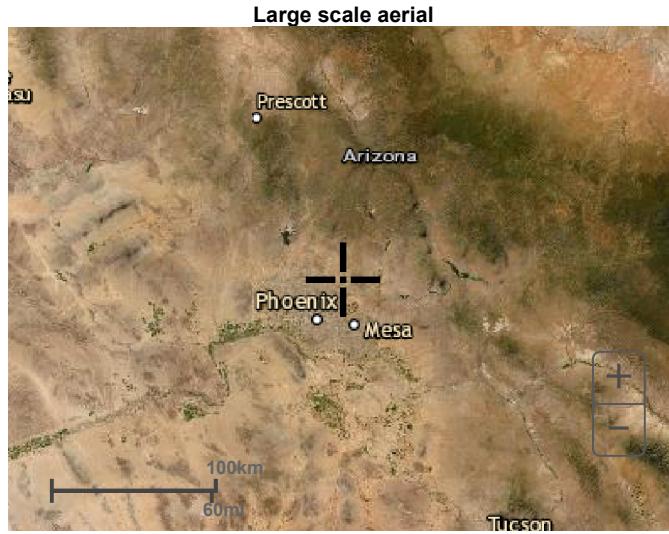

[Back to Top](#)

[US Department of Commerce](#)
[National Oceanic and Atmospheric Administration](#)
[National Weather Service](#)
[National Water Center](#)
1325 East West Highway
Silver Spring, MD 20910
Questions?: HDSC.Questions@noaa.gov

[Disclaimer](#)

Table 1 – Rational Method Summary

RATIONAL METHOD SUMMARY

100 YEAR, 10 YEAR, 2 YEAR

Project Axon
Location Scottsdale AZ
Project Number 205133
Project Engineer Aaron Fabian, EIT

Drainage Subbasin ID	ON-SITE WATERSHEDS								100 YEAR				10 YEAR				2 YEAR				
	Longest Watercourse 'L' (ft)	Longest Watercourse 'L' (mi)	Drainage Area 'A' (sf)	Drainage Area 'A' (Acres)	'K _b ' Type ¹	Watershed Resistance Coefficient 'K _b '	Top Elevation	Bottom Elevation	Basin Slope 'S' (ft/mi)	Calculated Q100 'Tc' (See Note 2) (min)	100 YEAR Intensity 'i' (in/hr)	100 YR Runoff Coefficient 'C'	Q100 Flow (cfs)	Calculated Q10 'Tc' (See Note 2) (min)	10 YEAR Intensity 'i' (in/hr)	10 YR Runoff Coefficient 'C'	Q10 Flow (cfs)	Calculated Q2 'Tc' (See Note 2) (min)	2 YEAR Intensity 'i' (in/hr)	2 YR Runoff Coefficient 'C'	Q2 Flow (cfs)
A1	240	0.045	173,630	3.99	A	0.0362	1605.5	1599.3	136.4	2.6	7.84	0.90	28.1	3.1	5.00	0.78	15.6	3.7	3.10	0.72	8.9
A2	210	0.040	77,940	1.79	A	0.0384	1604.0	1600.5	88.0	2.9	7.84	0.90	12.6	3.4	5.00	0.78	7.0	4.1	3.10	0.72	4.0
A3	110	0.021	7,450	0.17	A	0.0448	1607.5	1600.0	360.0	1.4	7.84	0.90	1.2	1.7	5.00	0.78	0.7	2.1	3.10	0.72	0.4
A4	150	0.028	7,450	0.17	A	0.0448	1607.5	1600.0	264.0	1.9	7.84	0.90	1.2	2.2	5.00	0.78	0.7	2.6	3.10	0.72	0.4
B1	500	0.095	226,020	5.19	A	0.0355	1607.5	1592.0	163.7	3.5	7.84	0.90	36.6	4.1	5.00	0.78	20.3	5.0	3.10	0.72	11.6
B2	300	0.057	49,130	1.13	A	0.0397	1606.0	1599.0	123.2	3.1	7.84	0.90	8.0	3.7	5.00	0.78	4.4	4.5	3.10	0.72	2.5
B3	200	0.038	29,580	0.68	A	0.0411	1605.0	1598.5	171.6	2.3	7.84	0.90	4.8	2.8	5.00	0.78	2.7	3.3	3.10	0.72	1.5
B4	50	0.009	124,650	2.86	A	0.0371	1606.9	1592.5	1520.6	0.6	7.84	0.90	20.2	0.7	5.00	0.78	11.2	0.8	3.10	0.72	6.4
B5	50	0.009	22,900	0.53	A	0.0417	1607.5	1594.0	1425.6	0.6	7.84	0.90	3.7	0.7	5.00	0.78	2.1	0.9	3.10	0.72	1.2
B6	100	0.019	86,750	1.99	A	0.0381	1607.5	1604.1	179.5	1.6	7.84	0.90	14.1	1.9	5.00	0.78	7.8	2.2	3.10	0.72	4.4
B7	250	0.047	230,110	5.28	A	0.0355	1606.5	1593.0	285.1	2.1	7.84	0.90	37.3	2.5	5.00	0.78	20.7	3.0	3.10	0.72	11.8
B8	350	0.066	84,820	1.95	A	0.0382	1605.8	1591.0	223.3	2.8	7.84	0.90	13.7	3.3	5.00	0.78	7.6	3.9	3.10	0.72	4.3
B9	50	0.009	16,500	0.38	A	0.0426	1597.1	1593.0	433.0	0.9	7.84	0.90	2.7	1.1	5.00	0.78	1.5	1.3	3.10	0.72	0.8
B10	650	0.123	267,300	6.14	A	0.0351	1607.5	1587.0	166.5	3.9	7.84	0.90	43.3	4.7	5.00	0.78	24.0	5.7	2.99	0.72	13.2
B11	450	0.085	138,900	3.19	A	0.0369	1600.0	1583.0	199.5	3.2	7.84	0.90	22.5	3.8	5.00	0.78	12.5	4.5	3.10	0.72	7.1
B12	20	0.004	15,700	0.36	A	0.0428	1592.7	1590.3	633.6	0.5	7.84	0.90	2.5	0.6	5.00	0.78	1.4	0.7	3.10	0.72	0.8
B13	20	0.004	14,500	0.33	A	0.0430	1592.7	1590.0	712.8	0.5	7.84	0.90	2.3	0.6	5.00	0.78	1.3	0.7	3.10	0.72	0.7
B14	40	0.008	20,500	0.47	A	0.0420	1592.7	1590.0	356.4	0.8	7.84	0.90	3.3	1.0	5.00	0.78	1.8	1.2	3.10	0.72	1.1
B15	150	0.028	43,100	0.99	A	0.0400	1592.7	1584.5	288.6	1.7	7.84	0.90	7.0	2.0	5.00	0.78	3.9	2.4	3.10	0.72	2.2
B16	150	0.028	59,000	1.35	A	0.0392	1592.7	1584.5	288.6	1.7	7.84	0.90	9.6	2.0	5.00	0.78	5.3	2.4	3.10	0.72	3.0
B17	200	0.038	64,500	1.48	A	0.0389	1603.0	1594.0	237.6	2.1	7.84	0.90	10.4	2.4	5.00	0.78	5.8	3.0	2.96	0.72	3.2
C1	120	0.023	28,340	0.65	A	0.0412	1607.0	1604.1	127.6	2.0	7.84	0.90	4.6	2.4	5.00	0.78	2.5	2.8	3.10	0.72	1.5
C2	150	0.028	20,910	0.48	A	0.0420	1607.0	1604.1	102.1	2.4	7.84	0.90	3.4	2.9	5.00	0.78	1.9	3.4	3.10	0.72	1.1
C3	150	0.028	23,130	0.53	A	0.0417	1607.0	1604.1	102.1	2.4	7.84	0.90	3.7	2.9	5.00	0.78	2.1	3.4	3.10	0.72	1.2
C4	160	0.030	14,340	0.33	A	0.0430	1607.0	1604.1	95.7	2.6	7.84	0.90	2.3	3.1	5.00	0.78	1.3	3.7	3.10	0.72	0.7
D1	410	0.078	8,980	0.21	A	0.0443	1592.0	1587.4	59.2	4.9	7.84	0.90	1.5	5.8	5.00	0.78	0.8	6.9	3.10	0.72	0.5
D2	410	0.078	7,721	0.18	A	0.0447	1596.3	1591.8	58.0	4.9	7.84	0.90	1.3	5.8	5.00	0.78	0.7	7.0	3.10	0.72	0.4

RATIONAL METHOD SUMMARY
 100 YEAR, 10 YEAR, 2 YEAR

Project Axon
 Location Scottsdale AZ
 Project Number 205133
 Project Engineer Aaron Fabian, EIT

OFF-SITE WATERSHEDS

Drainage Subbasin ID	100 YEAR								10 YEAR								2 YEAR							
	Longest Watercourse 'L' (ft)	Longest Watercourse 'L' (mi)	Drainage Area 'A' (sf)	Drainage Area 'A' (Acres)	'K _b ' Type ¹	Watershed Resistance Coefficient 'K _{b'}	Top Elevation	Bottom Elevation	Basin Slope 'S' (ft/mi)	Calculated Q100 'Tc' (See Note 2) (min)	100 YEAR Intensity 'I' (in/hr)	100 YR Runoff Coefficient 'C'	Q100 Flow (cfs)	Calculated Q10 'Tc' (See Note 2) (min)	10 YEAR Intensity 'I' (in/hr)	10 YR Runoff Coefficient 'C'	Q10 Flow (cfs)	Calculated Q2 'Tc' (See Note 2) (min)	2 YEAR Intensity 'I' (in/hr)	2 YR Runoff Coefficient 'C'	Q2 Flow (cfs)			
A1	43	0.008	10,460	0.24	A	0.0439	1606.0	1604.0	245.6	1.0	7.81	0.50	0.9	1.2	4.98	0.43	0.5	1.6	2.35	0.40	0.2			
CPA	43	0.008	10,460	0.24	A	0.0439	1606.0	1604.0	245.6	1.0	7.81	0.50	0.9	1.2	4.98	0.43	0.5	1.6	2.35	0.40	0.2			
B1	740	0.140	57,020	1.31	A	0.0393	1612.0	1607.0	35.7	7.6	6.84	0.64	5.7	9.3	3.95	0.55	2.9	13.1	1.60	0.51	1.1			
B2	663	0.126	44,510	1.02	A	0.0399	1632.0	1629.0	23.9	8.3	6.58	0.95	6.4	10.3	3.75	0.83	3.2	14.5	1.52	0.76	1.2			
B3	163	0.031	13,336	0.31	A	0.0432	1610.0	1602.0	259.1	1.9	7.81	0.50	1.2	2.3	4.98	0.43	0.7	3.0	2.35	0.40	0.3			
CPB3	1,225	0.232	114,865	2.64	A	0.0374	1612.0	1602.0	43.1	9.3	6.20	0.74	12.1	11.4	3.60	0.64	6.1	16.1	1.45	0.59	2.3			
B4	926	0.175	261,250	6.00	A	0.0351	1602.0	1591.0	62.7	6.6	7.21	0.50	21.6	8.0	4.26	0.43	11.1	11.4	1.71	0.40	4.1			
CPB	2,151	0.407	386,576	8.87	A	0.0341	1612.0	1591.0	51.5	11.5	5.63	0.57	28.6	14.2	3.23	0.50	14.3	19.9	1.33	0.46	5.4			
C1	190	0.036	16,366	0.38	A	0.0427	1612.0	1607.0	138.9	2.5	7.81	0.64	1.9	3.0	4.98	0.55	1.0	3.9	2.35	0.51	0.4			
C2	744	0.141	49,541	1.14	A	0.0397	1632.0	1628.0	28.4	8.3	6.58	0.95	7.1	10.3	3.75	0.83	3.5	14.5	1.52	0.76	1.3			
C3	350	0.066	21,281	0.49	A	0.0419	1615.0	1604.0	165.9	3.2	7.81	0.50	1.9	3.8	4.98	0.43	1.1	5.0	2.35	0.40	0.5			
CBC3	649	0.123	87,188	2.00	A	0.0381	1612.0	1604.0	65.1	5.6	7.59	0.78	11.9	6.8	4.55	0.68	6.2	9.5	1.85	0.62	2.3			
C4	910	0.172	265,305	6.09	A	0.0351	1604.0	1592.0	69.6	6.3	7.33	0.74	33.0	7.6	4.36	0.64	17.1	10.8	1.74	0.59	6.3			
CPC	1,559	0.295	352,493	8.09	A	0.0343	1612.0	1592.0	67.7	8.6	6.46	0.75	39.2	10.6	3.71	0.65	19.6	15.0	1.48	0.60	7.2			
D1	445	0.084	30,576	0.70	A	0.0410	1629.0	1622.0	83.1	4.4	7.81	0.95	5.2	5.2	4.93	0.83	2.9	7.2	2.11	0.76	1.1			
D2	347	0.066	21,795	0.50	A	0.0419	1627.0	1622.0	76.1	4.0	7.81	0.95	3.7	4.8	4.98	0.83	2.1	6.6	2.17	0.76	0.8			
D3	178	0.034	9,946	0.23	A	0.0440	1614.0	1605.0	267.0	2.0	7.81	0.50	0.9	2.4	4.98	0.43	0.5	3.2	2.35	0.40	0.2			
CBD3	723	0.137	62,317	1.43	A	0.0390	1629.0	1605.0	175.3	4.3	7.81	0.88	9.8	5.2	4.93	0.76	5.4	7.1	2.12	0.70	2.1			
D4	818	0.155	185,939	4.27	A	0.0361	1605.0	1593.0	77.5	5.8	7.51	0.77	24.7	7.0	4.50	0.67	12.9	10.0	1.79	0.62	4.7			
CPD	1,541	0.292	248,257	5.70	A	0.0353	1629.0	1593.0	123.3	6.9	7.10	0.80	32.3	8.5	4.14	0.69	16.4	12.0	1.67	0.64	6.1			
E1	455	0.086	70,201	1.61	A	0.0387	1614.0	1607.0	81.2	4.3	7.81	0.59	7.4	5.2	4.93	0.51	4.1	7.1	2.12	0.47	1.6			
E2	196	0.037	12,570	0.29	A	0.0434	1616.0	1615.0	26.9	4.3	7.81	0.95	2.1	5.1	4.96	0.83	1.2	7.0	2.13	0.76	0.5			
E3	422	0.080	30,729	0.71	A	0.0409	1622.0	1615.0	87.6	4.2	7.81	0.95	5.2	5.0	4.98	0.83	2.9	6.9	2.14	0.76	1.1			
E4	310	0.059	17,906	0.41	A	0.0424	1621.0	1617.0	68.1	4.0	7.81	0.95	3.0	4.7	4.98	0.83	1.7	6.4	2.20	0.76	0.7			
E5	280	0.053	33,512	0.77	A	0.0407	1615.0	1613.0	37.7	4.4	7.81	0.50	3.0	5.3	4.91	0.43	1.6	7.3	2.10	0.40	0.6			
CPE	800	0.152	164,917	3.79	A	0.0364	1614.0	1613.0	6.6	14.3	5.06	0.71	13.5	17.5	2.96	0.61	6.9	24.9	1.17	0.56	2.5			
F1	427	0.081	42,435	0.97	A	0.0401	1615.0	1614.0	12.4	8.2	6.61	0.95	6.1	10.1	3.77	0.83	3.0	14.2	1.53	0.76	1.1			
F2	209	0.040	14,340	0.33	A	0.0430	1614.0	1606.0	202.1	2.3	7.81	0.50	1.3	2.8	4.98	0.43	0.7	3.7	2.35	0.40	0.3			
CPF2	636	0.120	56,776	1.30	A	0.0																		

Table 2 – Retention Volumes Required

RETENTION BASIN VOLUMES
FIRST FLUSH VOLUME

Project Axon
Location Scottsdale AZ
Project Number 205133
Project Engineer Aaron Fabian, EIT

Rainfall Depth "P" = 0.5 inches

Weighted "C" Factor "C" = 1.0

Drainage Subbasin ID	Drainage Area "A" (Acres)	Runoff Coefficient "C"	A*C	Required Retention (AF)	Required Retention (cf)
B1	5.19	1.00	5.19	0.22	9,418
B2	1.13	1.00	1.13	0.05	2,047
B3	0.68	1.00	0.68	0.03	1,233
B4	2.86	1.00	2.86	0.12	5,194
B5	0.53	1.00	0.53	0.02	954
B6	1.99	1.00	1.99	0.08	3,615
B7	5.28	1.00	5.28	0.22	9,588
B8	1.95	1.00	1.95	0.08	3,534
B9	0.38	1.00	0.38	0.02	688
B10	6.14	1.00	6.14	0.26	11,138
B11	3.19	1.00	3.19	0.13	5,788
B12	0.36	1.00	0.36	0.02	654
B13	0.33	1.00	0.33	0.01	604
B14	0.47	1.00	0.47	0.02	854
B15	0.47	1.00	0.47	0.02	854
B16	0.99	1.00	0.99	0.04	1,796
B17	0.99	1.00	0.99	0.04	1,796
TOTAL	32.92			1.37	59,753

Calculated Values

$$\text{Required Retention} = V_{\text{required}} = (P/12) * C * A$$

Table 3 – Retention Volumes Provided

Project Axon
Location Scottsdale AZ
Project Number 205133
Project Engineer Aaron Fabian, EIT

Volume Method Used **Conic Approximation**

Retention Basin ID	Bottom Elevation	Top Elevation	Bottom Area (sf)	Top Area (sf)	Volume (cf)	Cumulative Volume (cf)	Cumulative Volume (AF)	Total Volume Provided (AF)	Volume Required First Flush Retention (AF)
B1	1,589.0	1,590.0	881	2,418	1,586	1,586	0.04	0.24	0.22
	1,590.0	1,591.0	2,418	4,520	3,415	5,001	0.11		
	1,591.0	1,592.0	4,520	6,877	5,657	10,658	0.24		
B2	1,599.5	1,600.5	2,345	3,662	2,979	2,979	0.07	0.07	0.05
B3	1,598.5	1,599.5	1,684	3,150	2,379	2,379	0.05	0.28	0.02
	1,599.5	1,600.5	3,150	4,975	4,028	6,407	0.15		
	1,600.5	1,601.5	4,975	7,025	5,971	12,378	0.28		
B4	1,602.5	1,603.5	3,429	9,497	6,211	6,211	0.14	0.14	0.12
B5	1,594.0	1,595.0	1,786	3,567	2,626	2,626	0.06	0.06	0.02
B7	1,593.0	1,594.0	13,610	16,876	15,214	15,214	0.35	1.29	0.22
	1,594.0	1,595.0	16,876	20,373	18,597	33,811	0.78		
	1,595.0	1,596.0	20,373	24,085	22,203	56,014	1.29		
B8	1,591.0	1,592.0	1,712	3,215	2,424	2,424	0.06	0.22	0.08
	1,592.0	1,593.0	3,215	5,013	4,081	6,505	0.15		
	1,593.0	1,593.5	5,013	7,025	2,995	9,501	0.22		
B9	1,593.0	1,594.0	861	2,075	1,424	1,424	0.03	0.03	0.02
B10	1,587.0	1,588.0	3,648	7,325	5,381	5,381	0.12	0.34	0.26
	1,588.0	1,589.0	7,325	11,840	9,493	14,873	0.34		
B11-1	1,588.0	1,589.0	695	1,549	1,094	1,094	0.03	0.15	0.15
	1,589.0	1,590.0	1,549	2,648	2,074	3,168	0.07		
	1,590.0	1,591.0	2,648	4,010	3,306	6,473	0.15		
B11-2	1,583.0	1,584.0	564	2,217	1,300	1,300	0.03	0.24	0.07
	1,584.0	1,585.0	2,217	4,532	3,306	4,606	0.11		
	1,585.0	1,586.0	4,532	7,182	5,806	10,412	0.24		
B12	1,590.3	1,590.8	1,802	2,300	1,023	1,023	0.02	0.02	0.02
B13	1,589.0	1,589.5	1,797	2,297	1,021	1,021	0.02	0.02	0.01
B14	1,590.0	1,590.5	1,802	2,300	1,023	1,023	0.02	0.02	0.02
B15	1,584.5	1,585.0	4,115	4,922	2,256	2,256	0.05	0.05	0.02
B16	1,584.5	1,585.0	5,511	6,400	2,975	2,975	0.07	0.07	0.04
B17-1	1,596.5	1,597.5	463	1,730	1,029	1,029	0.02	0.02	0.01
B17-2	1,595.0	1,596.0	491	1,724	1,045	1,045	0.02	0.02	0.01
B17-3	1,594.0	1,595.0	533	1,819	1,112	1,112	0.03	0.03	0.01
Total							3.33	1.37	

RETENTION BASIN VOLUMES
100 YEAR, 2-HOUR VOLUME

Project Axon
Location Scottsdale AZ
Project Number 205133
Project Engineer Aaron Fabian, EIT

Rainfall Depth "P" = 2.31 inches

Drainage Subbasin ID	Drainage Area "A" (Acres)	100 YR Runoff Coefficient "C"	A*C	Required Retention (AF)	Provided Retention (AF)
B3	0.68	0.90	0.61	0.12	0.28
B7	5.28	0.90	4.75	0.92	1.29
TOTAL	5.96			1.03	1.57

Calculated Values

$$\text{Required Retention} = V_{\text{required}} = (P/12)*C*A$$

$$\text{Weighted "C"} = ((A_1*C_1)+(A_2*C_2))/(A_1+A_2)$$

APPENDIX B – HYDRAULICS


Pipe Analysis Summary

Conduit FlexTable: Combined Pipe/Node Report


Label	Start Node	Stop Node	Invert (Start) (ft)	Invert (Stop) (ft)	Diameter (in)	Length (Unified) (ft)	Slope (Calculated) (ft/ft)	Flow (cfs)	Velocity (ft/s)	Hydraulic Grade Line (In) (ft)	Hydraulic Grade Line (Out) (ft)	Elevation Ground (Start) (ft)	Elevation Ground (Stop) (ft)
CO-1	H-B7-1	H-B7-2	1,598.70	1,598.50	18.0	67.7	0.003	24.30	6.88	1,600.83	1,599.82	1,602.00	1,601.50
CO-2	CB-B8	MH-1	1,588.00	1,587.80	36.0	50.5	0.004	55.72	7.88	1,592.60	1,592.25	1,597.00	1,598.50
CO-3	MH-1	MH-2	1,587.80	1,586.60	36.0	375.5	0.003	55.72	7.88	1,591.96	1,589.25	1,598.50	1,595.80
CO-4	MH-2	MH-3	1,586.60	1,583.40	42.0	375.0	0.009	55.72	10.09	1,588.94	1,588.09	1,595.80	1,591.80
CO-5	MH-3	JB	1,583.40	1,582.80	48.0	148.3	0.004	55.72	4.43	1,587.81	1,587.59	1,591.80	1,591.00
CO-6	JB	MH-5	1,582.80	1,582.60	60.0	83.3	0.002	213.92	7.28	1,587.02	1,586.91	1,591.00	1,590.20
CO-7	MH-5	MH-6	1,582.60	1,582.20	60.0	198.3	0.002	213.92	6.75	1,586.44	1,586.07	1,590.20	1,589.30
CO-8	MH-6	H-4	1,582.20	1,582.00	60.0	62.2	0.003	213.92	8.20	1,585.32	1,584.95	1,589.30	1,589.00
CO-10	CB-B11-2	MH-7	1,582.85	1,582.83	54.0	20.6	0.001	83.09	5.22	1,588.07	1,588.03	1,590.00	1,590.00
CO-11	MH-7	JB	1,582.83	1,582.80	54.0	31.8	0.001	83.09	5.22	1,587.65	1,587.59	1,590.00	1,591.00
CO-12	CB-D1	H-6	1,583.40	1,583.00	18.0	91.4	0.004	1.50	0.85	1,586.02	1,586.00	1,587.90	1,588.00
CO-13	CB-D2	H-7	1,588.30	1,588.00	18.0	76.7	0.004	1.30	2.89	1,589.01	1,589.00	1,592.30	1,592.00
CO-14	H-8	H-9	1,579.04	1,578.50	60.0	169.3	0.003	463.00	8.49	1,583.10	1,582.06	1,586.00	1,585.80
CO-15	CB-C4	CB-C3	1,601.00	1,599.40	24.0	96.8	0.017	2.30	5.53	1,601.53	1,600.50	1,604.10	1,604.10
CO-16	CB-C3	CB-C2	1,599.40	1,597.10	24.0	135.4	0.017	6.00	7.36	1,600.27	1,598.51	1,604.10	1,604.10
CO-17	CB-C2	CB-C1	1,597.10	1,595.50	24.0	102.9	0.016	9.40	8.08	1,598.20	1,597.27	1,604.10	1,604.10
CO-18	CB-C1	MH-9	1,595.50	1,593.90	24.0	98.0	0.016	14.00	9.13	1,596.85	1,595.43	1,604.10	1,604.50
CO-19	MH-9	MH-10	1,593.90	1,588.30	24.0	347.9	0.016	14.00	9.08	1,595.25	1,591.59	1,604.50	1,593.60
CO-20	MH-10	H-10	1,588.30	1,588.00	24.0	80.7	0.004	14.00	4.46	1,591.31	1,591.00	1,593.60	1,593.00
CO-22	H-A1	CB-A2	1,599.30	1,595.60	30.0	181.6	0.020	39.61	12.81	1,601.42	1,599.00	1,602.80	1,600.50
CO-23	CB-A2	T-1	1,595.60	1,595.00	36.0	32.2	0.019	52.21	13.33	1,598.36	1,598.24	1,600.50	1,599.90
CO-24	T-1	MH-11	1,595.00	1,592.10	36.0	172.4	0.017	53.41	12.88	1,597.37	1,595.63	1,599.90	1,597.10
CO-25	MH-11	MH-12	1,592.10	1,589.20	36.0	146.0	0.020	54.61	13.79	1,594.50	1,593.03	1,597.10	1,593.90
CO-26	MH-12	H-12	1,589.20	1,589.00	36.0	56.1	0.004	54.61	7.73	1,592.38	1,592.00	1,593.90	1,593.00
CO-27	CB-A3	T-1	1,596.00	1,595.75	18.0	79.3	0.003	1.20	0.68	1,598.25	1,598.24	1,600.70	1,599.90
CO-28	CB-A4	MH-11	1,595.00	1,592.85	18.0	118.4	0.018	1.20	4.88	1,595.62	1,595.63	1,605.50	1,597.10
CO-29	H-13	H-14	1,585.10	1,584.70	48.0	117.8	0.003	247.53	7.59	1,588.19	1,587.45	1,591.85	1,591.45
CO-32	CB-B1	JB	1,584.50	1,582.80	42.0	163.7	0.010	75.11	7.81	1,588.50	1,587.59	1,592.00	1,591.00

Profile Report

Engineering Profile - H-B7-1 TO H-B7-2 (5133-STORMCAD.stsw)

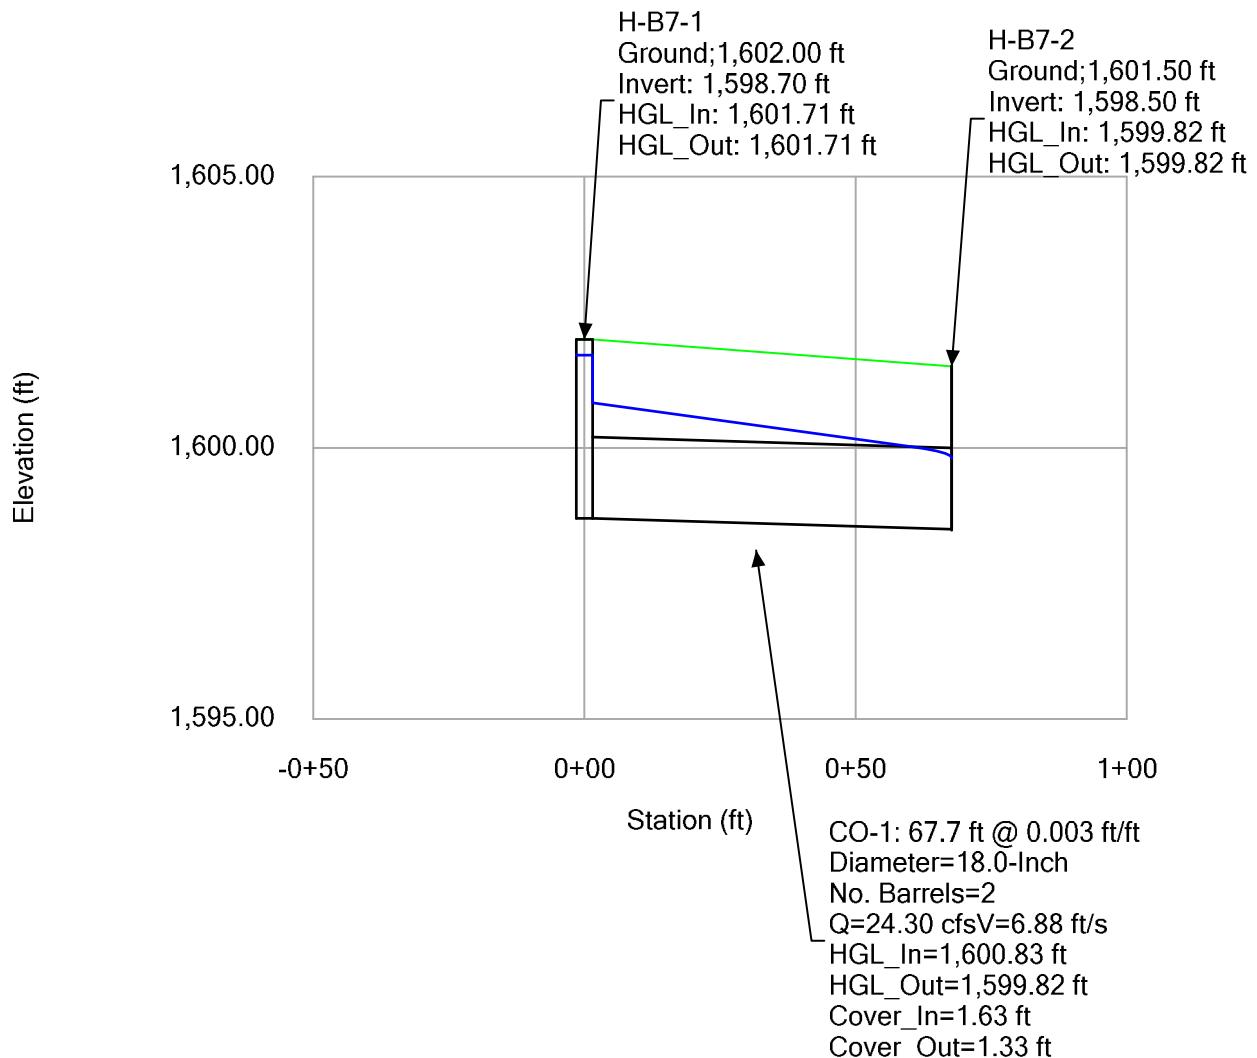


Profile Report
Engineering Profile - CB-C4 TO H-10 (5133-STORMCAD.stsw)

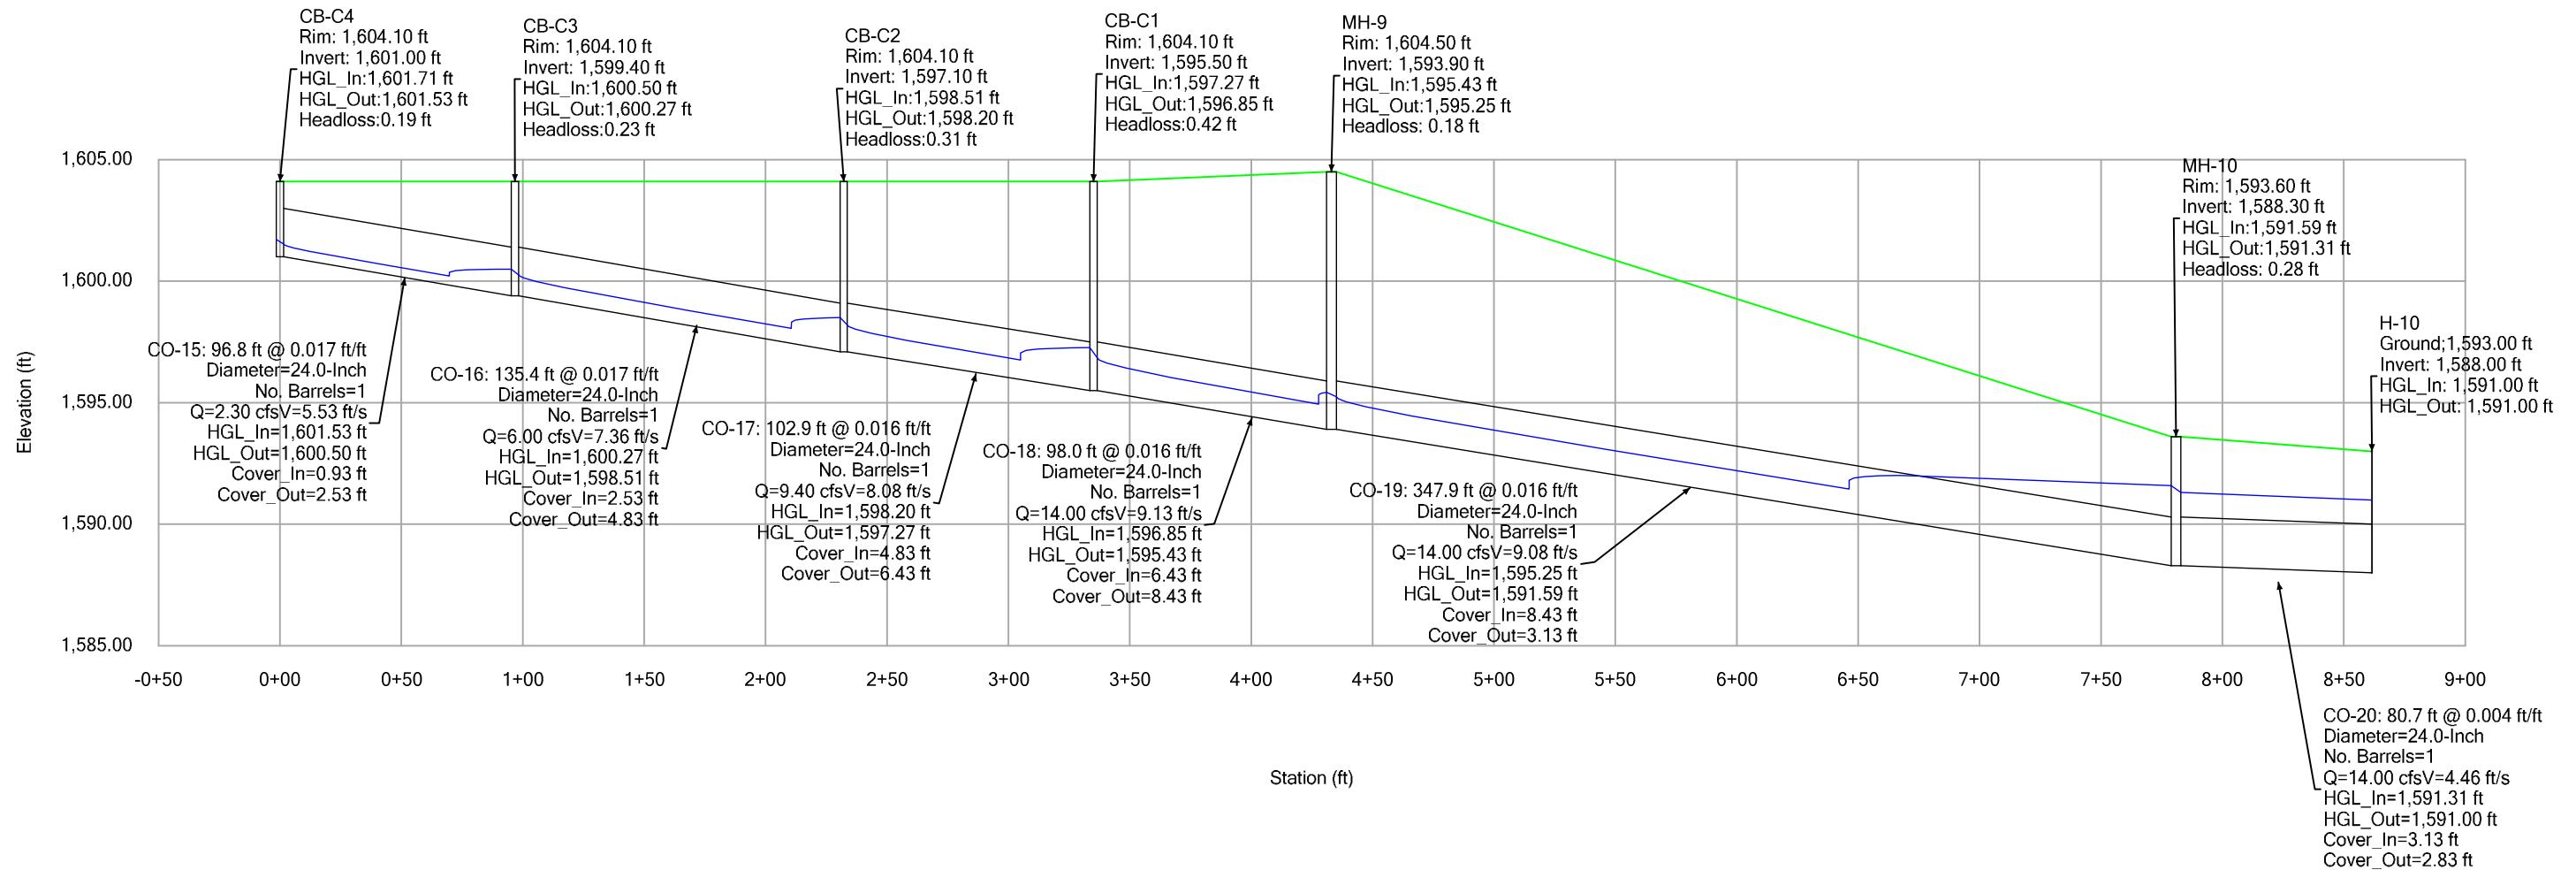


Profile Report


Engineering Profile - CB-B11-2 TO MH-5 (5133-STORMCAD.stsw)

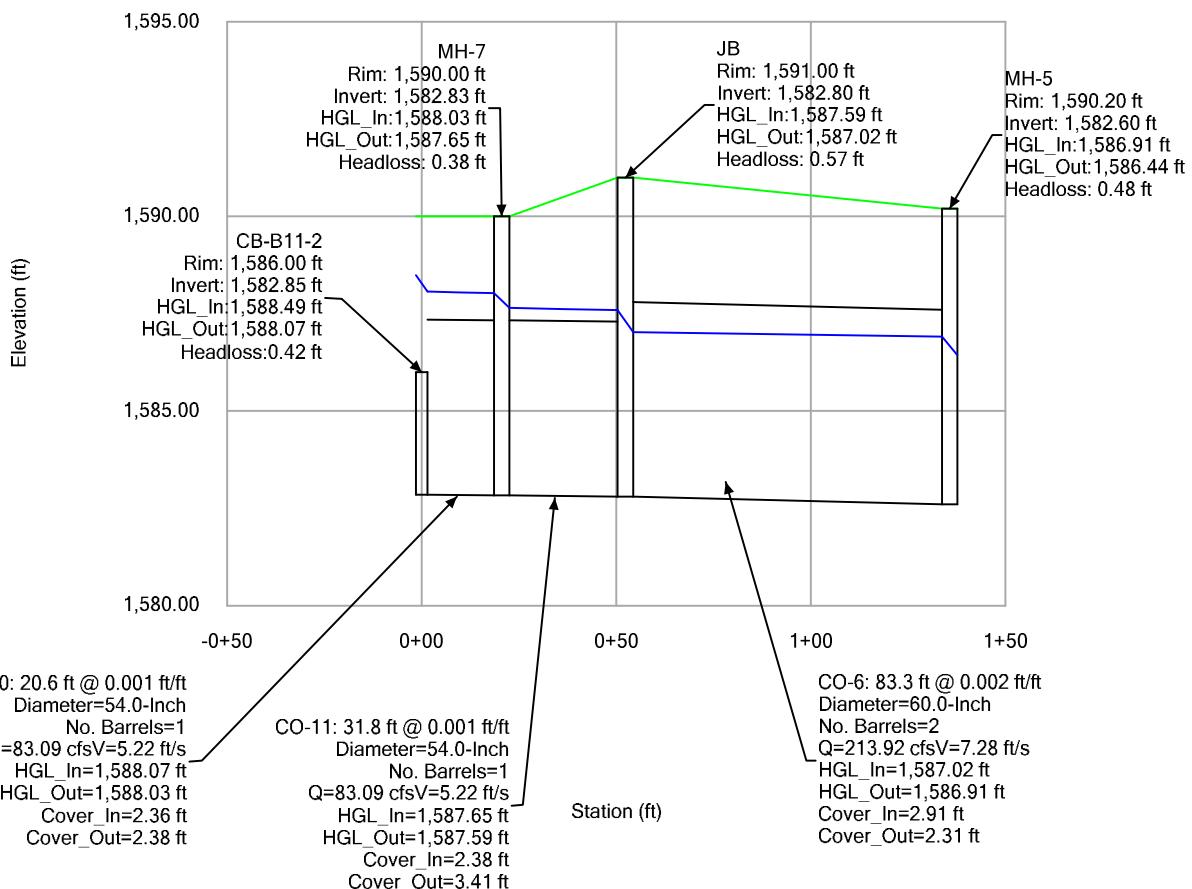

Profile Report
Engineering Profile - CB-B8 TO H-4 (5133-STORMCAD.stsw)

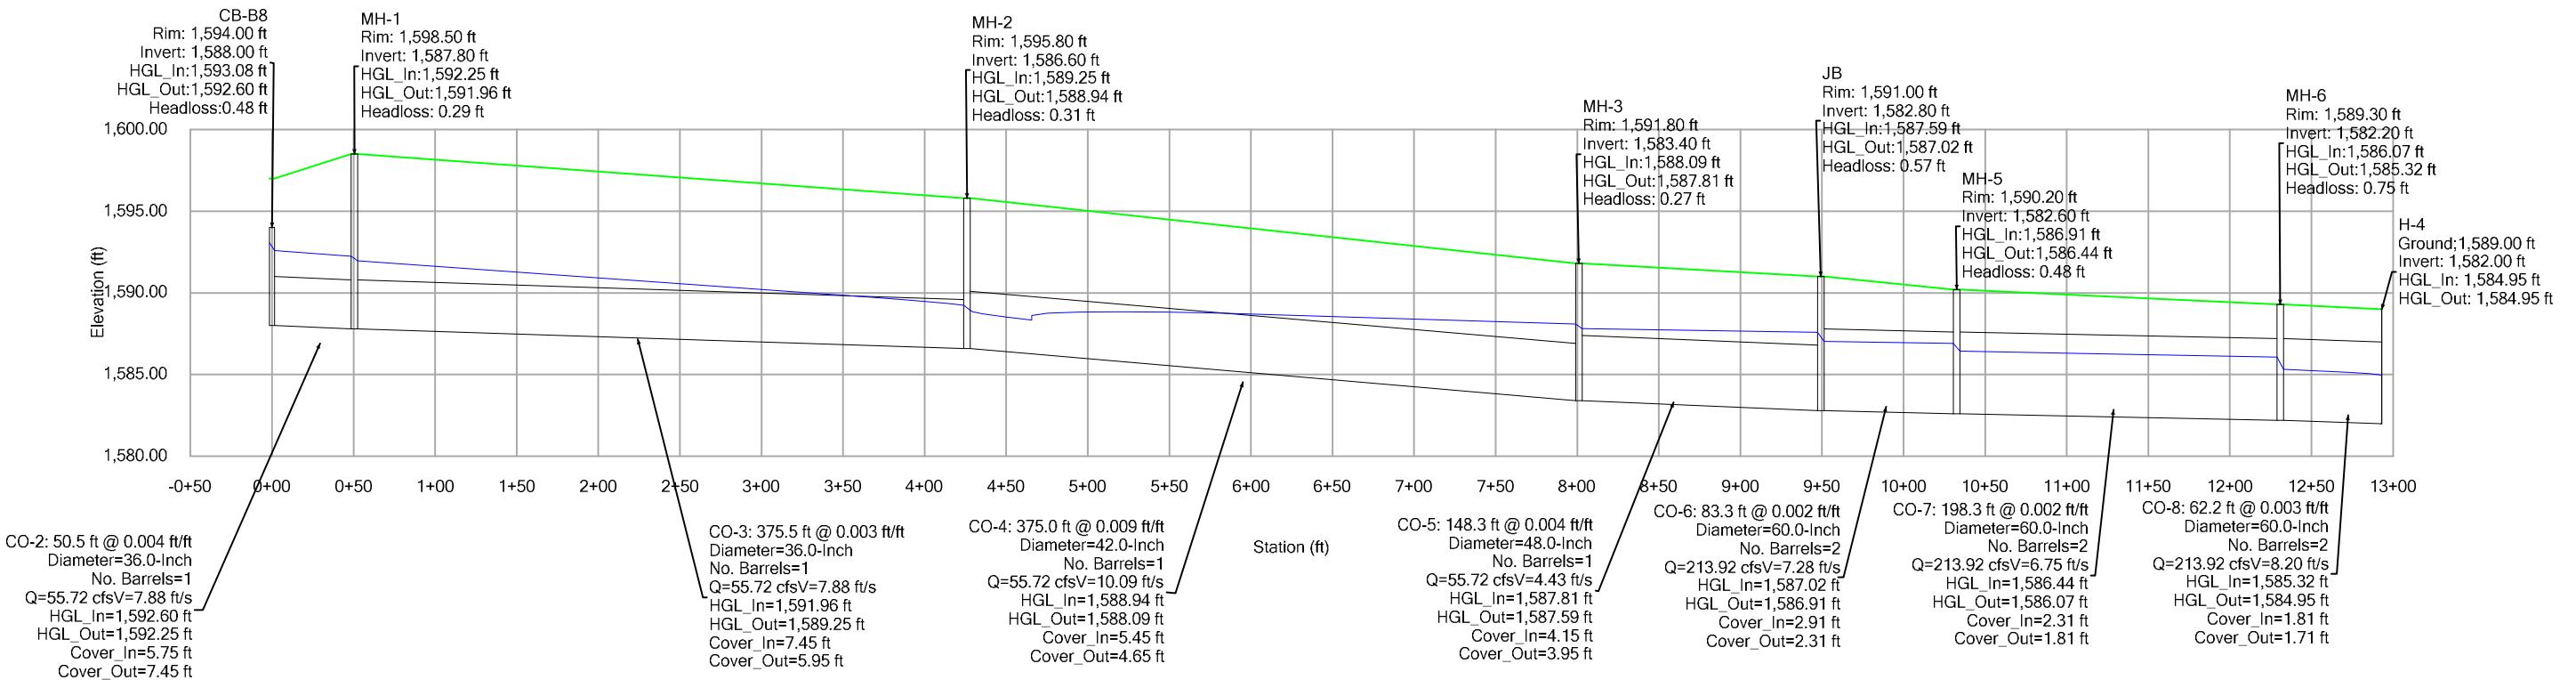


Profile Report
Engineering Profile - H-A1 TO H-12 (5133-STORMCAD.stsw)

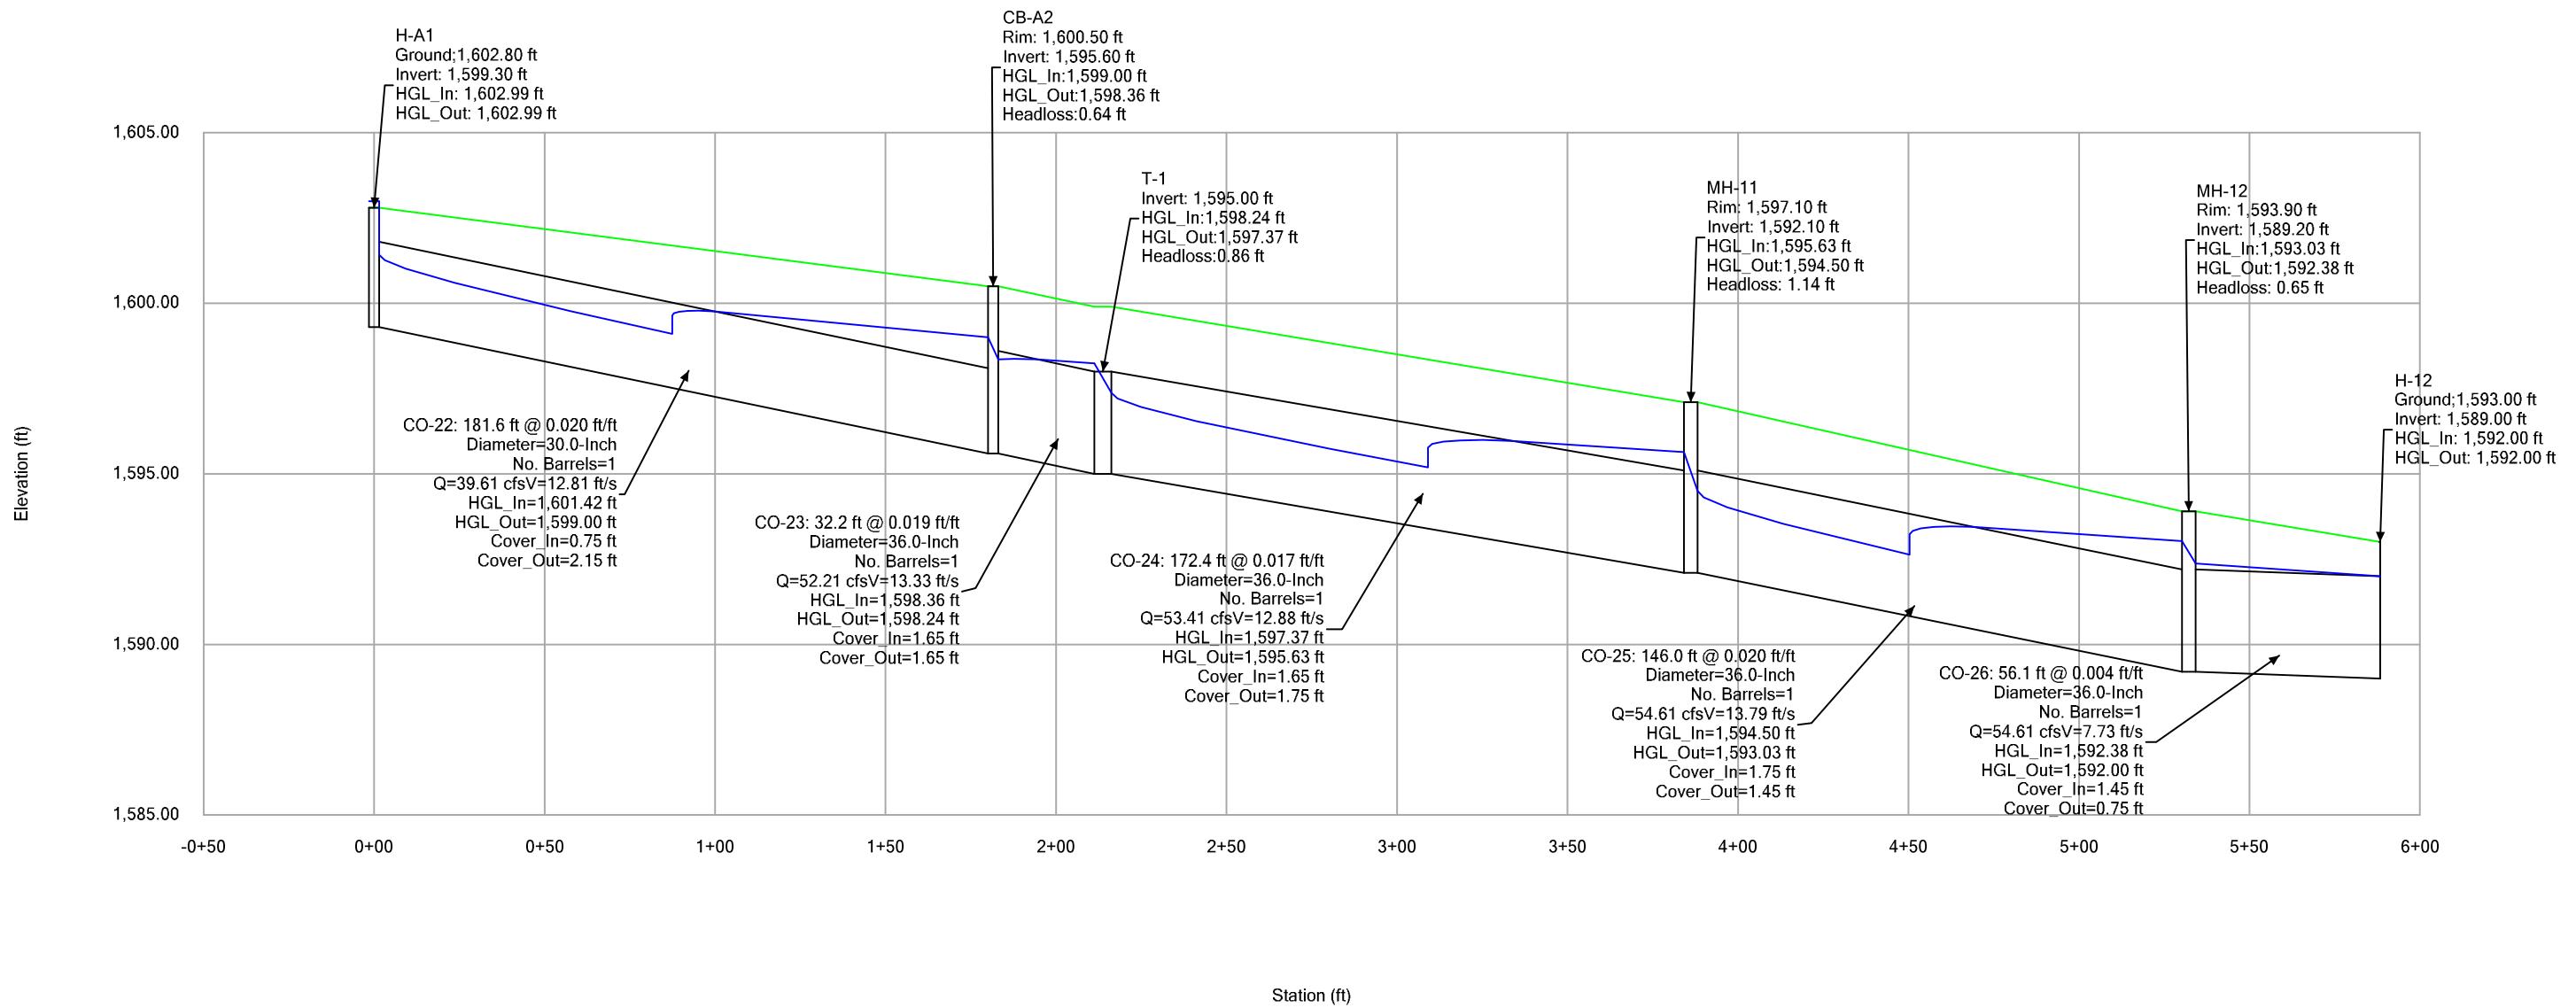


Profile Report

Engineering Profile - H-8 TO H-9 (5133-STORMCAD.stsw)

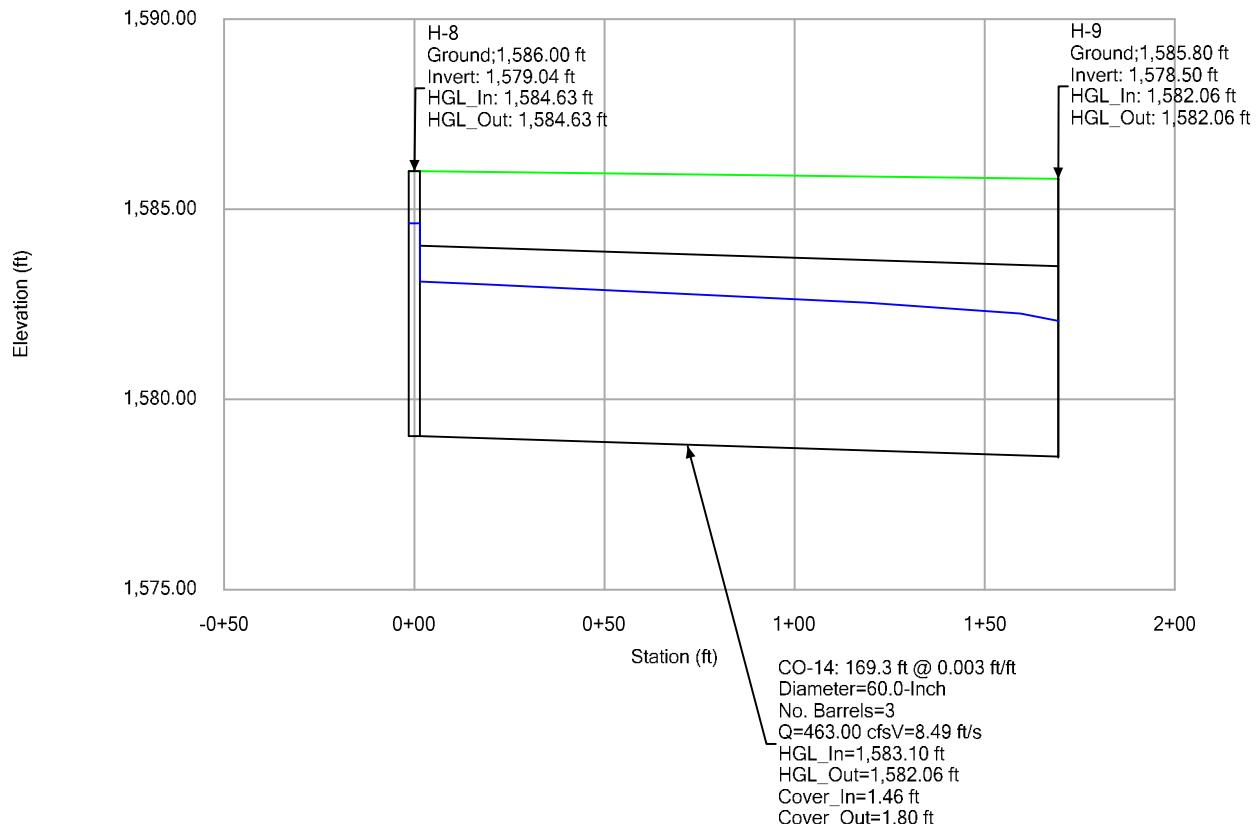


Profile Report

Engineering Profile - CB-B1 TO MH-5 (5133-STORMCAD.stsw)

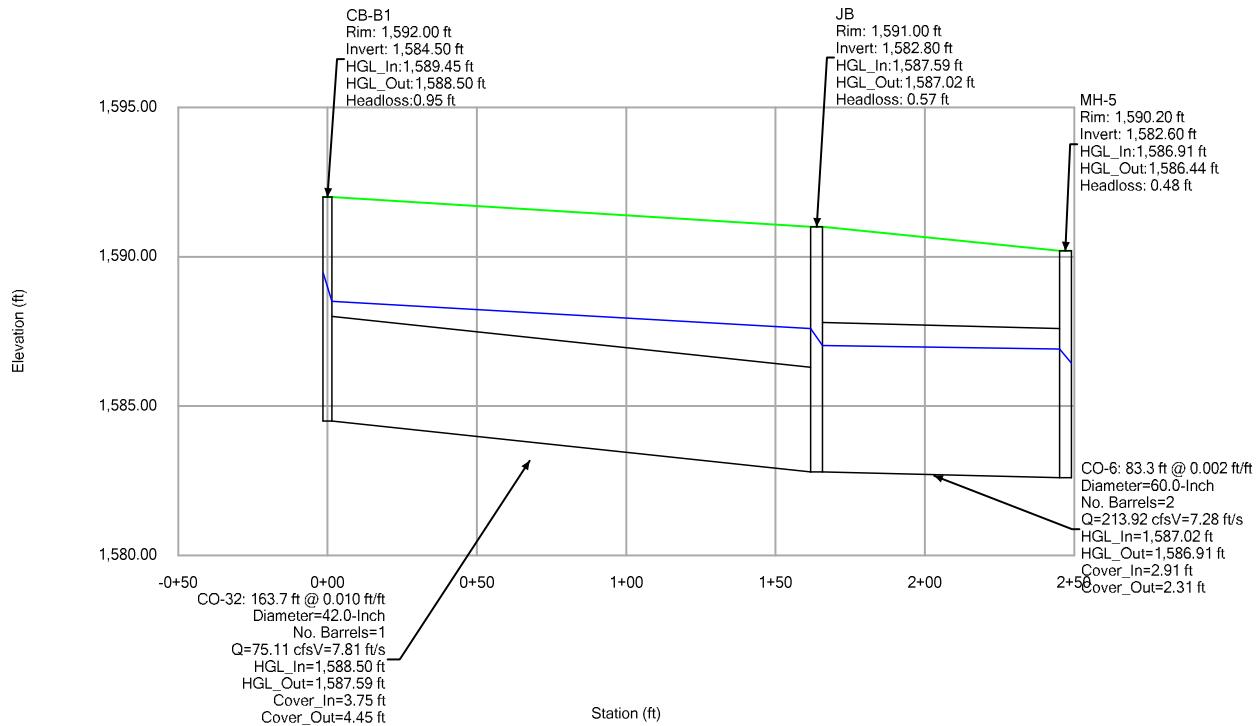


Profile Report

Engineering Profile - CB-D2 TO H-7 (5133-STORMCAD.stsw)

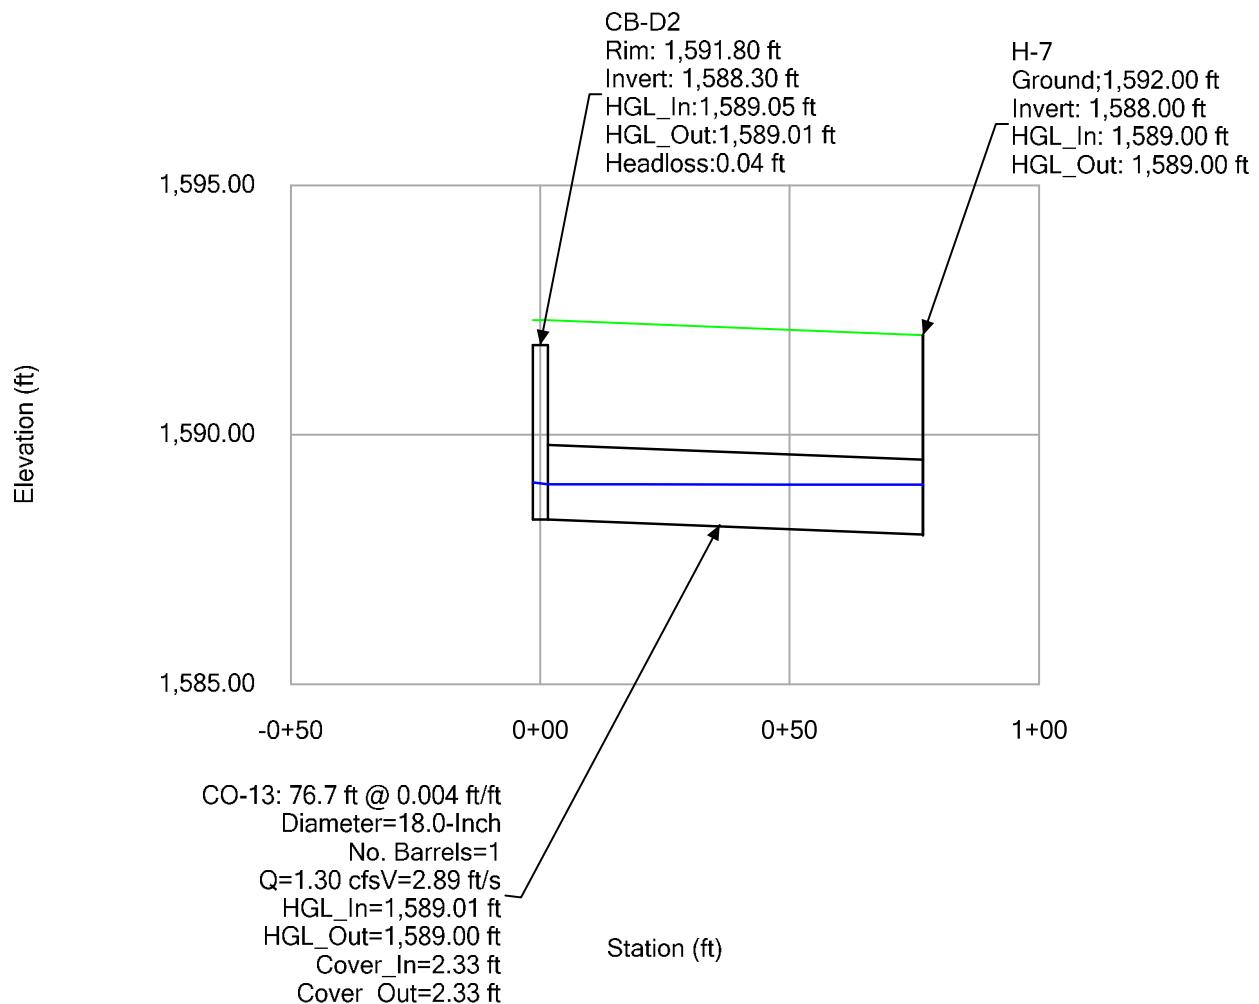


Profile Report

Engineering Profile - H-13 TO H-14 (5133-STORMCAD.stsw)

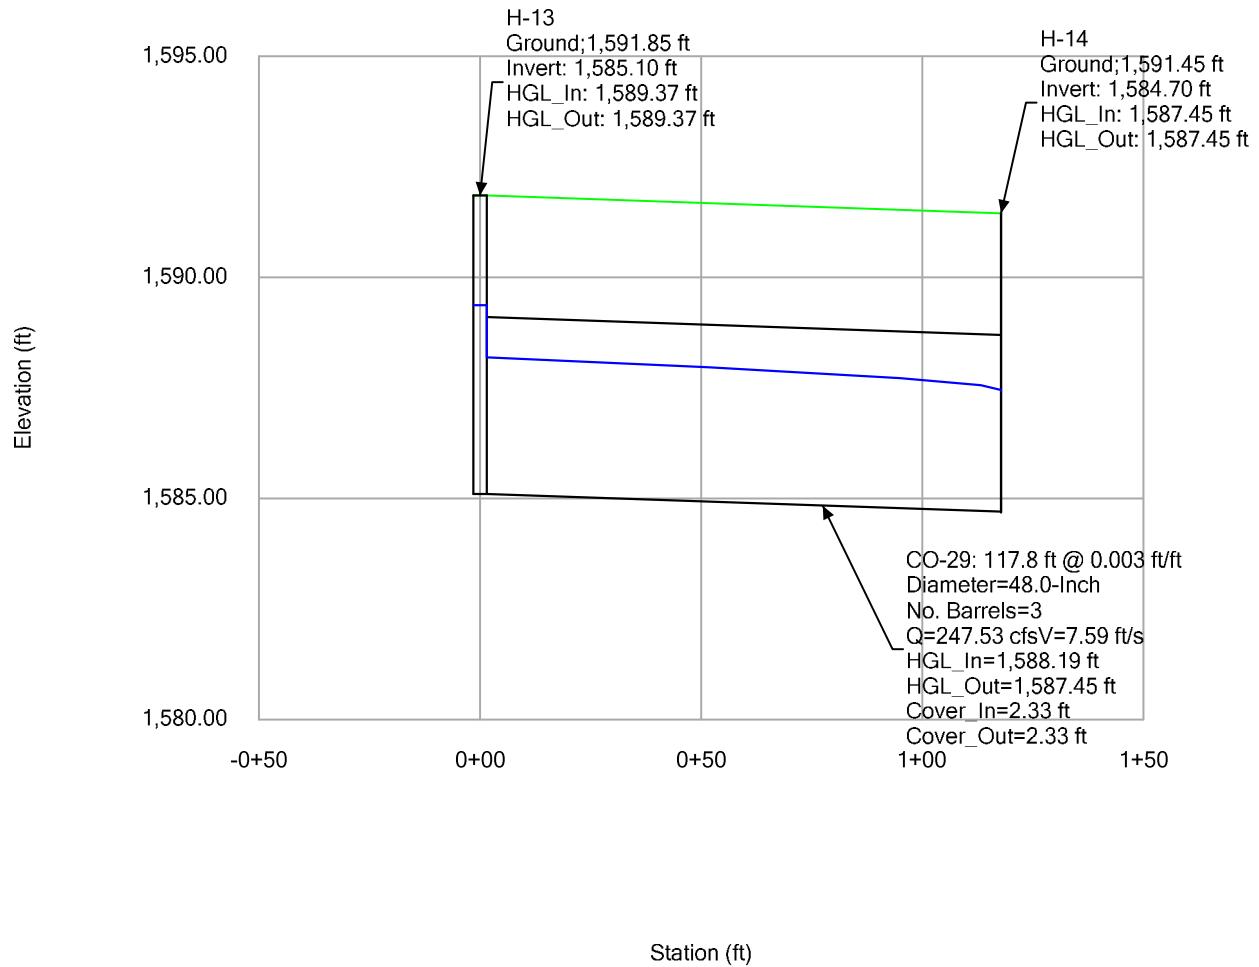

Profile Report


Engineering Profile - CB-D1 TO H-6 (5133-STORMCAD.stsw)

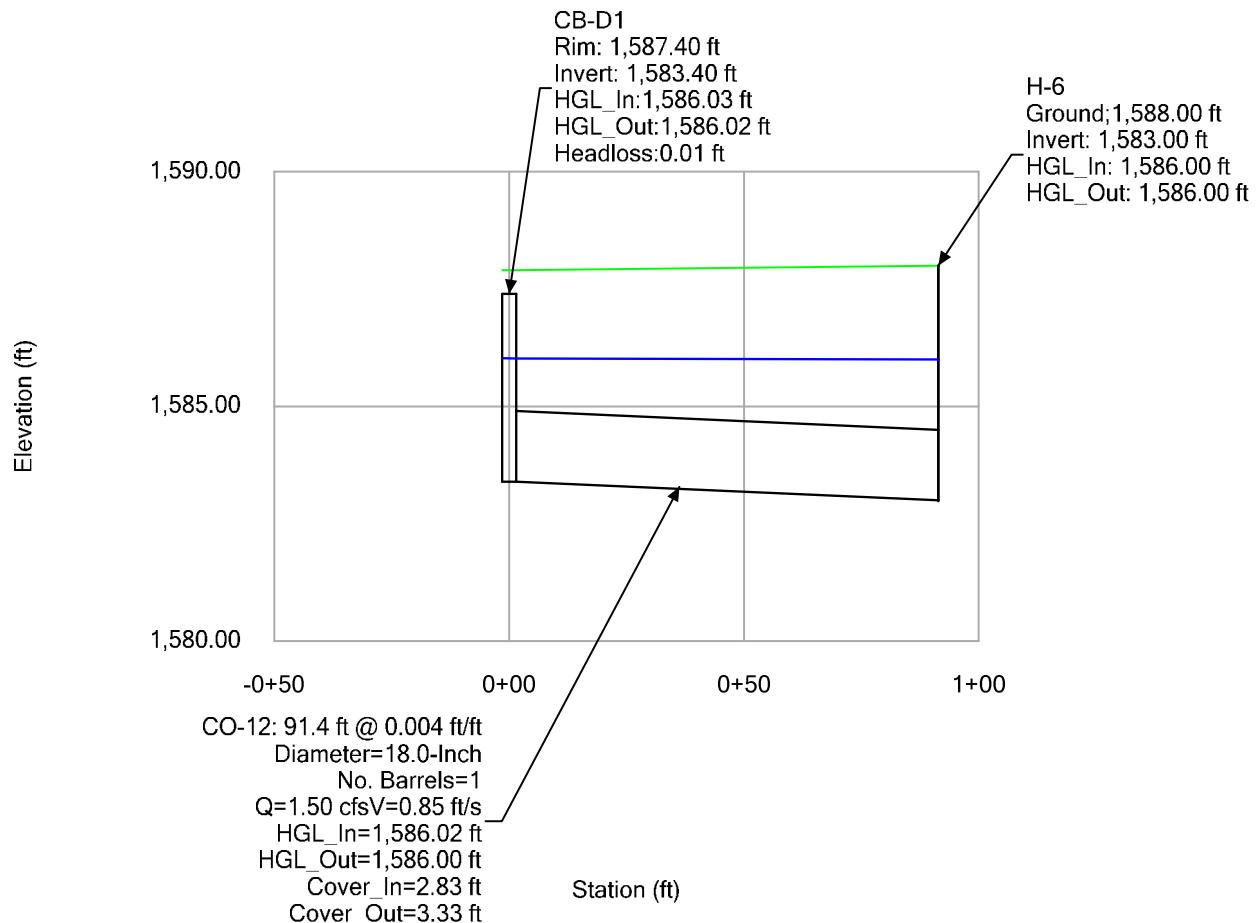

Hydraflow Output Report

Watershed Model Schematic

Hydraflow Hydrographs Extension for AutoCAD® Civil 3D® 2018 by Autodesk, Inc. v2018.3

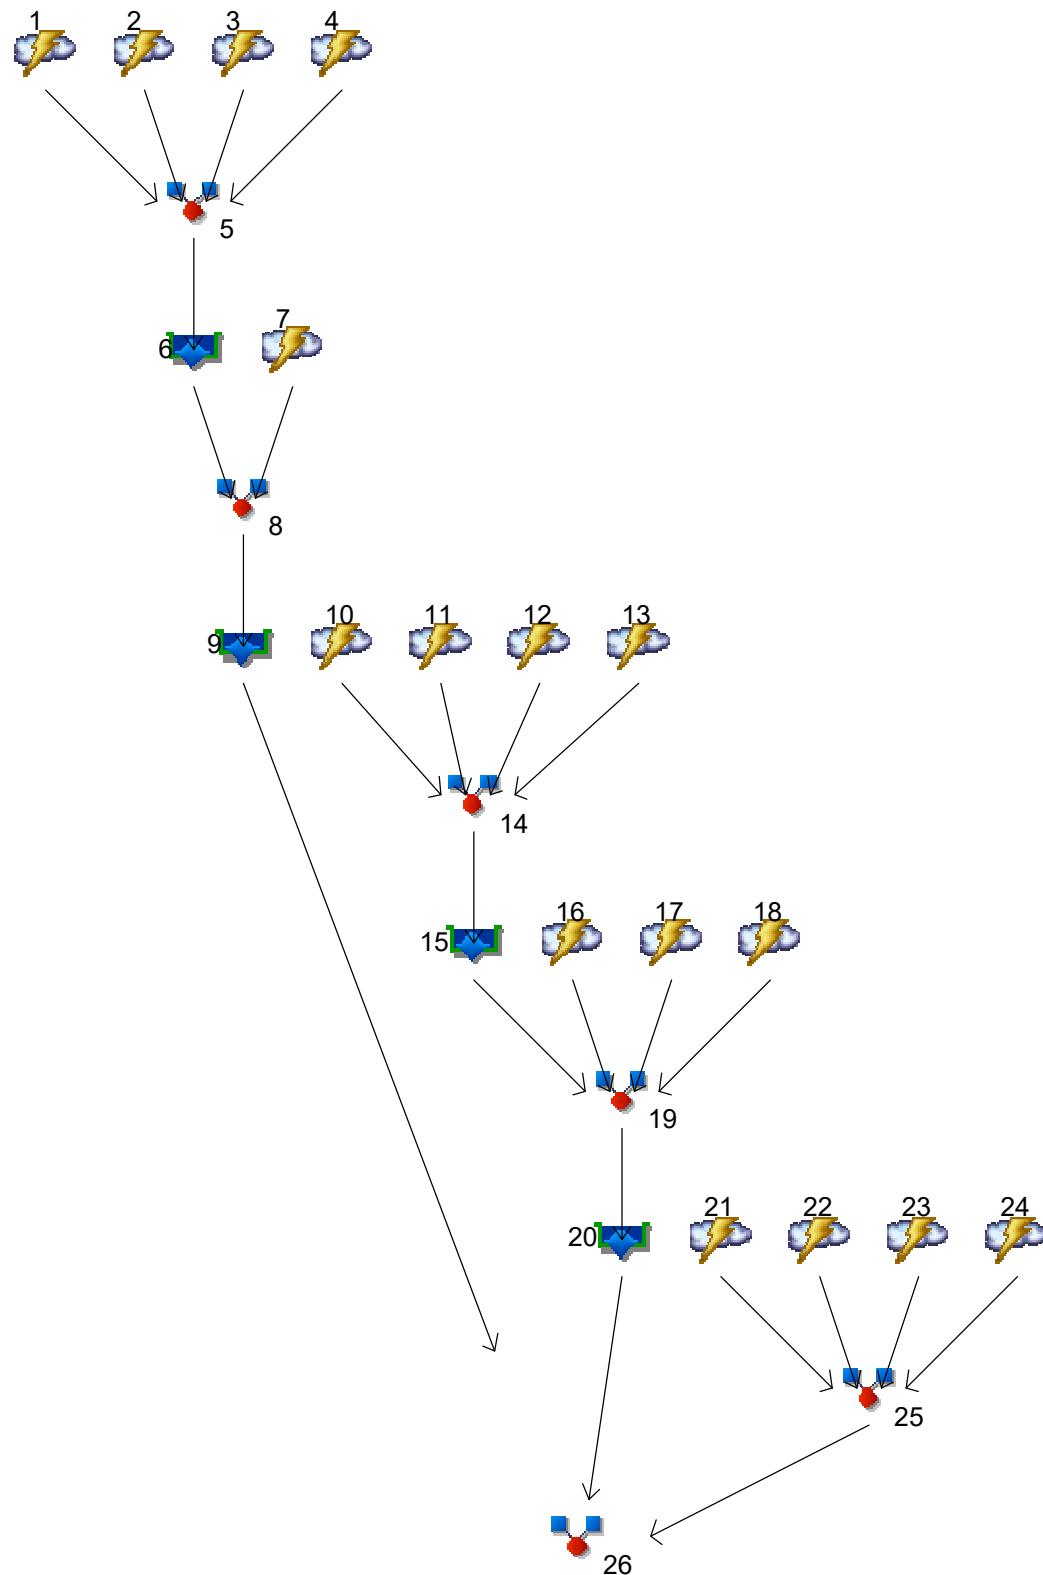

Hydrograph Summary Report

Hydraflow Hydrographs Extension for AutoCAD® Civil 3D® 2018 by Autodesk, Inc. v2018.3

Hyd. No.	Hydrograph type (origin)	Peak flow (cfs)	Time interval (min)	Time to Peak (min)	Hyd. volume (cuft)	Inflow hyd(s)	Maximum elevation (ft)	Total strge used (cuft)	Hydrograph Description
1	Rational	24.11	1	5	27,121	----	----	----	CPH
2	Rational	16.76	1	5	18,858	----	----	----	CPI
3	Rational	17.65	1	5	19,860	----	----	----	CPJ
4	Rational	36.01	1	5	40,506	----	----	----	ON-B7
5	Combine	94.53	1	5	104,928	1, 2, 3, 4	----	----	Combine at Basin B7
6	Reservoir	48.49	1	21	48,920	5	1598.44	67,474	Basin B7
7	Rational	13.85	1	5	15,579	----	----	----	ON-B8
8	Combine	55.72	1	20	64,291	6, 7	----	----	COMBINE B8
9	Reservoir	51.88	1	23	64,282	8	1594.58	17,158	BASIN B8
10	Rational	8.617	1	5	9,694	----	----	----	CPF2
11	Rational	21.23	1	5	23,888	----	----	----	CPE
12	Rational	4.829	1	5	5,433	----	----	----	ON-B3
13	Rational	20.31	1	5	22,850	----	----	----	ON-B4
14	Combine	54.99	1	5	61,039	10, 11, 12, 13	----	----	CPB3
15	Reservoir	39.61	1	14	61,030	14	1602.35	19,315	BASIN B3
16	Rational	8.025	1	5	9,028	----	----	----	ON-B2
17	Rational	3.764	1	5	4,234	----	----	----	ON-B5
18	Rational	36.86	1	5	41,465	----	----	----	ON-B1
19	Combine	76.32	1	12	115,028	15, 16, 17, 18	----	----	CPB1
20	Reservoir	75.11	1	14	115,022	19	1592.99	18,663	BASIN B1
21	Rational	2.699	1	5	3,036	----	----	----	ON-B9
22	Rational	43.60	1	5	49,055	----	----	----	ON-B10
23	Rational	14.13	1	5	15,899	----	----	----	ON-B6
24	Rational	22.65	1	5	25,486	----	----	----	ON-B11
25	Combine	83.09	1	5	92,230	21, 22, 23, 24	----	----	CP-B11
26	Combine	151.28	1	20	271,534	9, 20, 25	----	----	CP-SITE

Hydrograph Report


Hydraflow Hydrographs Extension for AutoCAD® Civil 3D® 2018 by Autodesk, Inc. v2018.3

Thursday, 09 / 10 / 2020

Hyd. No. 1

CPH

Hydrograph type	= Rational	Peak discharge	= 24.11 cfs
Storm frequency	= 100 yrs	Time to peak	= 0.08 hrs
Time interval	= 1 min	Hyd. volume	= 27,121 cuft
Drainage area	= 4.560 ac	Runoff coeff.	= 0.67
Intensity	= 7.891 in/hr	Tc by User	= 5.00 min
IDF Curve	= IDF.IDF	Asc/Rec limb fact	= 1/6.5

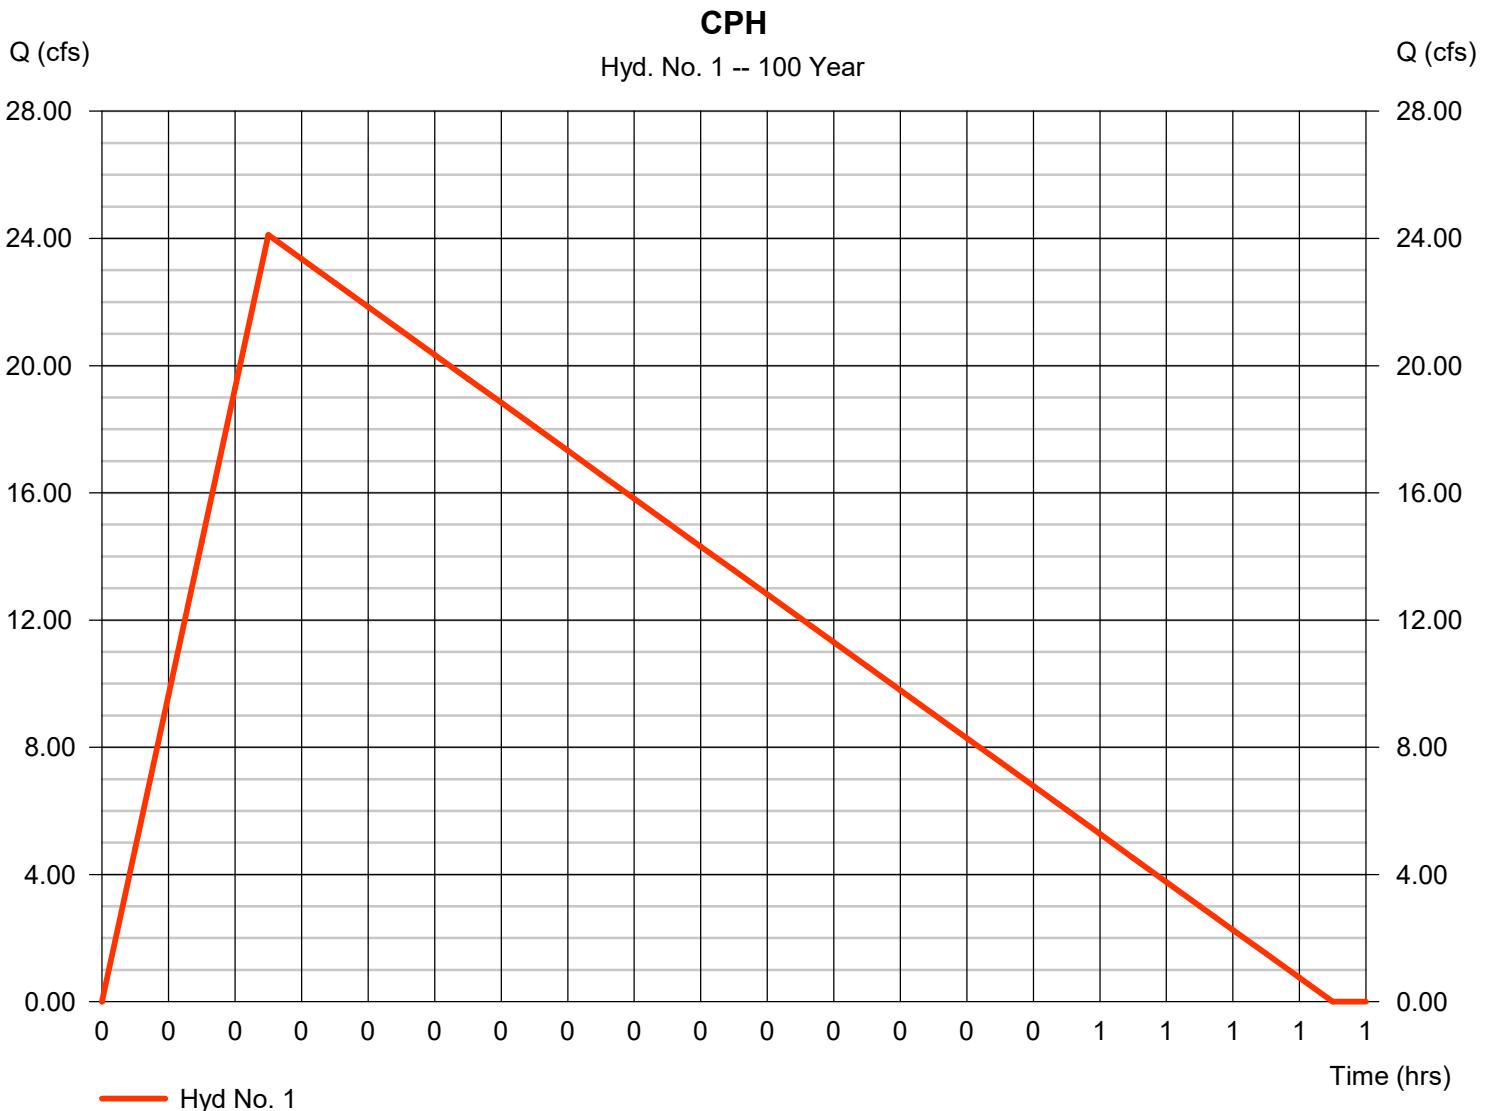

Hydrograph Report


Hydraflow Hydrographs Extension for AutoCAD® Civil 3D® 2018 by Autodesk, Inc. v2018.3

Thursday, 09 / 10 / 2020

Hyd. No. 2

CPI

Hydrograph type	= Rational	Peak discharge	= 16.76 cfs
Storm frequency	= 100 yrs	Time to peak	= 0.08 hrs
Time interval	= 1 min	Hyd. volume	= 18,858 cuft
Drainage area	= 2.910 ac	Runoff coeff.	= 0.73
Intensity	= 7.891 in/hr	Tc by User	= 5.00 min
IDF Curve	= IDF.IDF	Asc/Rec limb fact	= 1/6.5

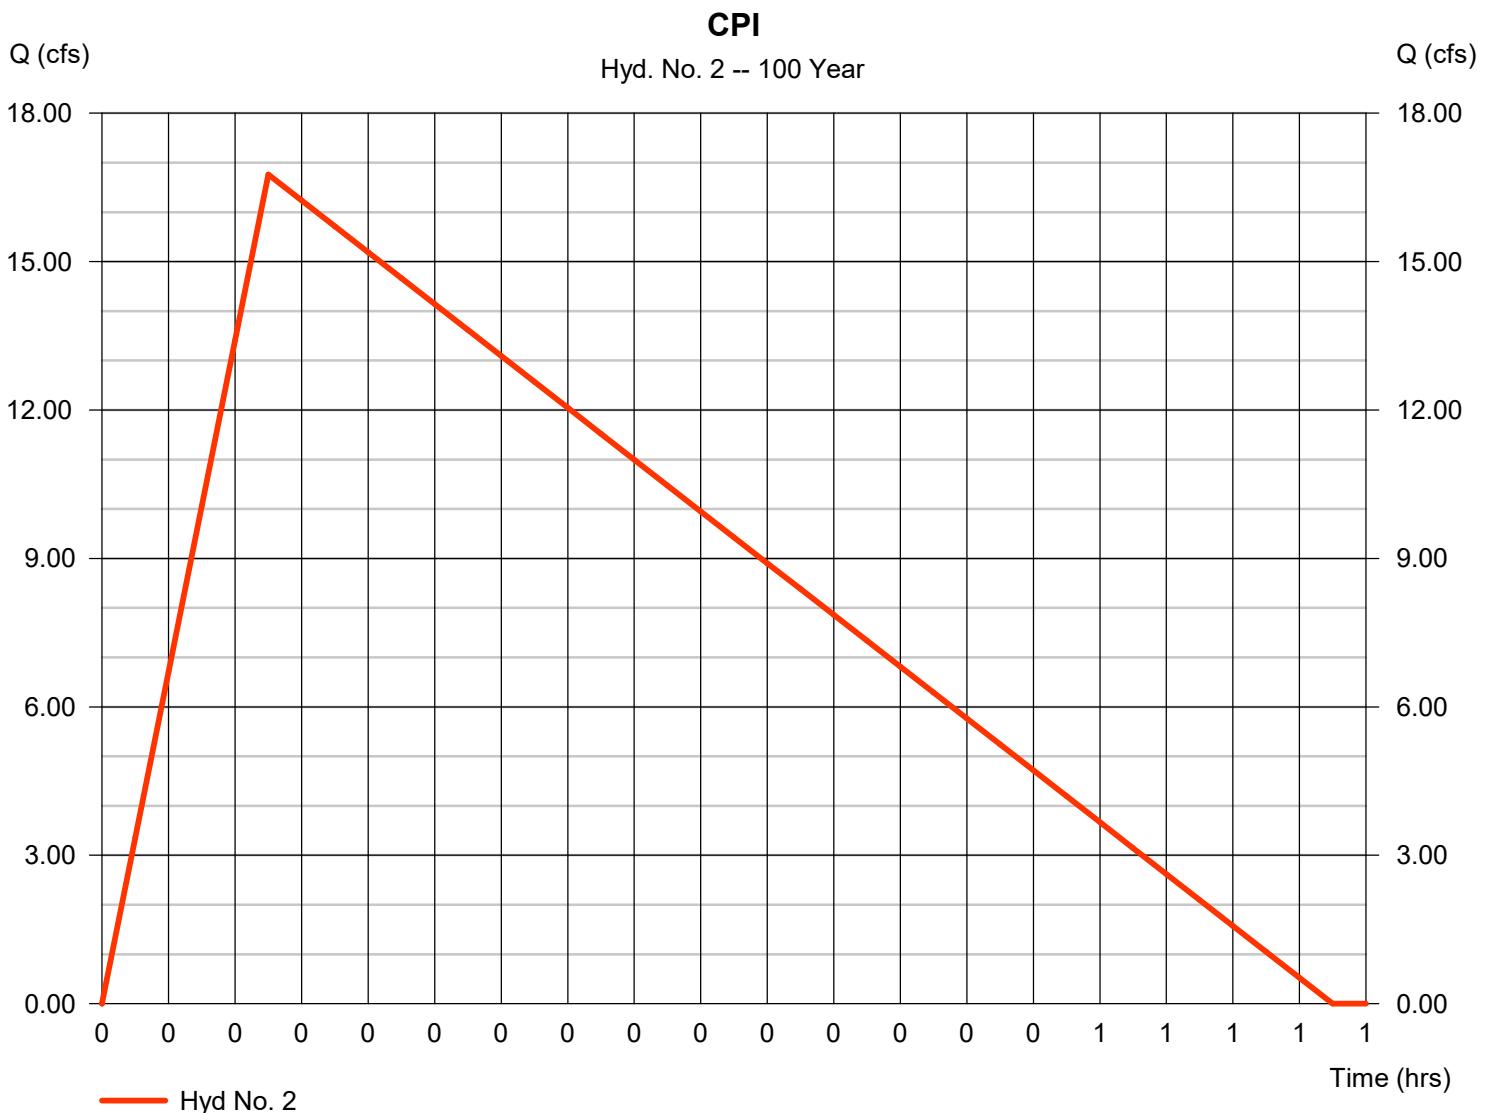


Hydrograph Report

Hyd. No. 3

CPJ

Hydrograph type	= Rational	Peak discharge	= 17.65 cfs
Storm frequency	= 100 yrs	Time to peak	= 0.08 hrs
Time interval	= 1 min	Hyd. volume	= 19,860 cuft
Drainage area	= 3.290 ac	Runoff coeff.	= 0.68
Intensity	= 7.891 in/hr	Tc by User	= 5.00 min
IDF Curve	= IDF.IDF	Asc/Rec limb fact	= 1/6.5

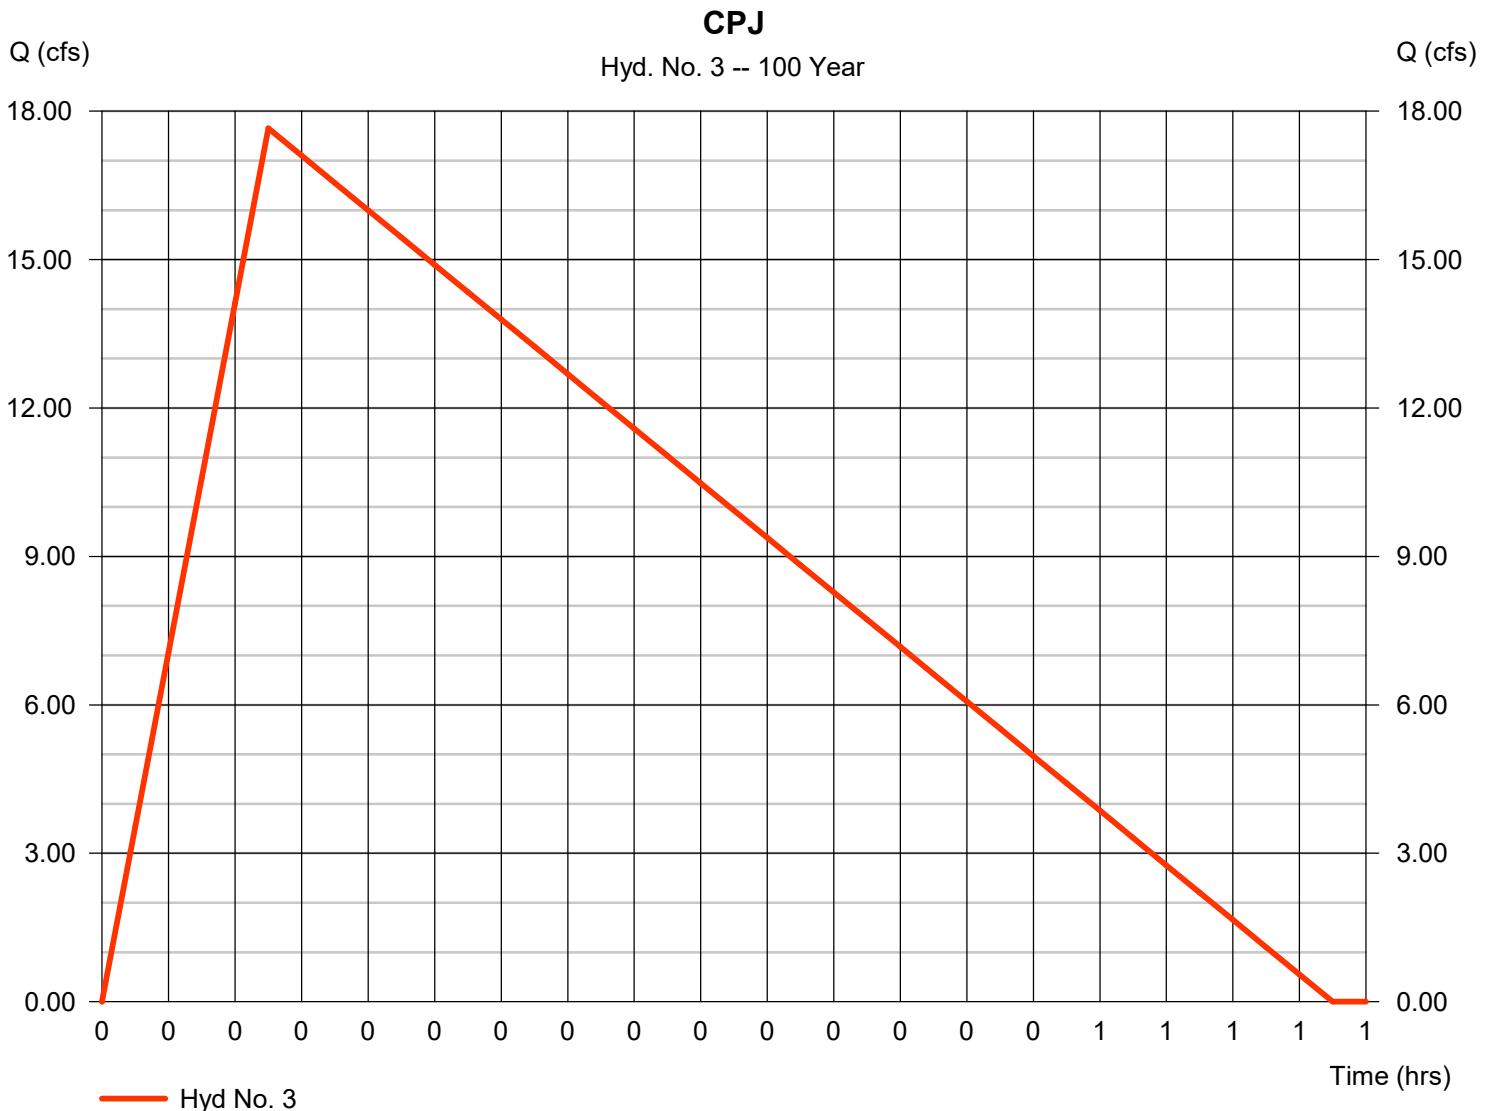

Hydrograph Report


Hydraflow Hydrographs Extension for AutoCAD® Civil 3D® 2018 by Autodesk, Inc. v2018.3

Thursday, 09 / 10 / 2020

Hyd. No. 4

ON-B7

Hydrograph type	= Rational	Peak discharge	= 36.01 cfs
Storm frequency	= 100 yrs	Time to peak	= 0.08 hrs
Time interval	= 1 min	Hyd. volume	= 40,506 cuft
Drainage area	= 5.070 ac	Runoff coeff.	= 0.9
Intensity	= 7.891 in/hr	Tc by User	= 5.00 min
IDF Curve	= IDF.IDF	Asc/Rec limb fact	= 1/6.5

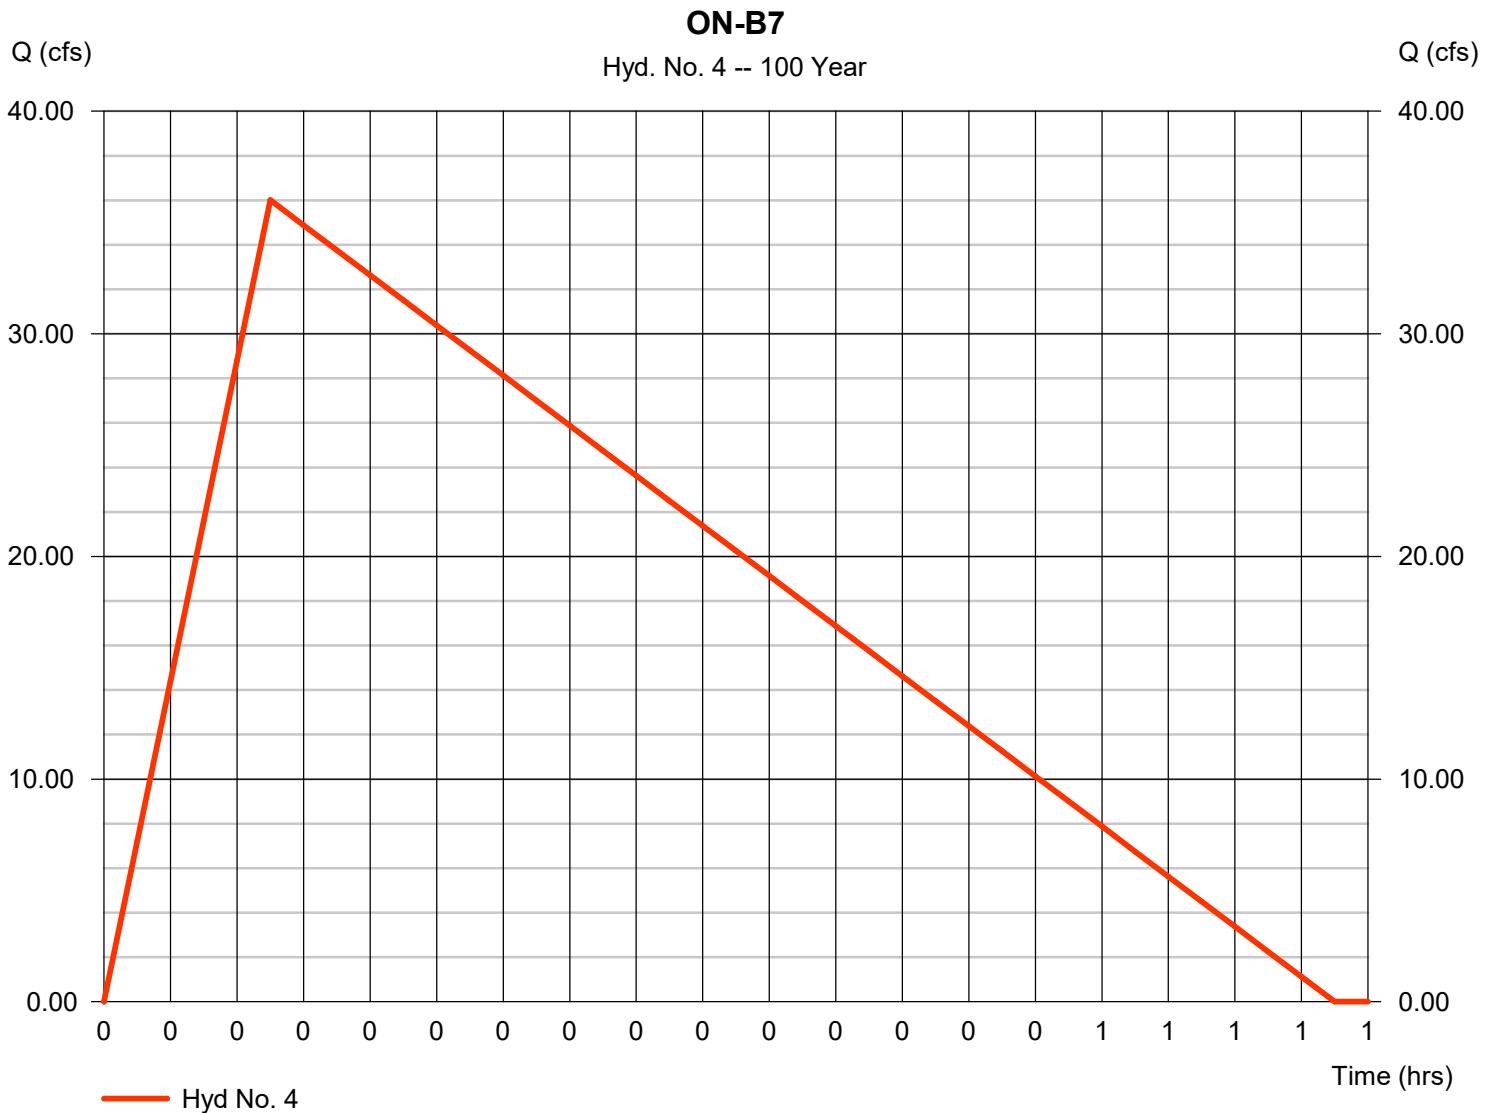


Hydrograph Report

Hyd. No. 5

Combine at Basin B7

Hydrograph type = Combine
 Storm frequency = 100 yrs
 Time interval = 1 min
 Inflow hyds. = 1, 2, 3, 4

Peak discharge	= 94.53 cfs
Time to peak	= 0.08 hrs
Hyd. volume	= 104,928 cuft
Contrib. drain. area	= 15.830 ac

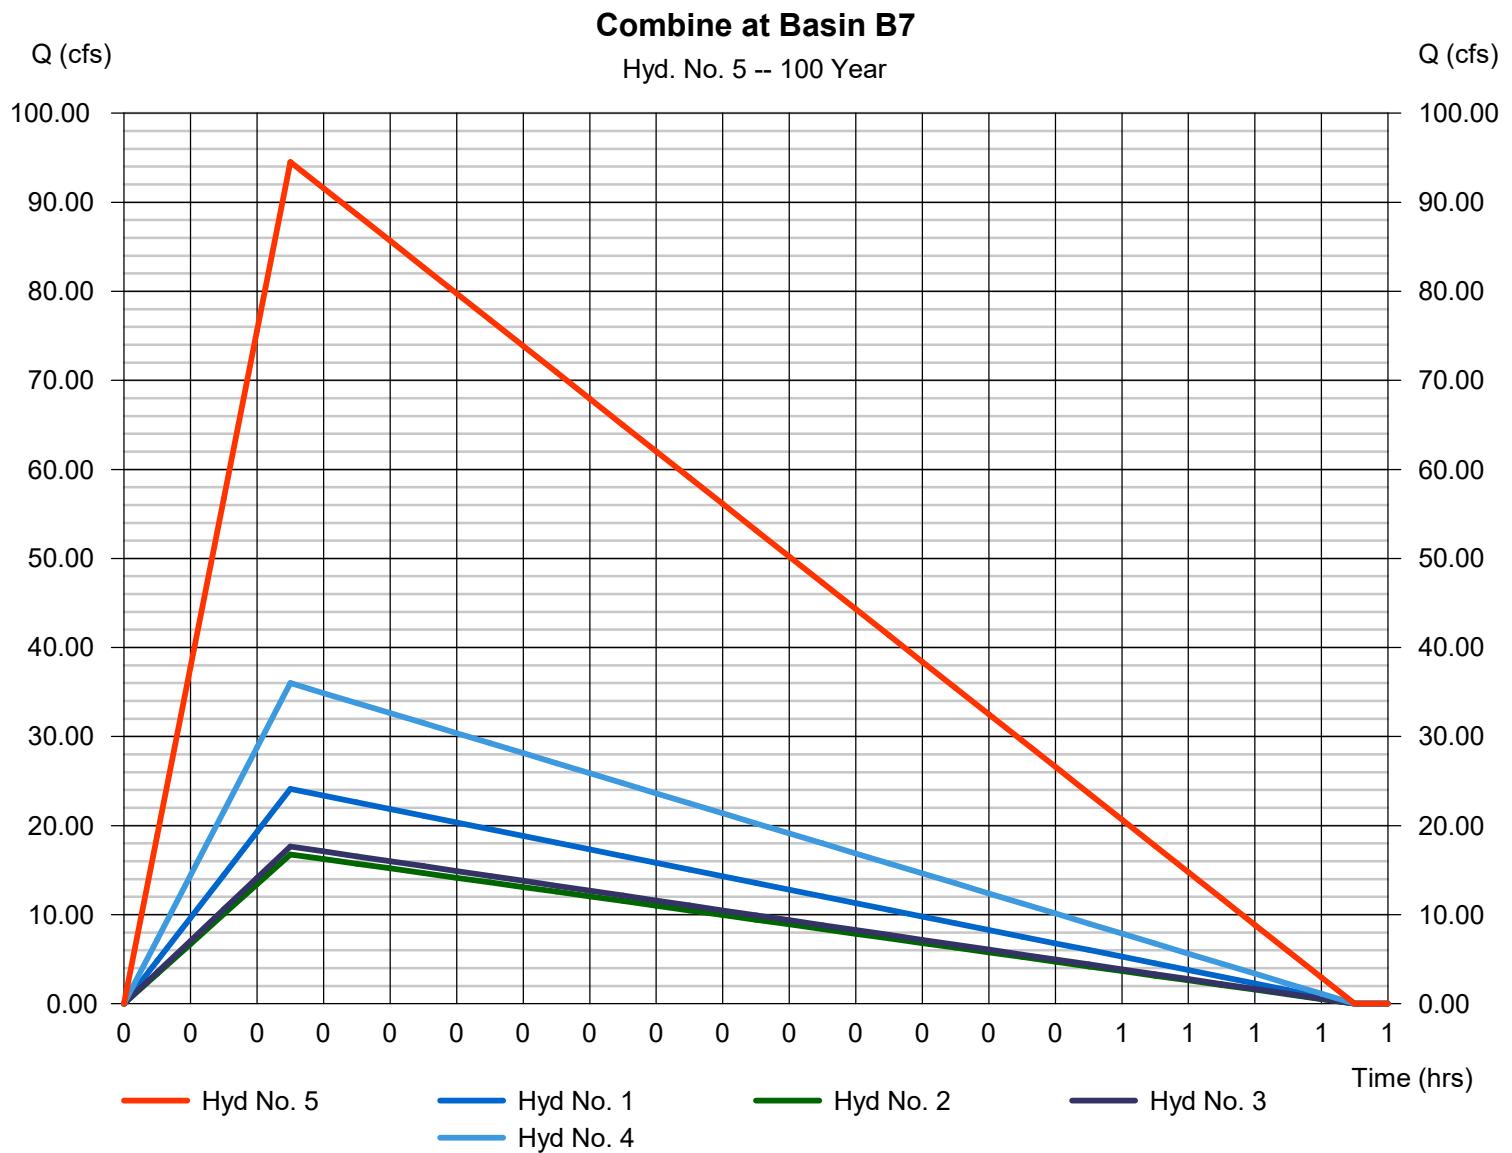

Hydrograph Report

Hydraflow Hydrographs Extension for AutoCAD® Civil 3D® 2018 by Autodesk, Inc. v2018.3


Thursday, 09 / 10 / 2020

Hyd. No. 6

Basin B7

Hydrograph type	= Reservoir	Peak discharge	= 48.49 cfs
Storm frequency	= 100 yrs	Time to peak	= 0.35 hrs
Time interval	= 1 min	Hyd. volume	= 48,920 cuft
Inflow hyd. No.	= 5 - Combine at Basin B7	Max. Elevation	= 1598.44 ft
Reservoir name	= Basin B7	Max. Storage	= 67,474 cuft

Storage Indication method used.

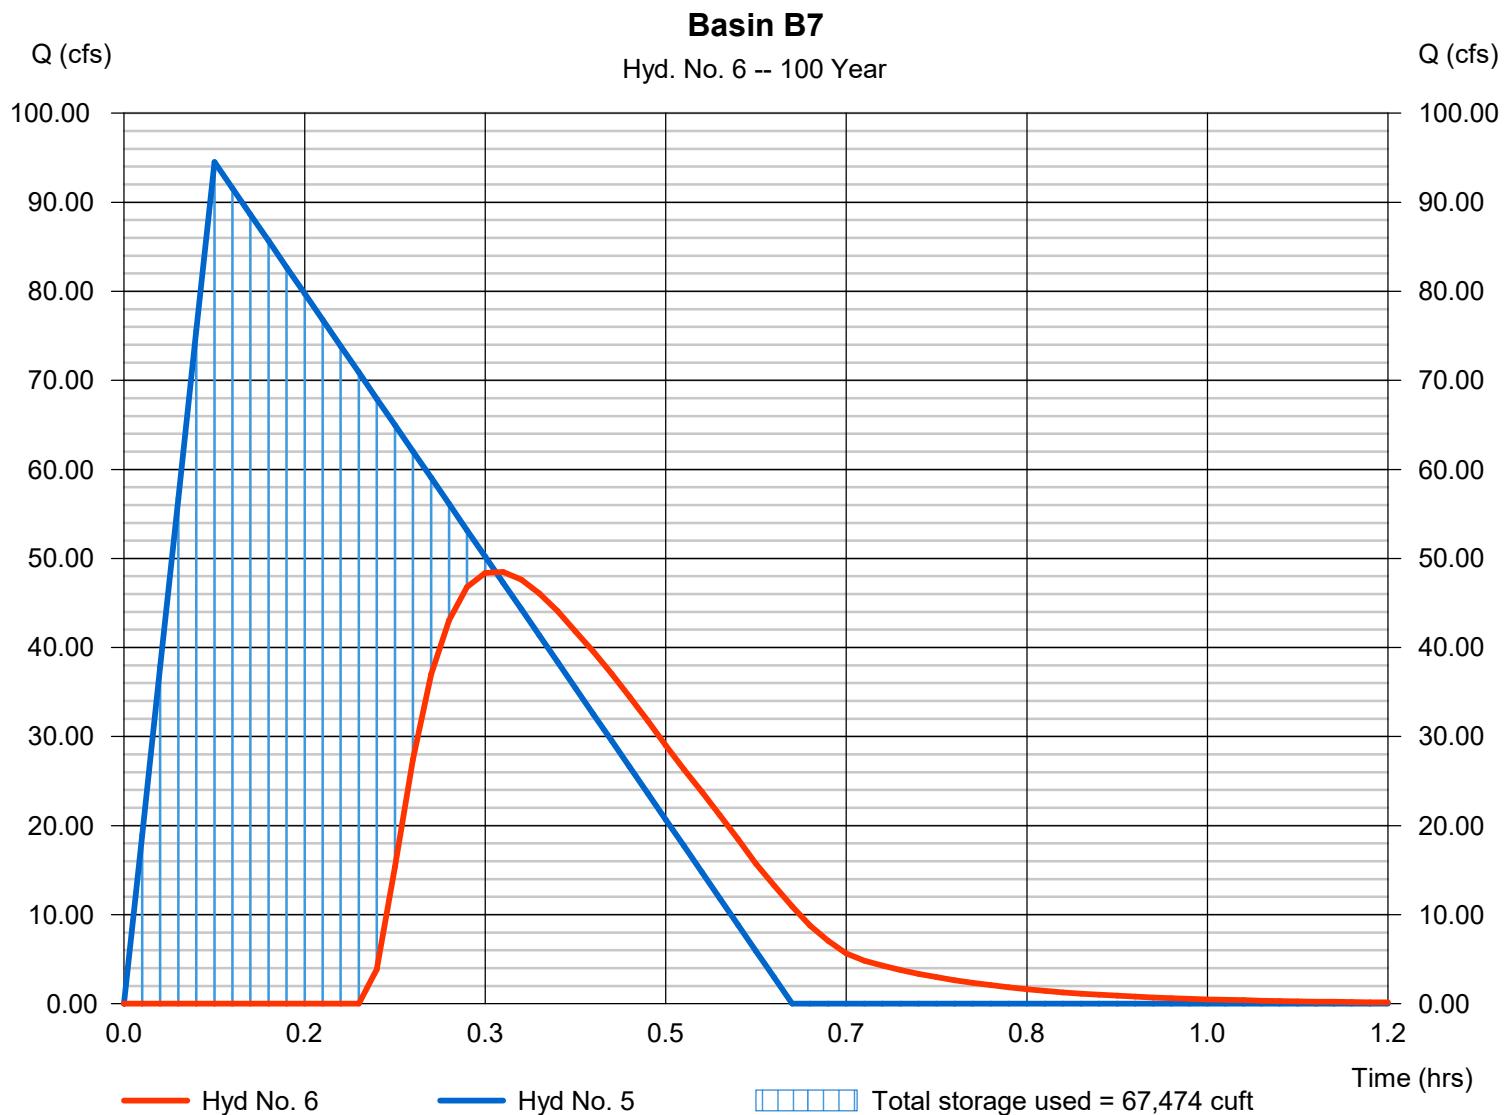


Hydrograph Report

Hyd. No. 7

ON-B8

Hydrograph type	= Rational	Peak discharge	= 13.85 cfs
Storm frequency	= 100 yrs	Time to peak	= 0.08 hrs
Time interval	= 1 min	Hyd. volume	= 15,579 cuft
Drainage area	= 1.950 ac	Runoff coeff.	= 0.9
Intensity	= 7.891 in/hr	Tc by User	= 5.00 min
IDF Curve	= IDF.IDF	Asc/Rec limb fact	= 1/6.5

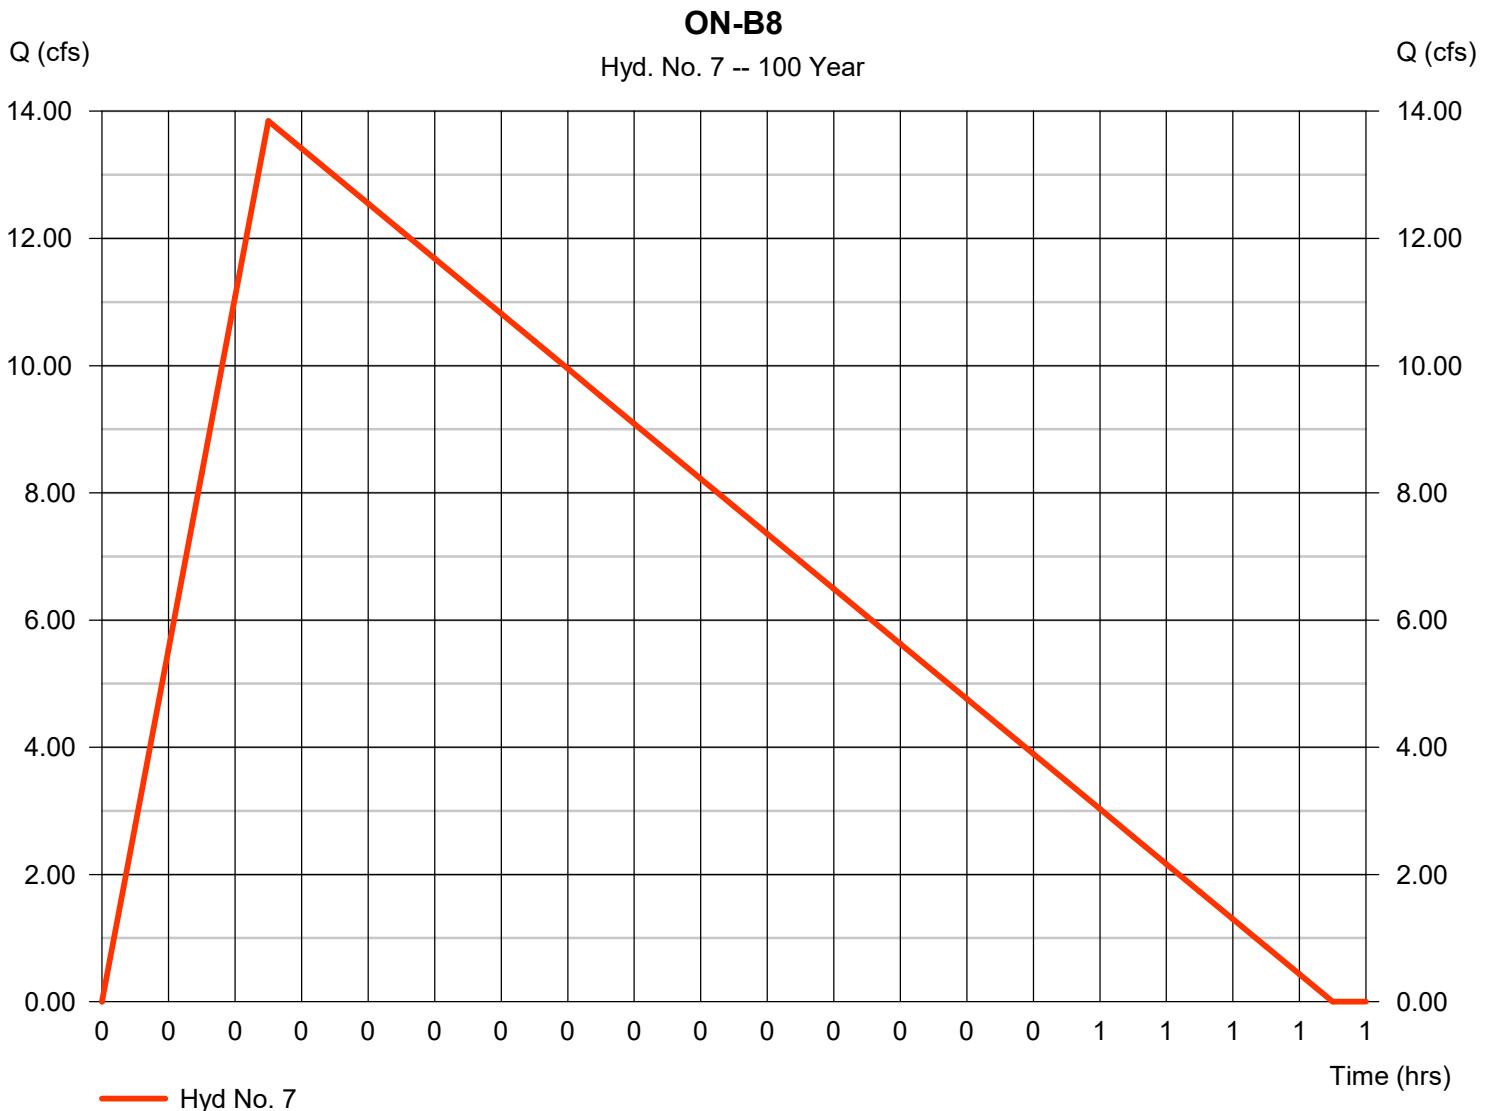


Hydrograph Report

Hyd. No. 8

COMBINE B8

Hydrograph type	= Combine	Peak discharge	= 55.72 cfs
Storm frequency	= 100 yrs	Time to peak	= 0.33 hrs
Time interval	= 1 min	Hyd. volume	= 64,291 cuft
Inflow hyds.	= 6, 7	Contrib. drain. area	= 1.950 ac

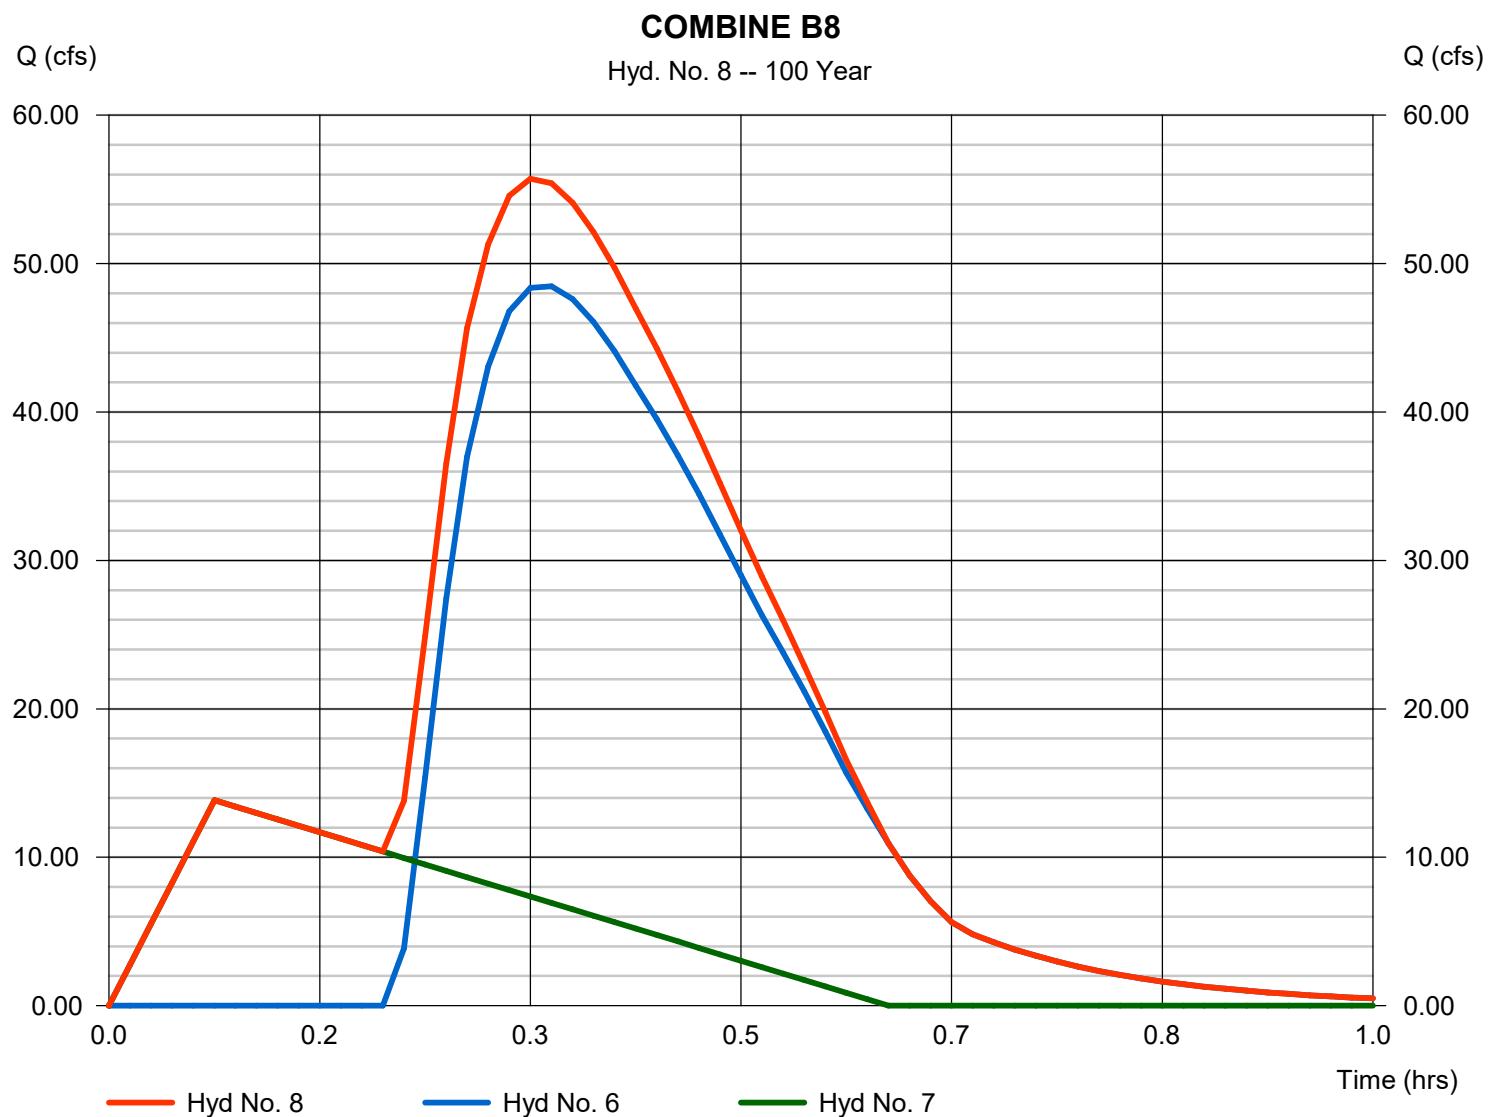

Hydrograph Report

Hydraflow Hydrographs Extension for AutoCAD® Civil 3D® 2018 by Autodesk, Inc. v2018.3


Thursday, 09 / 10 / 2020

Hyd. No. 9

BASIN B8

Hydrograph type	= Reservoir	Peak discharge	= 51.88 cfs
Storm frequency	= 100 yrs	Time to peak	= 0.38 hrs
Time interval	= 1 min	Hyd. volume	= 64,282 cuft
Inflow hyd. No.	= 8 - COMBINE B8	Max. Elevation	= 1594.58 ft
Reservoir name	= BASIN B8	Max. Storage	= 17,158 cuft

Storage Indication method used.

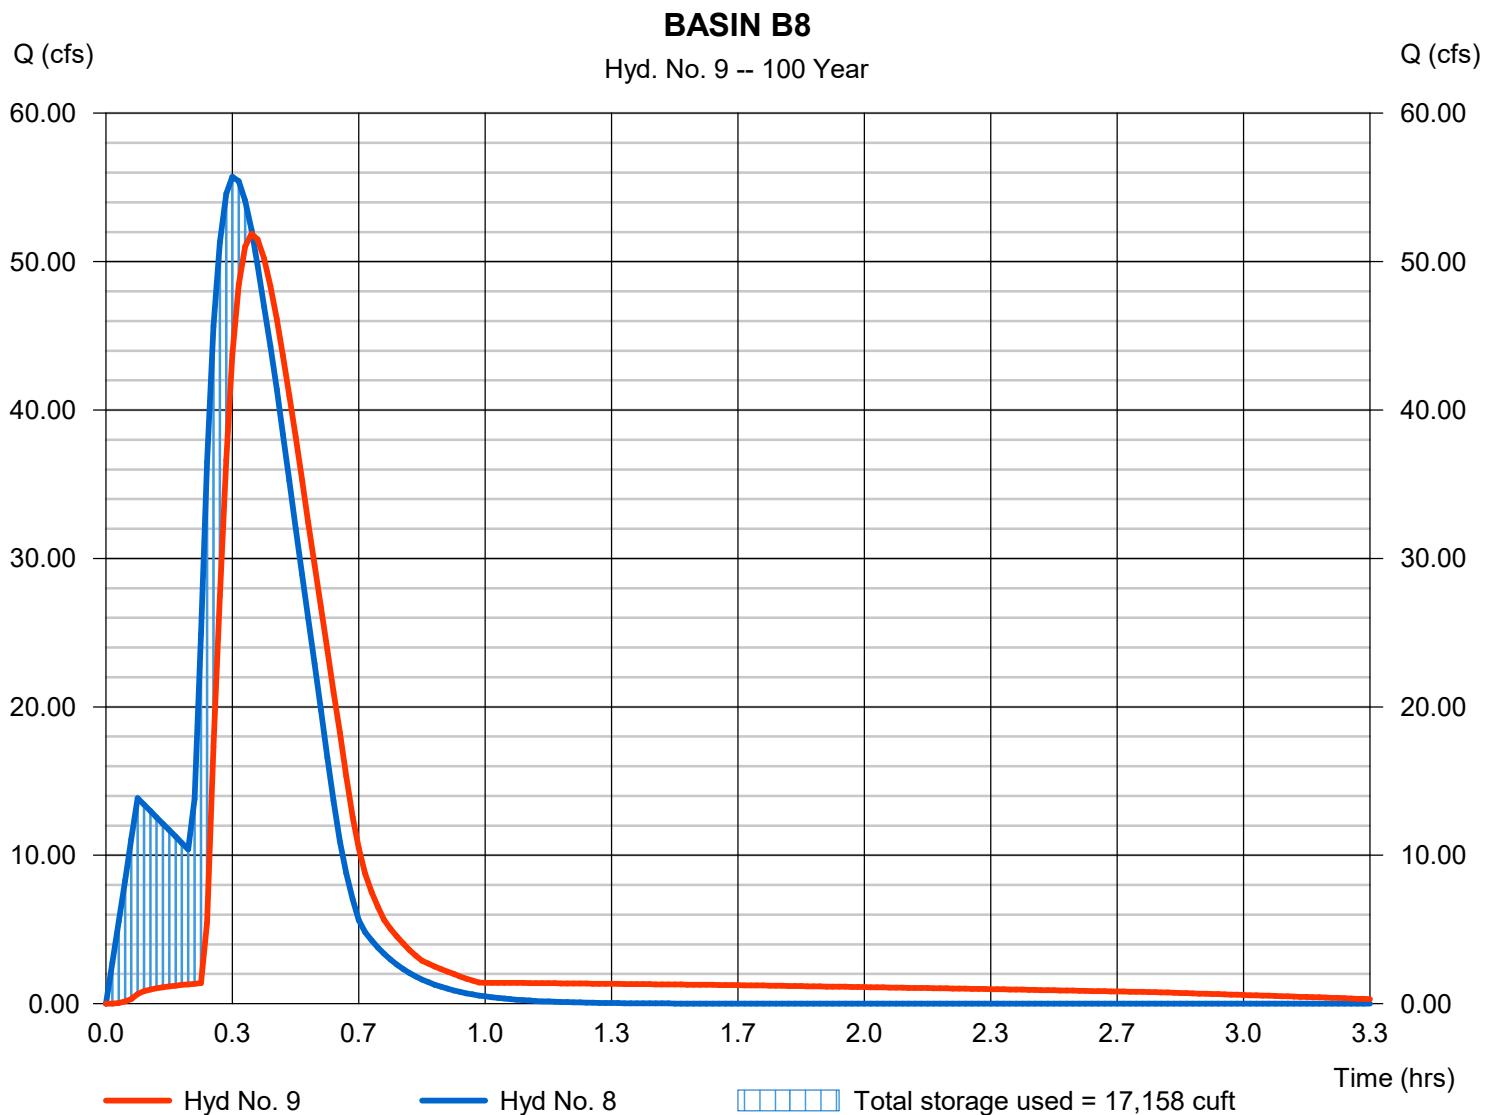

Hydrograph Report


Hydraflow Hydrographs Extension for AutoCAD® Civil 3D® 2018 by Autodesk, Inc. v2018.3

Thursday, 09 / 10 / 2020

Hyd. No. 10

CPF2

Hydrograph type	= Rational	Peak discharge	= 8.617 cfs
Storm frequency	= 100 yrs	Time to peak	= 0.08 hrs
Time interval	= 1 min	Hyd. volume	= 9,694 cuft
Drainage area	= 1.300 ac	Runoff coeff.	= 0.84
Intensity	= 7.891 in/hr	Tc by User	= 5.00 min
IDF Curve	= IDF.IDF	Asc/Rec limb fact	= 1/6.5

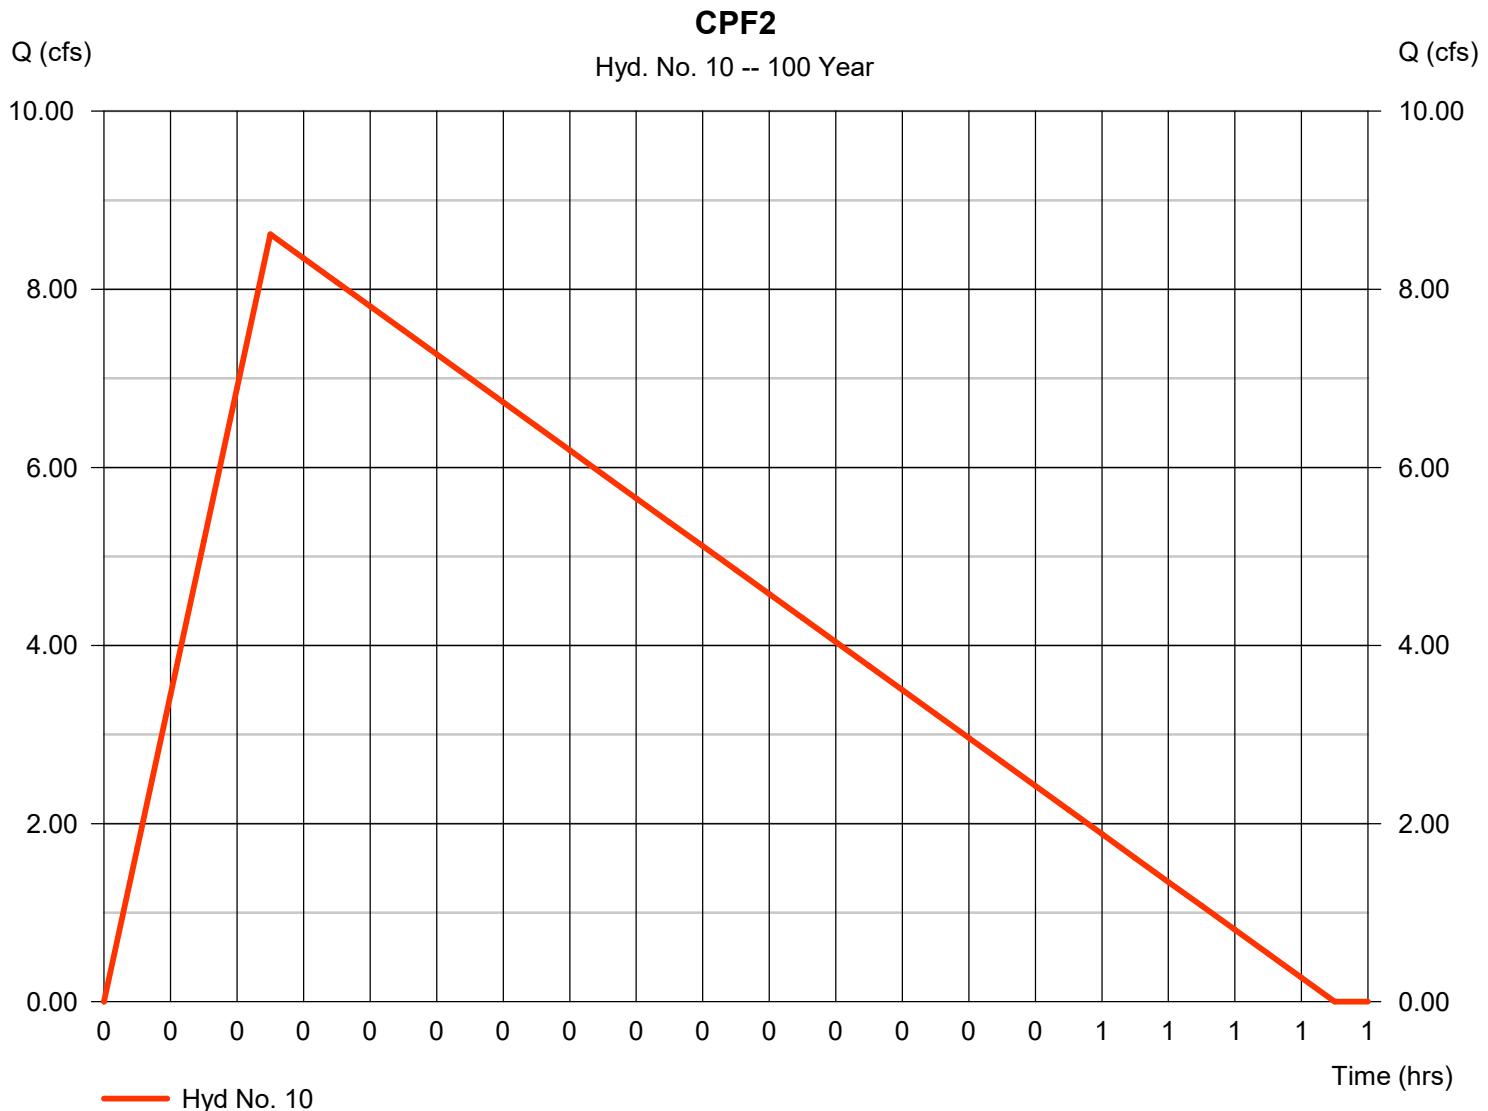


Hydrograph Report

Hyd. No. 11

CPE

Hydrograph type	= Rational	Peak discharge	= 21.23 cfs
Storm frequency	= 100 yrs	Time to peak	= 0.08 hrs
Time interval	= 1 min	Hyd. volume	= 23,888 cuft
Drainage area	= 3.790 ac	Runoff coeff.	= 0.71
Intensity	= 7.891 in/hr	Tc by User	= 5.00 min
IDF Curve	= IDF.IDF	Asc/Rec limb fact	= 1/6.5

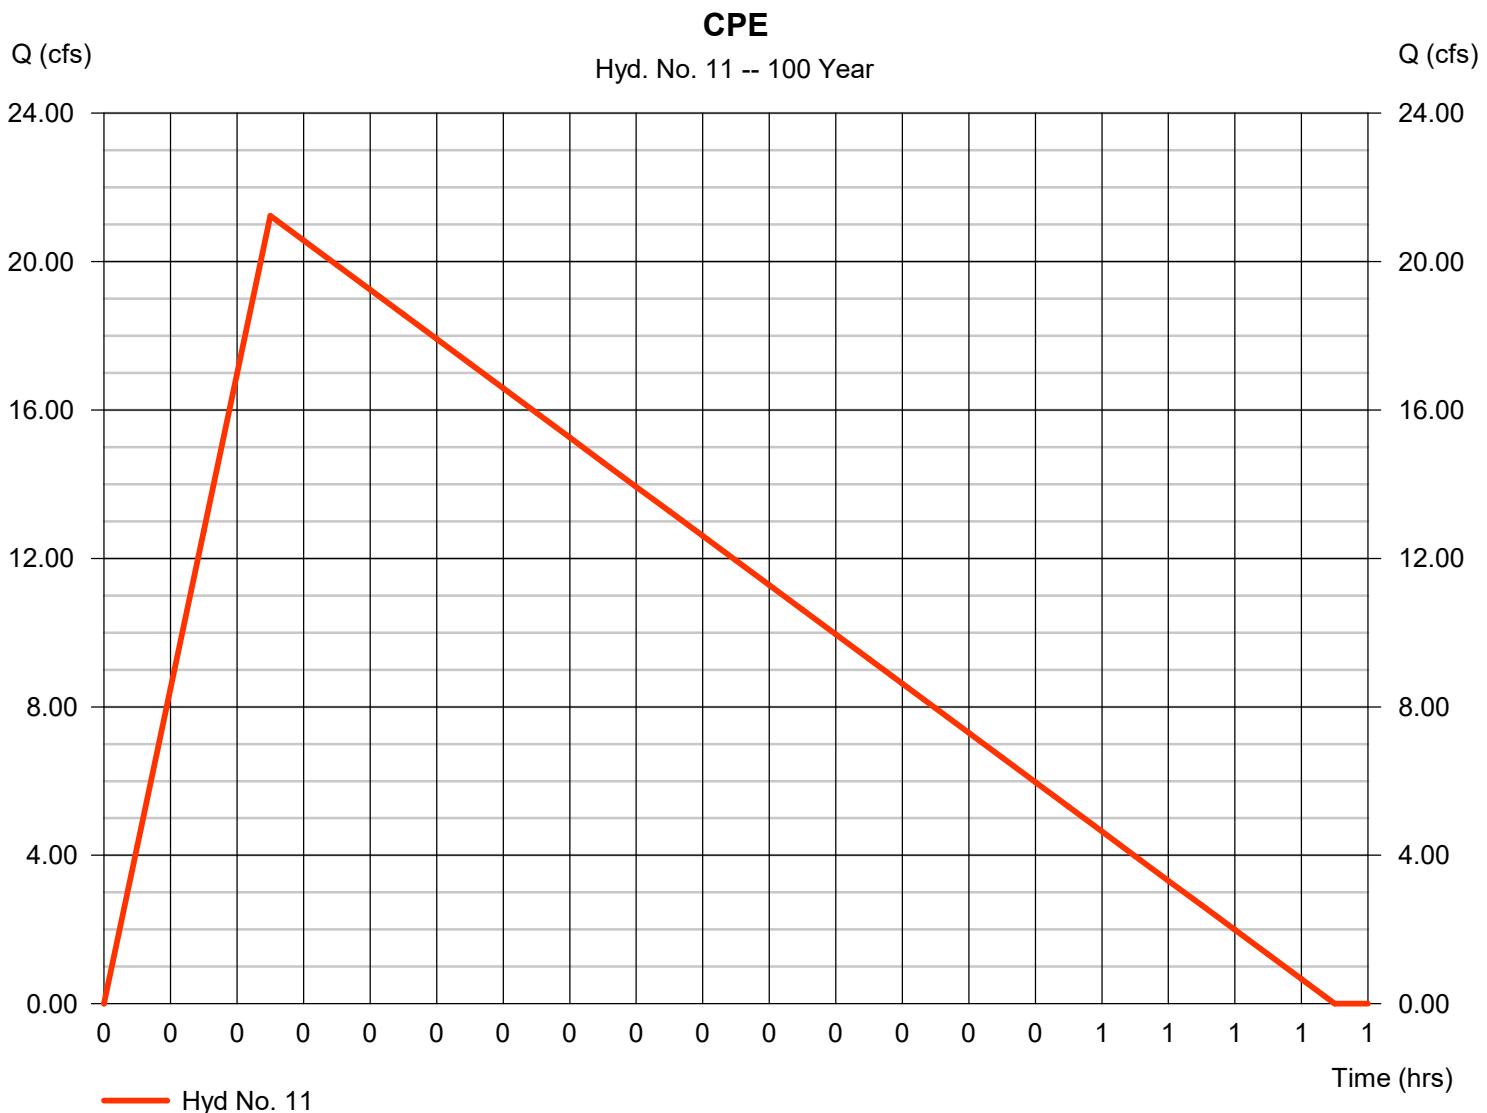


Hydrograph Report

Hyd. No. 12

ON-B3

Hydrograph type	= Rational	Peak discharge	= 4.829 cfs
Storm frequency	= 100 yrs	Time to peak	= 0.08 hrs
Time interval	= 1 min	Hyd. volume	= 5,433 cuft
Drainage area	= 0.680 ac	Runoff coeff.	= 0.9
Intensity	= 7.891 in/hr	Tc by User	= 5.00 min
IDF Curve	= IDF.IDF	Asc/Rec limb fact	= 1/6.5

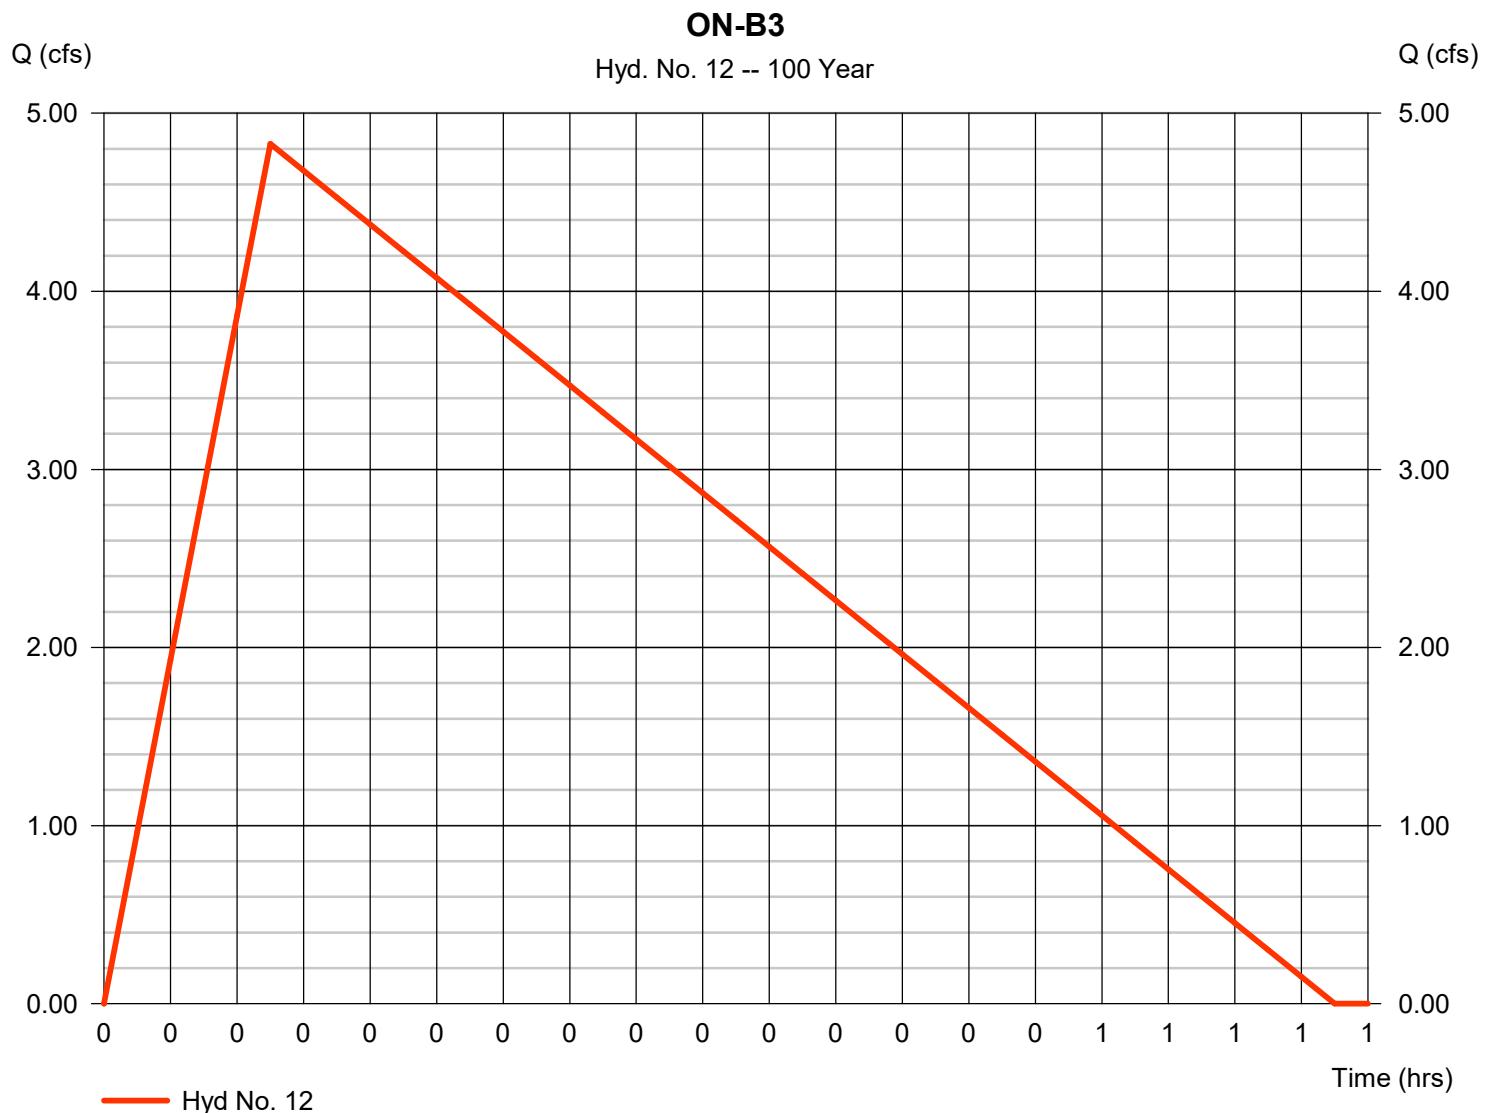


Hydrograph Report

Hyd. No. 13

ON-B4

Hydrograph type	= Rational	Peak discharge	= 20.31 cfs
Storm frequency	= 100 yrs	Time to peak	= 0.08 hrs
Time interval	= 1 min	Hyd. volume	= 22,850 cuft
Drainage area	= 2.860 ac	Runoff coeff.	= 0.9
Intensity	= 7.891 in/hr	Tc by User	= 5.00 min
IDF Curve	= IDF.IDF	Asc/Rec limb fact	= 1/6.5

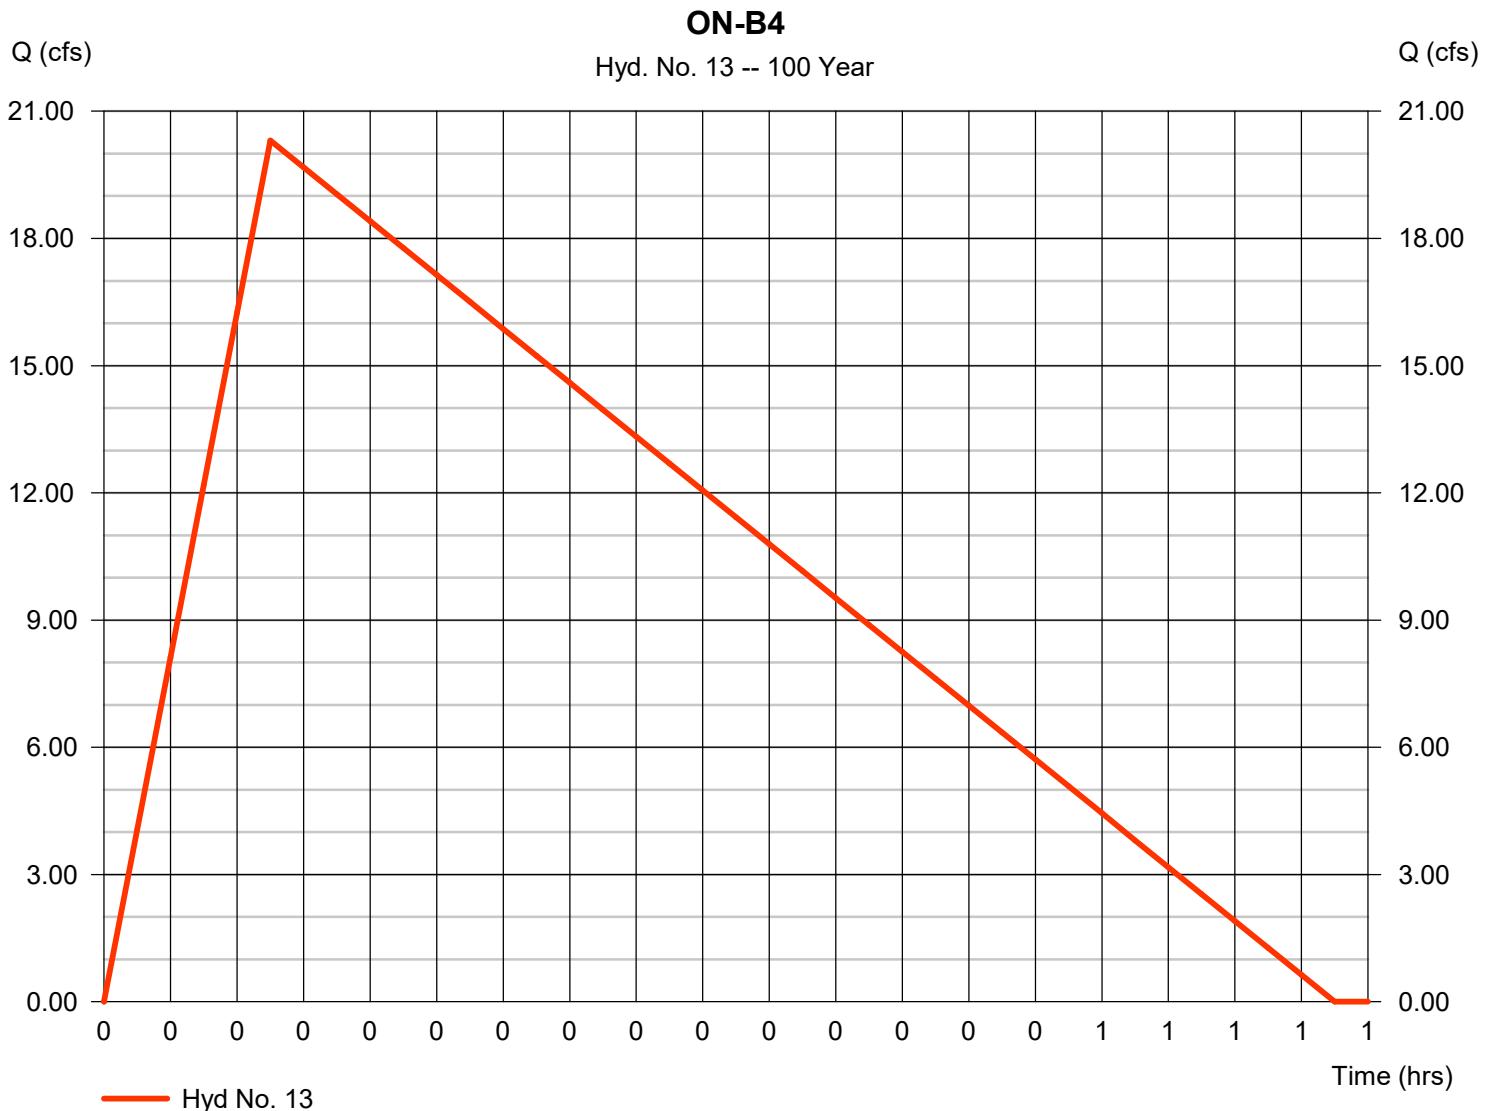

Hydrograph Report


Hydraflow Hydrographs Extension for AutoCAD® Civil 3D® 2018 by Autodesk, Inc. v2018.3

Thursday, 09 / 10 / 2020

Hyd. No. 14

CPB3

Hydrograph type	= Combine	Peak discharge	= 54.99 cfs
Storm frequency	= 100 yrs	Time to peak	= 0.08 hrs
Time interval	= 1 min	Hyd. volume	= 61,039 cuft
Inflow hyds.	= 10, 11, 12, 13	Contrib. drain. area	= 8.630 ac

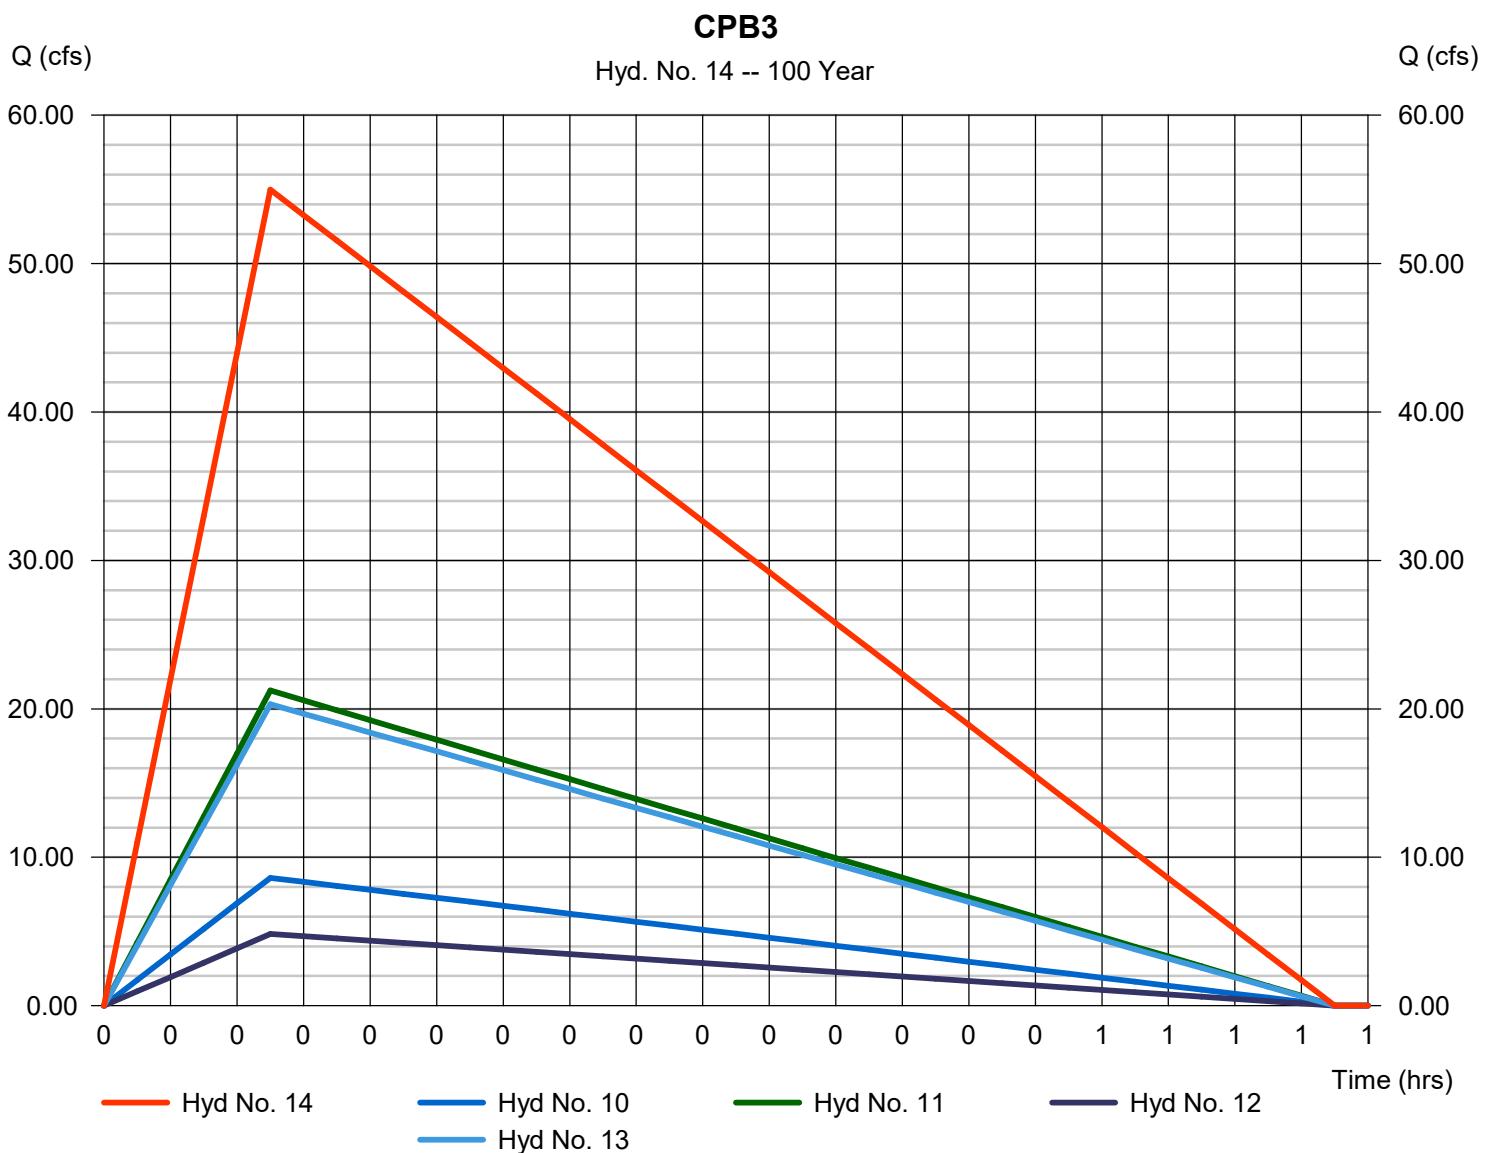

Hydrograph Report

Hydraflow Hydrographs Extension for AutoCAD® Civil 3D® 2018 by Autodesk, Inc. v2018.3


Thursday, 09 / 10 / 2020

Hyd. No. 15

BASIN B3

Hydrograph type	= Reservoir	Peak discharge	= 39.61 cfs
Storm frequency	= 100 yrs	Time to peak	= 0.23 hrs
Time interval	= 1 min	Hyd. volume	= 61,030 cuft
Inflow hyd. No.	= 14 - CPB3	Max. Elevation	= 1602.35 ft
Reservoir name	= BASIN B3	Max. Storage	= 19,315 cuft

Storage Indication method used.

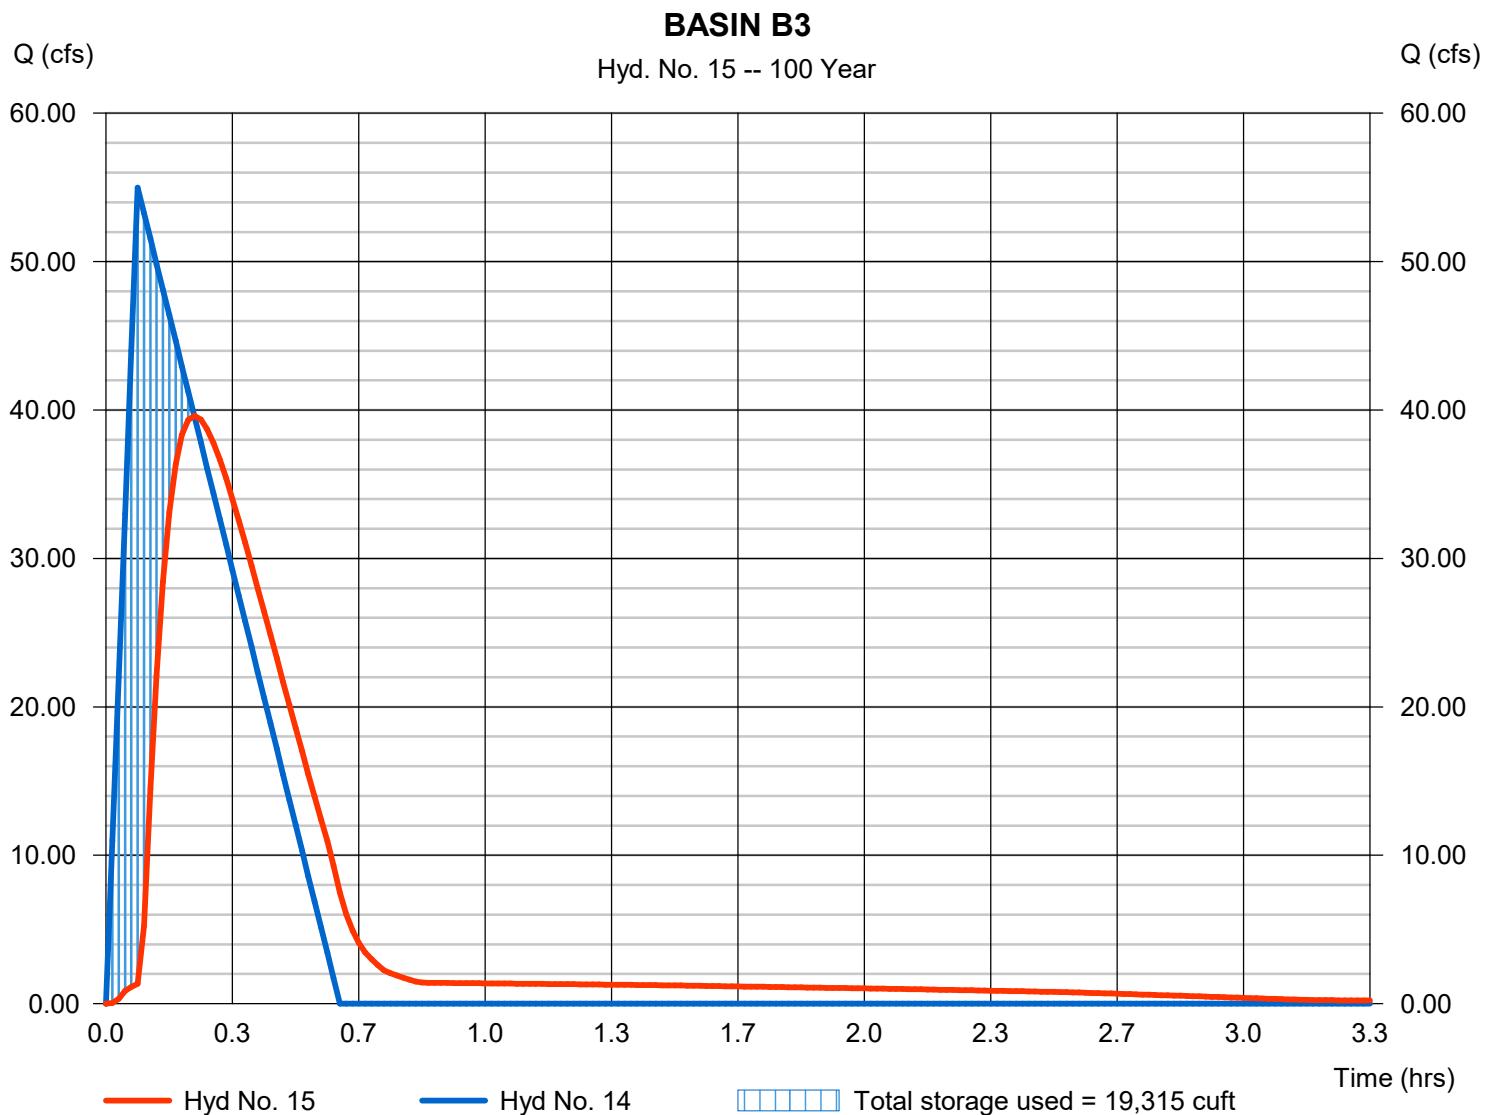

Hydrograph Report


Hydraflow Hydrographs Extension for AutoCAD® Civil 3D® 2018 by Autodesk, Inc. v2018.3

Thursday, 09 / 10 / 2020

Hyd. No. 16

ON-B2

Hydrograph type	= Rational	Peak discharge	= 8.025 cfs
Storm frequency	= 100 yrs	Time to peak	= 0.08 hrs
Time interval	= 1 min	Hyd. volume	= 9,028 cuft
Drainage area	= 1.130 ac	Runoff coeff.	= 0.9
Intensity	= 7.891 in/hr	Tc by User	= 5.00 min
IDF Curve	= IDF.IDF	Asc/Rec limb fact	= 1/6.5

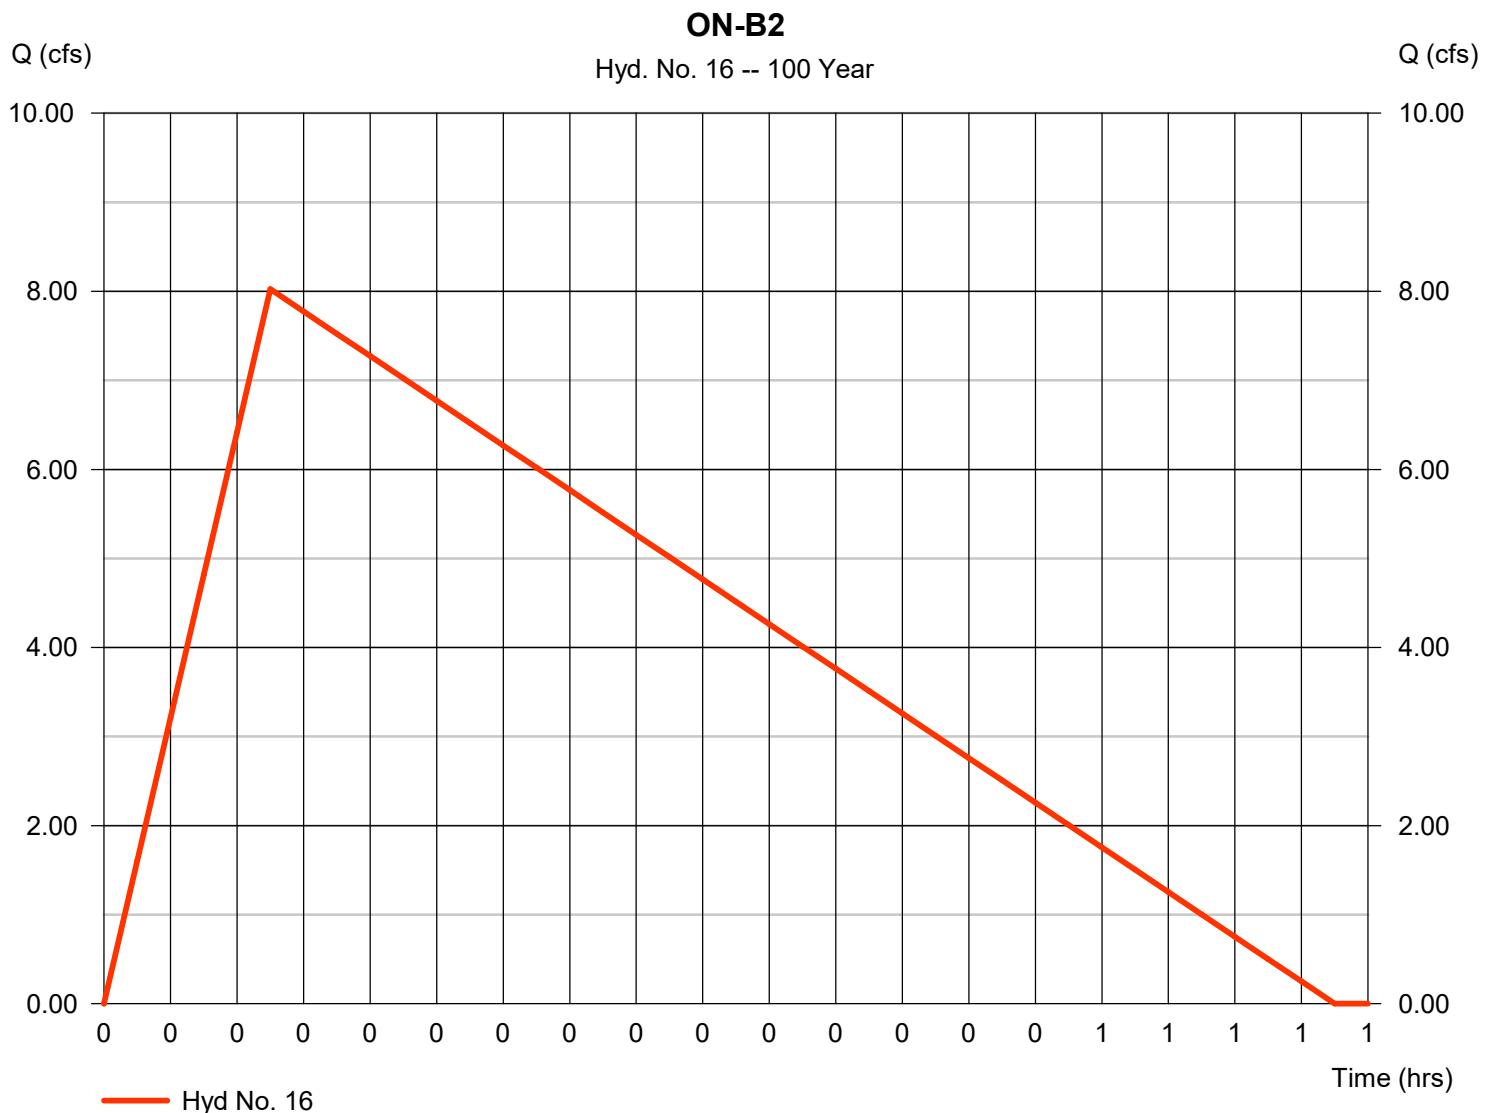

Hydrograph Report


Hydraflow Hydrographs Extension for AutoCAD® Civil 3D® 2018 by Autodesk, Inc. v2018.3

Thursday, 09 / 10 / 2020

Hyd. No. 17

ON-B5

Hydrograph type	= Rational	Peak discharge	= 3.764 cfs
Storm frequency	= 100 yrs	Time to peak	= 0.08 hrs
Time interval	= 1 min	Hyd. volume	= 4,234 cuft
Drainage area	= 0.530 ac	Runoff coeff.	= 0.9
Intensity	= 7.891 in/hr	Tc by User	= 5.00 min
IDF Curve	= IDF.IDF	Asc/Rec limb fact	= 1/6.5

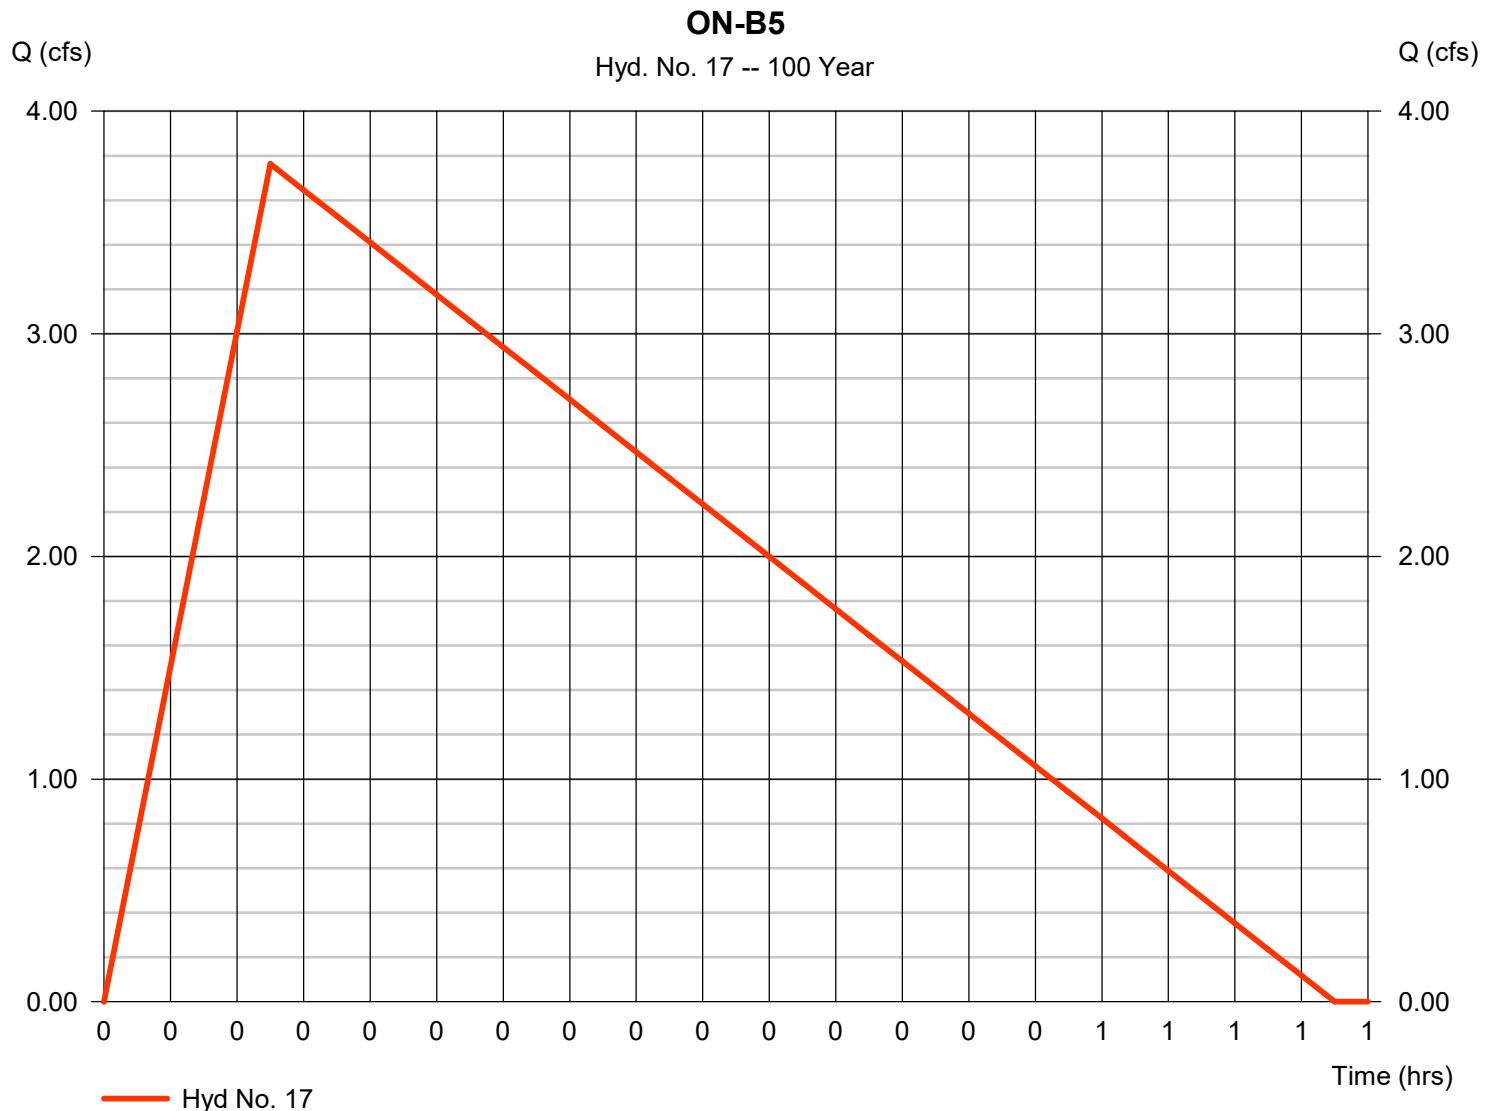


Hydrograph Report

Hyd. No. 18

ON-B1

Hydrograph type	= Rational	Peak discharge	= 36.86 cfs
Storm frequency	= 100 yrs	Time to peak	= 0.08 hrs
Time interval	= 1 min	Hyd. volume	= 41,465 cuft
Drainage area	= 5.190 ac	Runoff coeff.	= 0.9
Intensity	= 7.891 in/hr	Tc by User	= 5.00 min
IDF Curve	= IDF.IDF	Asc/Rec limb fact	= 1/6.5

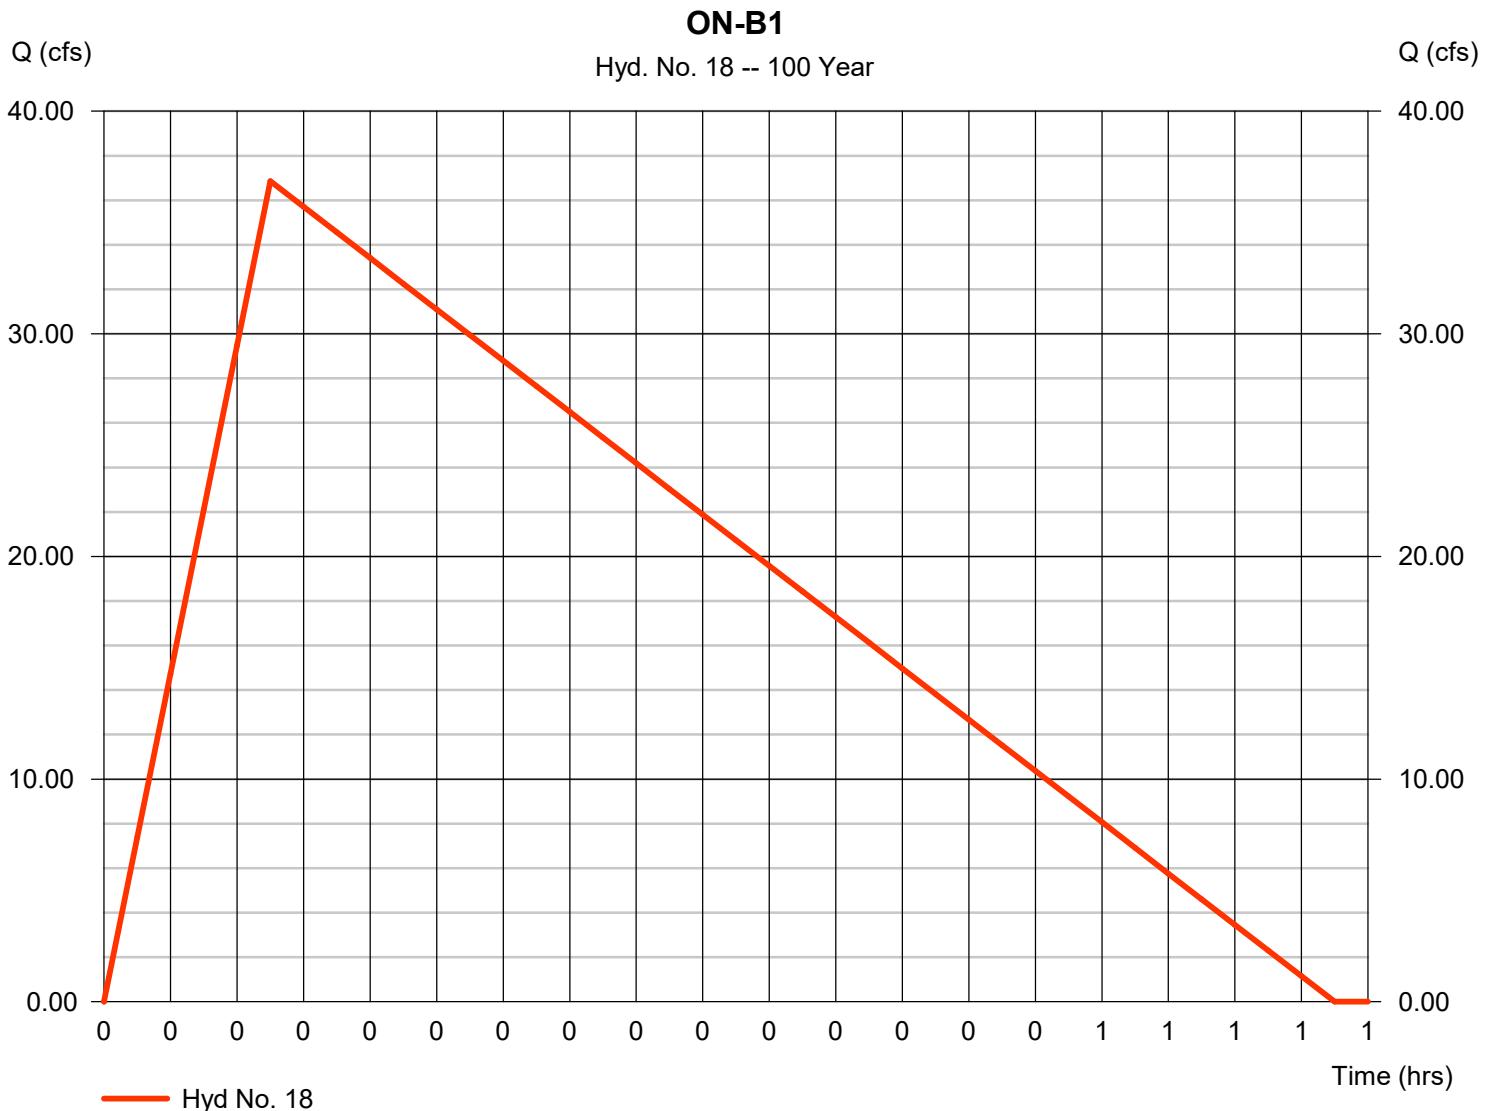

Hydrograph Report

Hydraflow Hydrographs Extension for AutoCAD® Civil 3D® 2018 by Autodesk, Inc. v2018.3

Thursday, 09 / 10 / 2020

Hyd. No. 19

CPB1

Hydrograph type

= Combine

Peak discharge

= 76.32 cfs

Storm frequency

= 100 yrs

Time to peak

= 0.20 hrs

Time interval

= 1 min

Hyd. volume


= 115,028 cuft

Inflow hyds.

= 15, 16, 17, 18

Contrib. drain. area

= 6.850 ac

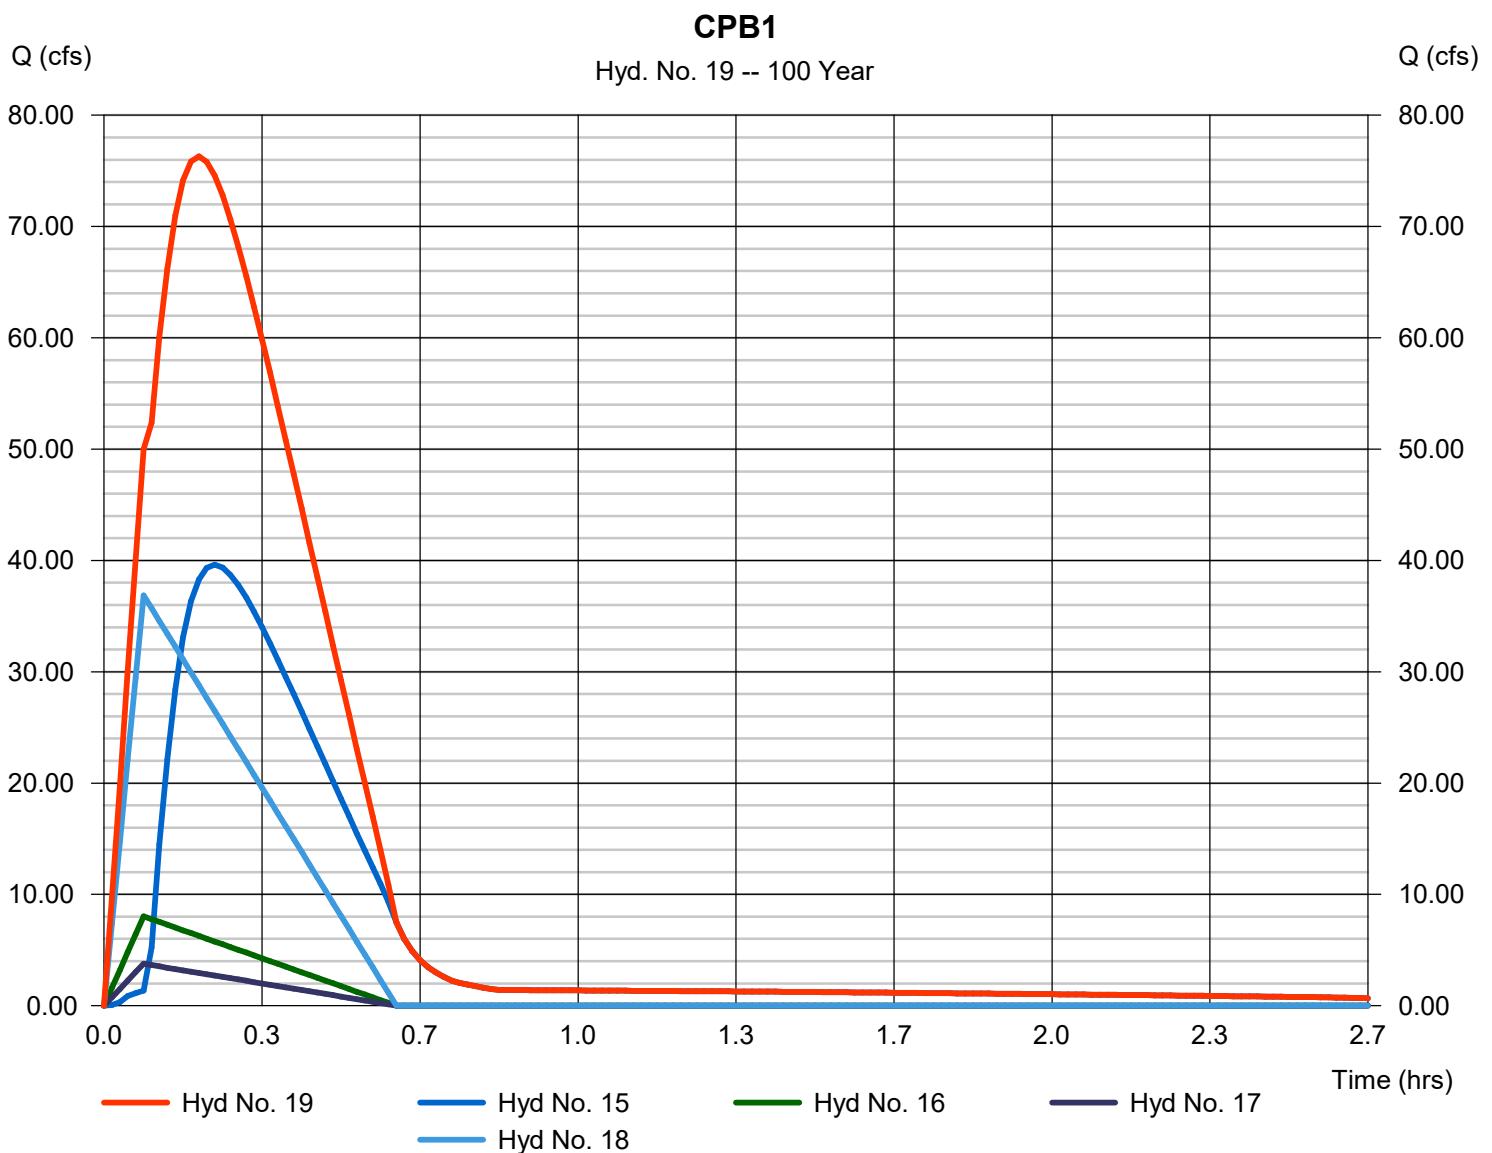

Hydrograph Report

Hydraflow Hydrographs Extension for AutoCAD® Civil 3D® 2018 by Autodesk, Inc. v2018.3


Thursday, 09 / 10 / 2020

Hyd. No. 20

BASIN B1

Hydrograph type	= Reservoir	Peak discharge	= 75.11 cfs
Storm frequency	= 100 yrs	Time to peak	= 0.23 hrs
Time interval	= 1 min	Hyd. volume	= 115,022 cuft
Inflow hyd. No.	= 19 - CPB1	Max. Elevation	= 1592.99 ft
Reservoir name	= BASIN B1	Max. Storage	= 18,663 cuft

Storage Indication method used.

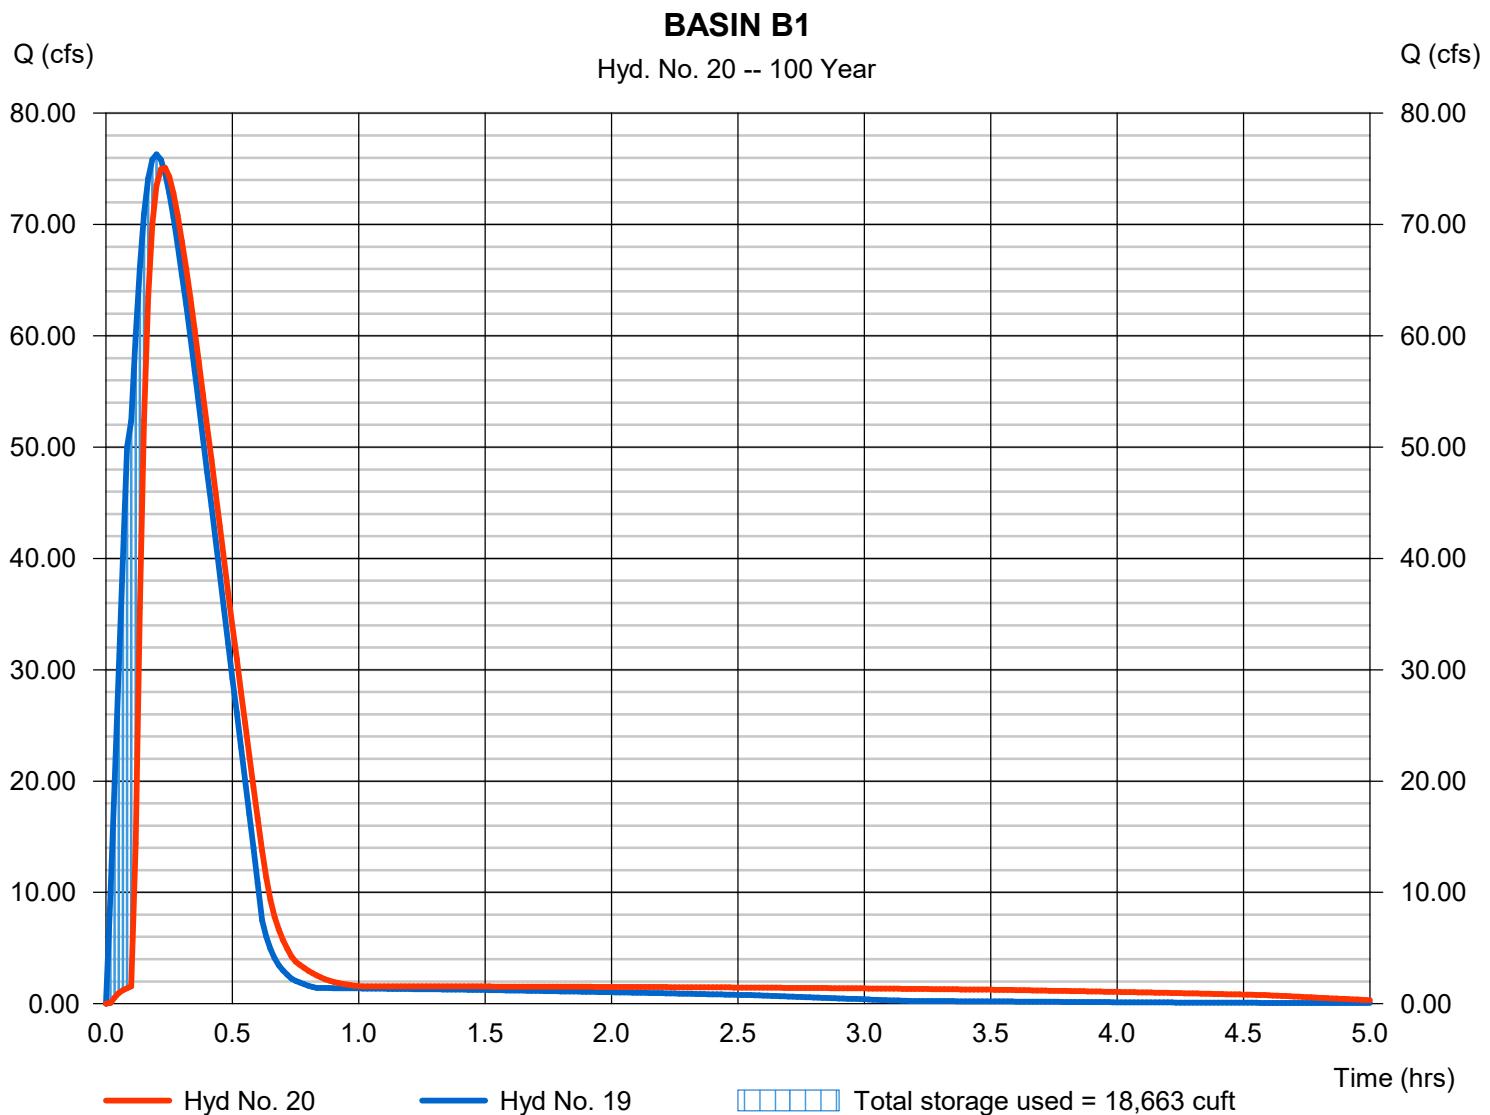

Hydrograph Report


Hydraflow Hydrographs Extension for AutoCAD® Civil 3D® 2018 by Autodesk, Inc. v2018.3

Thursday, 09 / 10 / 2020

Hyd. No. 21

ON-B9

Hydrograph type	= Rational	Peak discharge	= 2.699 cfs
Storm frequency	= 100 yrs	Time to peak	= 0.08 hrs
Time interval	= 1 min	Hyd. volume	= 3,036 cuft
Drainage area	= 0.380 ac	Runoff coeff.	= 0.9
Intensity	= 7.891 in/hr	Tc by User	= 5.00 min
IDF Curve	= IDF.IDF	Asc/Rec limb fact	= 1/6.5

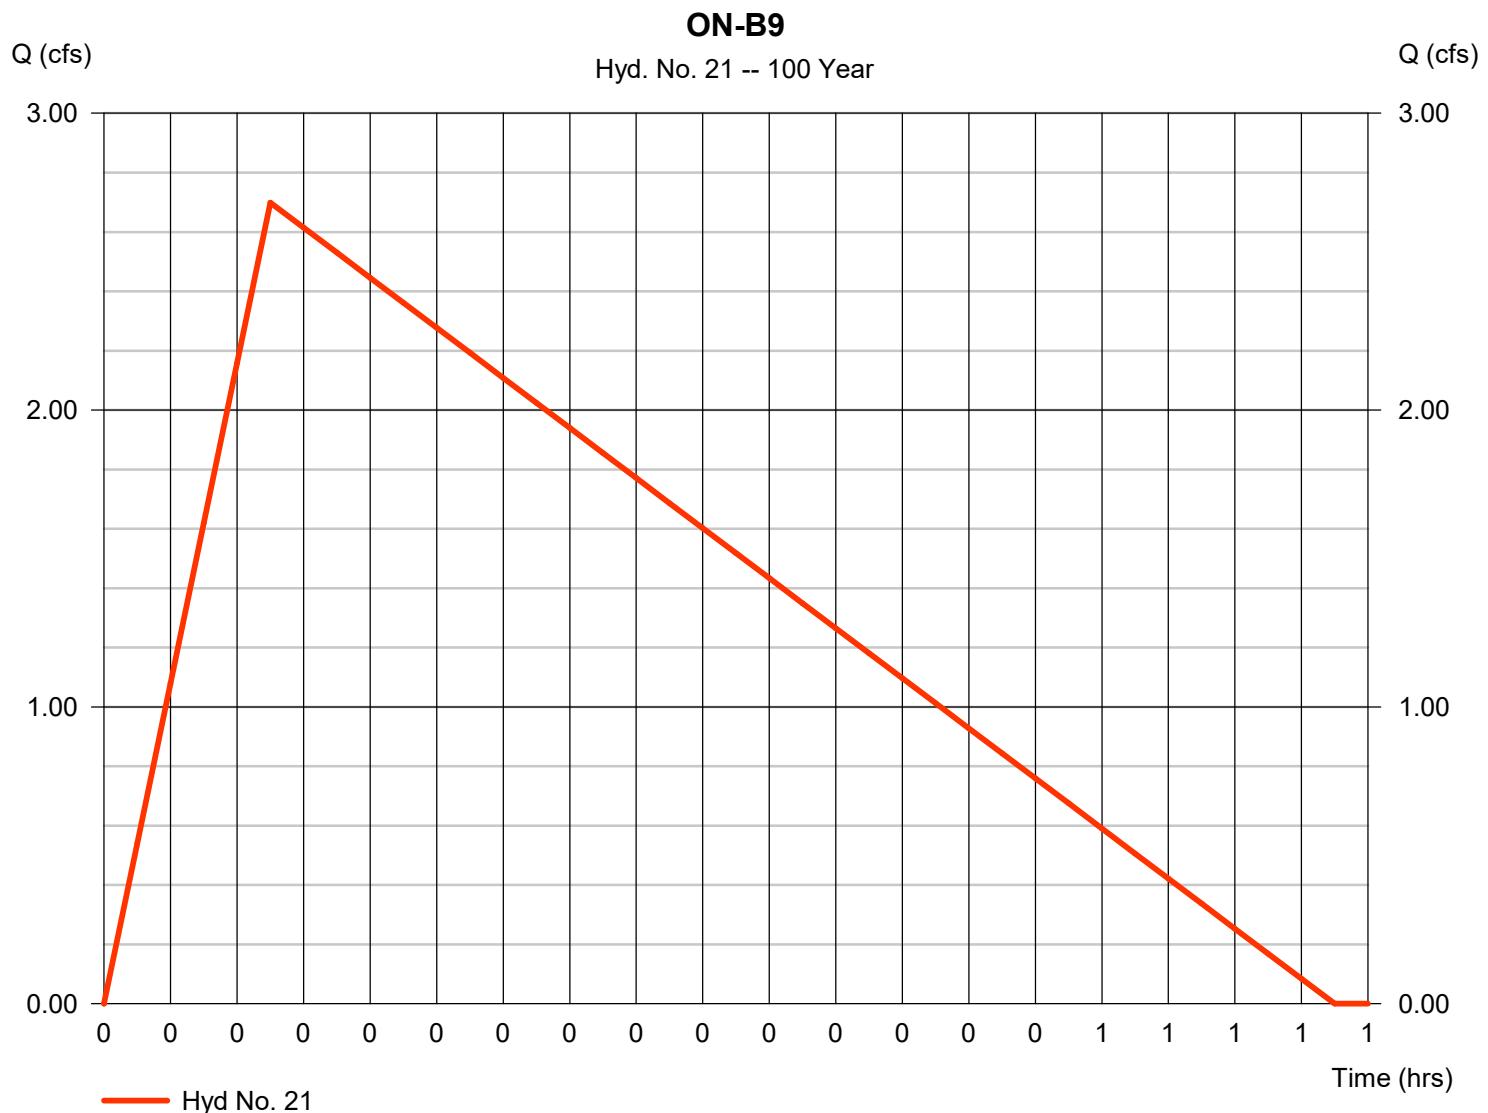


Hydrograph Report

Hyd. No. 22

ON-B10

Hydrograph type	= Rational	Peak discharge	= 43.60 cfs
Storm frequency	= 100 yrs	Time to peak	= 0.08 hrs
Time interval	= 1 min	Hyd. volume	= 49,055 cuft
Drainage area	= 6.140 ac	Runoff coeff.	= 0.9
Intensity	= 7.891 in/hr	Tc by User	= 5.00 min
IDF Curve	= IDF.IDF	Asc/Rec limb fact	= 1/6.5

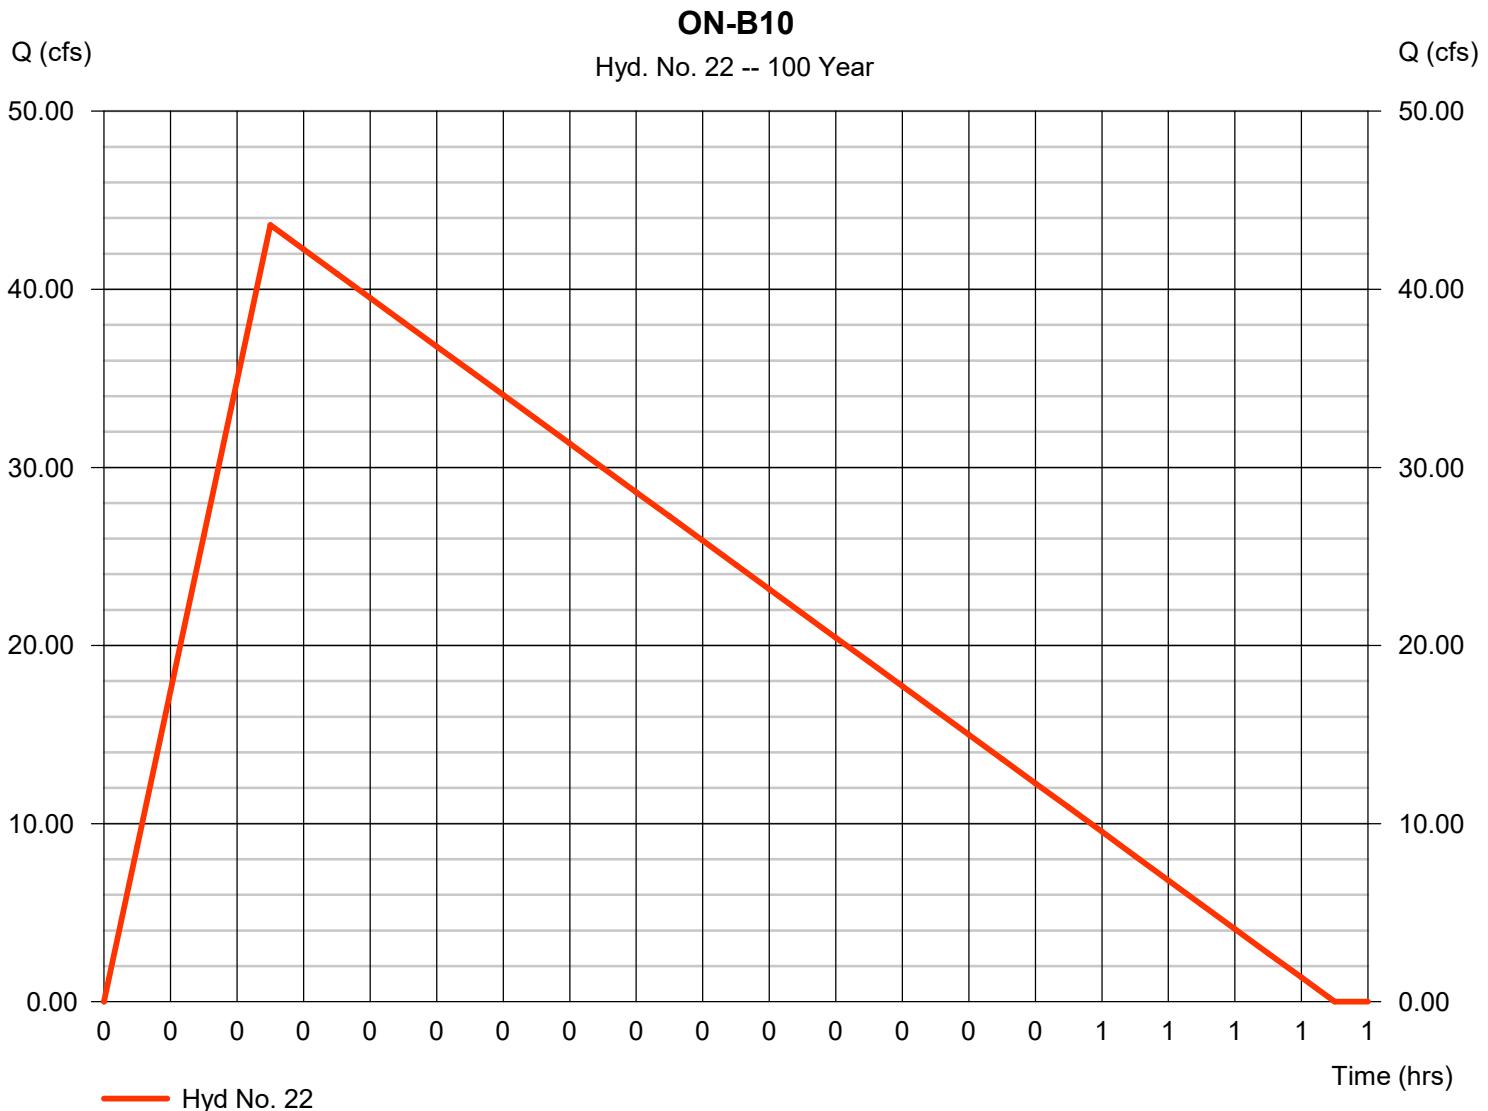


Hydrograph Report

Hyd. No. 23

ON-B6

Hydrograph type	= Rational	Peak discharge	= 14.13 cfs
Storm frequency	= 100 yrs	Time to peak	= 0.08 hrs
Time interval	= 1 min	Hyd. volume	= 15,899 cuft
Drainage area	= 1.990 ac	Runoff coeff.	= 0.9
Intensity	= 7.891 in/hr	Tc by User	= 5.00 min
IDF Curve	= IDF.IDF	Asc/Rec limb fact	= 1/6.5

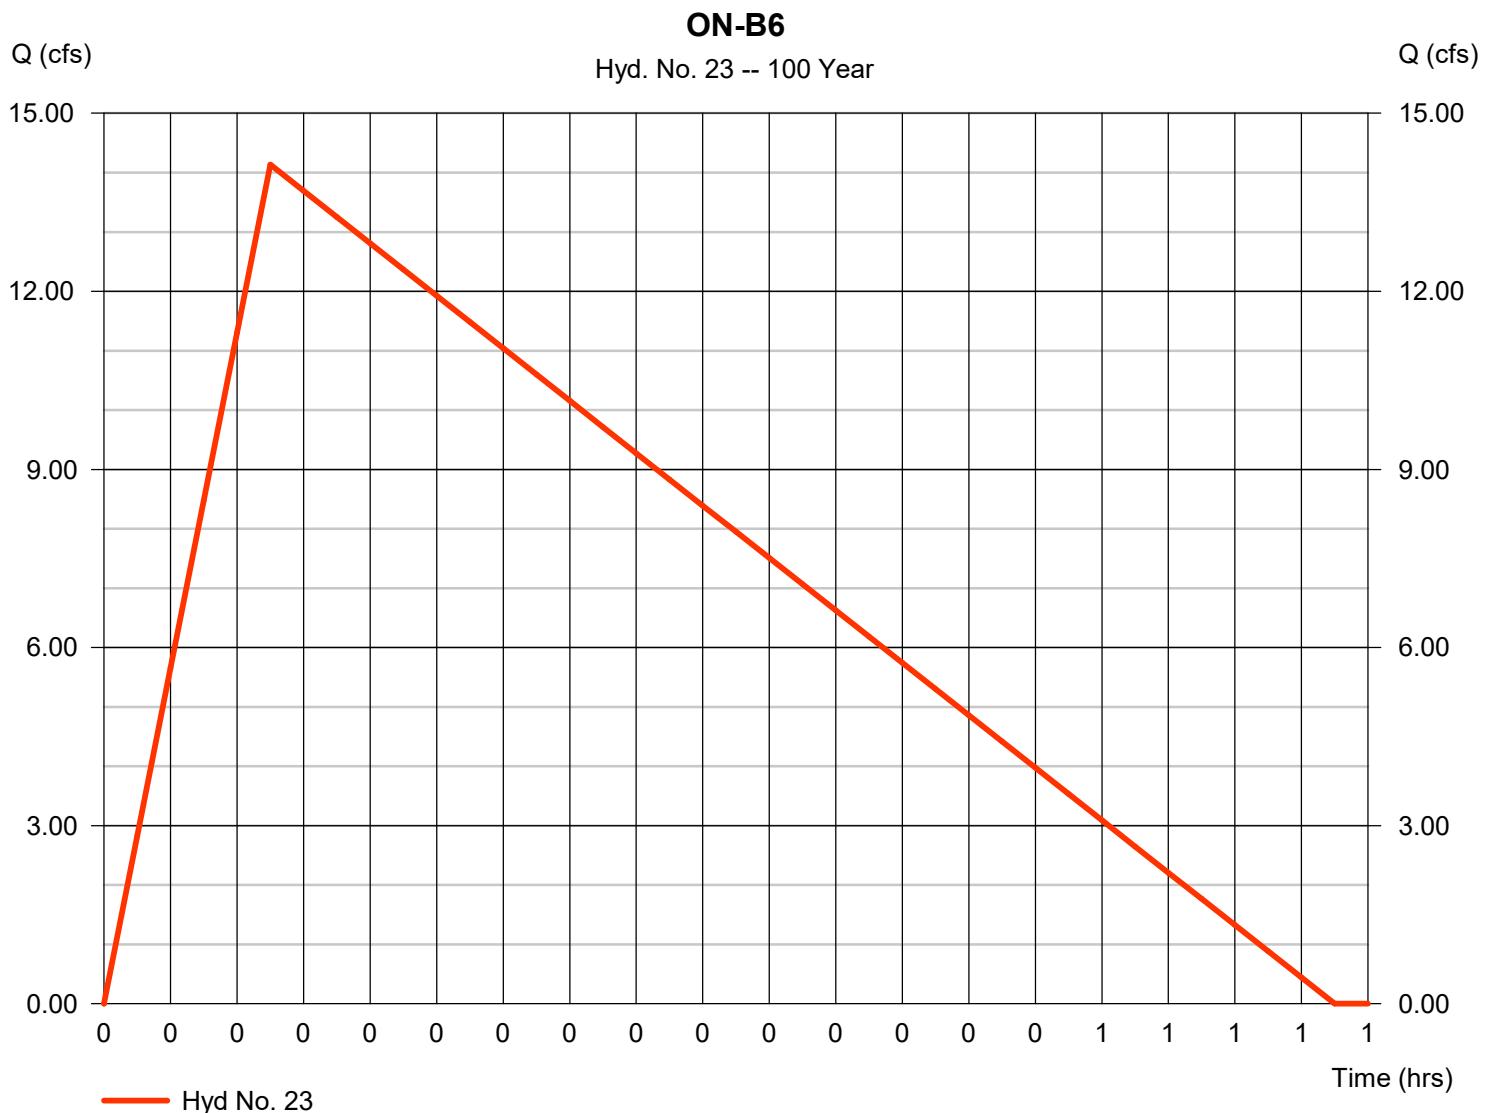

Hydrograph Report

Hyd. No. 24

ON-B11

Hydrograph type	= Rational	Peak discharge	= 22.65 cfs
Storm frequency	= 100 yrs	Time to peak	= 0.08 hrs
Time interval	= 1 min	Hyd. volume	= 25,486 cuft
Drainage area	= 3.190 ac	Runoff coeff.	= 0.9
Intensity	= 7.891 in/hr	Tc by User	= 5.00 min
IDF Curve	= IDF.IDF	Asc/Rec limb fact	= 1/6.5



Hydrograph Report

Hydraflow Hydrographs Extension for AutoCAD® Civil 3D® 2018 by Autodesk, Inc. v2018.3


Thursday, 09 / 10 / 2020

Hyd. No. 25

CP-B11

Hydrograph type = Combine
 Storm frequency = 100 yrs
 Time interval = 1 min
 Inflow hyds. = 21, 22, 23, 24

Peak discharge = 83.09 cfs
 Time to peak = 0.08 hrs
 Hyd. volume = 92,230 cuft
 Contrib. drain. area = 11.700 ac

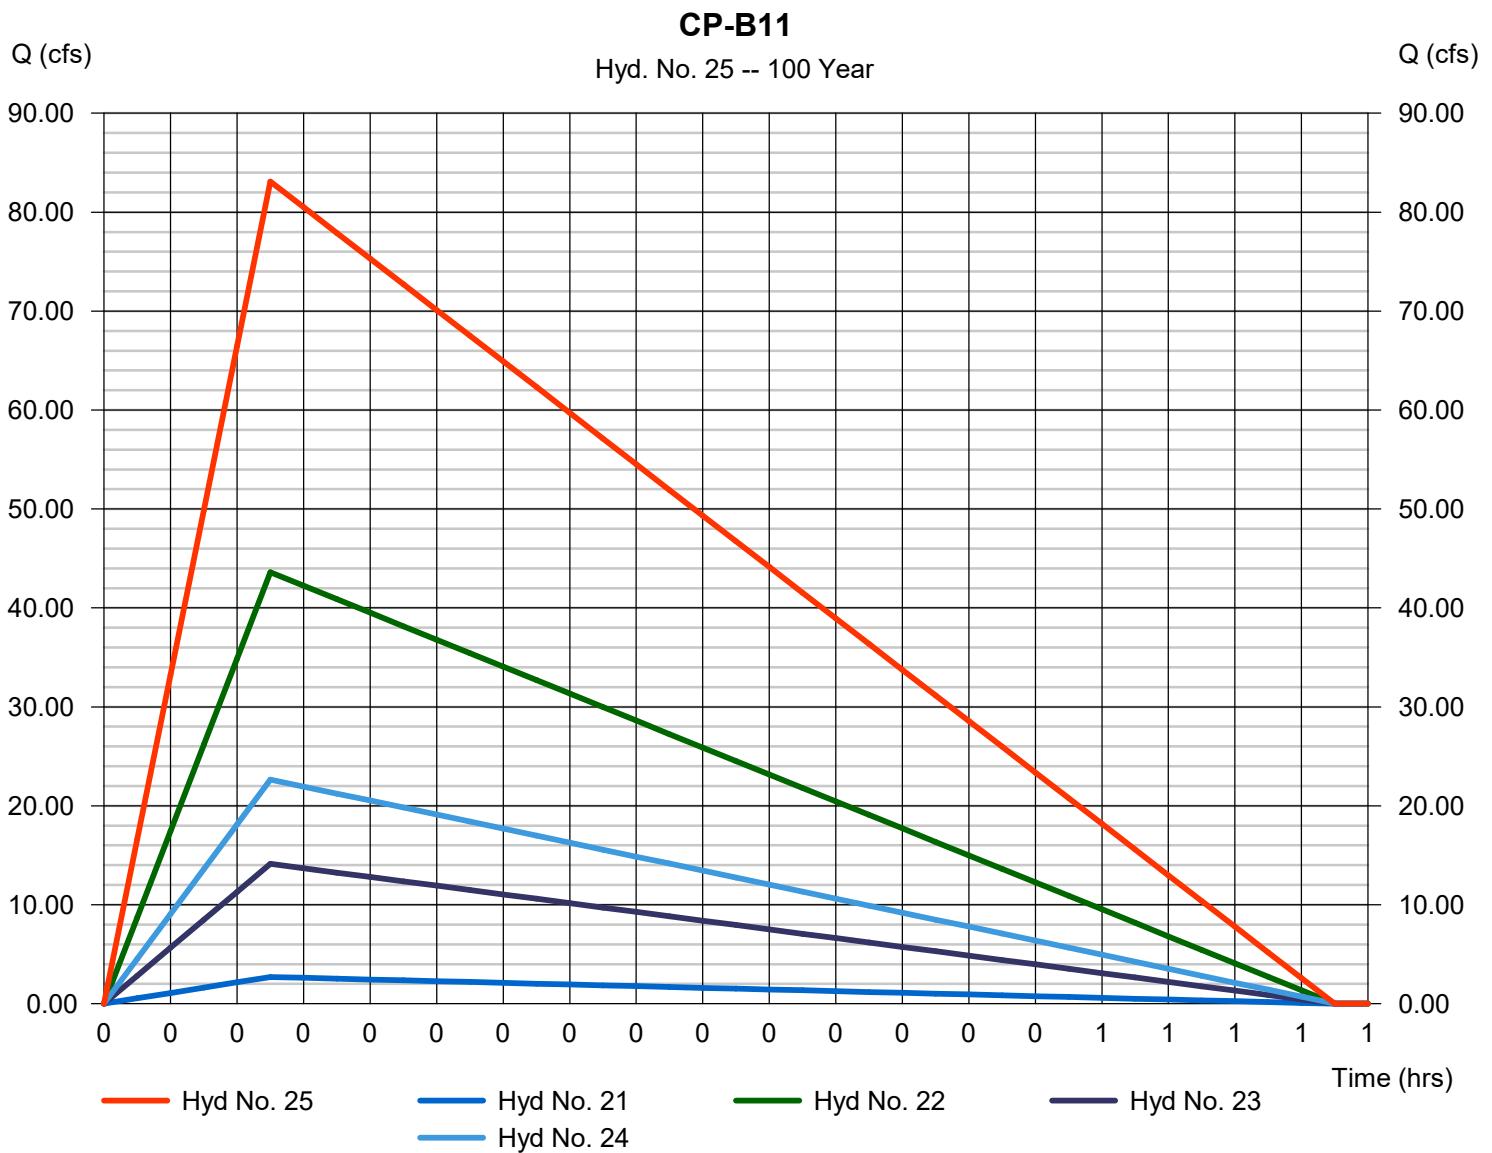

Hydrograph Report

Hydraflow Hydrographs Extension for AutoCAD® Civil 3D® 2018 by Autodesk, Inc. v2018.3

Thursday, 09 / 10 / 2020

Hyd. No. 26

CP-SITE

Hydrograph type

= Combine

Peak discharge

= 151.28 cfs

Storm frequency

= 100 yrs

Time to peak

= 0.33 hrs

Time interval

= 1 min

Hyd. volume


= 271,534 cuft

Inflow hyds.

= 9, 20, 25

Contrib. drain. area

= 0.000 ac

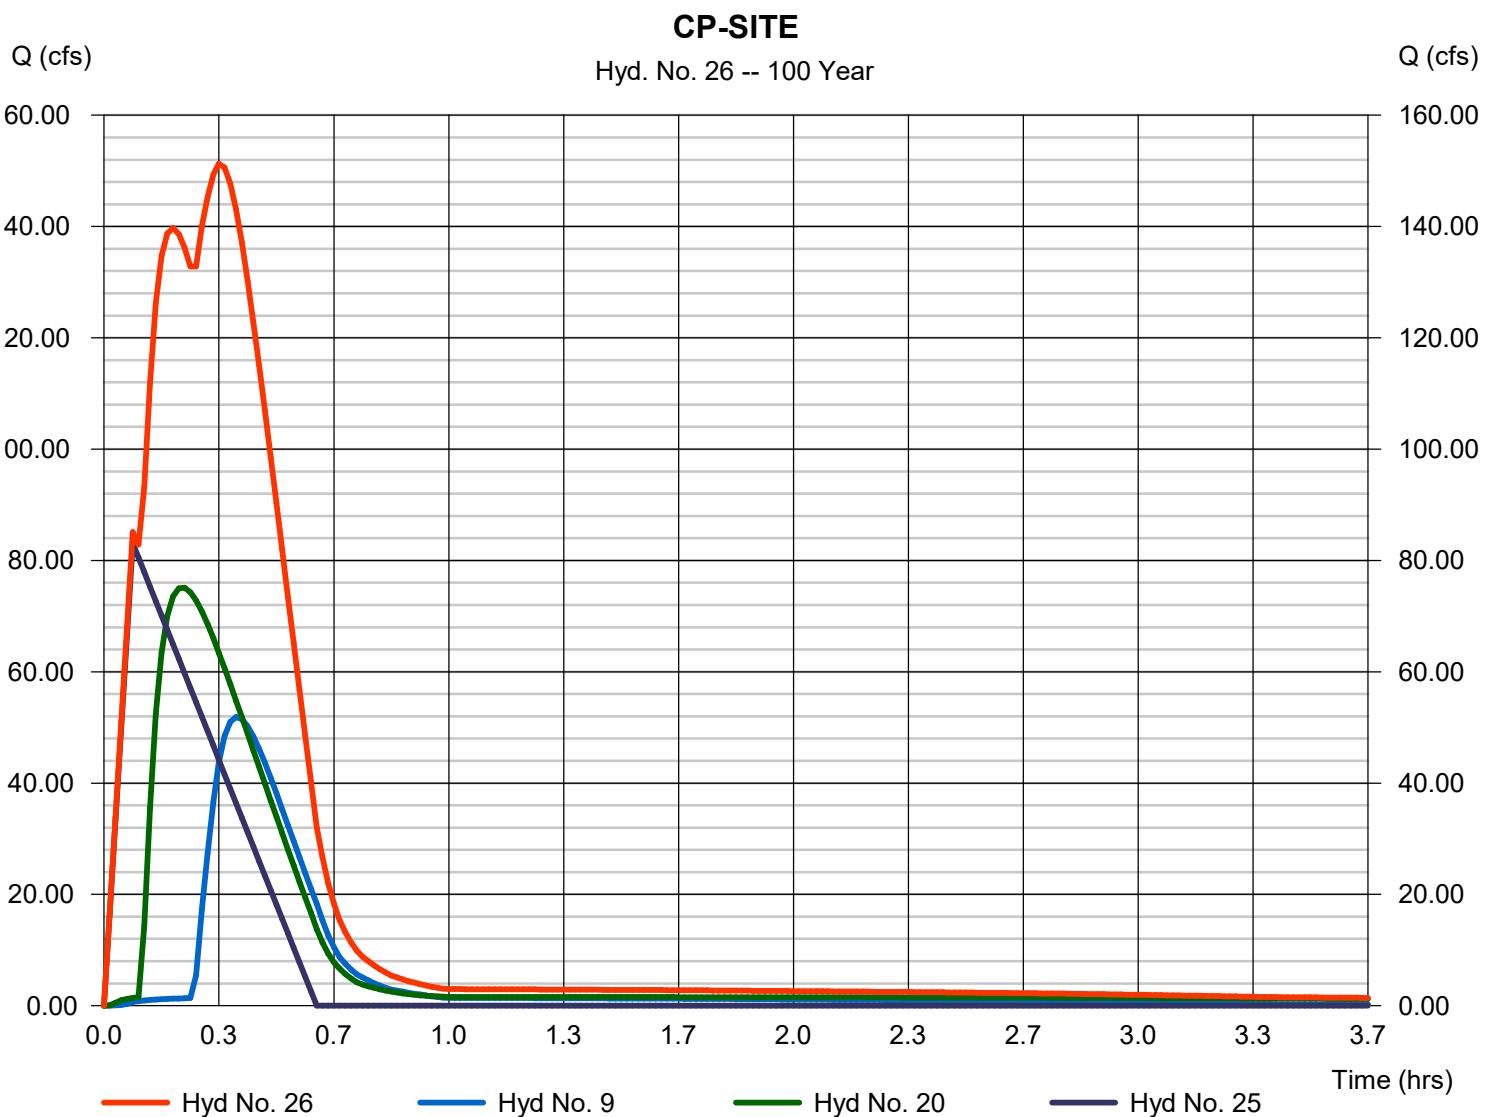

Hydraflow Table of Contents

SEC HAYDEN 101.gpw

Hydraflow Hydrographs Extension for AutoCAD® Civil 3D® 2018 by Autodesk, Inc. v2018.3


Thursday, 09 / 10 / 2020

Watershed Model Schematic..... 1

100 - Year

Summary Report.....	2
Hydrograph Reports.....	3
Hydrograph No. 1, Rational, CPH.....	3
Hydrograph No. 2, Rational, CPI.....	4
Hydrograph No. 3, Rational, CPJ.....	5
Hydrograph No. 4, Rational, ON-B7.....	6
Hydrograph No. 5, Combine, Combine at Basin B7.....	7
Hydrograph No. 6, Reservoir, Basin B7.....	8
Hydrograph No. 7, Rational, ON-B8.....	9
Hydrograph No. 8, Combine, COMBINE B8.....	10
Hydrograph No. 9, Reservoir, BASIN B8.....	11
Hydrograph No. 10, Rational, CPF2.....	12
Hydrograph No. 11, Rational, CPE.....	13
Hydrograph No. 12, Rational, ON-B3.....	14
Hydrograph No. 13, Rational, ON-B4.....	15
Hydrograph No. 14, Combine, CPB3.....	16
Hydrograph No. 15, Reservoir, BASIN B3.....	17
Hydrograph No. 16, Rational, ON-B2.....	18
Hydrograph No. 17, Rational, ON-B5.....	19
Hydrograph No. 18, Rational, ON-B1.....	20
Hydrograph No. 19, Combine, CPB1.....	21
Hydrograph No. 20, Reservoir, BASIN B1.....	22
Hydrograph No. 21, Rational, ON-B9.....	23
Hydrograph No. 22, Rational, ON-B10.....	24
Hydrograph No. 23, Rational, ON-B6.....	25
Hydrograph No. 24, Rational, ON-B11.....	26
Hydrograph No. 25, Combine, CP-B11.....	27
Hydrograph No. 26, Combine, CP-SITE.....	28


122_PinnaclePeakSouth - 100YR24HR

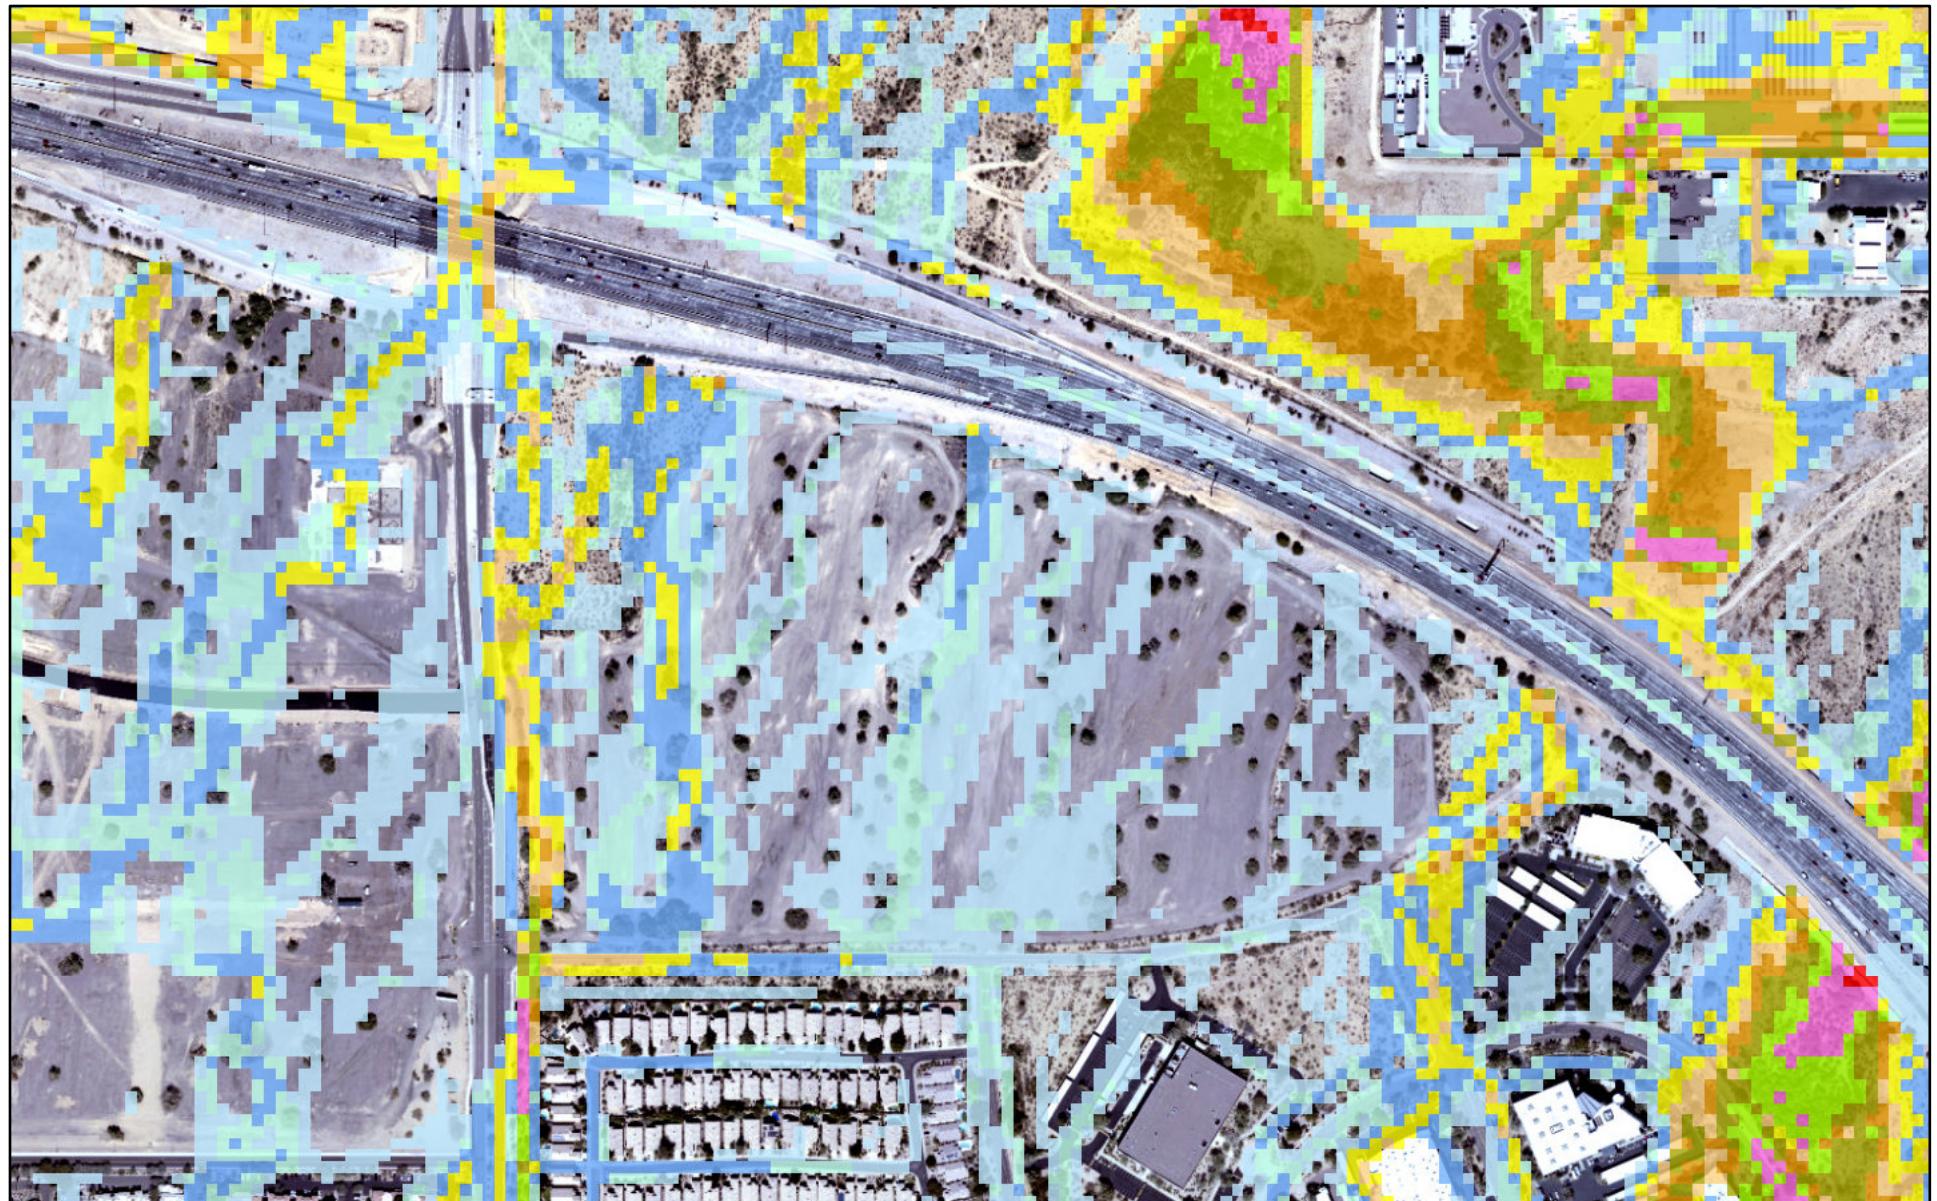

September 10, 2020


1:6,000
0 275 550 1,100 ft
0 80 160 320 m

122_PinnaclePeakSouth - 100YR24HR

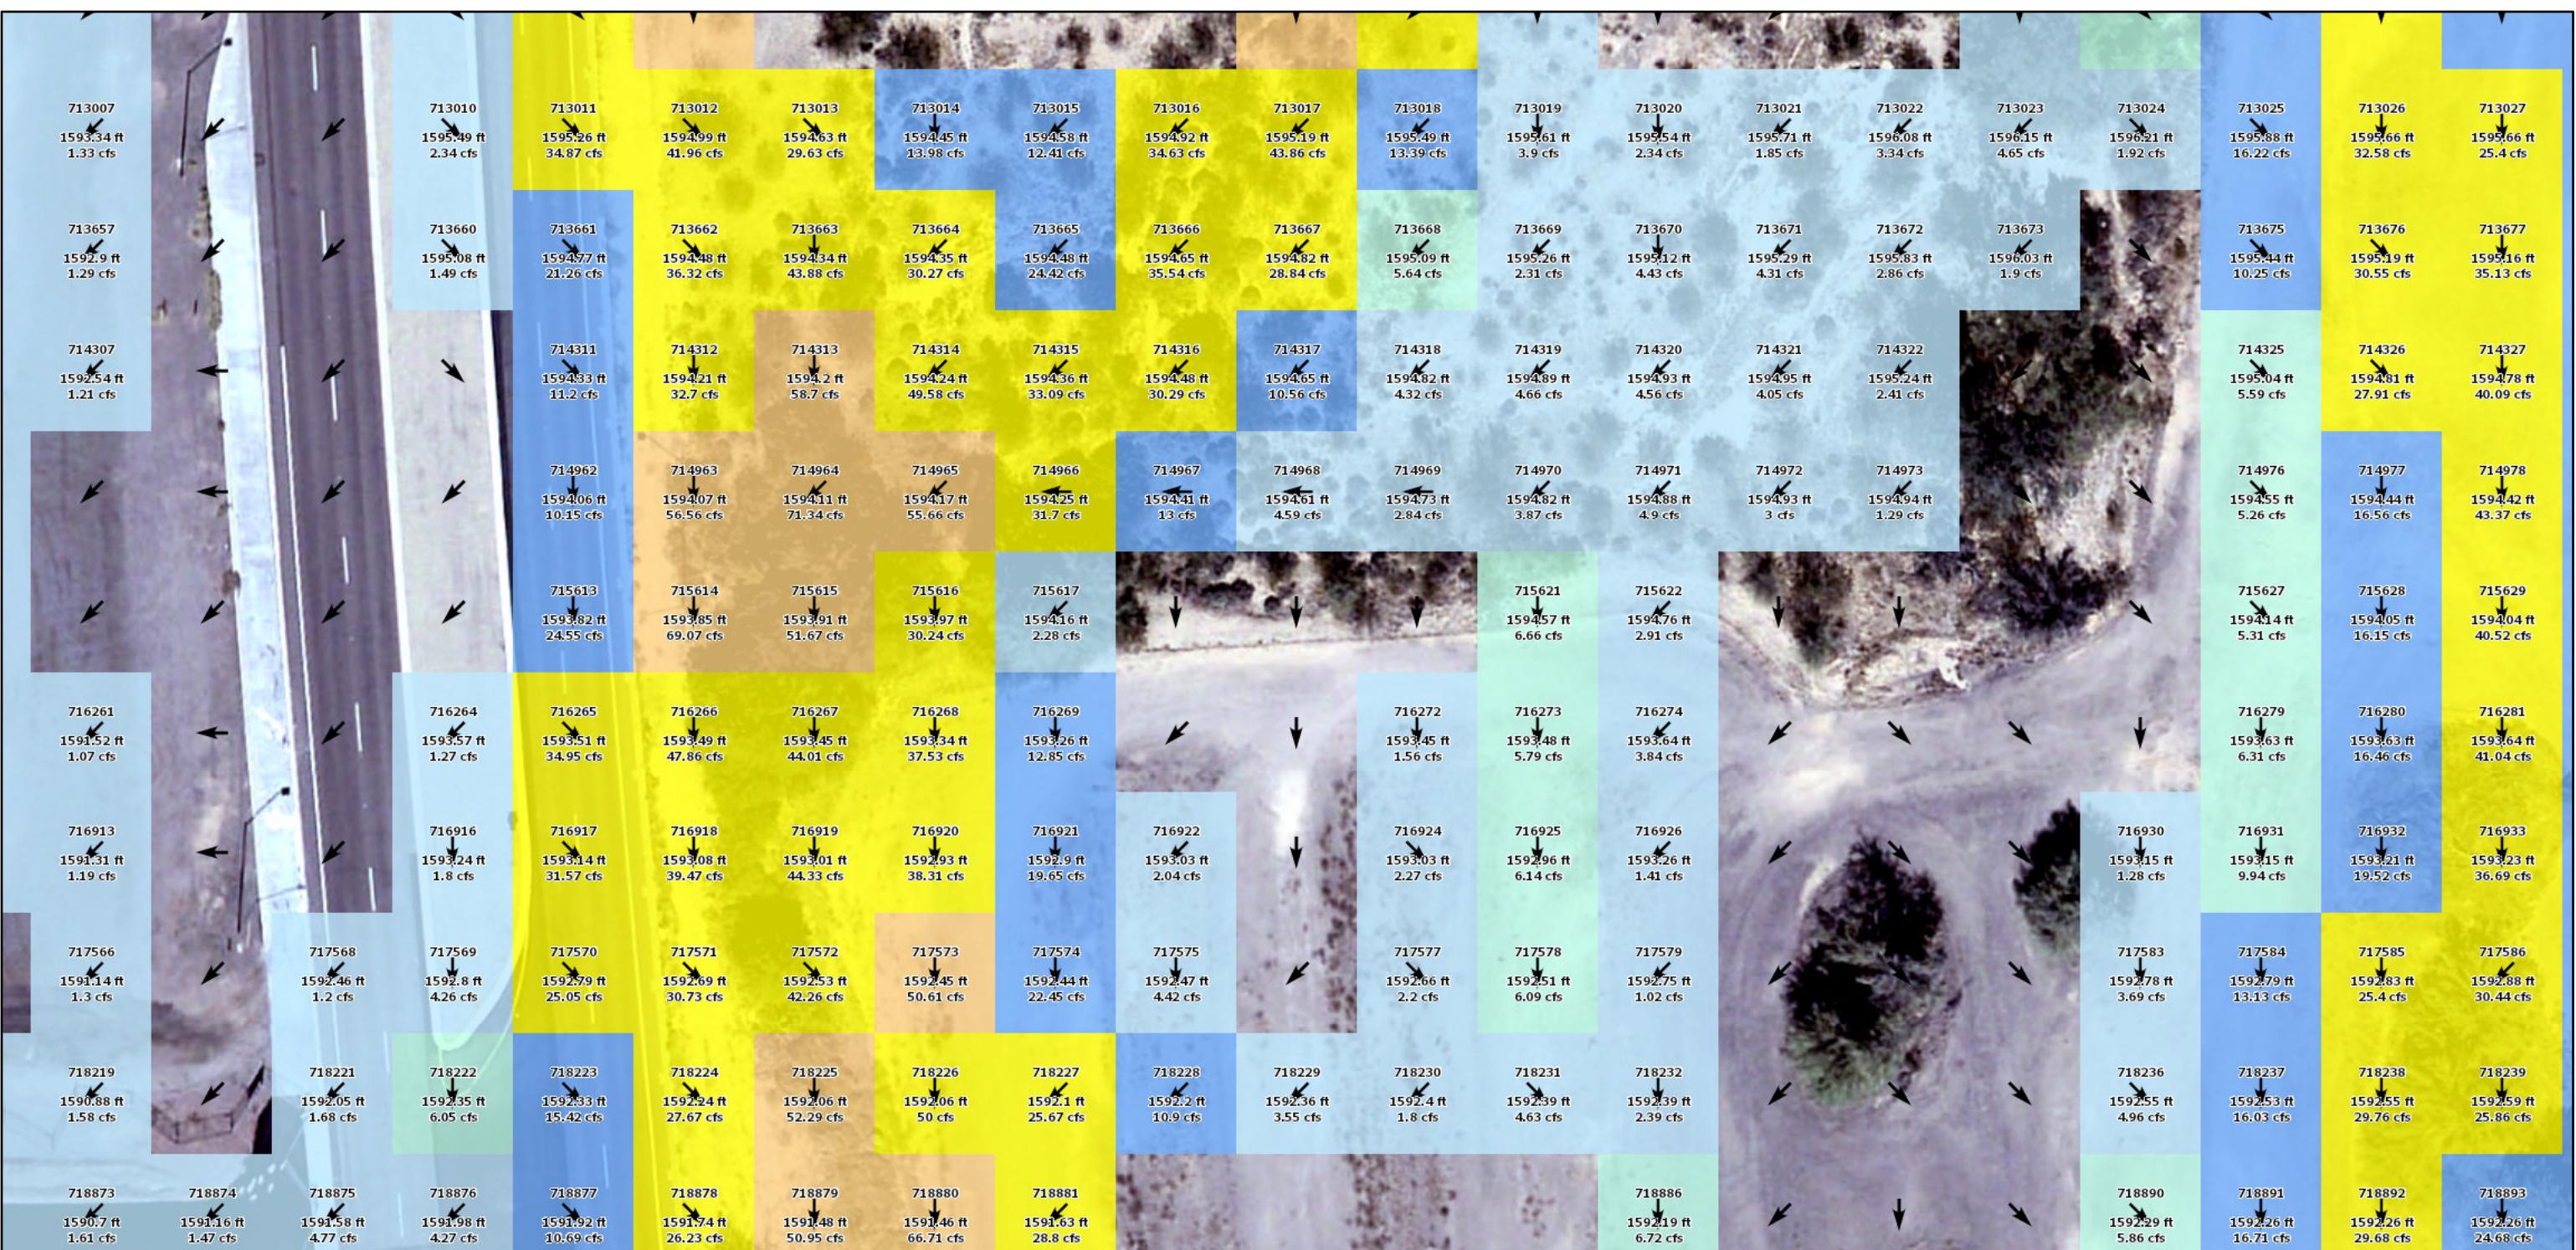


September 10, 2020

1:480




122_PinnaclePeakSouth - 100YR24HR

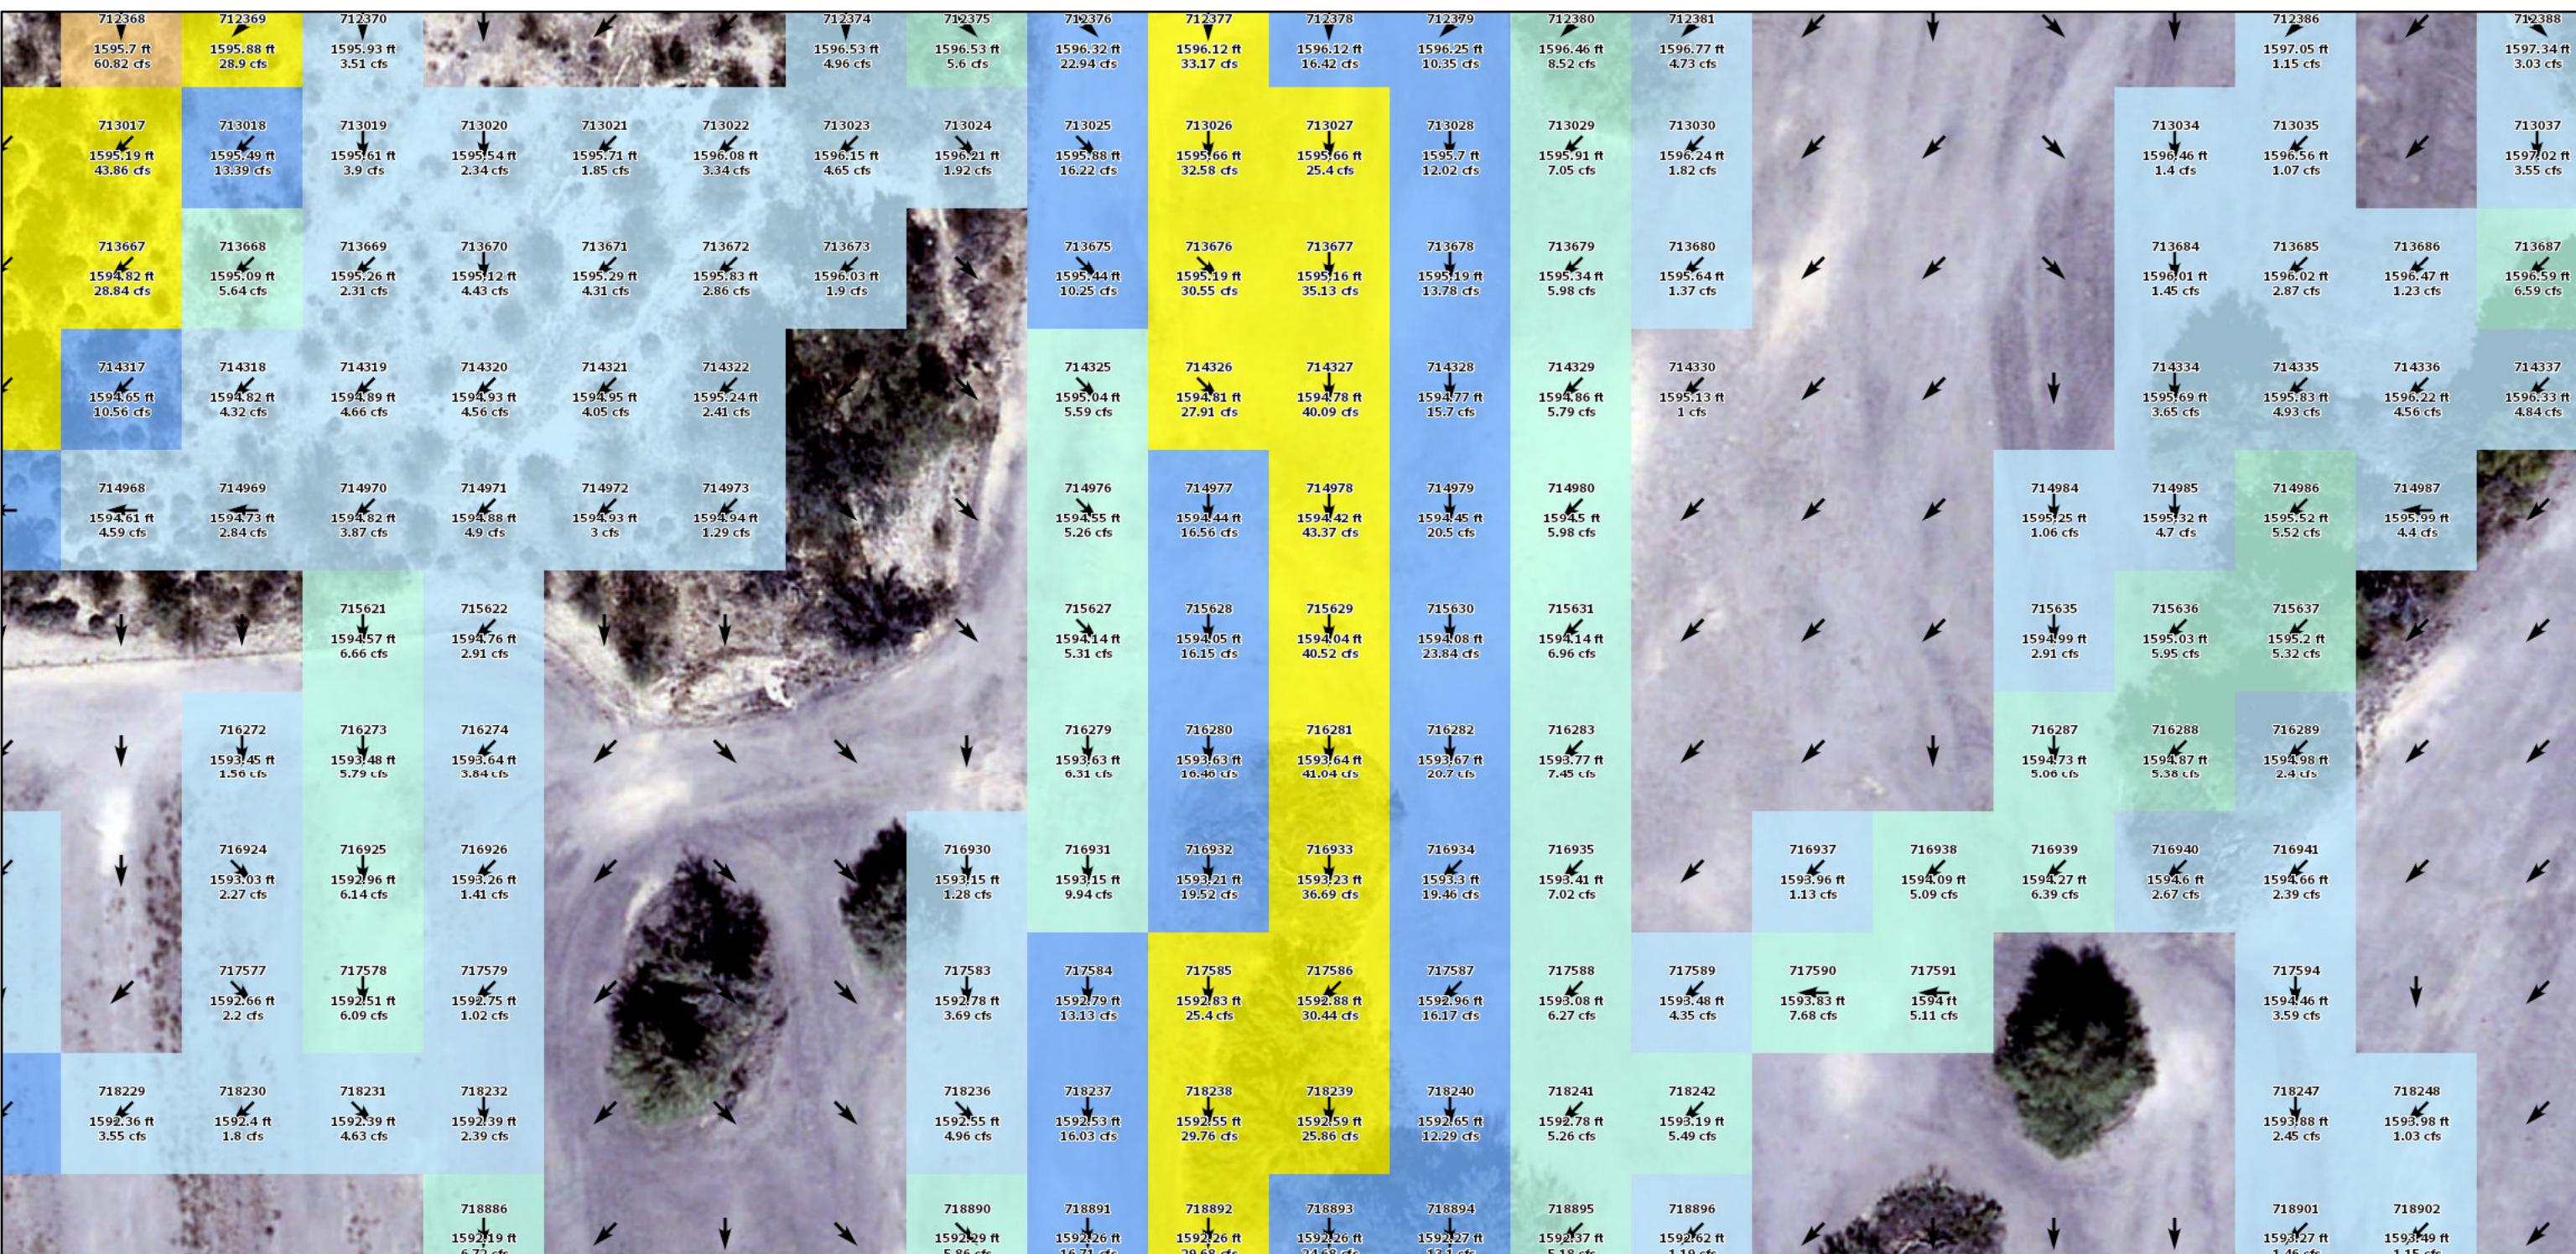

September 10, 2020

1:480



APPENDIX C – CROSS ROADS EAST TRAFFIC IMPACT MITIGATION ANALYSIS



CITY OF SCOTTSDALE

PUBLIC IMPROVEMENTS

COUNCIL
 W.J. "JIM" LANE, MAYOR
 SUZANNE KLAPP
 VIRGINIA KORTE
 KATHY LITTLEFIELD
 LINDA MILHAVEN
 GUY PHILLIPS
 SOLANGE WHITEHEAD

CITY MANAGER
 JIM THOMPSON

CITY ATTORNEY
 BRUCE WASHBURN

CITY CLERK
 CAROLYN JAGGER

"AS-BUILT" CERTIFICATION

I HEREBY CERTIFY THAT THE "AS-BUILT" IMPROVEMENTS AS SHOWN HEREON ARE LOCATED AS NOTED, AND THE LOCATIONS ARE CORRECT TO THE BEST OF MY KNOWLEDGE AND BELIEF.

REGISTERED LAND SURVEYOR DATE

CITY OF SCOTTSDALE

REVIEWED AND RECOMMENDED APPROVAL BY:


PAVING		STRUCTURES
GRADING & DRAINAGE		BUILDING
WATER & SEWER		PLUMBING
TRAFFIC		MECHANICAL
PLANNING IMPROVEMENTS		ELECTRICAL
PLANNING FACILITIES	FIRE IMPROVEMENTS	
LANDSCAPE	FIRE FACILITIES	
NATIVE PLANT		

ENGINEERING COORDINATION MANAGER (OR DESIGNEE) DATE


BUILDING OFFICIAL (OR DESIGNEE) DATE



CROSSROADS EAST DRAINAGE INFRASTRUCTURE PROJECT NO. 400-FB53B-56047

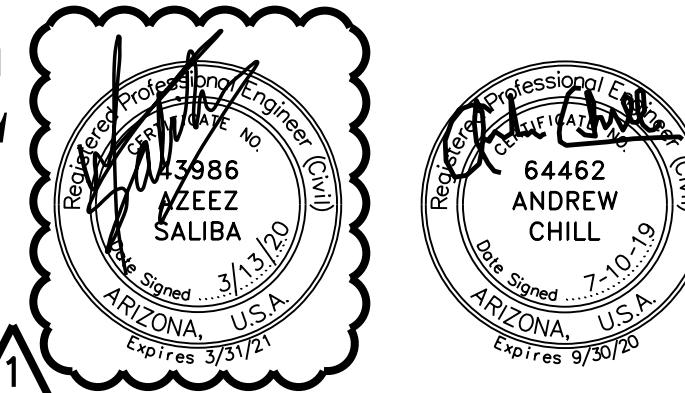

JULY 2019

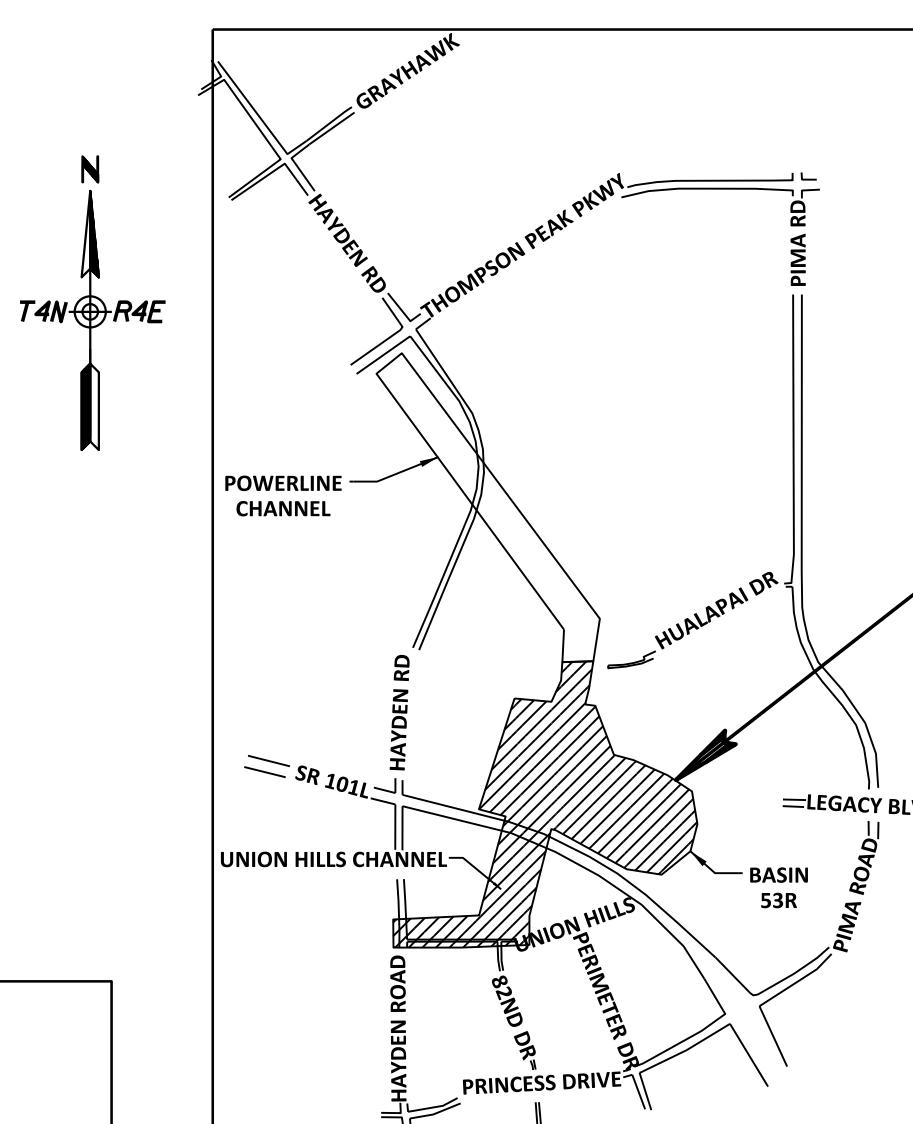

Vicinity Map
N.T.S.

SHEET INDEX		
Sht. No.	Dwg. No.	Description
1	G1	COVER SHEET
2	G2	GENERAL NOTES
3	G3	LEGEND AND ABBREVIATIONS
4	G4	CHANNEL TYPICAL SECTIONS
5	G5	QUANTITY SUMMARY SHEET
6-7	G6-G7	GEOMETRIC CONTROL PLAN
8	RW1	RIGHT OF WAY PLAN
9-15	SD1-SD7	CHANNEL PLAN & PROFILE
16-19	SD8-SD11	ACCESS ROAD PLAN & PROFILE
20-38	D1-D19	DETAILS

BENCH MARK (COS NAVD '88)

Description

HORIZONTAL CONTROL:
 SET GPS BASE POINT 10000 USING VRS (FROM USURY MOUNTAIN). ALL SECTION CORNERS, CENTERLINE MONUMENTS AND S6 TOPO CONTROL POINTS WERE LOCATED FROM THIS GPS BASE POINT. AN ADDITIONAL GPS BASE POINT 10001 WAS SET. AFTER COMPLETING THIS FIELD WORK, THE PROJECT NEEDED TO BE CALIBRATED TO THE CITY OF SCOTTSDALE (COS) COORDINATE SYSTEM AND BENCHMARKS. ONLY ONE ORIGINAL COS CONTROL MONUMENT WAS FOUND SO THIS POINT WAS HELD BOTH HORIZONTALLY AND VERTICALLY. FOUR OTHER SECTION CORNERS WERE POSSIBLY ORIGINAL COS CONTROL MONUMENTS OR AT THE PERPETUATION OF THE ORIGINAL COS CONTROL MONUMENT. A CALIBRATION WAS PERFORMED HOLDING THESE FIVE MONUMENTS WITH ALL RESIDUALS BEING 0.14' OR LESS.

VERTICAL CONTROL:

3" MARICOPA COUNTY BRASS CAP STAMPED "T4N R4E S26 S25 S35 S26 LS33307 2003" FLUSH IN CONCRETE NORTHEAST CORNER SECTION 35, T4N R4E. ELEVATION = 1612.665 (NAVD88 DATUM) PER PLSS RECORD OF SURVEY RECORDED IN BOOK 693, PAGE 3, MCR.

GENERAL CONSTRUCTION NOTES FOR CAPITAL PROJECTS

- A. All improvement construction shall comply with the 2015 Maricopa County Association of Governments Standard Specifications and Details for Public Works Construction as amended by the latest version of the City of Scottsdale Supplemental Standard Specifications and Details and City of Scottsdale's Design Standards & Policies Manual (DS&PM). If there is a conflict, the latter shall apply. All facilities construction shall comply with the latest building codes as amended and adopted by the City of Scottsdale.
- B. The engineering designs on these plans are approved by the City in scope and not in detail. If construction quantities are shown on these plans, they are not verified by the City.
- C. Based on the information submitted on the plans and associated documents, the City has reviewed and found them to be in accordance with the Scottsdale Revised Code and are acceptable for permit issuance. This acceptance by the City does not authorize violations of any applicable code, ordinance or standard as adopted by the Scottsdale Revised Code.
- D. Approval of the plans by the City is valid for six months. If a permit for the construction has not been issued within six months of review, the plans shall be resubmitted to the City for reapproval.
- E. Any deviation from the approved plans shall be reviewed and approved by the City prior to that change being incorporated into the project.
- F. A City Capital Projects Inspector will inspect all work within the City rights-of-way, easements and facilities.
- G. Any Special Inspection required shall be in addition to any routine inspection by the City.
- H. City encroachment and building permits are required for work in public rights-of-way, easements granted for public purposes and facilities. Permits will be issued by the City through the City's One Stop Shop. Copies of all permits shall be retained on-site and shall be available for inspection at all times. Failure to produce the required permits will result in immediate work stoppage until the proper permit documentation is obtained.
- I. The Contractor shall be responsible for obtaining all necessary permits for salvaging protected native plants prior to the start of construction.
- J. Wherever excavation is done contact the Blue Stake Center at (602) 263-1100 two working days before excavation is to begin. The Center will see that the location of the underground utility lines is identified for the project.
- K. All excavation and grading which is not in public rights-of-way or in easements granted for public purposes must conform to Section 1803 and Appendix J of the latest International Code Council as adopted and amended by the City of Scottsdale. A permit for this grading must be secured from the City.
- L. Thrust restraint, where required, on all City water lines shall be provided using Megalug mechanical joint restraints or City-approved equal.
- M. Any asphalt mix design used on City projects shall have been approved for that use per Section 5-10 the City's DS&PM and appear on the "Approved List of Asphalt Mixes" as distributed by the East Valley Asphalt Committee (EVAC).
- N. The Contractor shall be responsible to remove and replace, at no additional cost to the City, any and all pavement, sidewalk, curb and gutter, drainage structures, etc. outside the pay limit that are damaged due to their activities on the project. This includes, but is not limited to, the removal and replacement of newly cracked roadway infrastructure, the removal and replacement of existing cracked roadway infrastructure where the cracks have been enlarged due to the Contractor's operations, the removal and replacement of deformed roadway infrastructure. All sawcuts used for the removal of these items shall be perpendicular and parallel to the centerline controlling that item, or at the direction of the City's Capital Projects Inspector.


CONCRETE RUBBLE SPECIFICATION

1. The specific gravity shall be at least 2.3 or the specific weight shall be at least 143.5 lb per cubic foot.
2. Materials shall be free of grease, oils, paint, chemicals, and other pollutants.
3. All protruding foreign material such as rebar must be cut off.
4. The longest dimension shall not be more than three times the shortest dimension. The length shall not be greater than twice its width.
5. Materials, when trucked or imported to the site, must be sorted at the site.
6. Materials shall be stockpiled before placement to allow for inspection. Visual inspection shall ensure that materials are free of cracks, soft seams or other structural defects.
7. Materials shall be hard, durable, rough and angular in shape. Additional tests may be required subject to the inspector's judgment. Examples of such tests include the Los Angeles Abrasion Test (AASHTO T96), Durability and Soundness Test (AASHTO T104), Absorption Test (AASHTO T85), Drop Test (USACE, 1990, EM 1110-2-2302). The requirements for these tests are a maximum loss of 45% for the Los Angeles Abrasion Test, a maximum loss of 12% for the Durability and Soundness Test, and a maximum of 5% for the Absorption Test. The Drop Test requirements are: no new cracks developed, or no existing crack widened more than an additional 0.1 inch, or final largest dimension greater than or equal to 90% of the original largest dimension of a dropped piece.
8. The maximum weight of any piece shall not exceed 500 lbs.
9. Materials shall be reasonably well graded. The gradation shall be based on general rip-rap gradation documented in Detail I on sheet D13. All large slabs shall be broken up to conform to the gradation requirement.
10. All material shall be placed in a manner such that the large and small sizes are evenly distributed and placed so as to fill the voids between the larger pieces without sharp exposed edges.
11. All material shall be placed in a manner such that each piece is touching the adjacent piece in a configuration creating the highest possible density while producing a reasonably solid mass within the limits shown in the plans.
12. The largest material must be keyed into the toe and also used in the base of the riprap.

NATIVE TREE AND CACTI LOCATIONS

POINT	NORTHING	EASTING	ITEM
1	963962.16	702906.00	Tree
2	963971.75	703184.46	Tree
3	963965.63	703208.57	Tree
4	963967.70	703375.92	Tree
5	963991.35	703591.47	Tree
6	963958.36	703699.09	Tree
7	963972.47	703707.41	Tree
8	963989.50	703707.33	Tree
9	963996.57	703766.70	Tree
10	964010.86	703779.82	Tree
11	964014.30	703798.41	Tree
12	965020.74	704146.18	Tree
13	965558.07	704151.19	Tree
14	965552.01	704165.04	Tree
15	965791.45	704179.92	Tree
16	965810.21	704184.52	Tree
17	966425.56	704663.47	Tree
18	966480.75	704648.34	Tree
19	966450.98	704691.09	Tree
20	966446.39	704756.13	Tree
21	966487.03	704752.07	Tree
22	966533.45	704798.35	Cactus
23	966537.56	704774.17	Tree
24	966588.34	704686.76	Tree
25	966600.46	704766.26	Tree
26	966578.82	704801.50	Tree
27	966680.00	704859.11	Tree
28	966741.31	704786.17	Tree
29	966754.59	704920.80	Tree
30	966815.01	704811.88	Tree
31	966805.01	704840.67	Tree
32	966811.90	704859.99	Tree
33	966824.30	704867.74	Tree
34	966864.08	704848.72	Tree
35	966862.20	704883.08	Tree
36	966885.56	704848.42	Tree
37	966875.17	704860.53	Cactus
38	966843.00	704953.83	Tree
39	966862.22	704966.36	Tree
40	966902.78	704974.34	Tree
41	966911.09	704917.60	Tree
42	966941.80	704982.23	Tree
43	967000.82	705007.41	Tree
44	967024.43	704886.99	Tree
45	967051.35	704912.46	Tree
46	967057.80	704918.84	Tree
47	967059.15	704939.84	Tree
48	967065.38	704931.53	Cactus
49	967109.81	704896.94	Tree
50	967126.74	704971.84	Tree
51	967100.26	705014.36	Cactus
52	967177.19	705018.66	Cactus
53	967211.72	704956.73	Cactus
54	967224.57	704973.58	Cactus
55	967384.60	705000.34	Tree
56	967447.76	705019.39	Tree
57	967462.56	705019.85	Cactus
58	965745.20	705373.78	Tree
59	965749.89	705414.86	Tree
60	965739.32	705403.89	Tree
61	965688.87	705529.69	Tree
62	965622.85	705493.21	Tree
63	965576.02	705416.35	Tree
64	965563.58	705530.88	Tree
65	965468.81	705494.06	Tree

POINT	NORTHING	EASTING	ITEM
66	965418.21	705498.20	Tree
67	965414.46	705512.11	Tree
68	965402.32	705502.85	Tree
69	965165.99	705093.35	Tree
70	965124.89	705123.69	Tree
71	965141.67	705175.52	Tree
72	965109.73	705233.25	Tree
73	965134.60	705260.31	Tree
74	965077.19	705266.96	Tree
75	965060.18	705279.34	Tree
76	965046.54	705270.83	Tree
77	965045.03	705287.79	Tree
78	965040.47	705299.37	Tree
79	965029.03	705299.02	Tree
80	965022.23	705318.30	Tree
81	965011.24	705356.62	Tree
82	964939.18	705456.90	Tree
83	964926.31	705505.02	Tree
84	964908.34	706015.23	Tree
85	964954.60	706049.41	Cactus
86	965213.66	705434.55	Tree
87	965217.87	705442.02	Tree
88	965229.59	705453.81	Tree
89	965235.33	705448.69	Tree
90	965243.86	705461.30	Tree
91	965379.42	705694.03	Tree
92	965373.78	705824.90	Tree
93	965333.95	705857.39	Tree
94	965291.87	705869.26	Tree
95	965269.46	705914.72	Tree
96	965524.25	706224.25	Tree
97	965423.34	706159.12	Tree
98	965374.36	706160.13	Tree
99	965357.84	706178.22	Tree
100	965359.46	706191.36	Tree
101	965350.94	706194.10	Tree
102	965346.73	706204.29	Tree
103	965343.25	706215.63	Tree
104	965339.25	706222.90	Tree
105	965354.24	706240.28	Tree
106	965280.85	706315.12	Tree
107	965322.38	706379.49	Tree
108	965446.07	706337.16	Tree
109	965449.45	706354.12	Tree

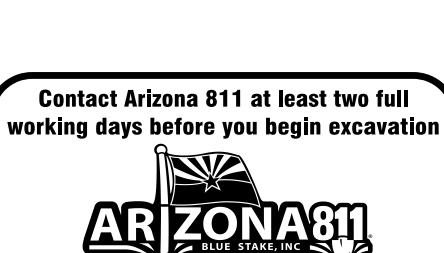


DATE:	REVISION:	PUBLIC WORKS
64462 ANDREW CHILL 7-10-19 Date Signed ARIZONA, USA Expires 3/31/21		CAPITAL PROJECT MANAGEMENT
7447 E. INDIAN SCHOOL RD., SCOTTSDALE, ARIZONA 85251		
SHEET TITLE: GENERAL NOTES		
PROJECT TITLE: CROSSROADS EAST DRAINAGE INFRASTRUCTURE		
SCALE: N/A	DESIGNED AC DRAWN JJP	DATE 07/19 AS-BUILT XX/XX
VERT. N/A		BID NO. XXXX PROJECT NO. 400-FB53B-56047
SHT. G2		

ABBREVIATIONS

ACRES	AC	LANE	LN	TRAFFIC BARRICADE MANUAL	TBM
AGGREGATE BASE	AB	LINEAR FEET	LF	TRAFFIC CONTROL PLANS	TCP
AHEAD	AHD	LEFT	L / LT	TRAFFIC INTERCHANGE	TI
AIR RELEASE VALVE	ARV	LENGTH OF CURVE	L	TRAFFIC SIGNAL	T/S
ALUMINUM	AL	MANUAL ON UNIFORM TRAFFIC CONTROL	MUTCD	TRANSFORMER	TSFM
AMERICAN SOCIETY FOR TESTING AND MATERIALS	ASTM	DEVICES		TYPICAL	TYP
AMERICAN TELEPHONE & TELEGRAPH	AT&T	MARICOPA COUNTY DEPARTMENT OF	MCDOT	UNKNOWN	UNKN
ANGLE POINT	AP	TRANSPORTATION		VALLEY GUTTER	VG
APPROXIMATE	APPROX	MARICOPA COUNTY RECORDER	MCR	VARIES	VAR
ARIZONA DEPARTMENT OF TRANSPORTATION	ADOT	MARICOPA COUNTY HIGHWAY DEPARTMENT	MCHD	VEHICULAR NON-ACCESS EASEMENT	VNA
ASPHALTIC CONCRETE	AC	MARICOPA ASSOCIATION OF GOVERNMENTS	MAG	VELOCITY	VEL
ASSESSORS PARCEL NUMBER	APN	MAXIMUM	MAX	VOLUME	VOL
AVENUE	AVE	MEASURED	(M)	WATER	WTR / WAT
BACK OF CURB	B/C	MILE POST	MP	WATER METER	VM
BACK OF CURB RETURN	BCR	MILLIMETER	MM	WELL WATER LINE	WELL
BACKFLOW PREVENTER	BFP	MINIMUM	MIN	WATER VAULT / MANHOLE	WMH
BEGIN	BEG	MINUTES	'	WEST	W
BLACK	BK	MISCELLANEOUS	MISC	WESTBOUND	WB
BOULEVARD	BLVD	MONUMENT	MON	WITH	W/
BRASS CAP	BC	NATIONAL GEODETIC VERTICAL DATUM	NGVD	YEAR	YR
BRASS CAP FLUSH	BCF	NATURAL GROUND	NG		
BRASS CAP IN HANHOLE	BCHH	NORTH	N		
CALCULATED	C	NOT TO SCALE	NTS		
CATCH BASIN	CB	NUMBER	NO		
CENTERLINE	C	OFFSET	OFF		
CONSTRUCTION	CST	OUTSIDE	OD		
CENTURYLINK	CLN	PARCEL	PAR		
CHISELED X	CHX	PARKWAY	PKWY		
CITY OF PHOENIX	COP	PAVEMENT	PVMT		
CITY OF SCOTTSDALE	COS/C.O.S.	PEDESTRIAN	PED		
CONCRETE BOX CULVERT	CBC	PROPOSED GRADE LINE	PGL		
COTTON PICKER SPINDLE	CPS	PLACE	PL		
CAST IN PLACE CONCRETE PIPE	CIP / C.I.P.	POINT OF COMPOUND	PCC		
CONSTRUCTION	CONSTR / CST	POINT OF CURVATURE	PC		
CORNER	COR	POINT OF INTERSECTION	PI		
COUNTY	CO	POINT OF REVERSE CURVE	PRC		
CURB AND GUTTER	C&B	POINT OF TANGENT	PT		
DEGREES	D	POINT ON CURVE	POC		
DEGREE OF CURVE	DEPT	POINT ON TANGENT	POT		
DEPARTMENT	DS&PM	POLYETHYLENE	POST		
DESIGN STANDARDS & POLICIES MANUAL	DTL	PORTLAND CEMENT CONCRETE PAVEMENT	PE		
DETAIL	DWN	PROPOSED	PCCP		
DOWN	DWG	PROPOSED GRADE LINE	PROP		
DRAWING	DRAIN	PUBLIC UTILITY EASEMENT	PGL		
DRAINAGE	DR	POINT OF VERTICAL INTERSECTION	PUE		
DRIVE	DWY	RADIUS	PVI		
DRIVeway	DIP / D.I.P.	RAILROAD	R		
DUCTILE IRON PIPE	EA	RAISED PAVEMENT MARKER	RR		
EACH	ESMT	RANGE	RPM		
EASEMENT	E	REBAR AND CAP	R		
EAST	EB	RECORD	R&C		
EASTBOUND	EVAC	REFERENCE	(R)		
EAST VALLEY ASPHALT COMMITTEE	EP	REINFORCED CONCRETE PIPE	REF		
EDGE OF PAVEMENT	EJB	RUBBER GASKET REINFORCED CONCRETE	RCP		
ELECTRIC JUNCTION BOX	CAB	PIPE	RGRCP		
ELECTRIC CABINET	EM	RIGHT	R / RT		
ELECTRIC METER	ESU	RIGHT OF WAY	R/W / ROW		
ELECTRIC STUB UP	EV	ROAD	RD		
ELECTRIC VAULT	ELEC	SALT RIVER PROJECT	SRP		
ELECTRICAL	ELEV	SCUPPER	SCPR		
ELEVATION	ECR	SECONDS	/		
END CURB RETURN	EQUA	SECTION	SEC		
EQUATION	EQUIV	SHEET	SHT		
EQUIVALENT	EXIST	SIDEWALK	S/W		
EXISTING	F/C	SIGN OR STREET SIGN	SGN		
FACE OF CURB	FED	SOUTH	S		
FEDERAL	FT / "	SOUTHWEST GAS	SWG		
FEET	F/O	SPECIFICATION(S)	SPEC		
FIBER OPTIC	FG	STEEL	STL		
FINISHED GRADE	FL	STORM DRAIN MANHOLE	SDMH		
FLOWLINE	FD	SQUARE	SQ		
FOUND	GA	SQUARE FEET	SF		
GAUGE	GN	SQUARE YARD	SY		
GREEN	GLO	STANDARD	STD		
GOVERNMENT LAND OFFICE	G	STATE ROUTE	SR		
GUTTER	HH	STATION	STA		
HANDLE	HDWL	STREET	ST		
HEADWALL	HWY	SUBDIVISION	SUBD		
HIGHWAY	HWE	SUPPLEMENTAL	SUPPL		
HIGH WATER ELEVATION	HGL	TANGENT LENGTH	T		
HYDRAULIC GRADE LINE	IN / "	TELEPHONE	TL		
INCH	ITS	TEMPORARY CONSTRUCTION EASEMENT	TCE		
INTELLIGENT TRANSPORTATION SYSTEM	INV	TEMPORARY	TEMP		
INVERT	IRR	TO BE VERIFIED	TBV		
IRRIGATION	JCT	TOP OF CURB	TC		
JUNCTION		TOP OF WALL	TW		
		TOWNSHIP	T		

SYMBOL LEGEND

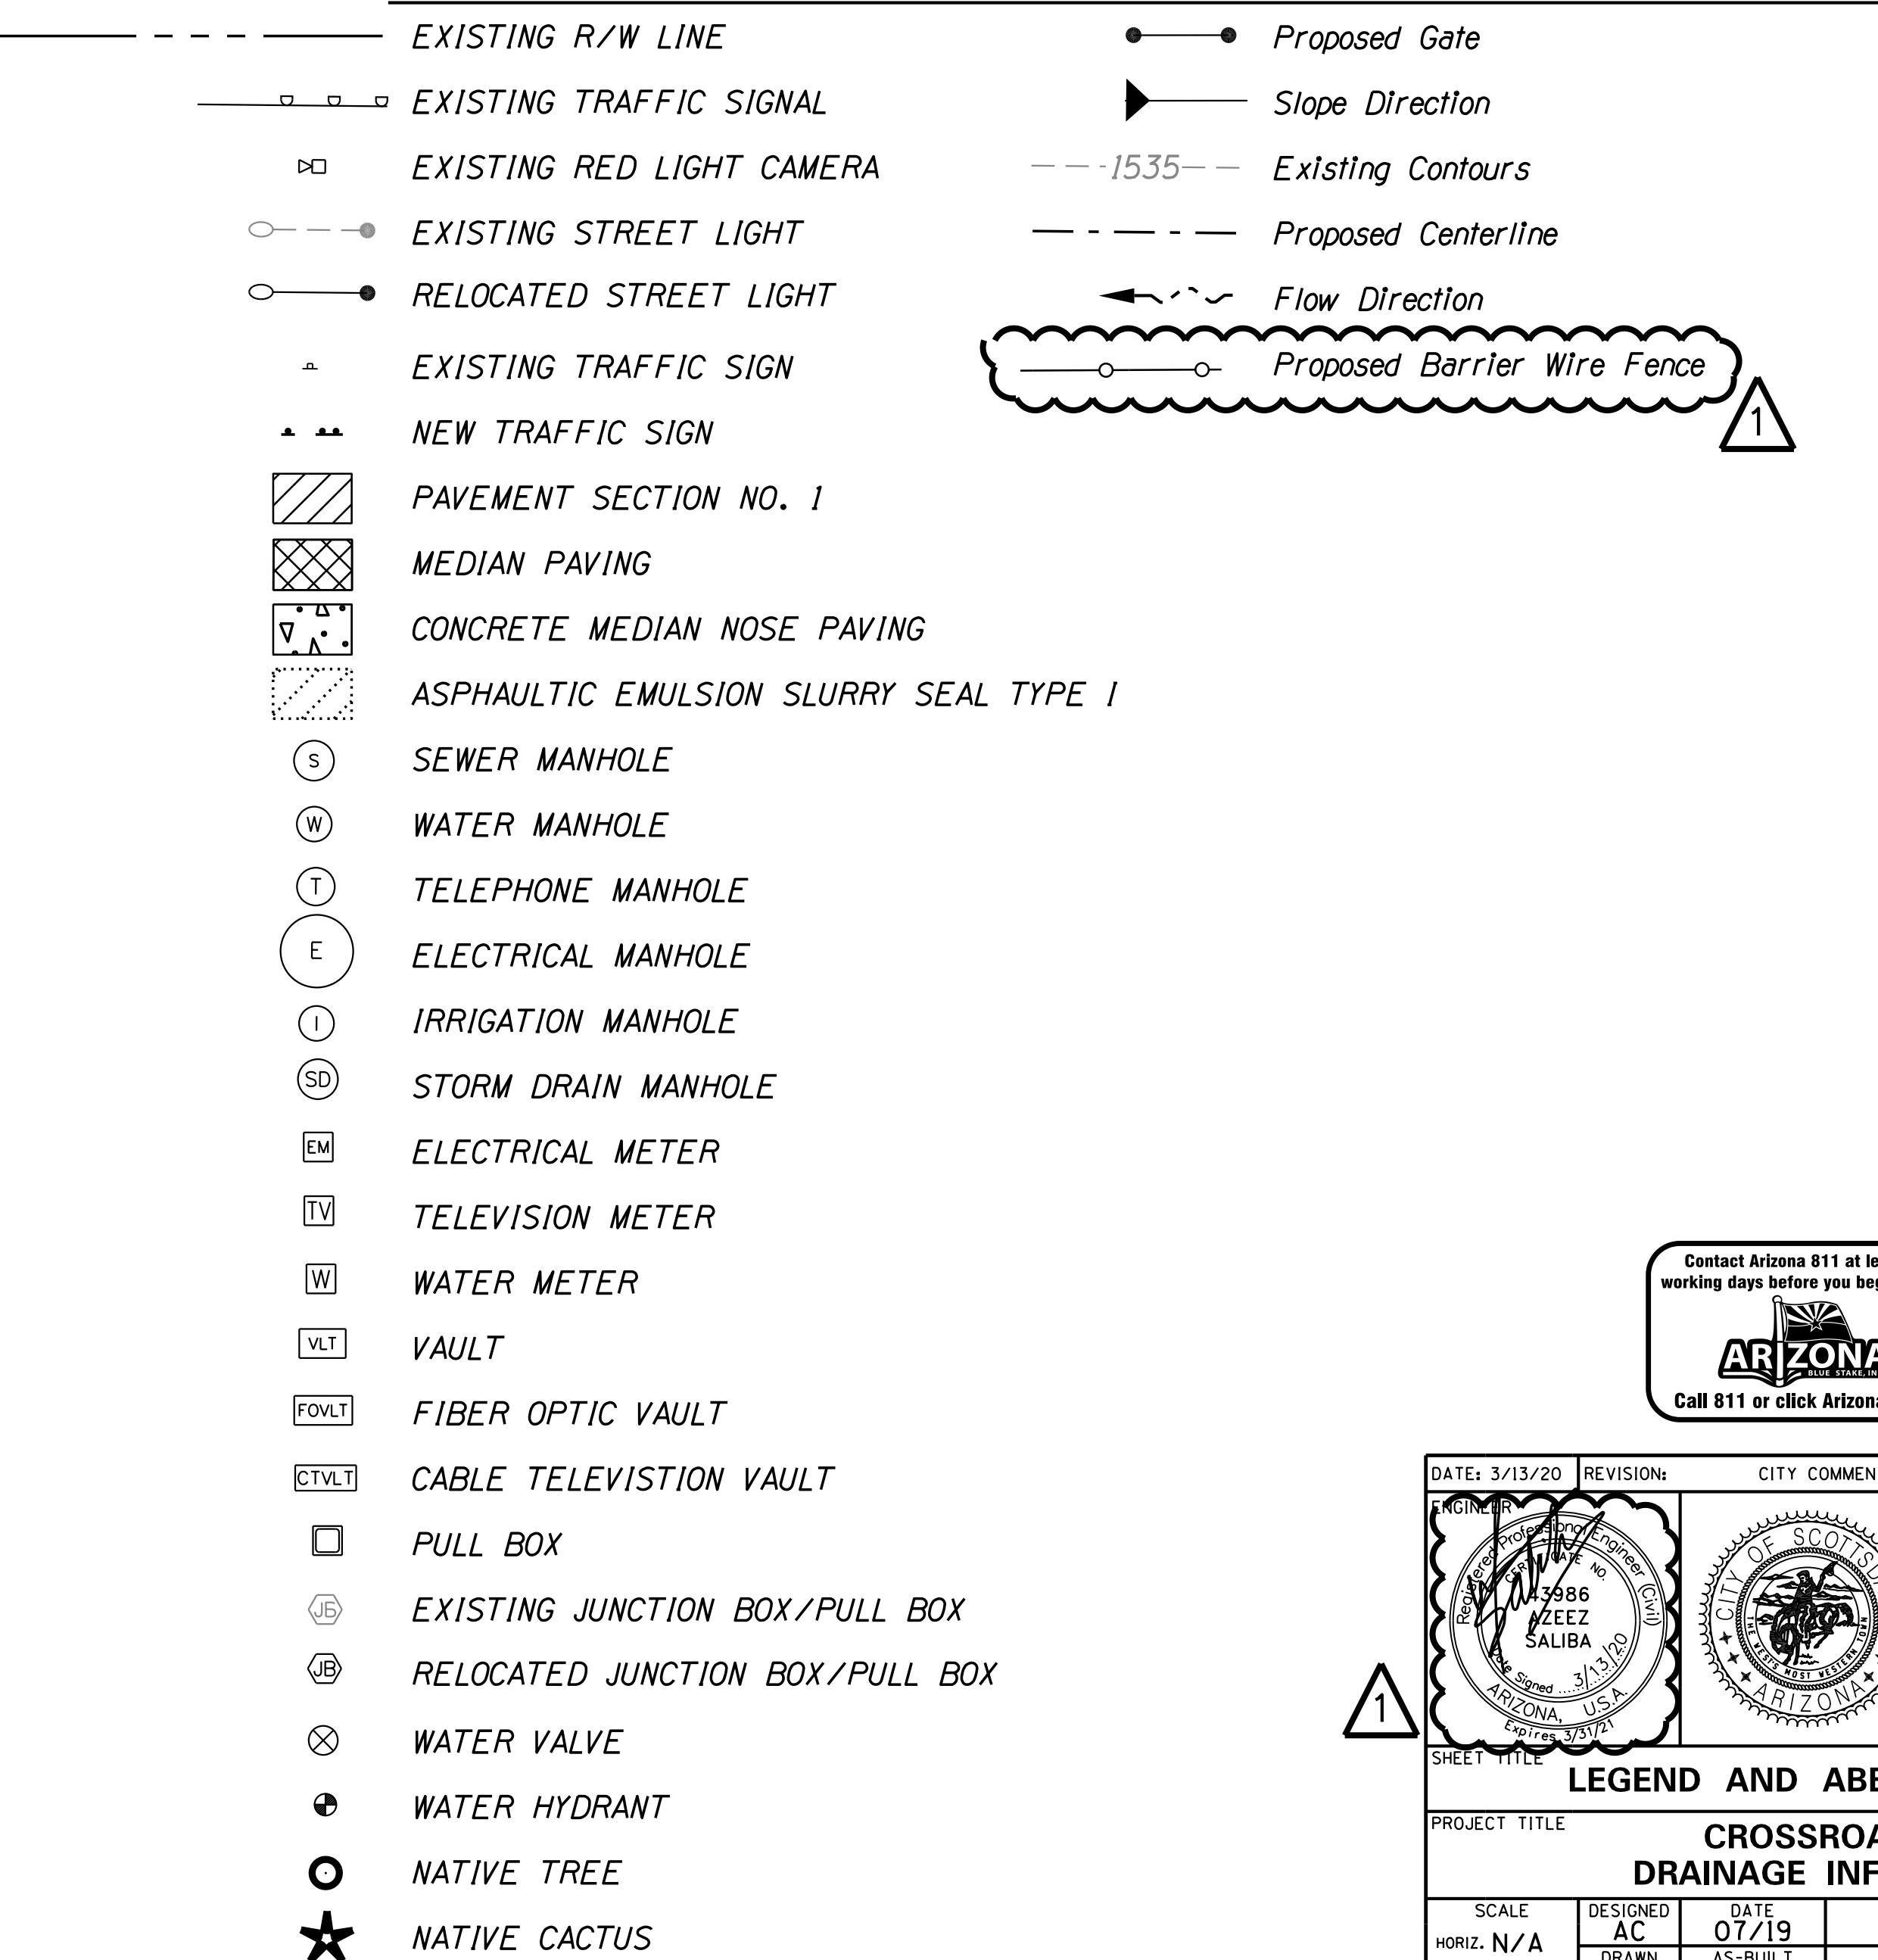

DATE: 3/13/20		REVISION:	CITY COMMENTS		BY: A.S.N.
PROJECT NO. 5986		JEEZ SALIBA		PUBLIC WORKS	
REGISTRATION NO. 313120		EXPIRES 3/31/20		CAPITAL PROJECT MANAGEMENT	
PROJECT TITLE: CROSSROADS EAST DRAINAGE INFRASTRUCTURE		SHEET TITLE: 7447 E. INDIAN SCHOOL RD., SCOTTSDALE, ARIZONA 85251		PROJECT NO. 400-FB53B-56047	
SCALE HORIZ. N/A VERT. N/A	DESIGNED AC DRAWN JJP	DATE 07/19 AS-BUILT XX/XX	BID NO. XXX PROJECT NO. 3 of 38	SHT. G3	

PLOT DATE: 3/13/2020

DESIGN FILE: W:\P\POJ\169678_Crossroads_East\CAD\Sheet_Files\Drainage\G4_Typical Section.dgn

POWERLINE CHANNEL TYPICAL SECTION DIMENSIONS

Begin Station	End Station
204+95.94	211+90.00

POWERLINE CHANNEL TYPICAL SECTION DIMENSIONS

Begin Station	End Station
213+11.00	213+86.88

HUALAPAI CHANNEL TYPICAL SECTION DIMENSIONS

Begin Station	End Station
10+10.68	11+76.23


UNION HILLS CHANNEL VANES (Looking Upstation)

SEE VANES DETAIL SHEET D18

Begin Station	End Station
102+26.90	101+41.08

UNION HILLS CHANNEL TYPICAL SECTION DIMENSIONS

Begin Station	End Station
102+76.89	111+53.58

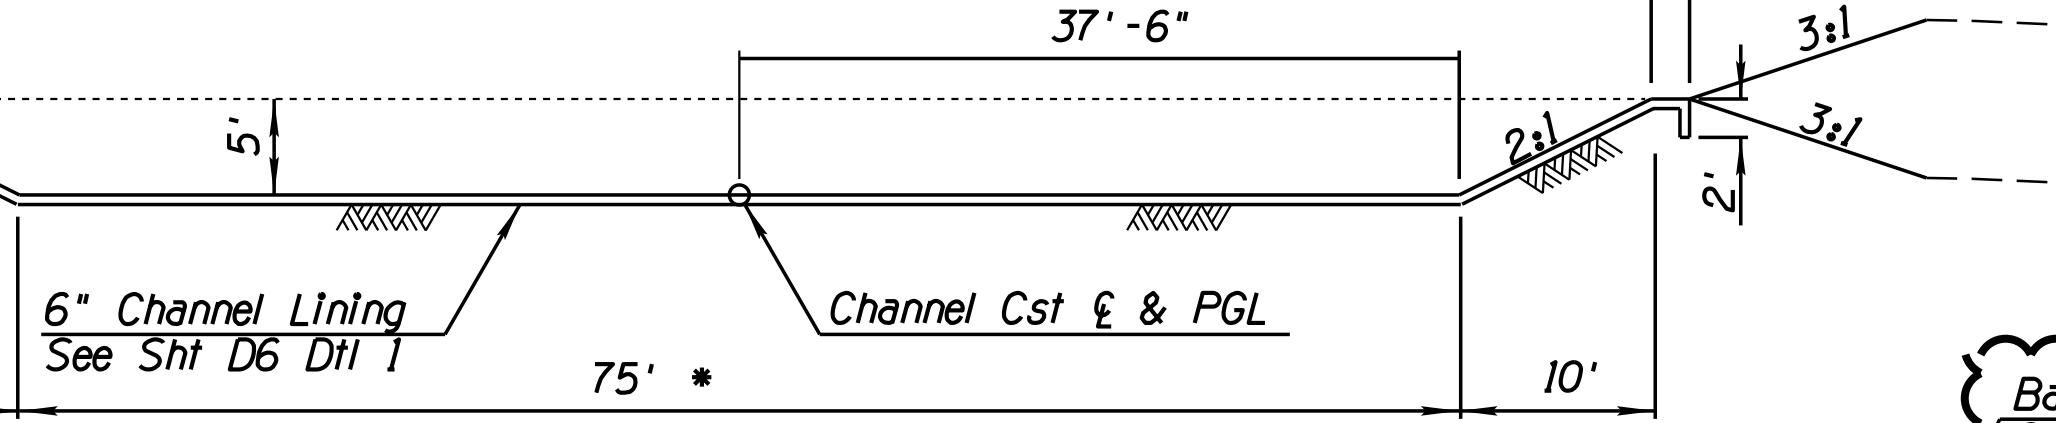

POWERLINE CHANNEL (Looking Upstation)

*Varies from Sta 211+90.00 to Sta 213+11.00

POWERLINE CHANNEL TYPICAL SECTION DIMENSIONS

Begin Station	End Station
213+86.88	214+36.88


POWERLINE CHANNEL TYPICAL SECTION DIMENSIONS

Begin Station	End Station
213+11.00	213+86.88

HUALAPAI CHANNEL TYPICAL SECTION DIMENSIONS

Begin Station	End Station
10+10.68	11+76.23

POWERLINE CHANNEL (Looking Upstation)

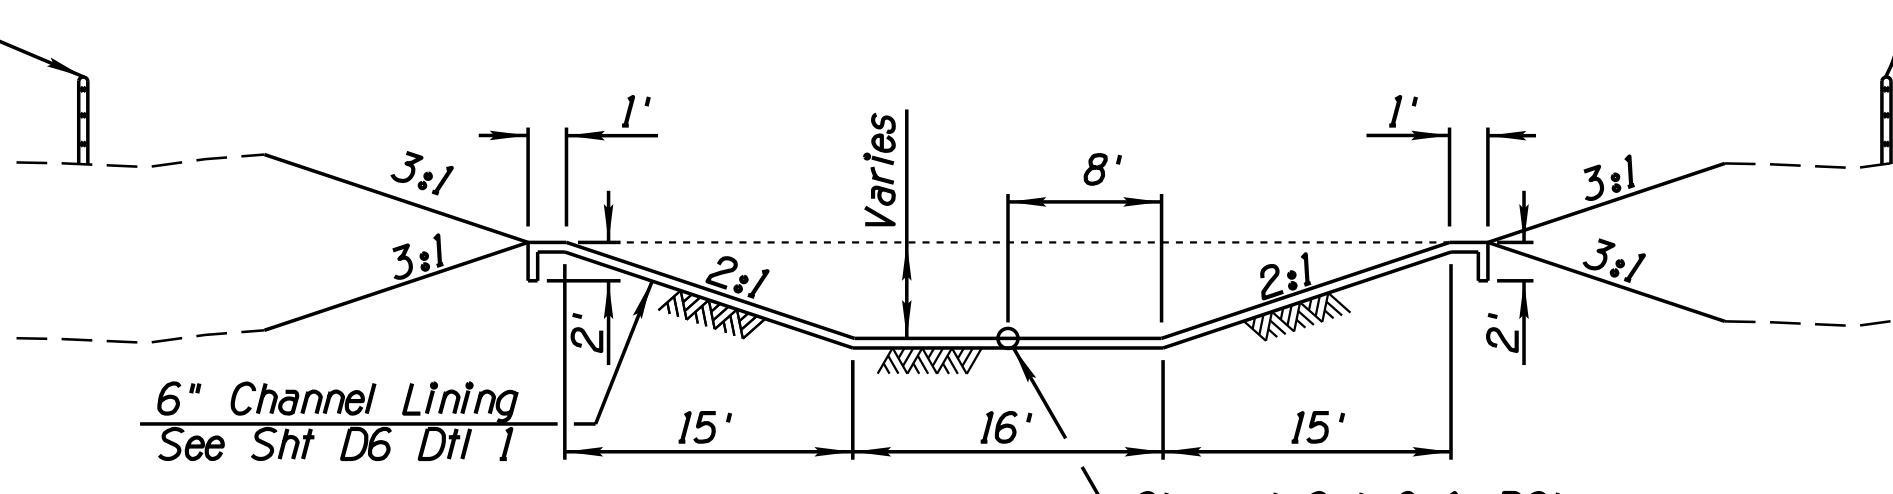

HUALAPAI CHANNEL (Looking Upstation)


*Varies from Sta 101+90.00 to Sta 102+51.38

UNION HILLS CHANNEL TYPICAL SECTION DIMENSIONS


Begin Station	End Station
101+42.06	101+90.00

UNION HILLS CHANNEL TYPICAL SECTION DIMENSIONS

Begin Station	End Station
102+76.89	111+53.58

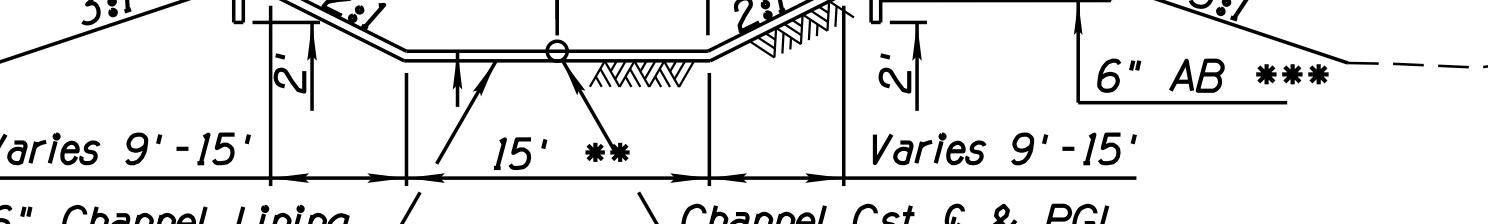


Transition to Vanes between Sta 102+76.89 to 102+26.90

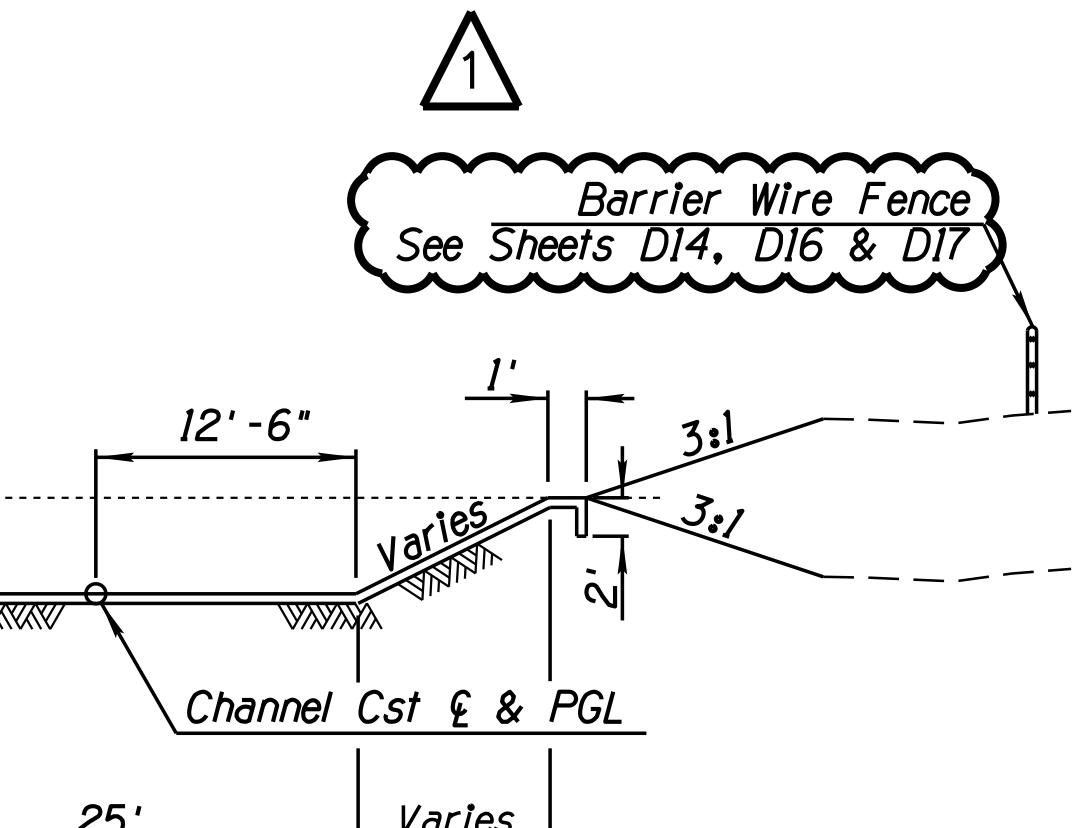


POWERLINE CHANNEL (Looking Upstation)

Scalify 1' of Soil
And Recompack To 95%
Relative Comp (Typ)

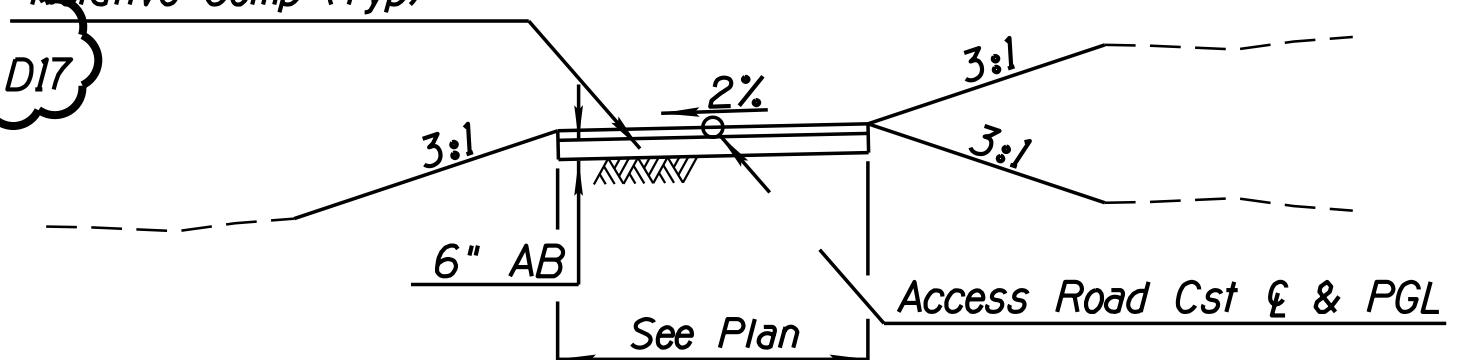


AB ACCESS ROAD (Looking Upstation)

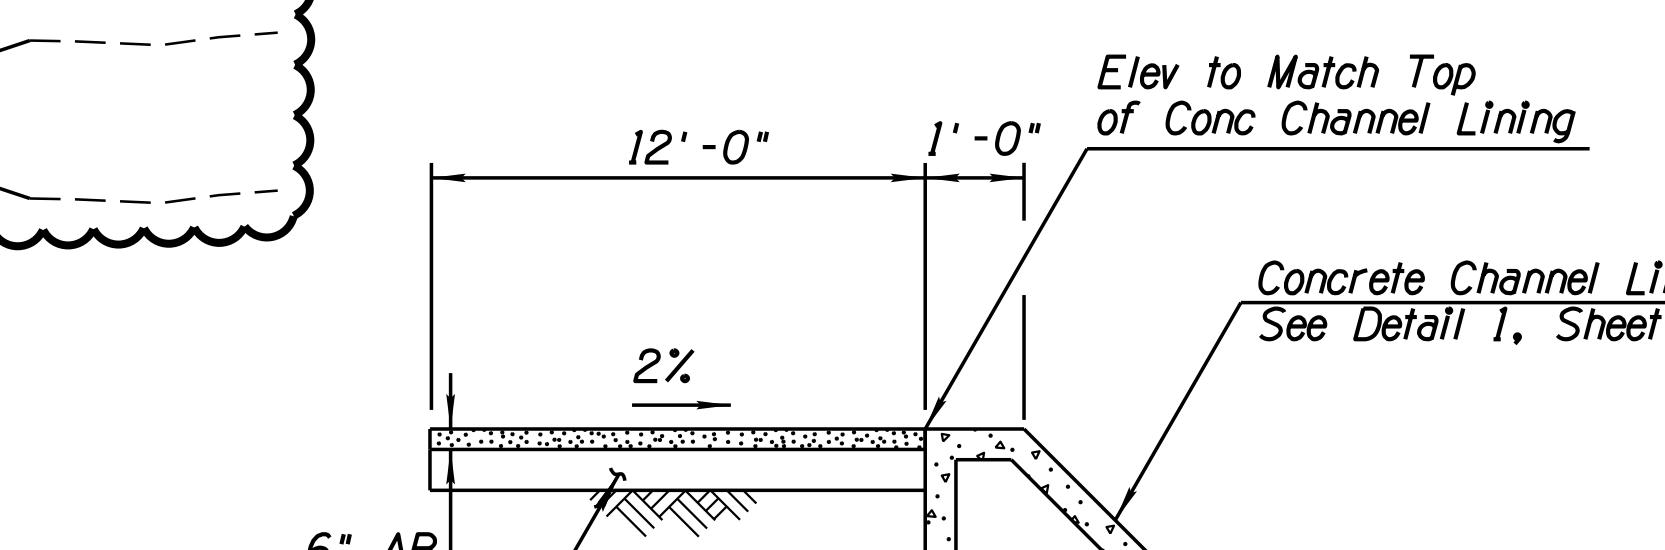

AB CHANNEL MAINTENANCE ROAD

Scalify 1' of Soil
and recompack to 95%
relative compaction.

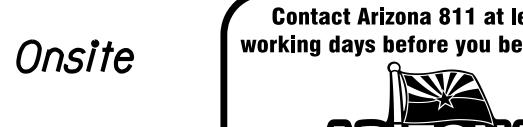

*** Option to Reuse Onsite
Asphalt Millings



DATE: 3/13/20	REVISION:	CITY COMMENTS	BY: A.S.N.
ENGINEER		PUBLIC WORKS	
REG. NO. 5986 NAME: ZEEZ SALIBA TITLE: Project Manager COMPANY: CITY OF SCOTTSDALE, ARIZONA ADDRESS: 7447 E. INDIAN SCHOOL RD., SCOTTSDALE, ARIZONA 85251		CAPITAL PROJECT MANAGEMENT	
SHEET TITLE: CHANNEL TYPICAL SECTIONS			
PROJECT TITLE: CROSSROADS EAST DRAINAGE INFRASTRUCTURE			
SCALE: N/A	DESIGNED BY: A.C.	DATE: 07/19	BID NO.: XXXX
HORIZ. VERT. N/A	DRAWN BY: W.D.F.	AS-BUILT XX/XX	SH.T. G4
PROJECT NO. 400-FB53B-56047			

2:22:50 PM

PLOT DATE: 3/13/2020

Quantity Summary Sheet.dwg

CONSTRUCTION QUANTITIES

BID ITEM NO.	BID ITEM DESCRIPTION	PLAN REF. NO.	UNITS	PLAN SHEET NUMBER																	TOTAL		
				SD1	SD2	SD3	SD4	SD5	SD6	SD7	SD8	SD9	SD10	SD11	D1	D5	D7	D8	D9	D16	D18	D19	
505192	CONCRETE CHANNEL LINING (Dtl 1 Sheet D7)		2	SY	1,872	2,675				4,183	6,233											14,963	
505191	CONCRETE MAINTENANCE RAMP (Dtl 3 Sheet D8)		4	EA	1					1												2	
625022	STORM DRAIN MANHOLE (MAG 521 & 522)		5	EA		2	2	2														6	
505131	CONCRETE HEADWALL (Dtls on Sheet D9)		6	EA		1																1	
621060	60'' CMP		8	LF		264	1,800	340														2,404	
515901	ACCESS BARRIER (COS 2526)		9	EA		2																2	
220403	DUMPED RIPRAP (TYPE I, D50 = 6'')		13	CY						647			55	15	1,935	20	33					2,705	
220403	DUMPED RIPRAP (TYPE II, D50 = 9'')		13	CY						389												389	
220403	DUMPED RIPRAP (TYPE III, D50 = 12'')		13	CY											1,220							1,220	
618538	PIPE COLLAR (MAG 505)		15	EA					2													2	
310106	6'' AB ACCESS ROAD		17	SY	284	759				841		722	588	818	262	3,803						8,077	
520001	HANDRAIL (COS 2508)		19	LF	305	46													600			951	
515902	TRASH RACK		20	EA					1													1	
403710	PAINT EXISTING HANDRAIL		21	LS	1																	1	
403711	CONSTRUCT WEIR WALL		22	LS								1										1	
505608	STRUCTURAL CONCRETE			CY														15	1,289		580	81	1,965
206001	STRUCTURAL EXCAVATION			CY															10,165		2,566	1,667	14,398
206101	STRUCTURAL BACKFILL			CY															941		154	100	1,195
430009	HYDROSEEDING			ACRE													21					21	
505501	REINFORCING STEEL			LB														1,349	53,576		24,597	10,210	89,732
XXXXXX	BARRIER WIRE FENCE		23	LF															9,435				9,435
XXXXXX	WIRE FENCE GATE		24	EA															7			7	

REMOVAL QUANTITIES

BID ITEM NO.	BID ITEM DESCRIPTION	PLAN REF. NO.	UNITS	PLAN SHEET NUMBER																	TOTAL	
				SD1	SD2	SD3	SD4	SD5	SD6	SD7	SD8	SD9	SD10	SD11	D1	D5	D7	D8	D9	D16	D18	D19
350021	REMOVE CONCRETE		1	SY																		18
430621	SALVAGE AND RELOCATE NATIVE TREES (COS 2620)		3	EA	3	8		1	29	4									55			100
430602	SALVAGE AND RELOCATE NATIVE CATI (COS 2620)		7	EA					3	5									1			9
350801	REMOVALS (MISC)			LS																		1
350716	BANK EARTHWORK EXPORT			CY												244,808					244,808	
350317	SALVAGE AND RELOCATE RIPRAP		8	SY													140					140

Note: The Estimated Quantities are Shown for Informational Purposes Only. The Contractor Shall be Responsible for the Completeness and Accuracy of a Detailed Estimate Based on these Plans.




DATE: 3/13/20	REVISION:	CITY COMMENTS	BY: A.S.N.
ENGINEER		PUBLIC WORKS	
Project Name: 169678-Drainage\Sheet F1\Crossroads East\CAD\Sheets		CAPITAL PROJECT MANAGEMENT	
Address: 7447 E. INDIAN SCHOOL RD., SCOTTSDALE, ARIZONA 85251		SHEET TITLE	
Expedited Drawings		PROJECT TITLE	
Signature: ZEEZ SALIBA		CROSSROADS EAST DRAINAGE INFRASTRUCTURE	
SCALE HORIZ. N/A	DESIGNED AC DRAWN JJP	DATE 07/19 AS-BUILT XX/XX	BID NO. XXXX PROJECT NO. 400-FB53B-56047
VERT. N/A		SHT. G5	5 of 38

6:54:34 AM

PLOT DATE: 3/13/2020

DESIGN FILE: W:\P\POJ\169678-Crossroads.East\CAD\Sheet Files\Drainage\169678-G6_Channel_Geo_01.dgn

Crossroads East Control		
Point	Northing	Easting
34	965904.180	702641.017
35	968545.852	702640.246

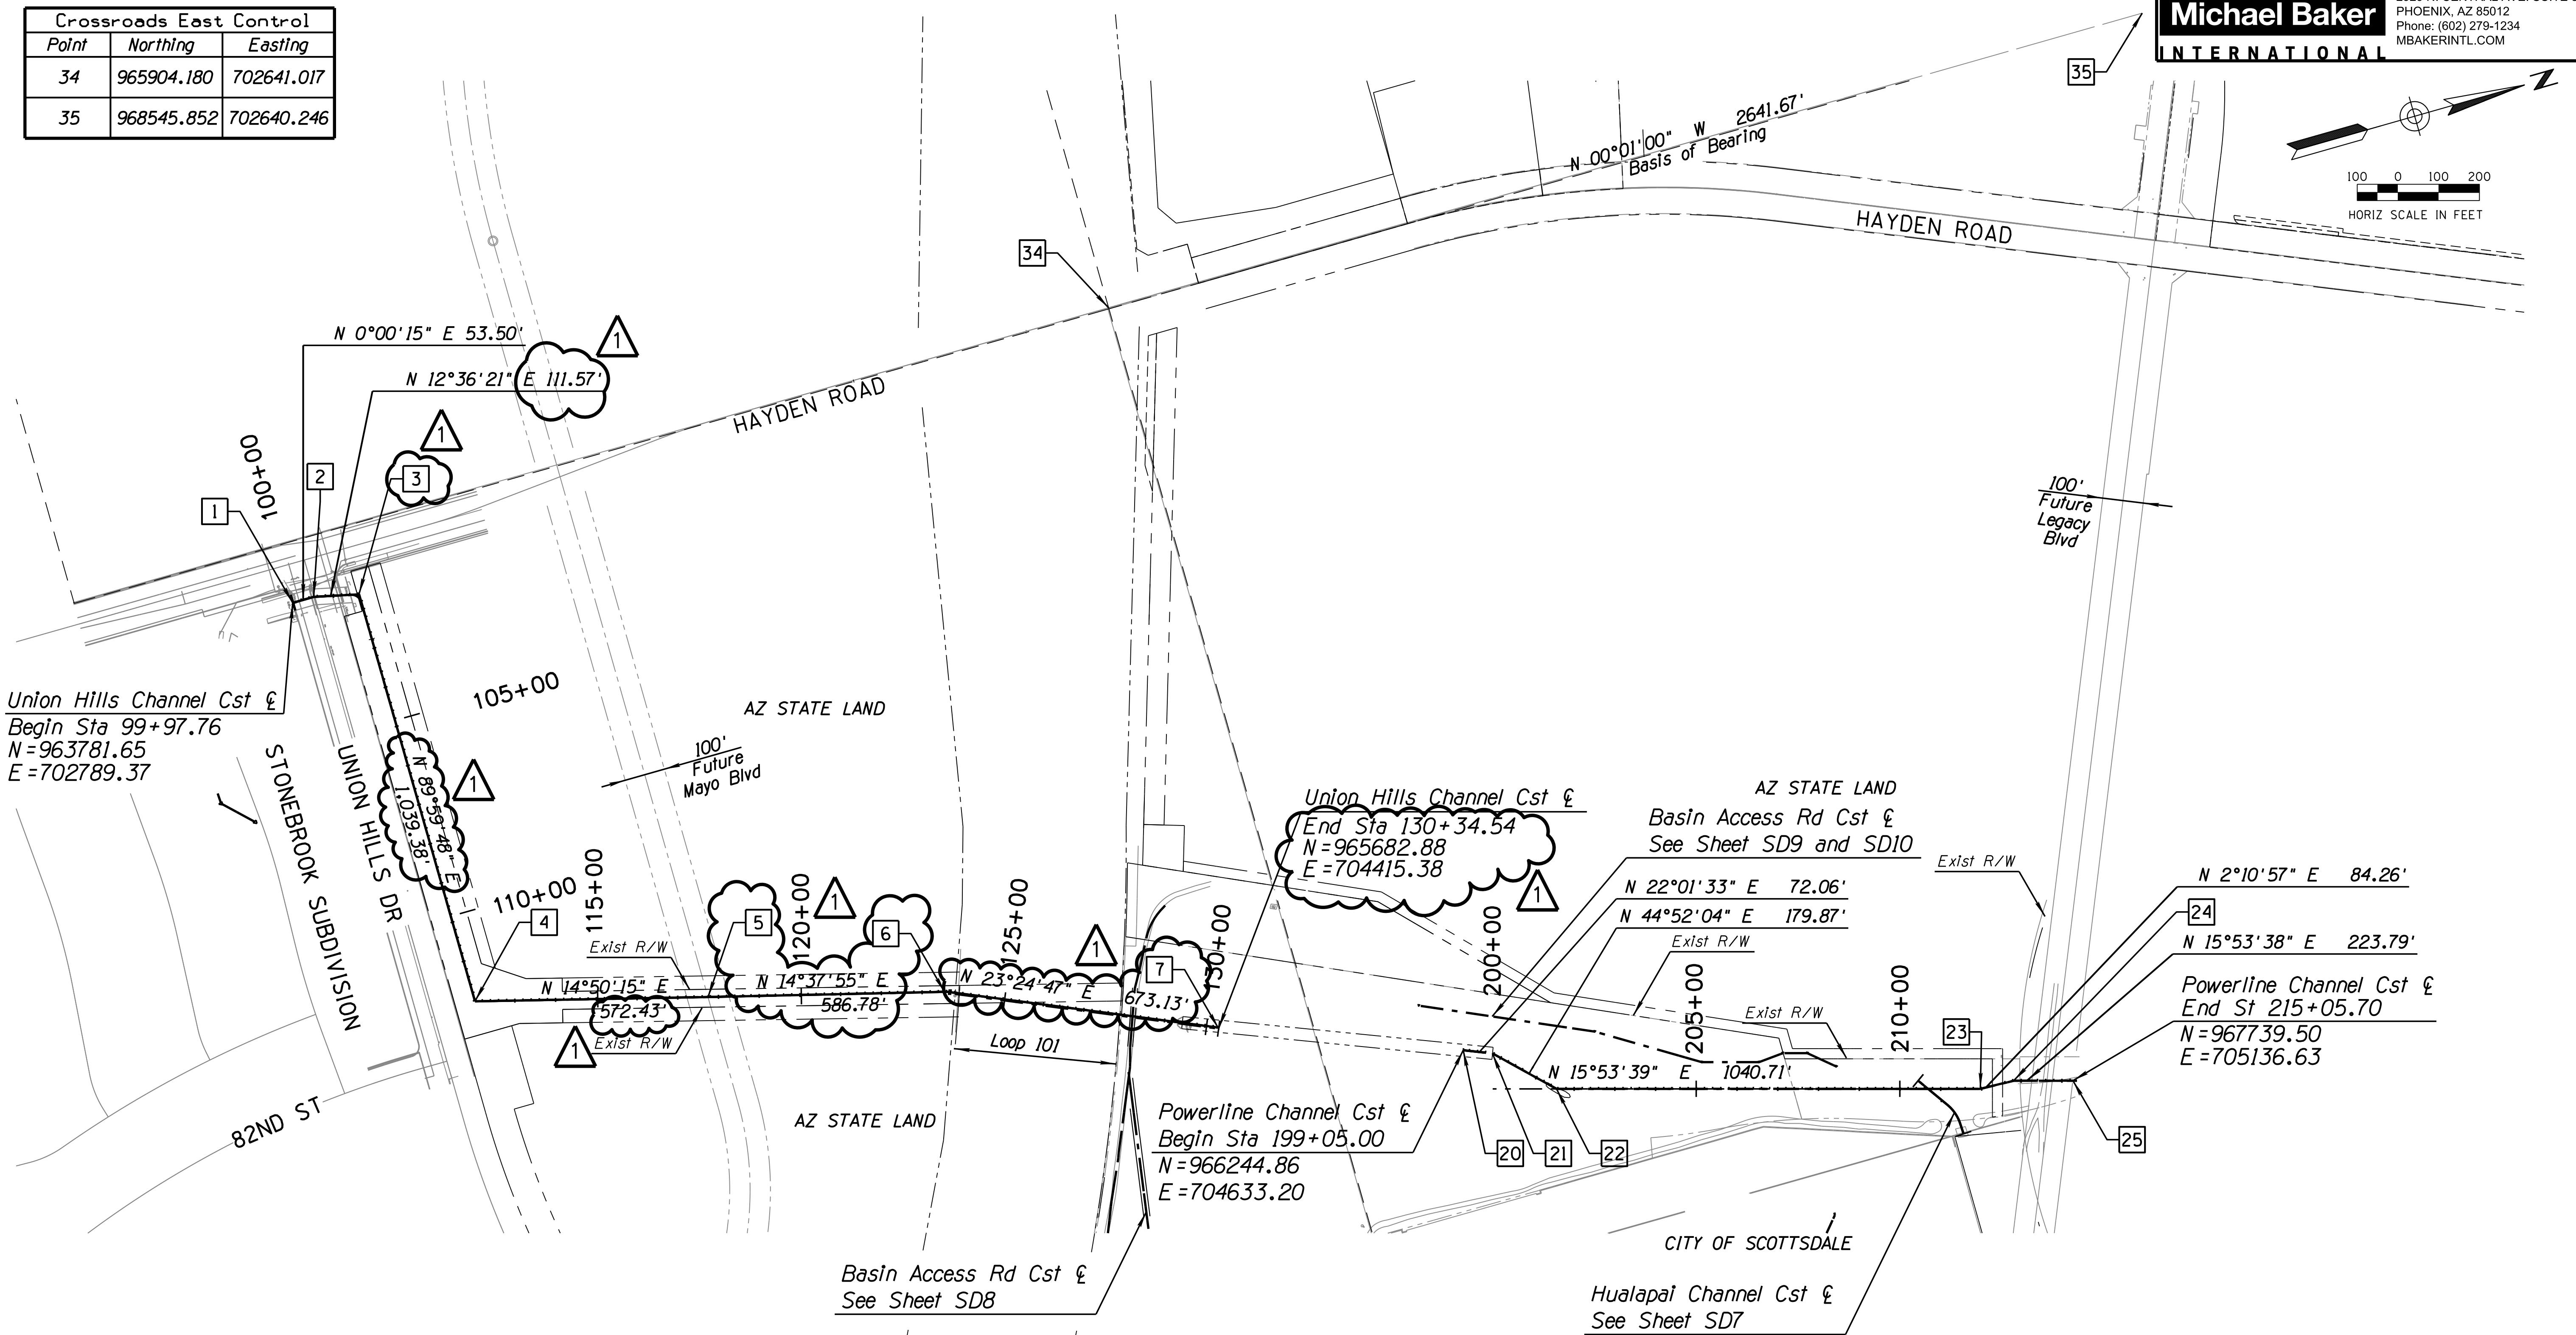

Union Hills Channel Point Table			
Point	Northing	Easting	Station
1	963781.65	702789.37	99+97.76
2	963835.15	702789.37	100+51.26
3	963944.03	702813.72	101+62.83
4	963944.09	703853.10	112+02.21
5	964497.43	703999.68	117+74.64
6	965065.18	704147.91	123+61.42
7	965682.88	704415.38	130+34.54

Powerline Channel Point Table			
Point	Northing	Easting	Station
20	966244.86	704633.20	199+05.00
21	966311.66	704660.23	199+77.06
22	966439.14	704787.13	201+56.93
23	967440.07	705072.13	211+97.64
24	967524.26	705075.34	212+81.90
25	967739.50	705136.63	215+05.70

DATE: 3/09/20 REVISION: CITY COMMENTS BY: A.S.N.

ENGINEER: JEFFREY L. COOPER, P.E. CITY OF SCOTTSDALE PUBLIC WORKS

DESIGNER: ZEEZ SALIBA CAPITAL PROJECT MANAGEMENT

DATE: 3/09/2020 SHEET TITLE: GEOMETRIC CONTROL PLAN

PROJECT TITLE: CROSSROADS EAST DRAINAGE INFRASTRUCTURE

SCALE: HORIZ. 1"=200'	DESIGNED AC DRAWN JJP	DATE: 07/19 AS-BUILT XX/XX	BID NO. XXXX PROJECT NO. 400-FB53B-56047	SHT. G6
VERT. N/A				

124-SA-2018 Plan Check No: 4817-18-6

124-SA-2018 DESIGN FILE: W:\P\POJ\169678-Crossroads.East\CAD\Sheet Files\Drainage\169678-G6_Channel_Geo_01.dgn

124-SA-2018

PLOT DATE: 3/13/2020 6:55:06 AM

Crossroads East Control		
<i>Point</i>	<i>Northing</i>	<i>Easting</i>
34	965904.180	702641.017
35	968545.852	702640.246


Basin Perimeter Access Road Point Table			
Point	Northing	Easting	Station
1	965047.23	706274.84	10+00.00
2 PC	965043.00	706268.62	10+07.50
2 PT	965025.70	706212.97	10+66.67
3 PC	965025.45	706169.01	11+10.61
3 PT	964997.34	706100.07	11+86.90
4	964990.60	706093.10	11+96.59
5 PC	964808.84	705905.08	14+58.10
5 PT	964792.73	705681.08	17+01.93
6	964955.80	705455.00	19+80.63

Basin Perimeter Access Road Point Table			
Point	Northing	Easting	Station
7	965126.11	705143.29	23+35.
8	965146.45	705103.09	23+80.
9	965151.99	705094.36	23+91.
10	965212.62	704974.80	25+25.
11	965260.27	704880.71	26+30.
12	965312.76	704752.75	27+69.


Basin Perimeter Access Road Point Table				
	Point	Northing	Easting	Station
9	13	965357.76	704655.45	28+76.32
4	14	965361.55	704644.93	28+87.49
9	15	965446.70	704448.44	31+01.64
3	16	965460.30	704401.71	31+50.31
1	17	965510.67	704266.34	32+94.85
2	18	965537.05	704220.90	33+47.30


Basin Perimeter Access Road Point Table			
<i>Point</i>	<i>Northing</i>	<i>Easting</i>	<i>Station</i>
19 PC	965571.41	704155.99	34+20.74
19 PT	965626.81	704097.54	35+02.28
20	965638.13	704090.74	35+15.49

Union Hills Channel Curve Data Table				
Curve No.	Radius	Delta	Length	Tangent
C1	100.00'	33°52'56"	59.14'	30.46'
C2	100.00'	43°42'33"	76.29'	40.11'
C3	175.00'	79°49'51"	243.83'	146.40'
C4	150.00'	31°08'48"	81.54'	41.81'

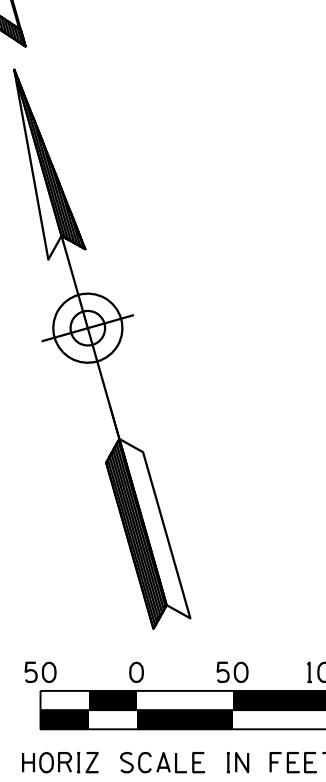

DESIGN FILE: W:\Proj\169678-Crossroads-East\CAD\Sheet Files\Drainage\169678_G7_Channel_Geo_02.dwg

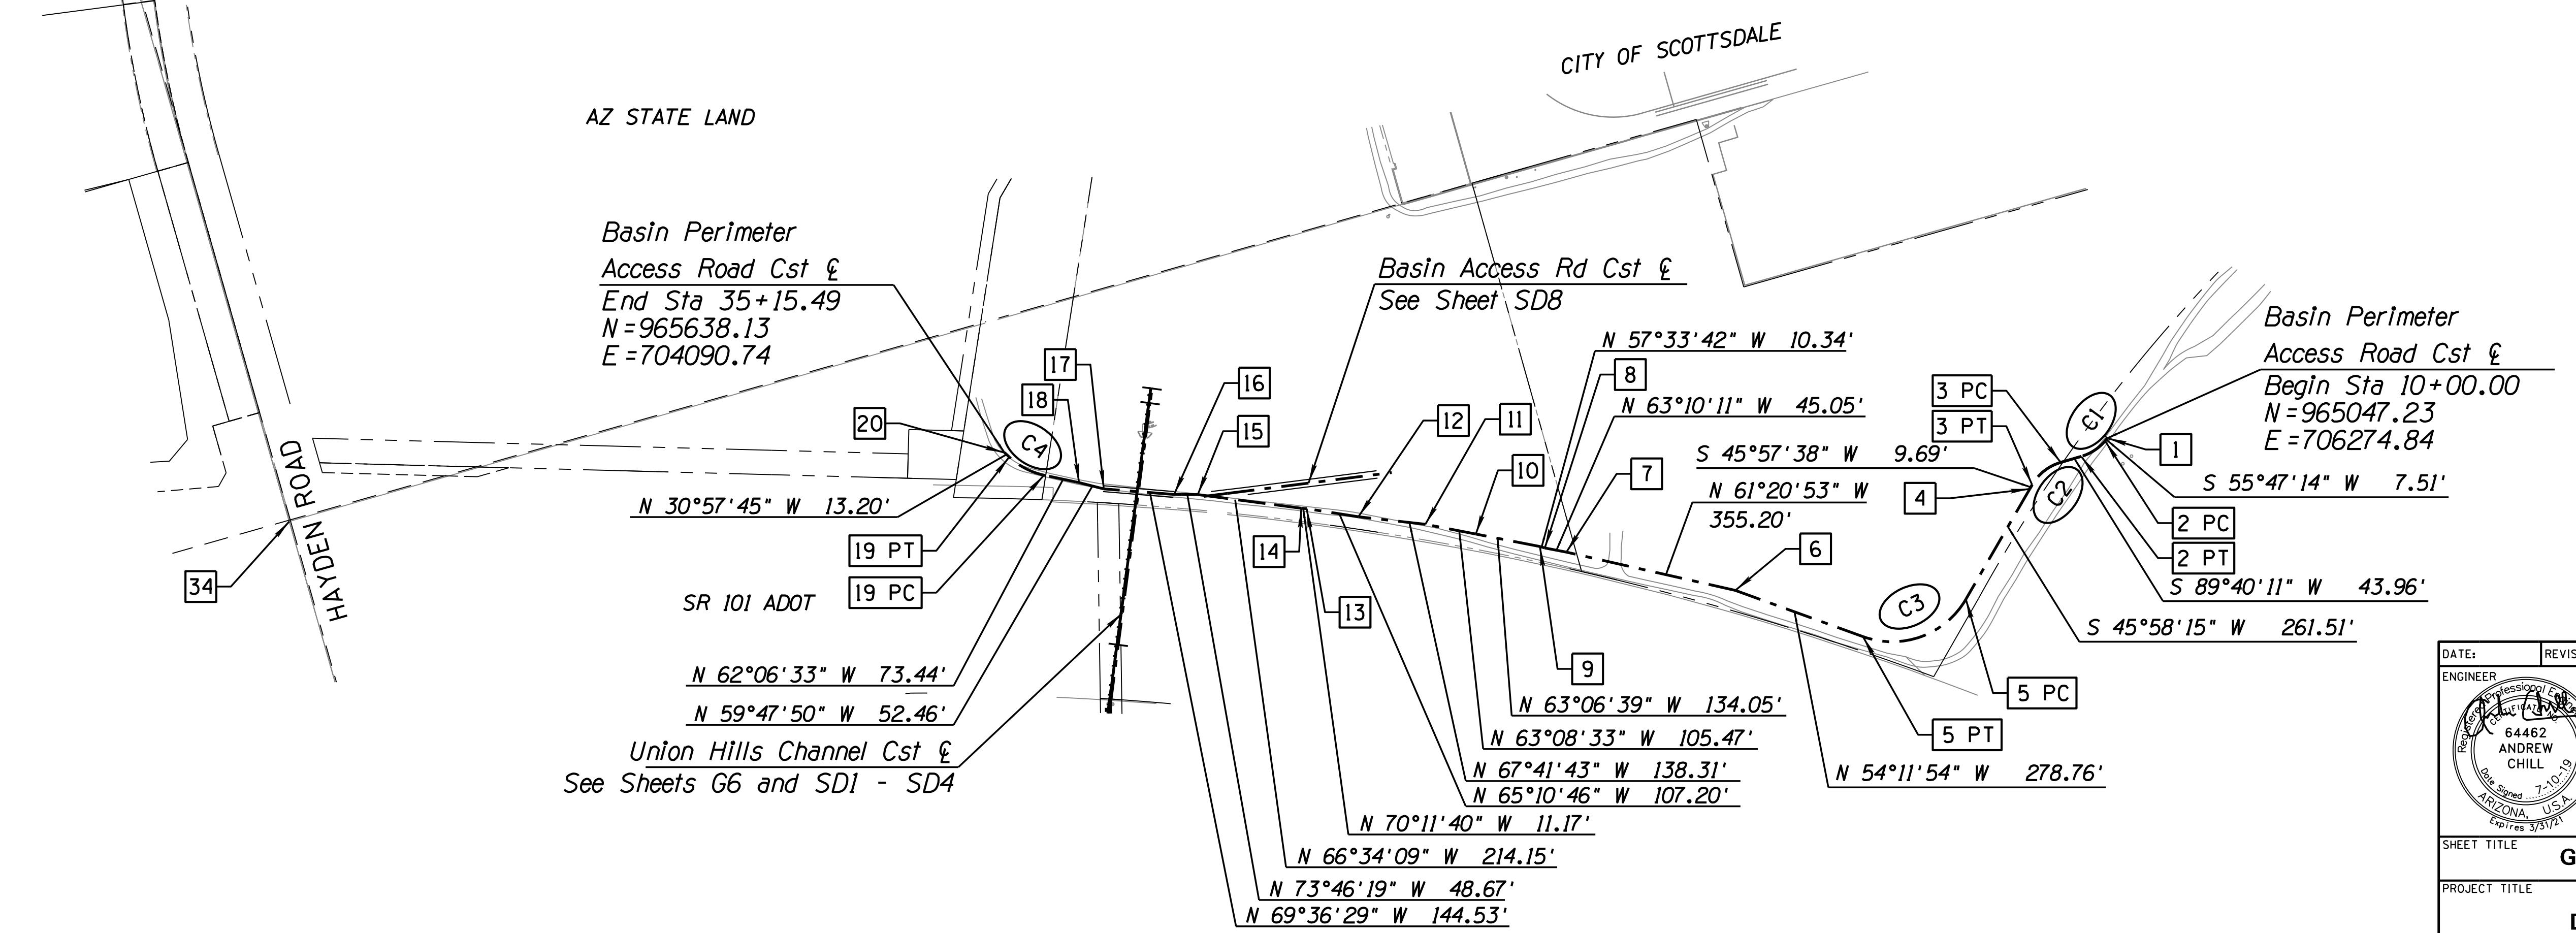


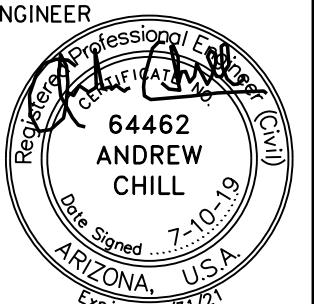DATE:	REVISION:	BY:		
		PUBLIC WORKS CAPITAL PROJECT MANAGEMENT 7447 E. INDIAN SCHOOL RD. SCOTTSDALE, ARIZONA 85251		
SHEET TITLE GEOMETRIC CONTROL PLAN PROJECT TITLE CROSSROADS EAST DRAINAGE INFRASTRUCTURE				
SCALE HORIZ. 1"=200'	DESIGNED AC	DATE 07/19	BID NO. XXXX	SHT. G7
VERT. N/A	DRAWN JJP	AS-BUILT XX/XX	PROJECT NO. 400-FB53B-56047	7 OF 36

6:55:23 AM

PLOT DATE: 3/13/2020

DESIGN FILE: W:\P\PJ\169678_Crossroads_East\CAD\Sheet Files\Drainage\169678_Rw1_Right of way.dwg

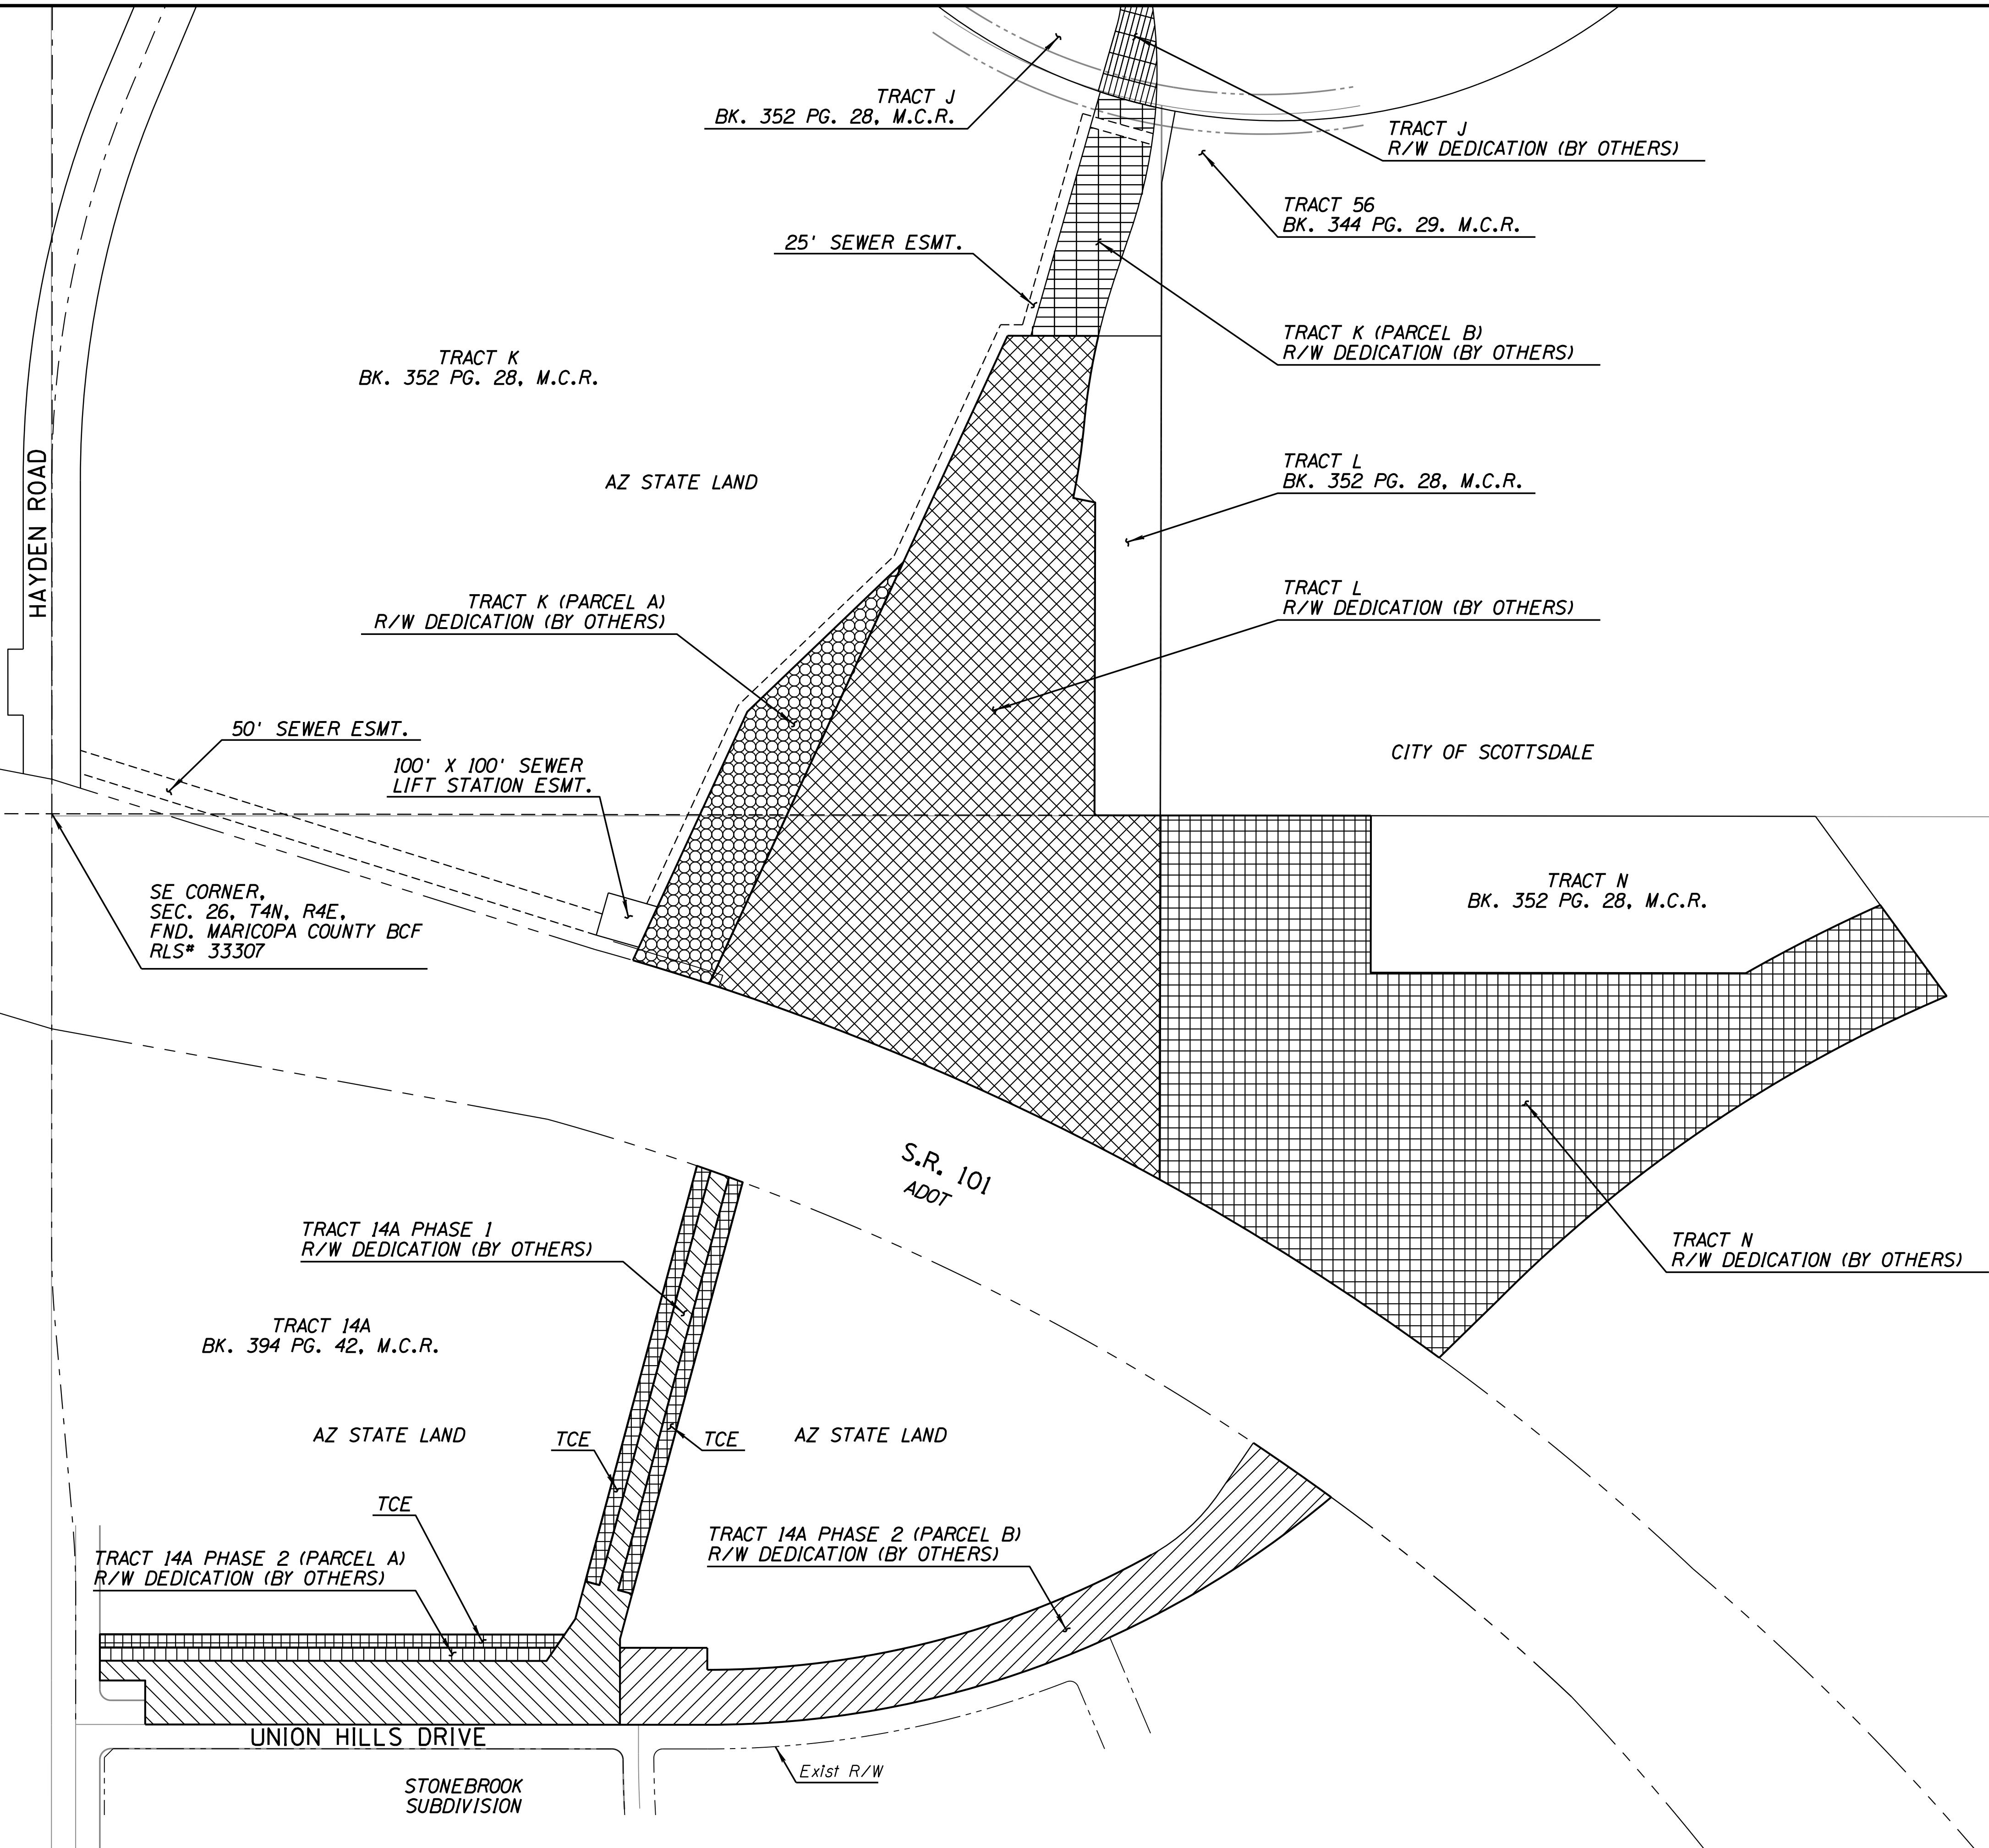

100 0 100 200
HORIZ SCALE IN FEET



DATE:	REVISION:	BY:
ENGINEER:	64462 ANDREW CHILL	7-10-19
REMOVED FROM PLAT	EXPIRES 3/31/21	SCOTTSDALE, ARIZONA 85251
SHEET TITLE: RIGHT OF WAY PLAN		
PROJECT TITLE: CROSSROADS EAST DRAINAGE INFRASTRUCTURE		
SCALE: HORIZ. 1"=200 VERT. N/A	DESIGNED AC DRAWN JJP	DATE 07/19 AS-BUILT XX/XX
		BID NO. XXXX PROJECT NO. 400-FB53B-56047
		SHT. RW1

REMOVAL & RELOCATION NOTES

Description	Unit	Quan
3 Salvage and Relocate Native Trees	EA	3

CONSTRUCTION NOTES

Description	Unit	Quan
1 Excavate Channel/Pipe	SY	2,248
2 Construct Trapezoidal Channel with Concrete, Bottom Width Per Plans	EA	1
4 Concrete Maintenance Ramp See Dtl 1 on Sheet D8	SY	284
17 6" AB Access Road per Section on Sheet G4, Width per plan	LF	305
19 Handrail per COS Std Dtl 2508 Type II, 3 Rail, and Paint SW 7055 Enduring Bronze	LS	1
21 Paint Existing Handrail, Color SW7055 Enduring Bronze	LF	650
23 Barrier Wire Fence See Sheets D16, D17 & See Detail 1, Sheet D14		





DATE: 3/13/20	REVISION:	CITY COMMENTS	BY: A.S.N.
PROJECT TITLE: UNION HILLS CHANNEL PLAN & PROFILE			
CROSSROADS EAST DRAINAGE INFRASTRUCTURE			
SCALE: HORIZ. 1"=40' VERT. 1"=8'	DESIGNED BY: AC DRAWN BY: JJP	DATE: 07/19 AS-BUILT XX/XX	BID NO. XXXX PROJECT NO. 400-FB53B-56047 SHT. SD1 9 of 38

10:17:21 AM

PLOT DATE: 3/13/2020

DESIGN FILE: W:\PJ\169678-Crossroads-East\CAD\Sheet Files\Drainage\169678_SD1_Channel.dwg

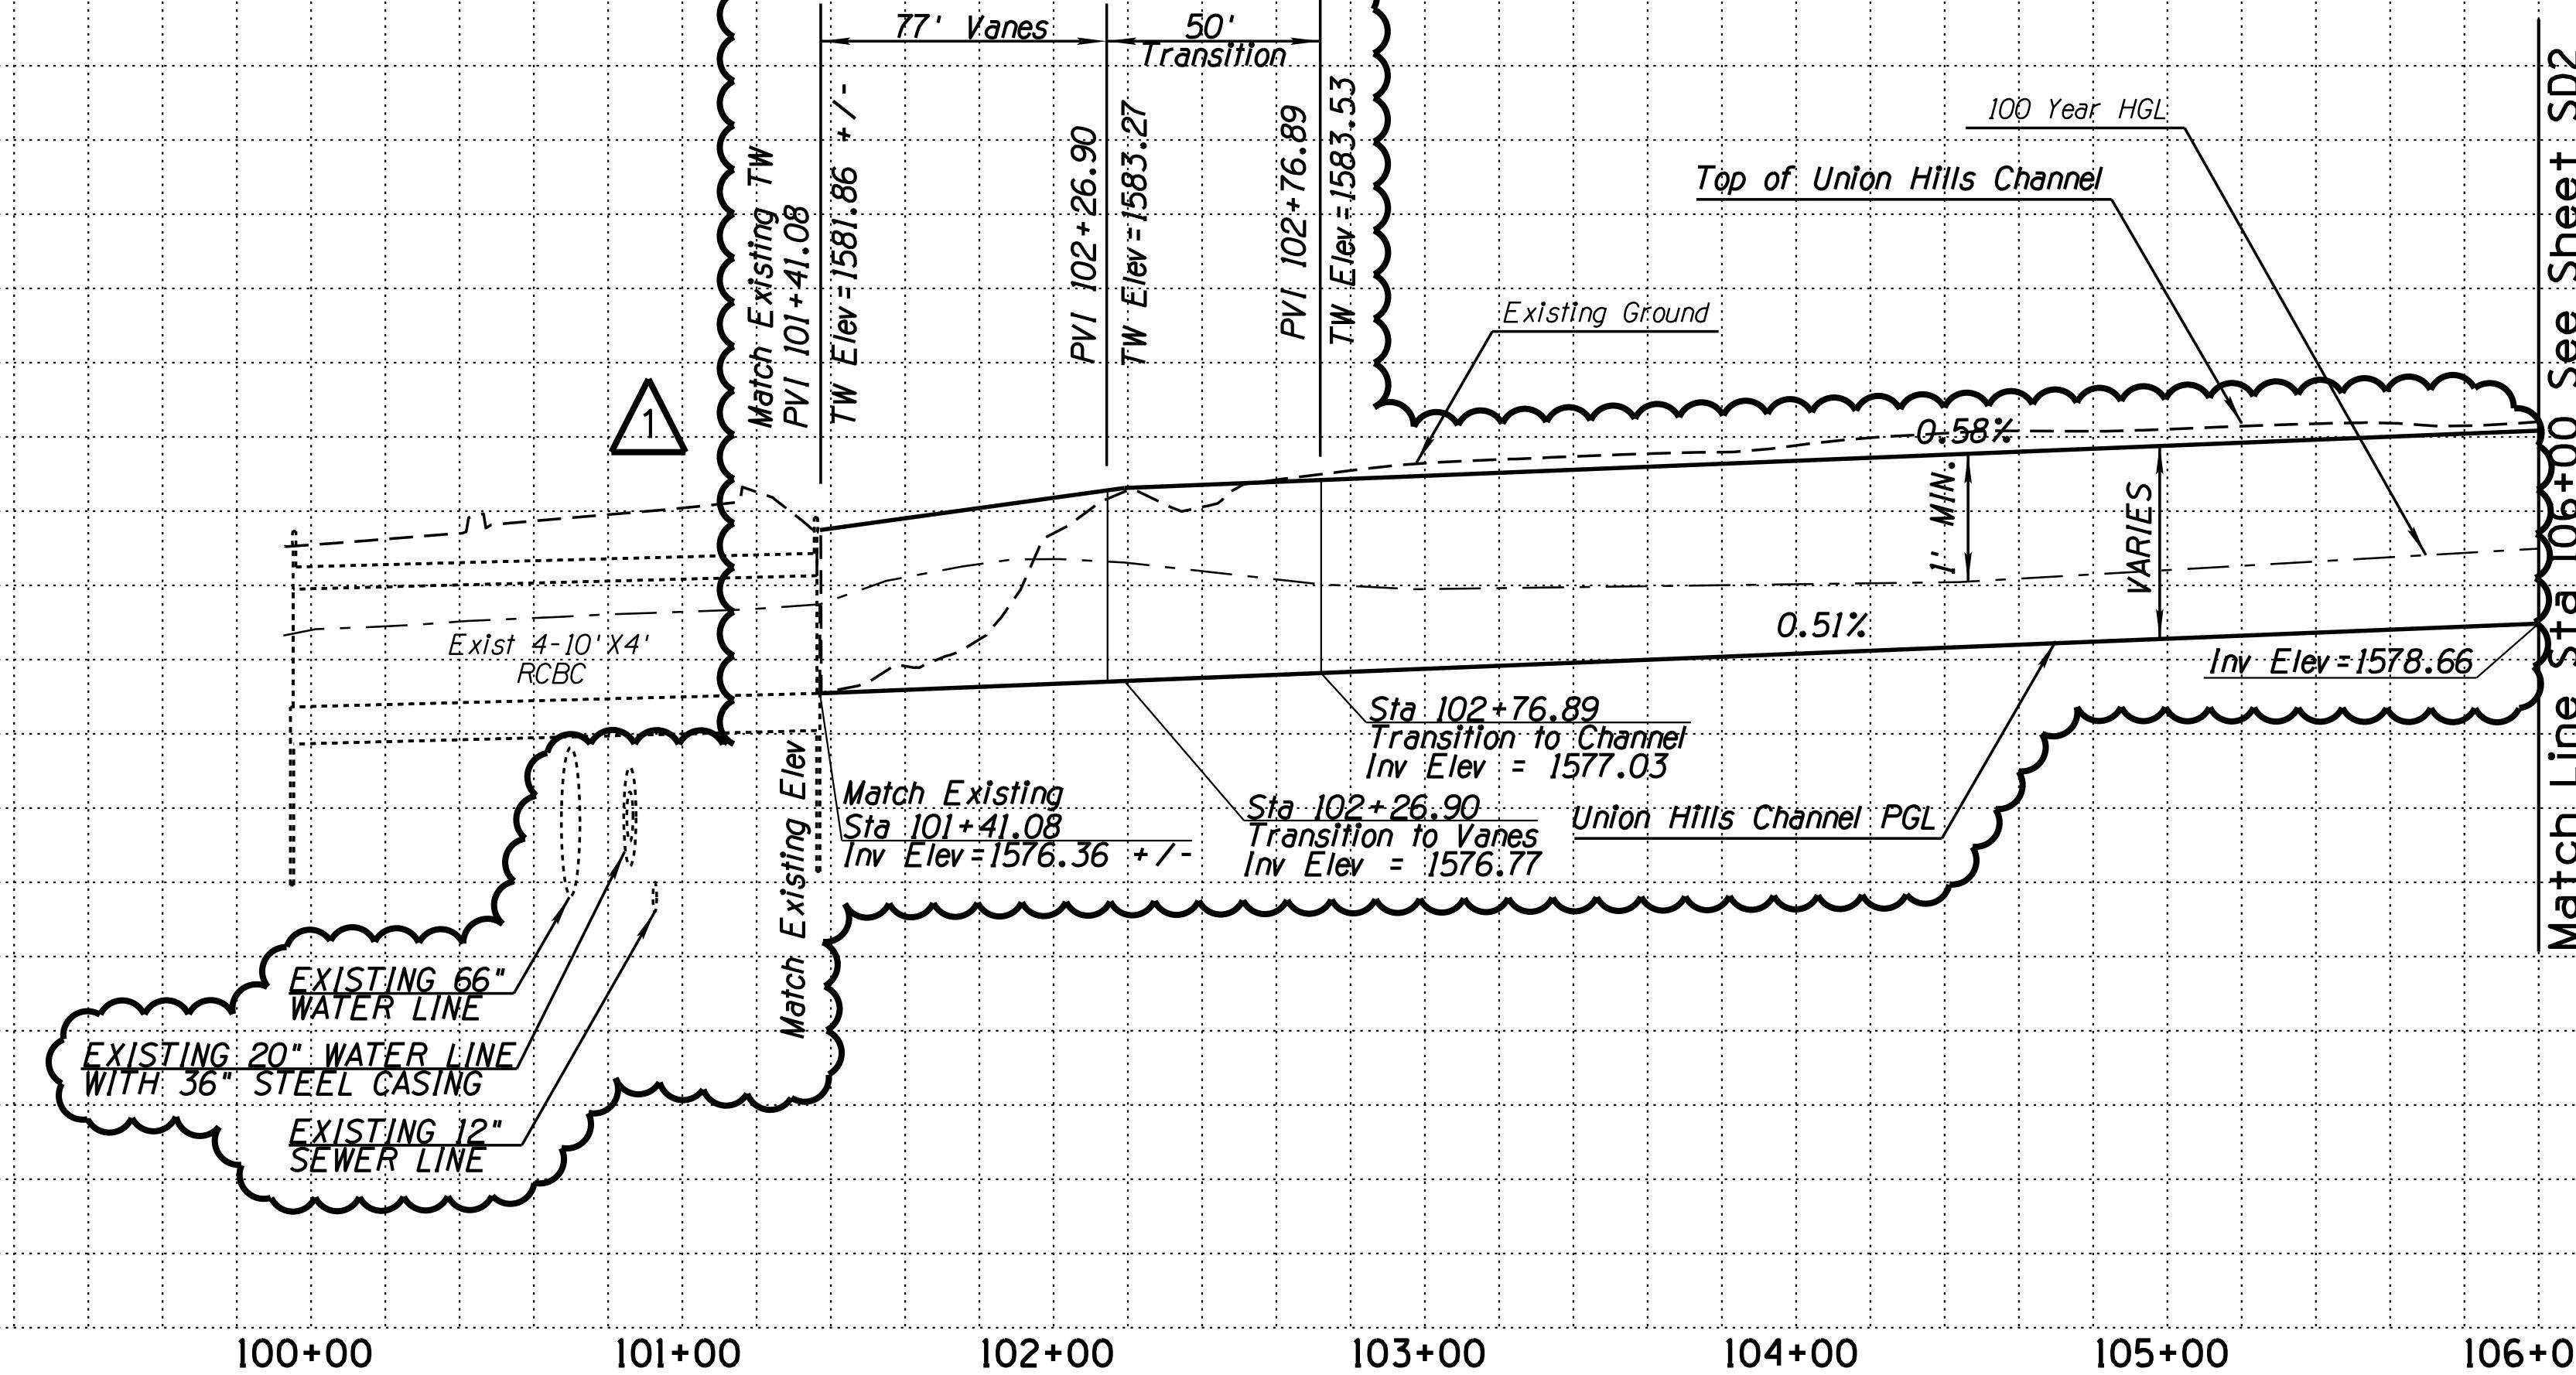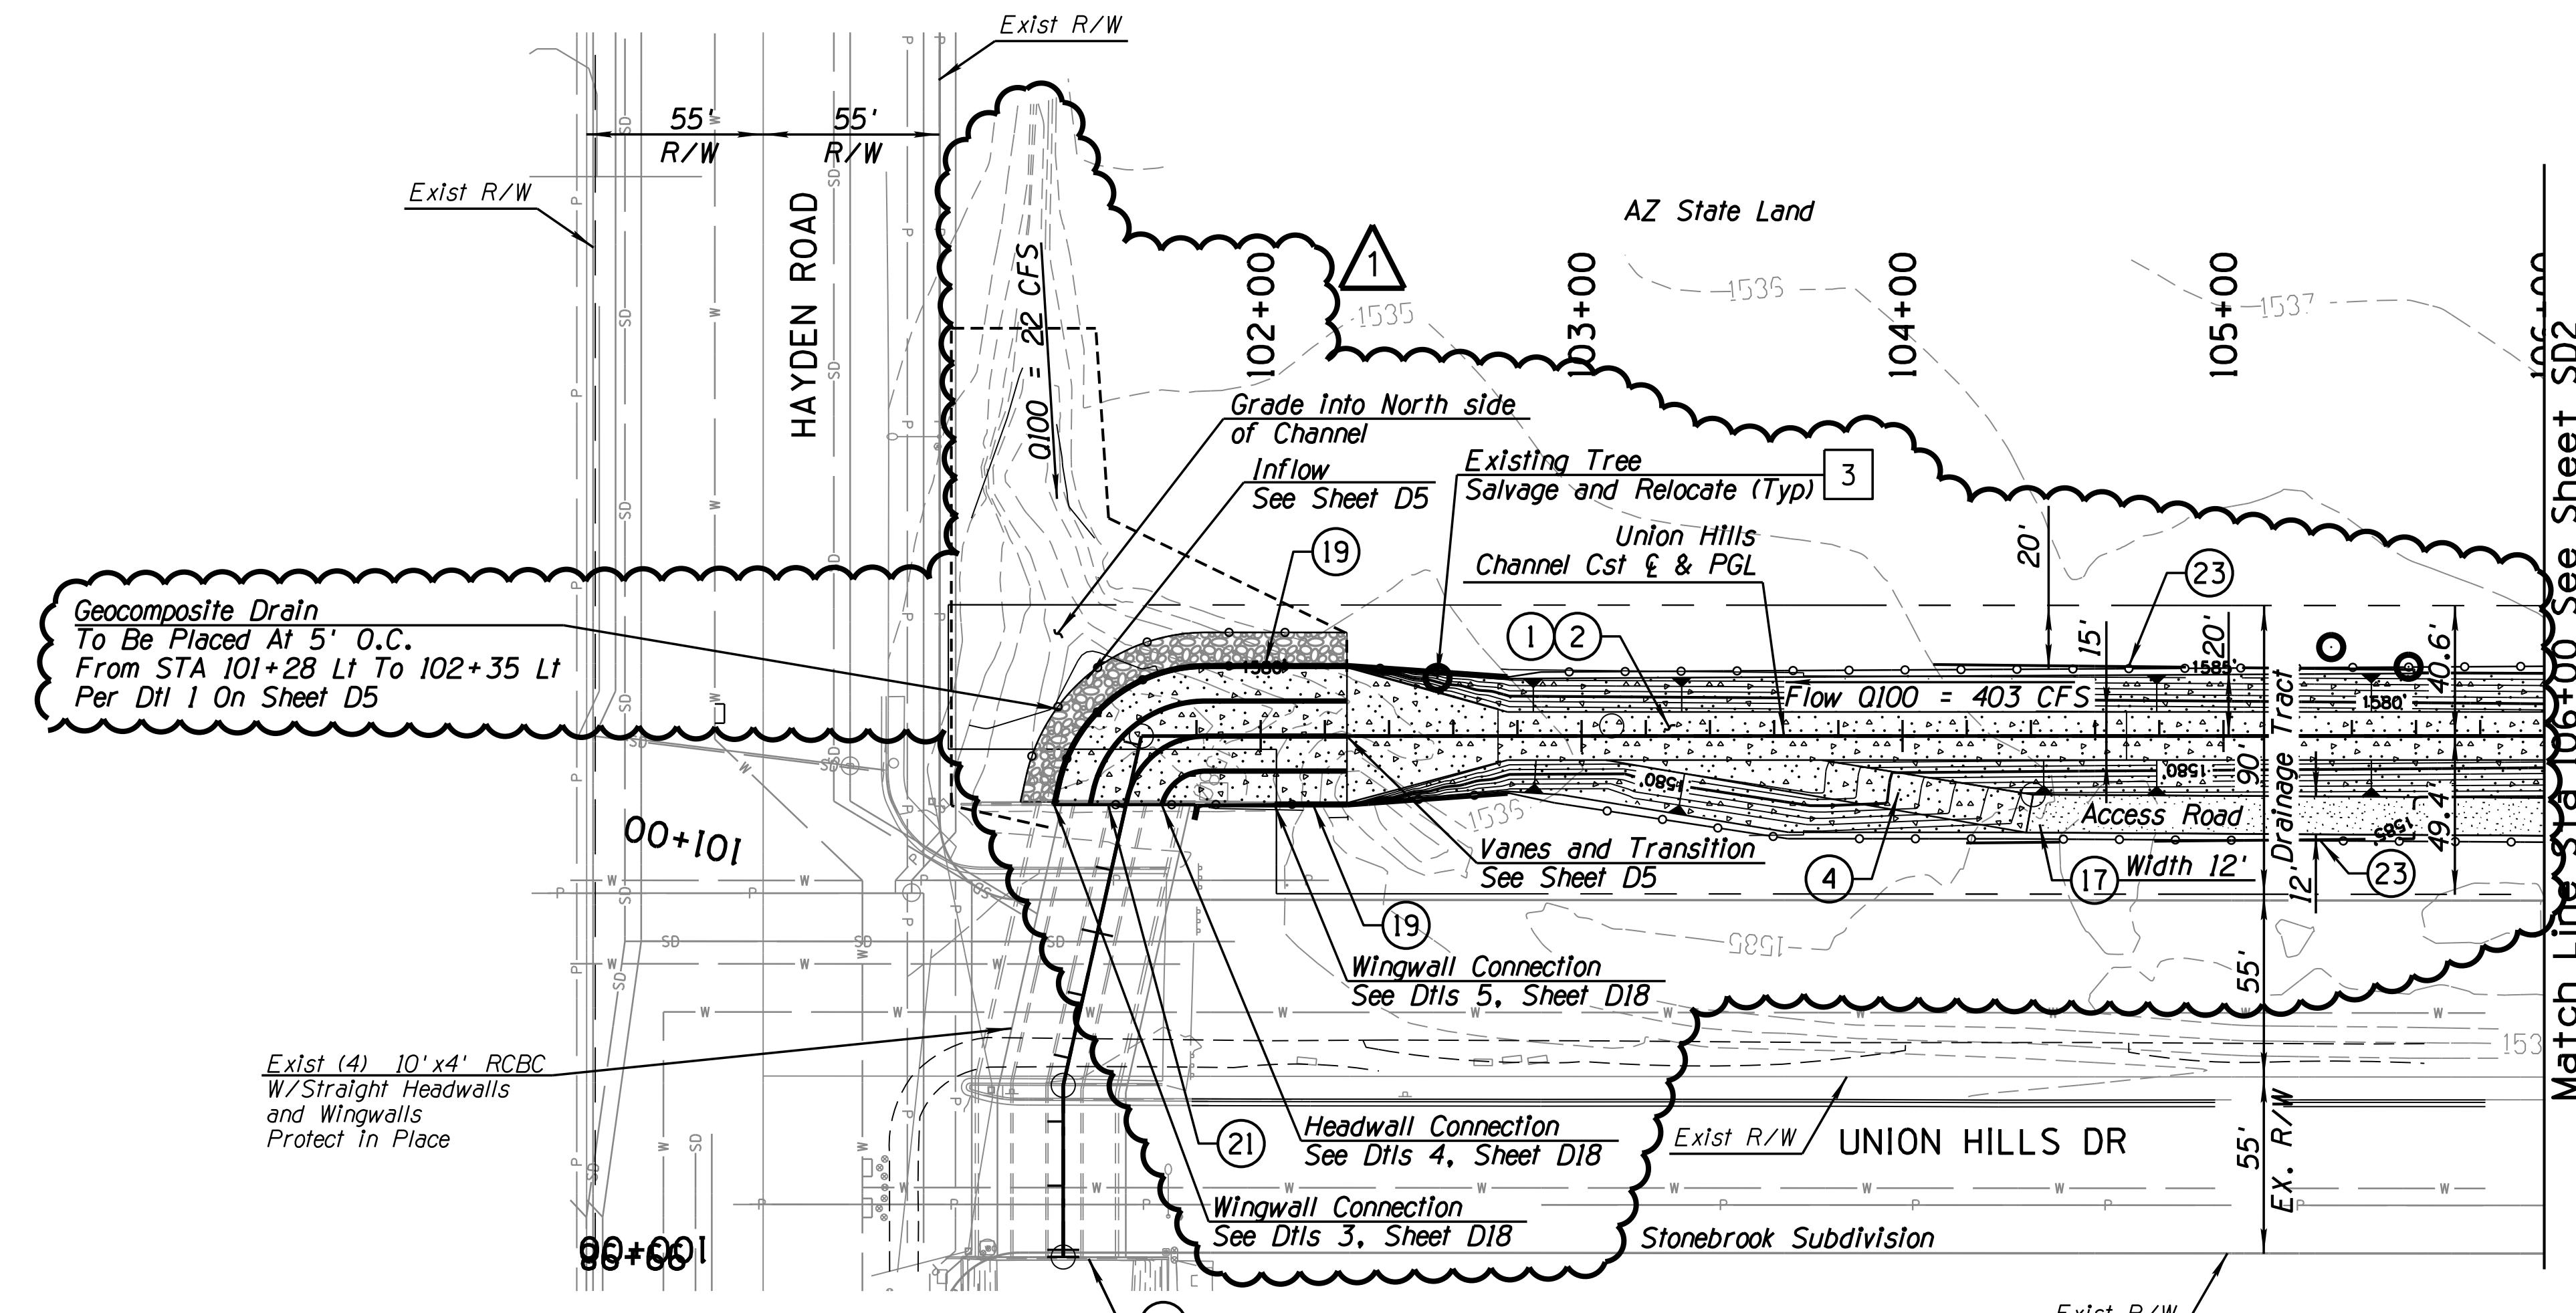


REMOVAL & RELOCATION NOTES

Description	Unit	Quan
3 Salvage and Relocate Native Trees	EA	8

CONSTRUCTION NOTES

Description	Unit	Quan
① Excavate Channel/Pipe		
② Construct Trapezoidal Channel with Concrete, Bottom Width Per Plans	SY	2,675
⑤ Manhole per MAG Std. Det 521 and 522. 30" Pressure Manhole per MAG Std Det 523-1,2 and COS Std Det 2520	EA	2
⑥ Headwall per Dtl on Sheet D8, Storm Drain Inlet Marker per COS Std Det 2560-1,2 Type A	EA	1
⑧ 2-60" CMP 16GA Galvanized Storm Drain Pipes per MAG Std. Dtl. 200-1 Type D and 510	LF	264
⑨ Install Barrier Per COS Std Dtl 2562-1,2	EA	2
⑯ 6" AB Access Road per Section on Sheet G4, Width per plan	SY	759
⑯ Handrail per COS Std Dtl 2508 Type II, 3 Rail, and Paint SW 7055 Enduring Bronze	LF	46
㉓ Barrier Wire Fence See Sheets D16, D17 & See Detail 1, Sheet D14	LF	1,110
㉔ Wire Fence Gate See Detail 2, Sheet D14	EA	1


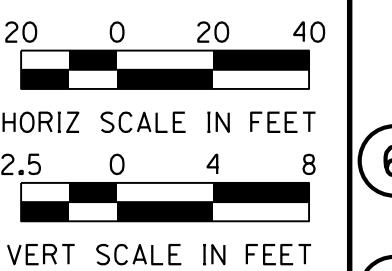


DATE: 3/13/20	REVISION:	CITY COMMENTS	BY: A.S.N.
PROJECT TITLE: CROSSROADS EAST DRAINAGE INFRASTRUCTURE			
DESIGNER: Michael Baker International	ENGINEER: Michael Baker International	CONTRACTOR: Michael Baker International	PUBLIC WORKS
REGISTRATION NO. 5986	REGISTRATION NO. 5986	REGISTRATION NO. 5986	CAPITAL PROJECT MANAGEMENT
ZEEZ SALIBA	ZEEZ SALIBA	ZEEZ SALIBA	7447 E. INDIAN SCHOOL RD., SCOTTSDALE, ARIZONA 85251
TRITONIA, USA	TRITONIA, USA	TRITONIA, USA	SHEET TITLE: UNION HILLS CHANNEL PLAN & PROFILE
EXPIRATION DATE: 3/31/20	EXPIRATION DATE: 3/31/20	EXPIRATION DATE: 3/31/20	PROJECT NO: 400-FB53B-56047
SCALE: HORIZ. 1"=40'	DESIGNED AC: DRAWN JJP	DATE: 07/19	BID NO: XXXX
VERT. 1"=8'	AS-BUILT XX/XX	SH. SD2	10 of 38

8:41:14 AM

PLOT DATE: 3/13/2020

DESIGN FILE: W:\POJ\169678_Crossroads_East\CAD\Sheet_Files\Drainage\SD2-Channel_PLPF.dgn

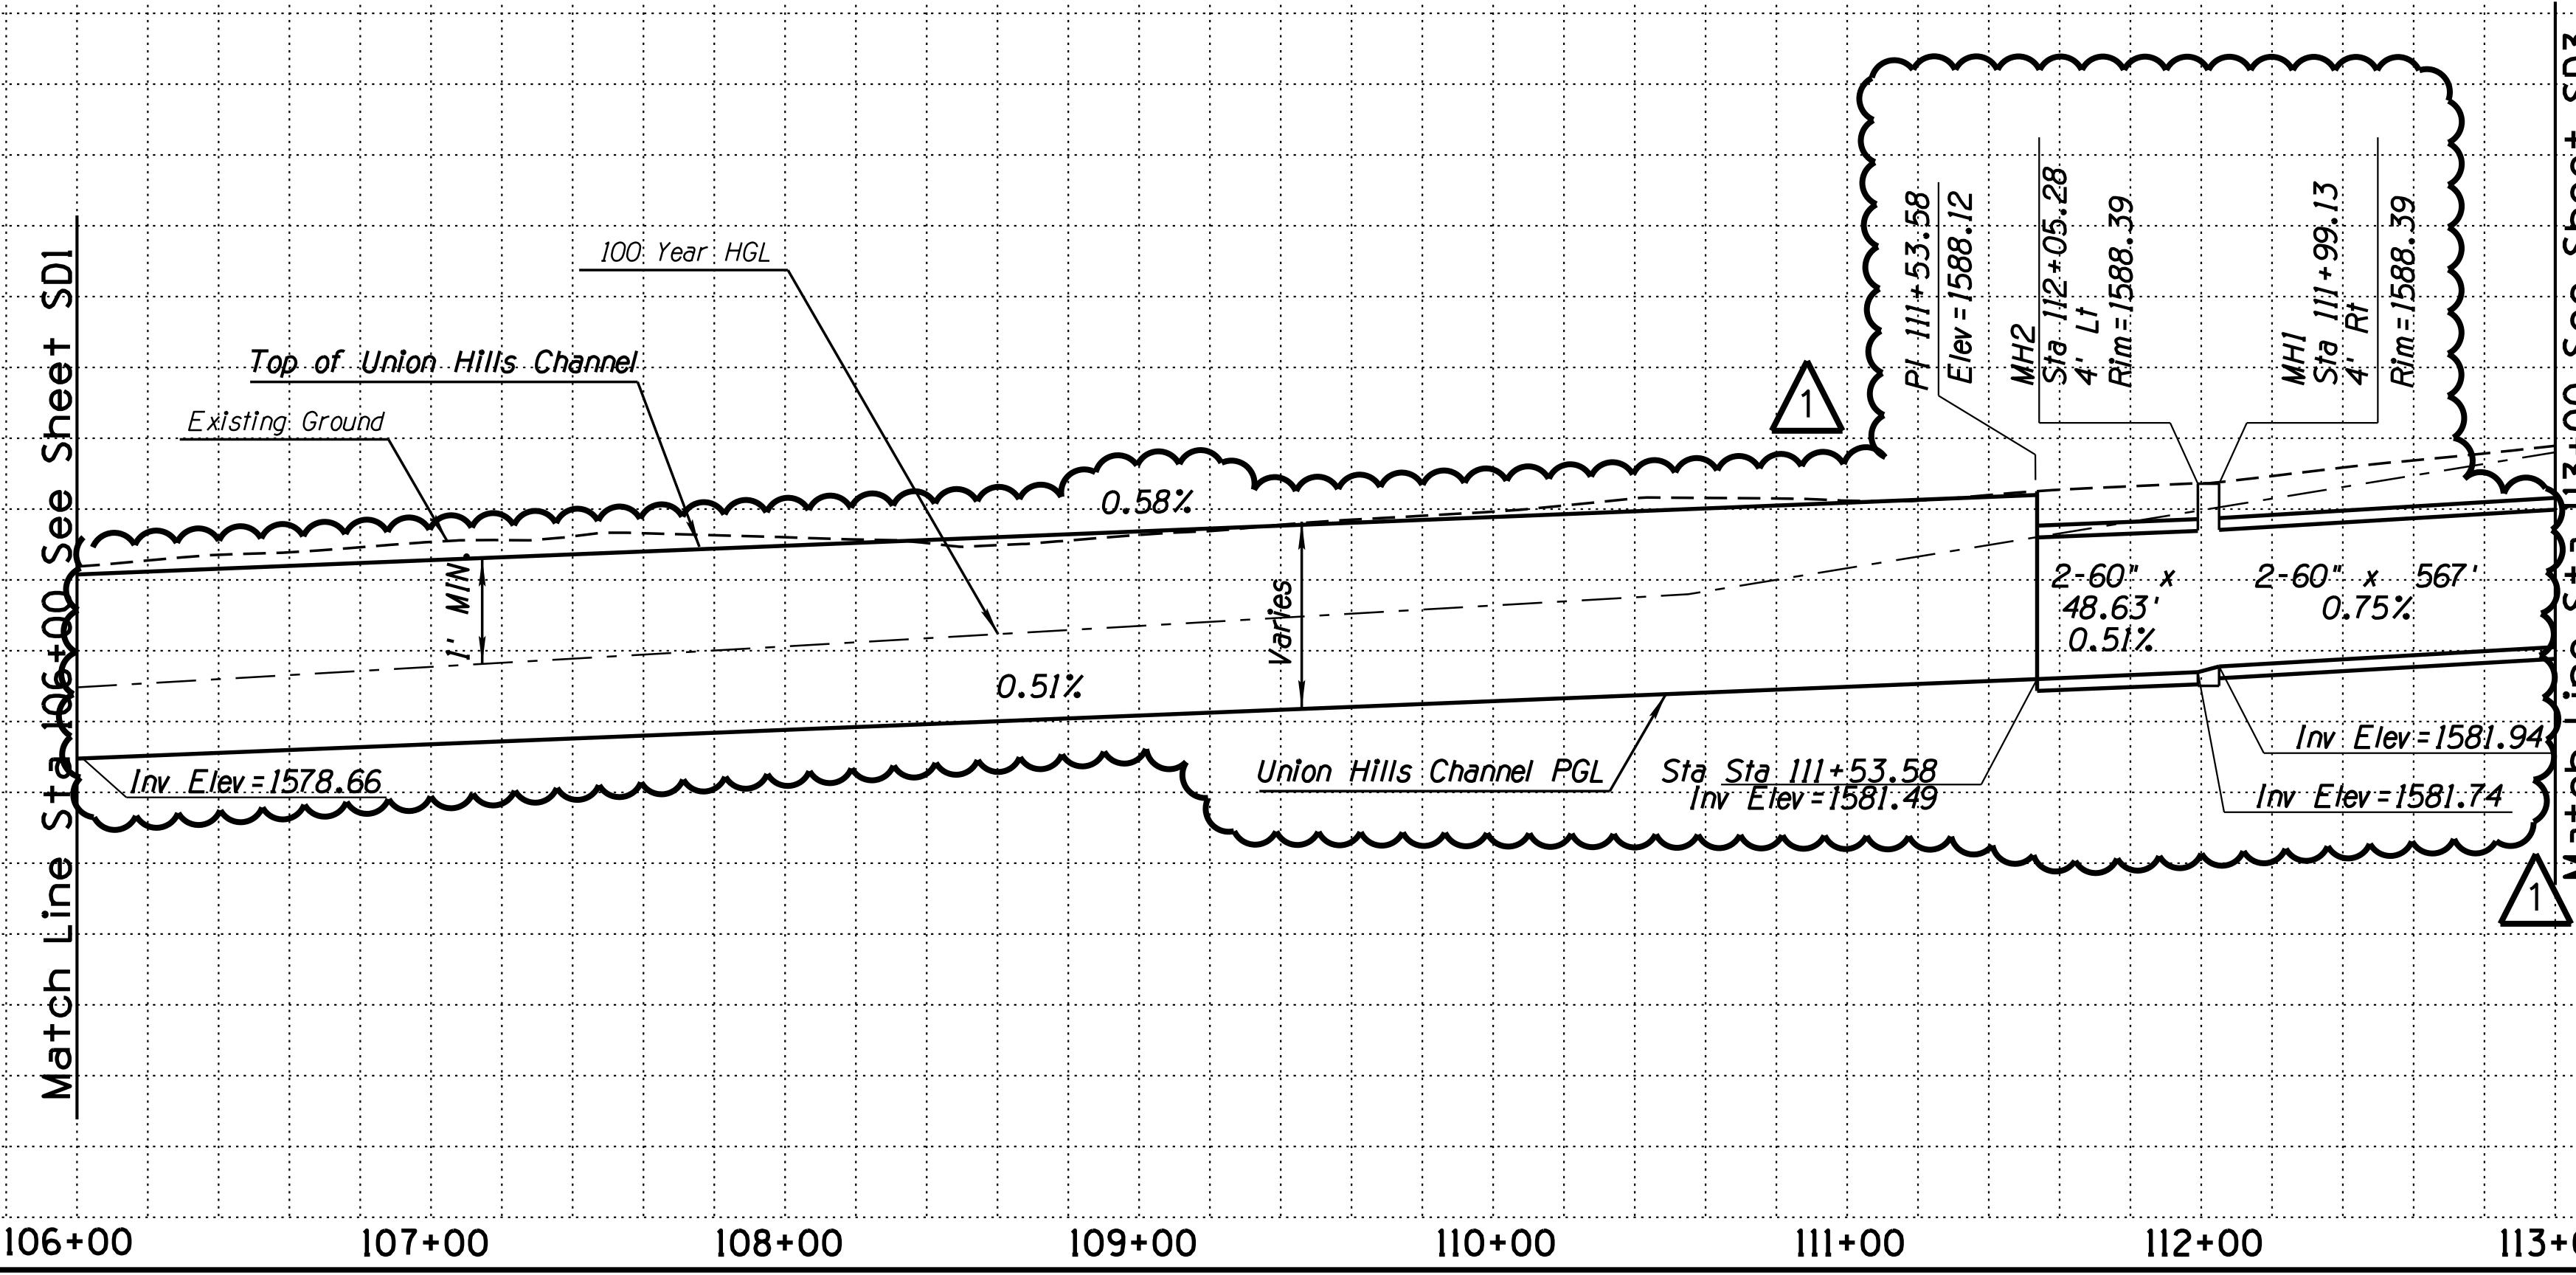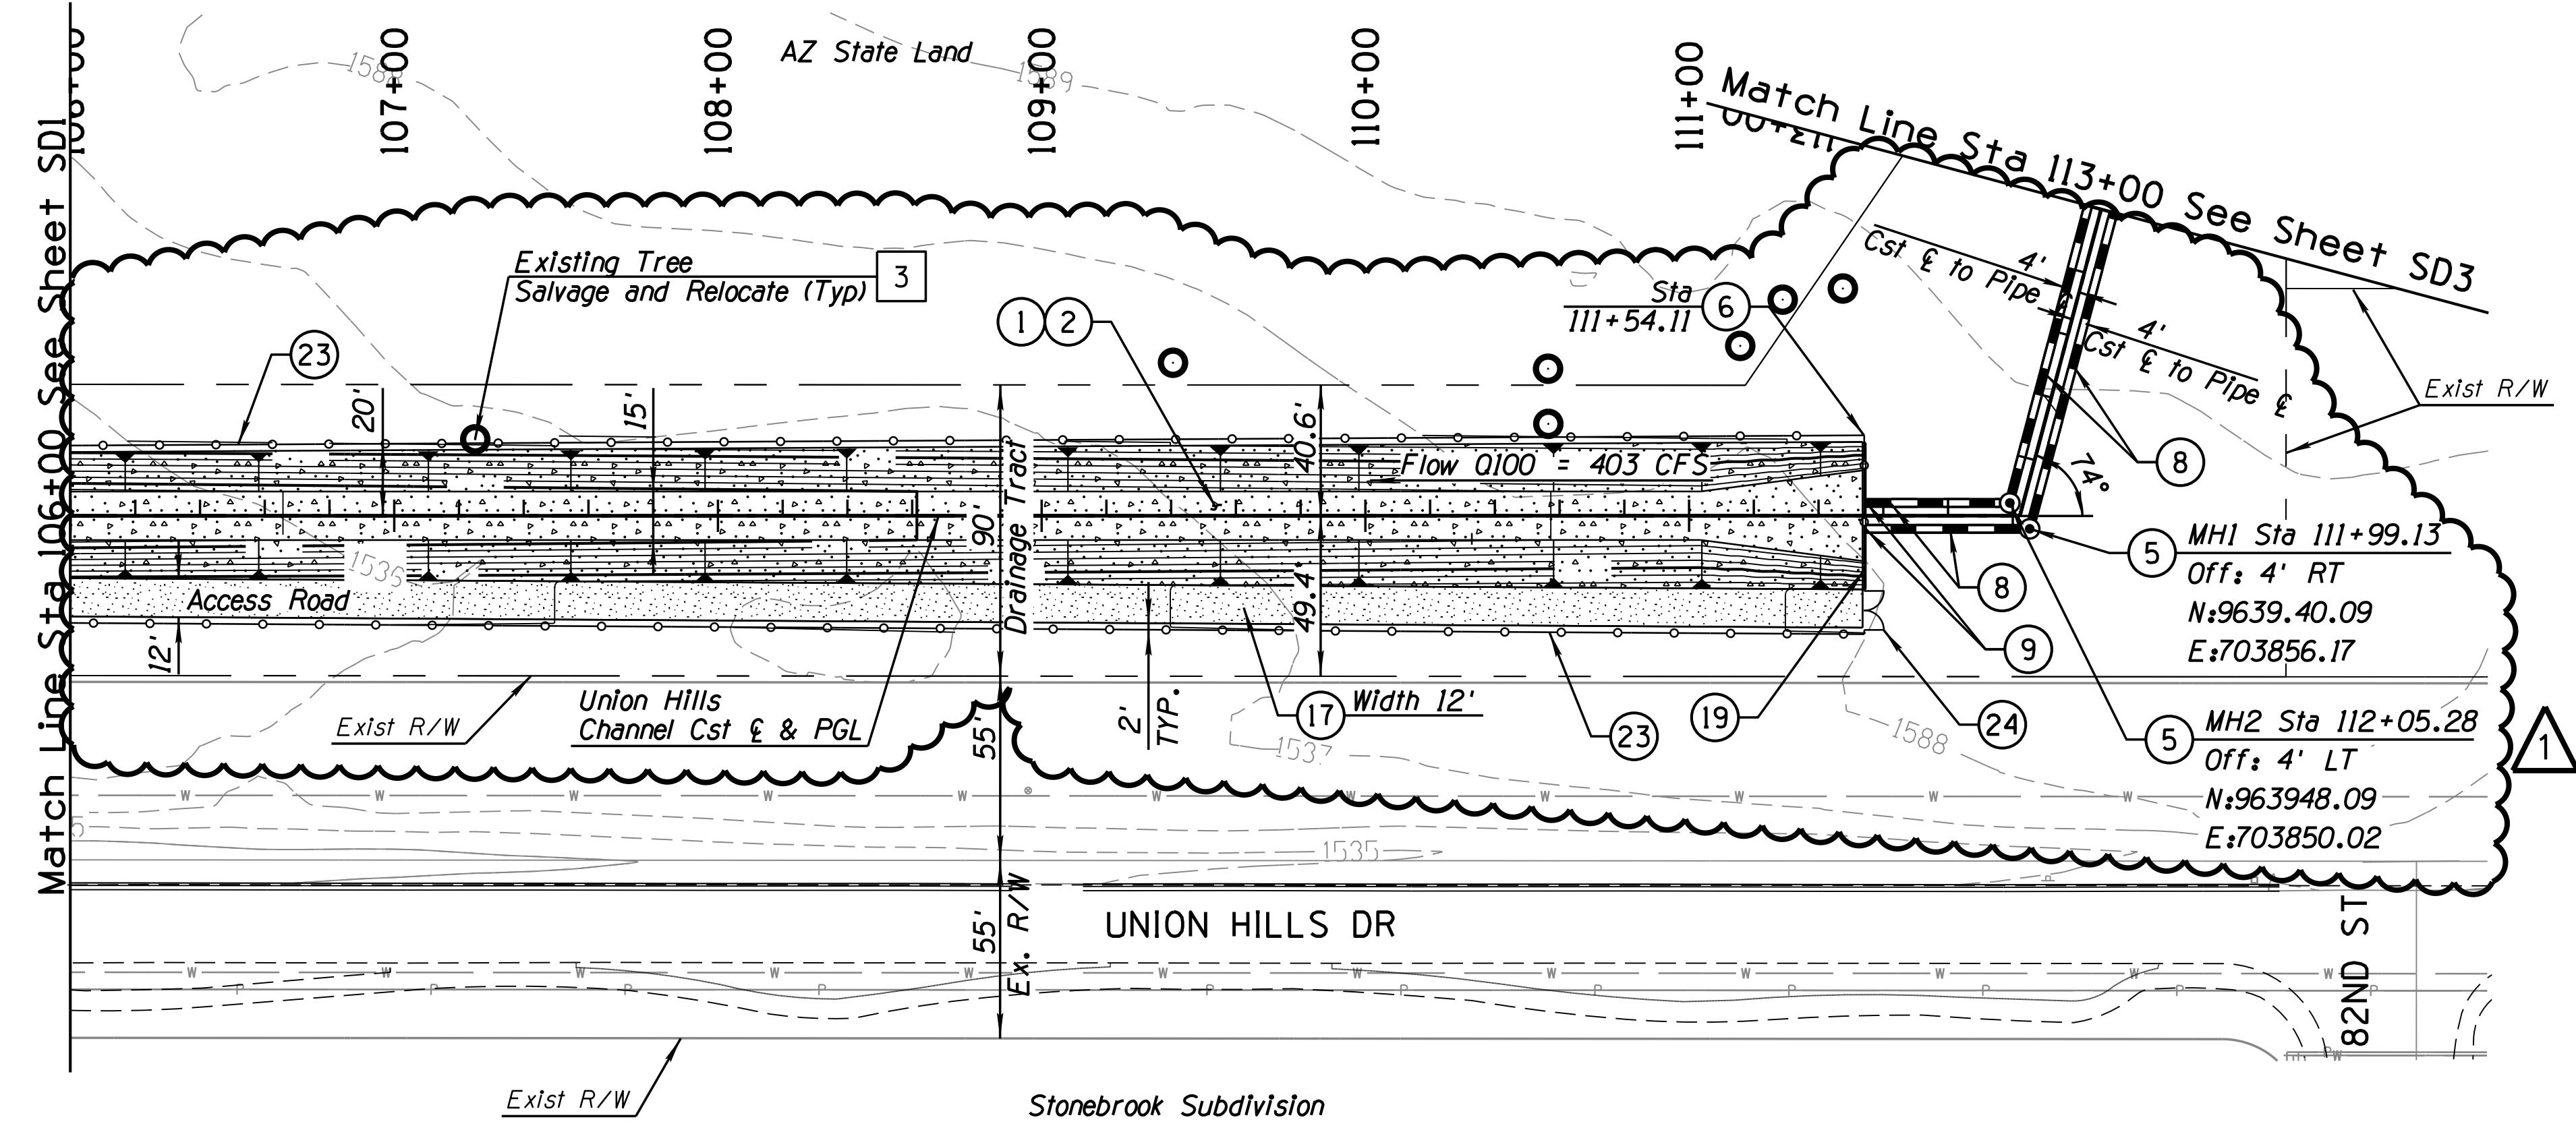


REMOVAL & RELOCATION NOTES

Description	Unit	Quan


CONSTRUCTION NOTES

Description	Unit	Quan
(1) Excavate Channel/Pipe Manhole per MAG Std. Det 521 and 522. 30" Pressure Manhole per MAG Std Dtl 523-1,2 and COS Std Det 2520	EA	2
(5) MH4 Sta 117+74.65 Off: 4' Lt Cst & PGL		
(8) 2-60" CMP 16GA Galvanized Storm Drain Pipes per MAG Std Dtl 200-1 Type D and 510	LF	1,800

20 0 20 40
HORIZ SCALE IN FEET
2.5 0 4 8
VERT SCALE IN FEET

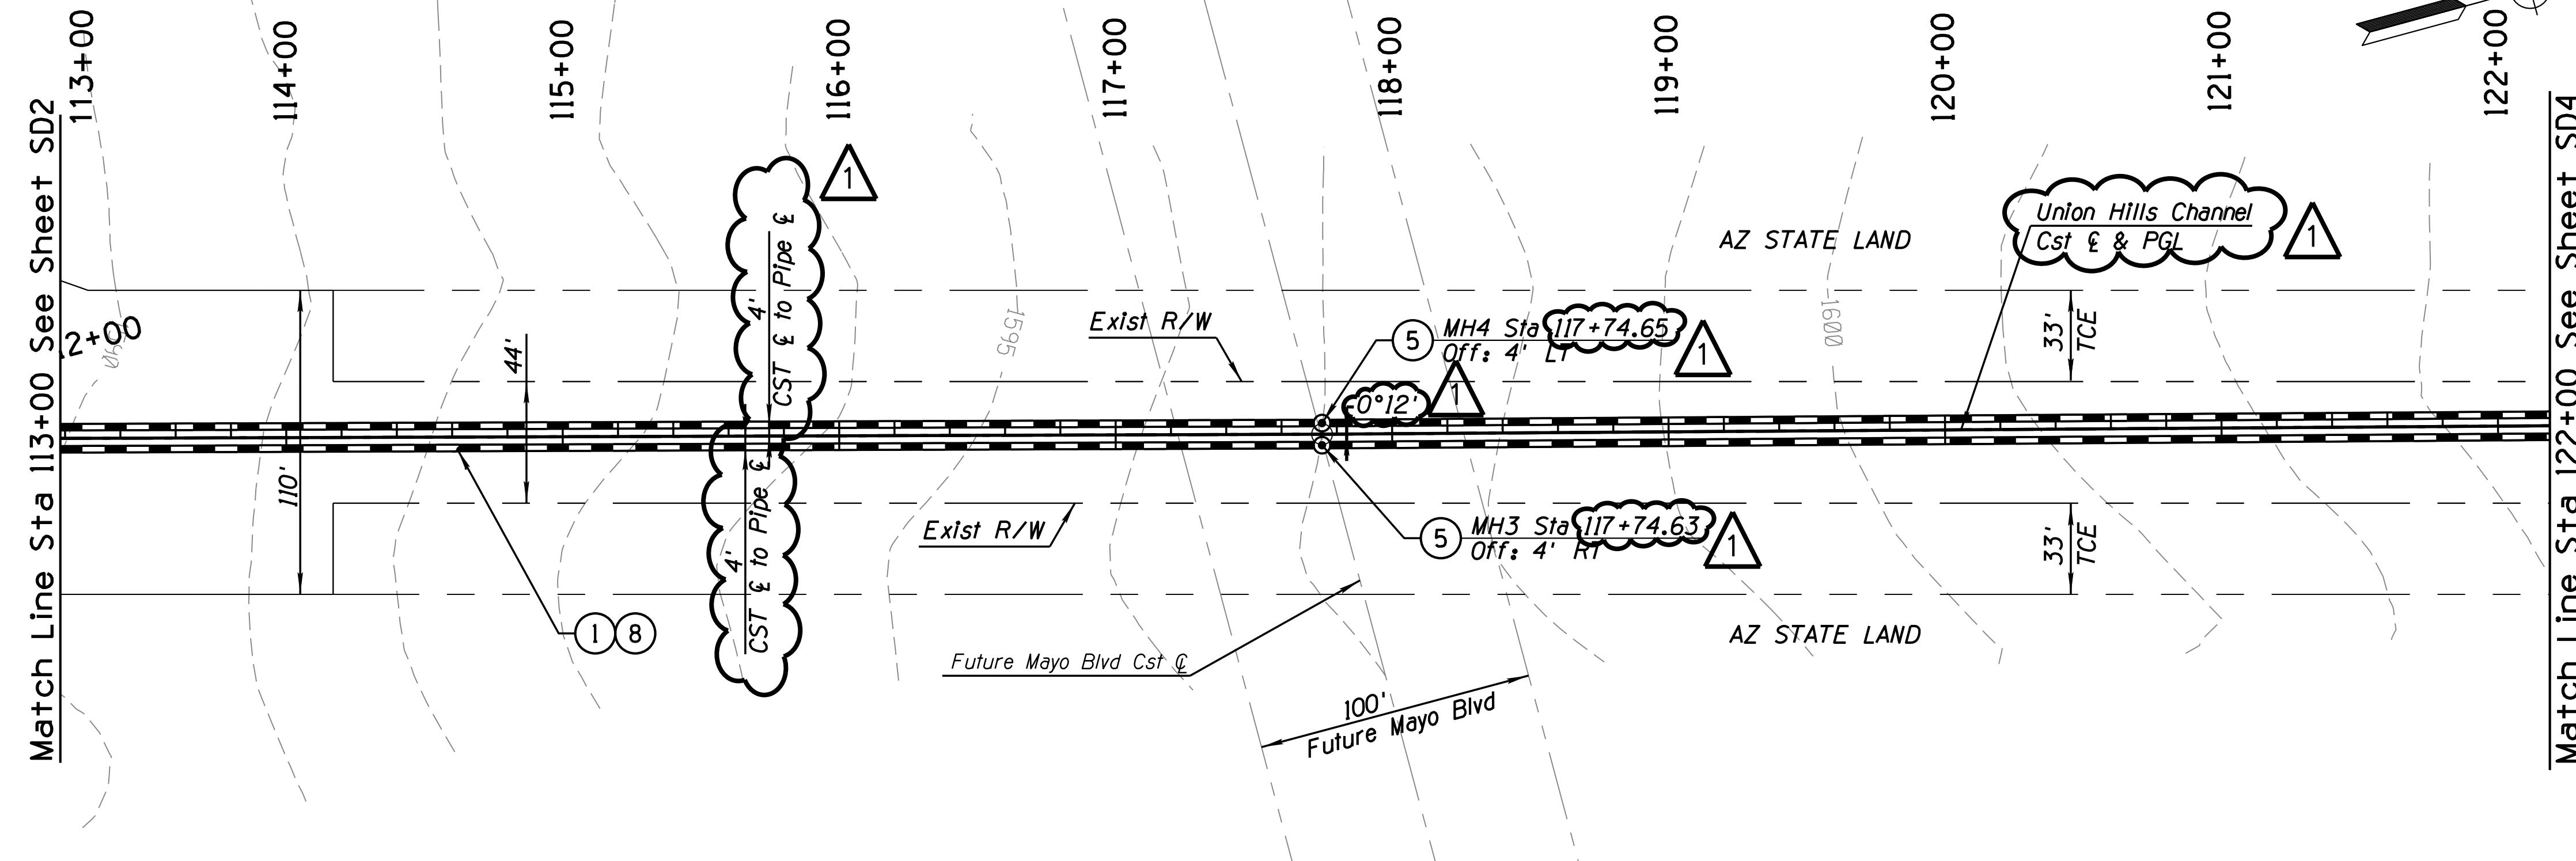

Match Line Sta 122+00 See Sheet SD4

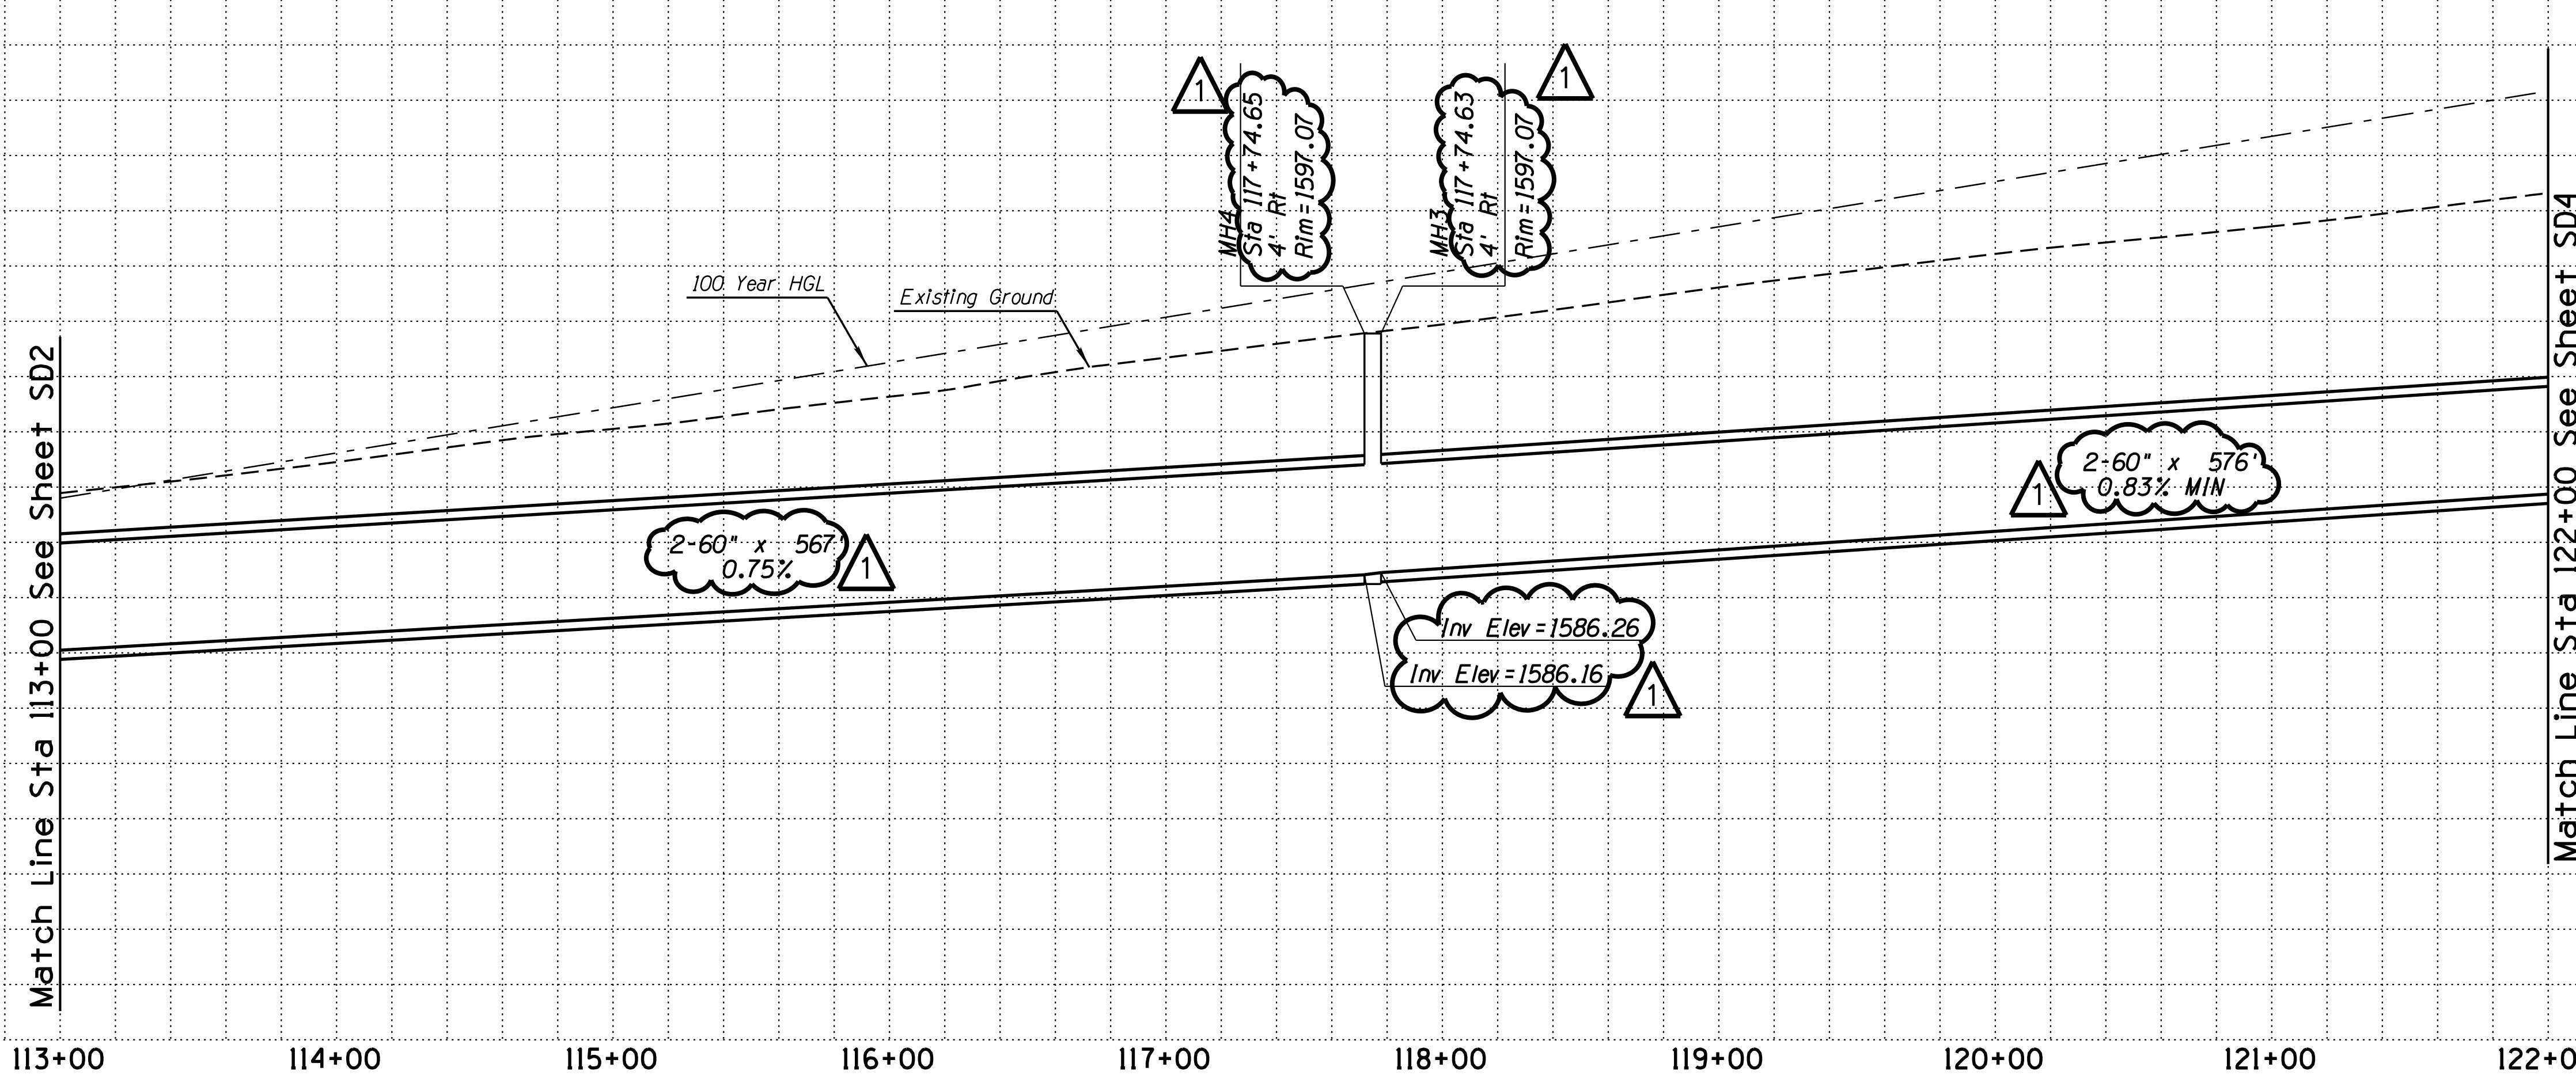

Match Line Sta 122+00 See Sheet SD4



DATE: 3/13/20	REVISION:	CITY COMMENTS	BY: A.S.N.
PROJECT TITLE: UNION HILLS CHANNEL PLAN & PROFILE			
CROSSROADS EAST DRAINAGE INFRASTRUCTURE			
SCALE: HORIZ. 1"=40' VERT. 1"=8'	DESIGNED AC DRAWN JJP	DATE 07/19 AS-BUILT XX/XX	BID NO. XXXX PROJECT NO. 400-FB53B-56047
SHT. SD3 11 of 38			

REMOVAL & RELOCATION NOTES

Description	Unit	Quan
3 Salvage and Relocate Native Trees	EA	1

CONSTRUCTION NOTES

Description	Unit	Quan
1 Excavate Channel/Pipe		
5 Manhole per MAG Std. Det 521 and 522. 30" Pressure Manhole per MAG Std Dtl 523-1,2 and COS Std Dtl 2520	EA	2
8 2-60" CMP 16GA Galvanized Storm Drain Pipes per MAG Std Dtl 200-1 Type D and 510	LF	340
15 Connect to Existing Pipe Per MAG Std Dtl 505	EA	2
20 Install Trash Rack See Sheet D15	EA	1

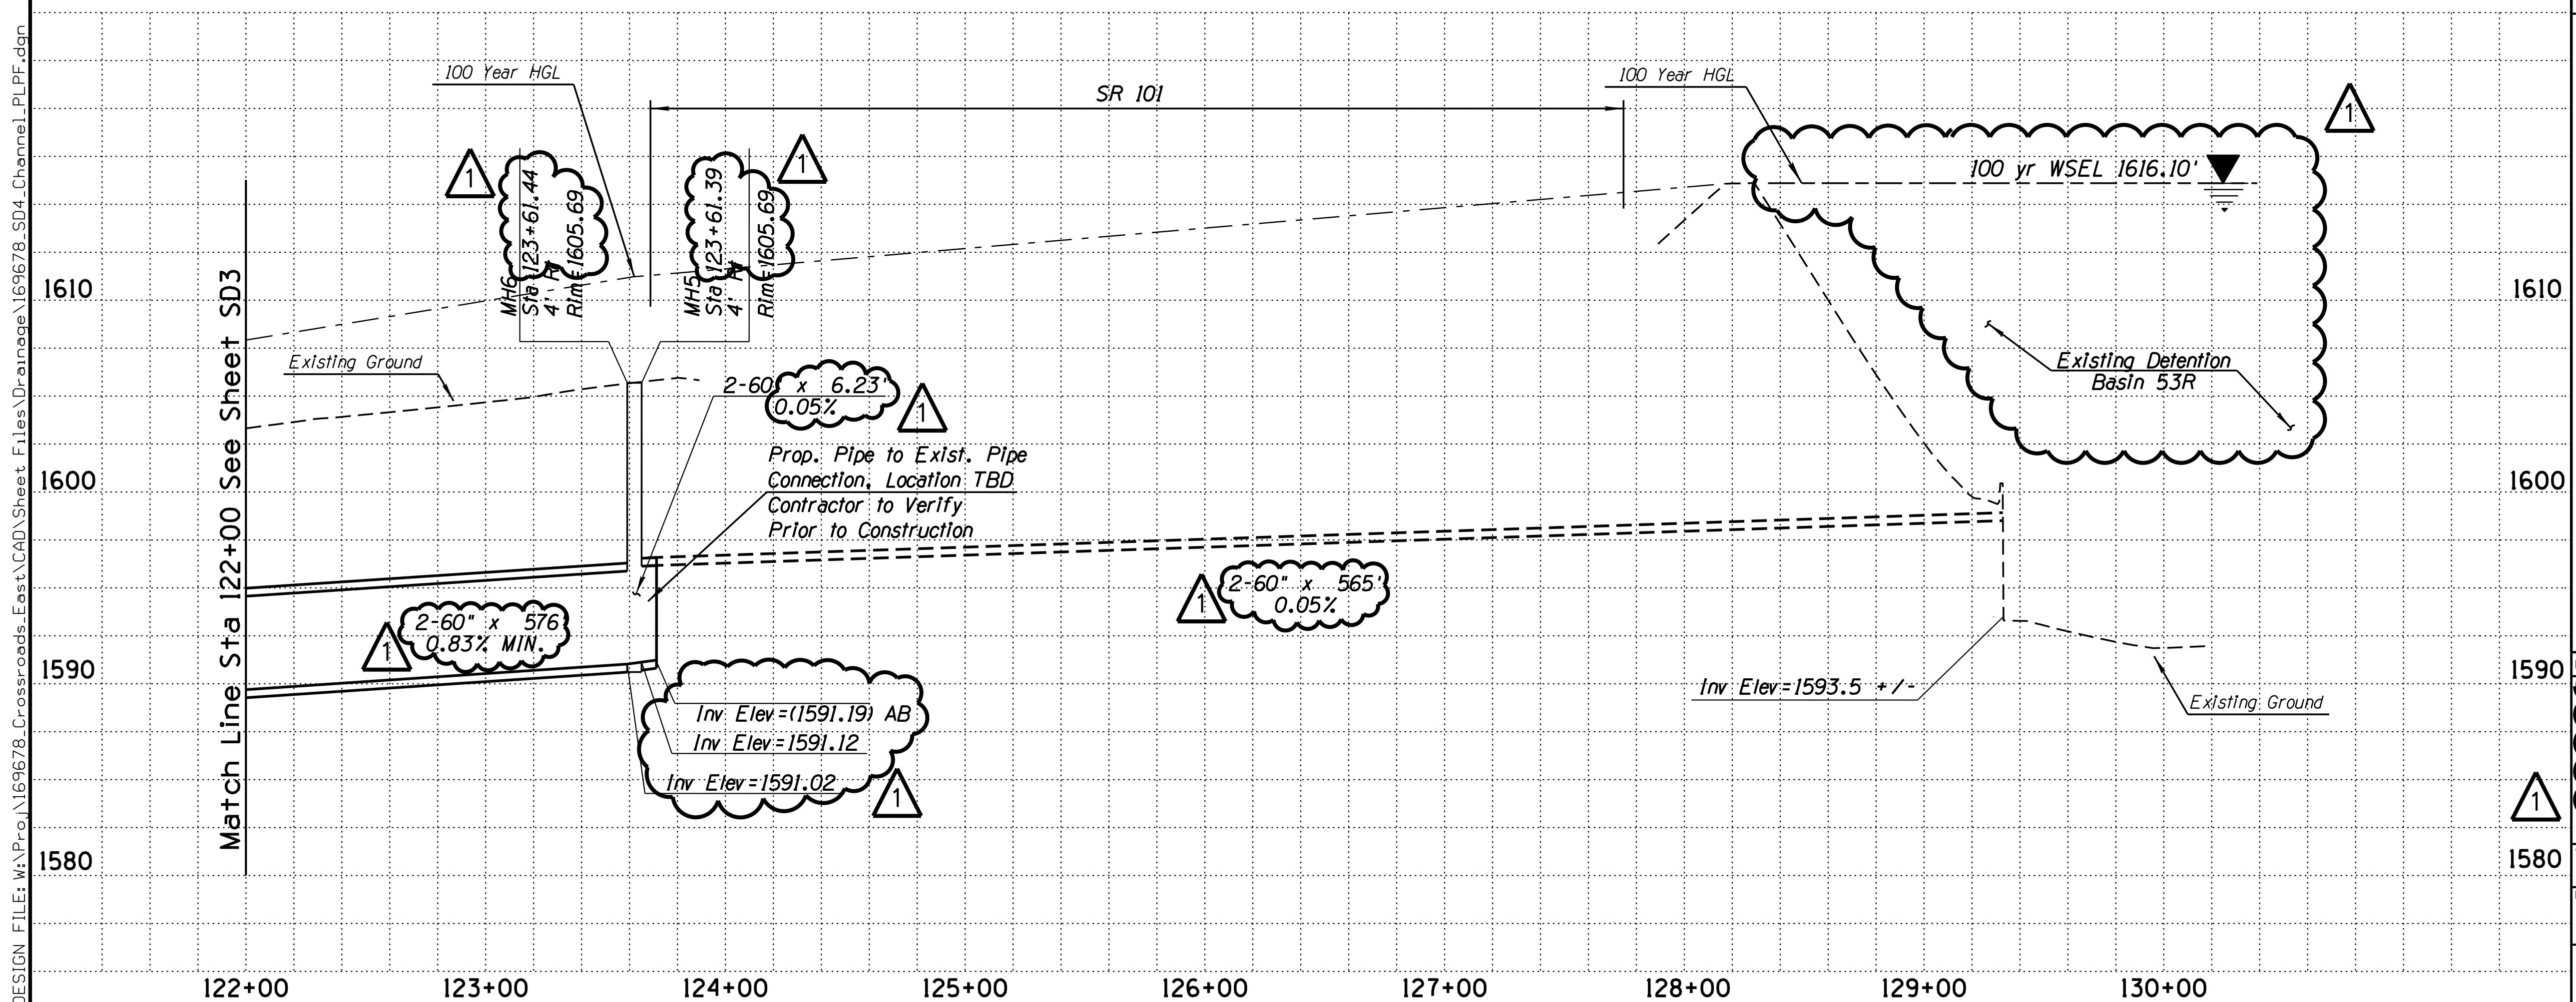
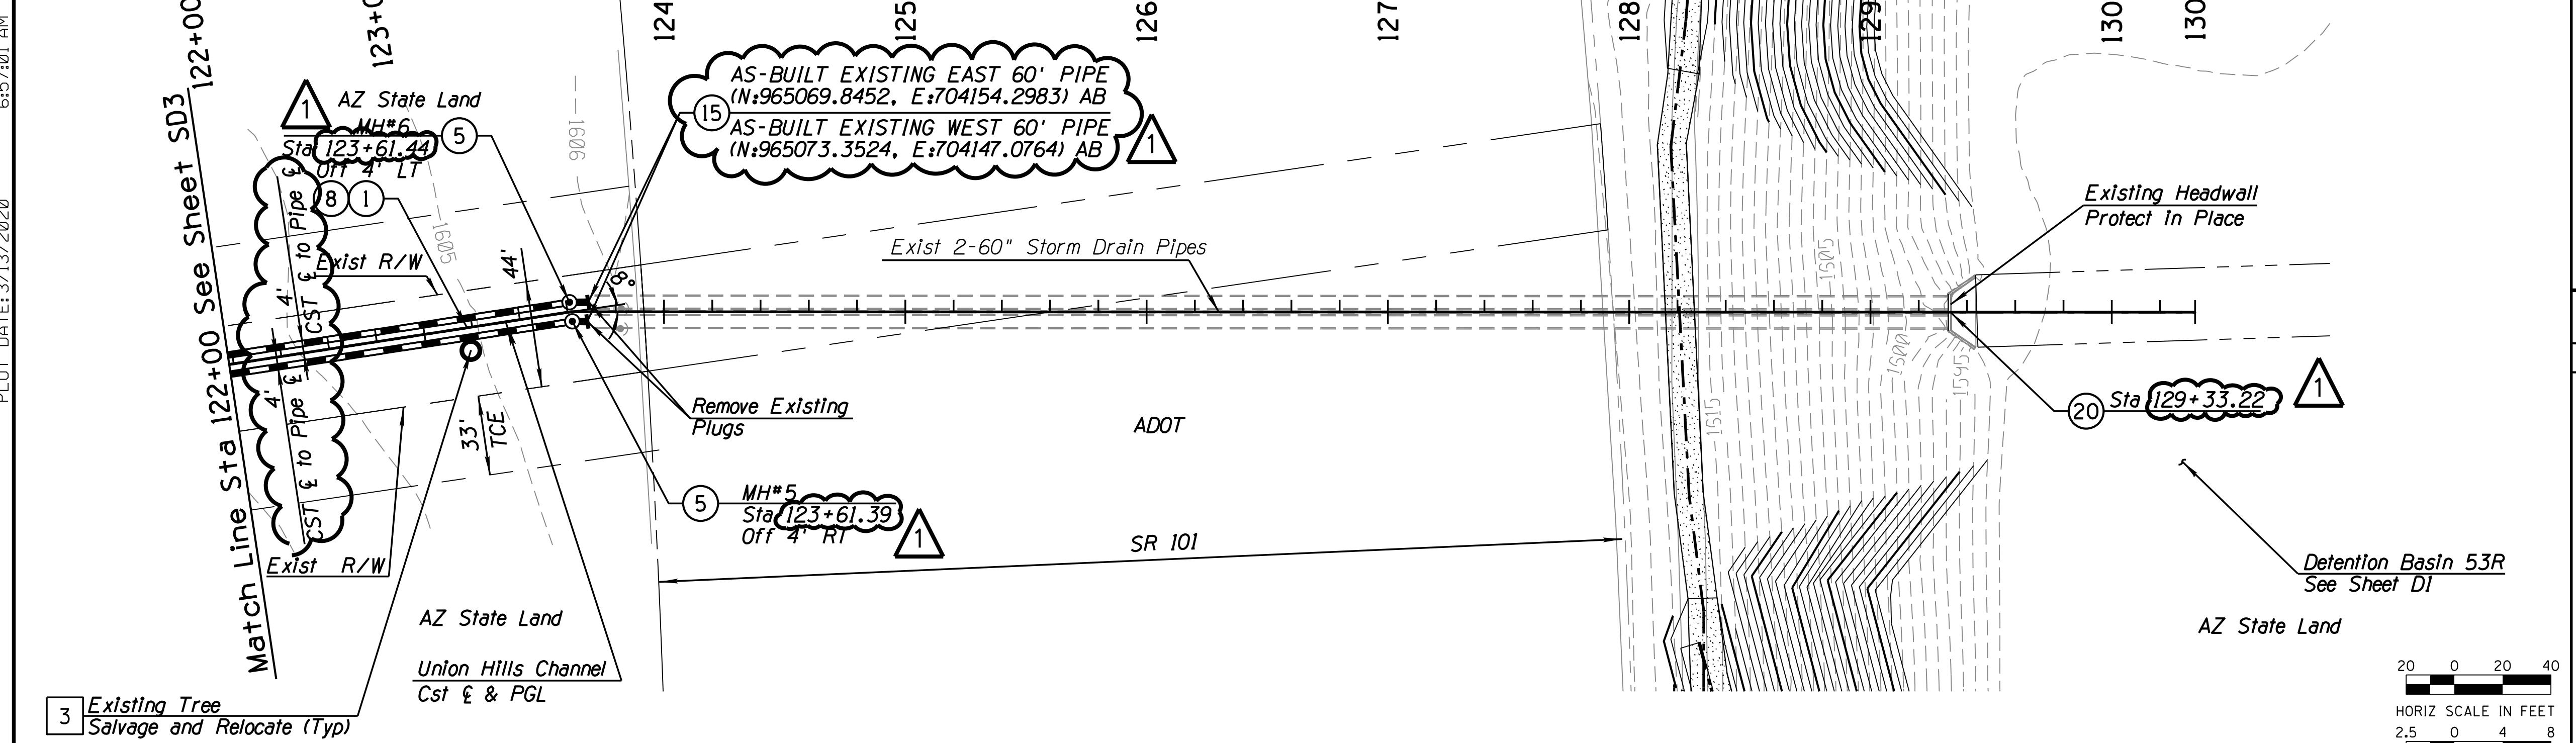


The image shows two circular seals. The left seal is for 'ARIZONA STATE BOARD OF PROFESSIONAL ENGINEERS' and includes the name 'AZEEZ SALIBA' and the date '3/13/20'. The right seal is for 'CITY OF SCOTTSDALE, ARIZONA' and features a central figure. To the right of the seals, the text 'PUBLIC WORKS' is at the top, followed by 'CAPITAL PROJECT MANAGEMENT' below it, and the address '7447 E. INDIAN SCHOOL RD. SCOTTSDALE, ARIZONA 85251' at the bottom.

UNION HILLS CHANNEL PLAN & PROFILE

CROSSROADS EAST

DRAINAGE INFRASTRUCTURE

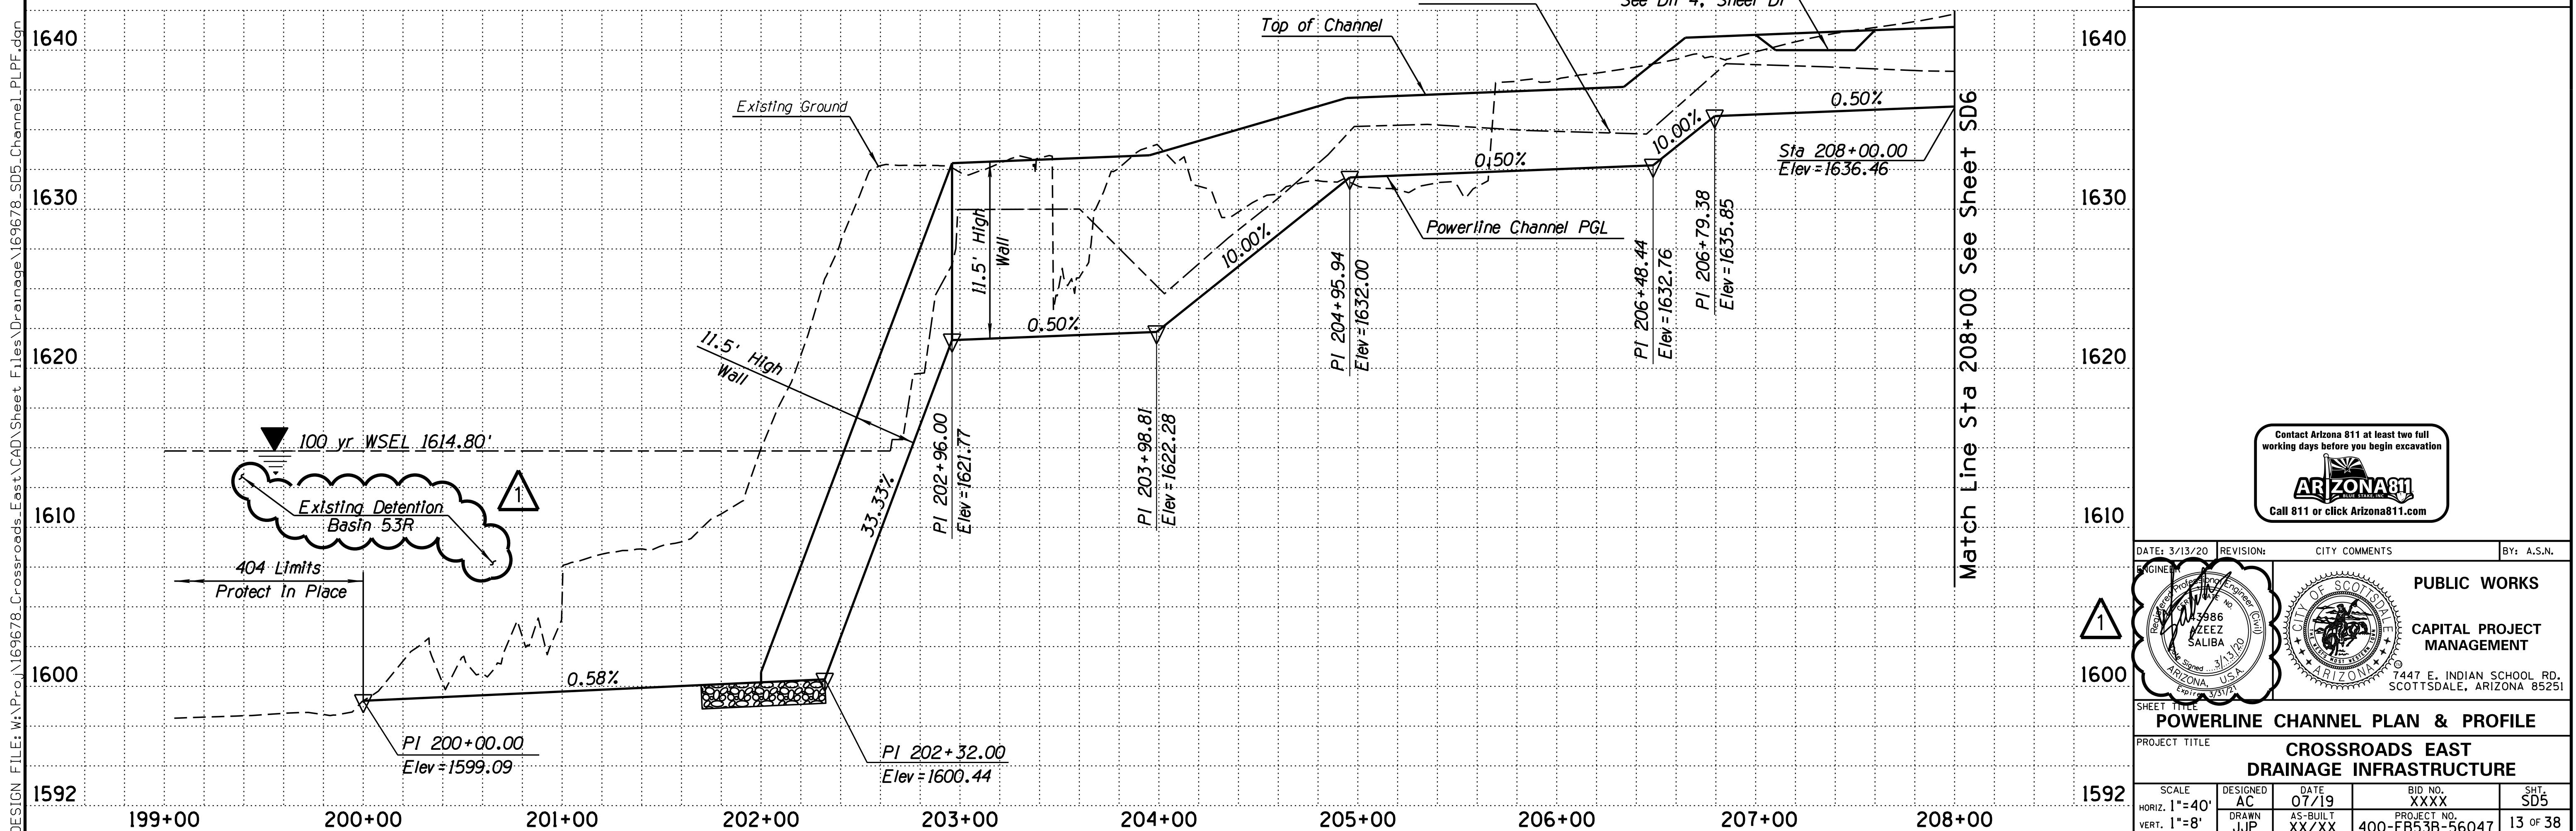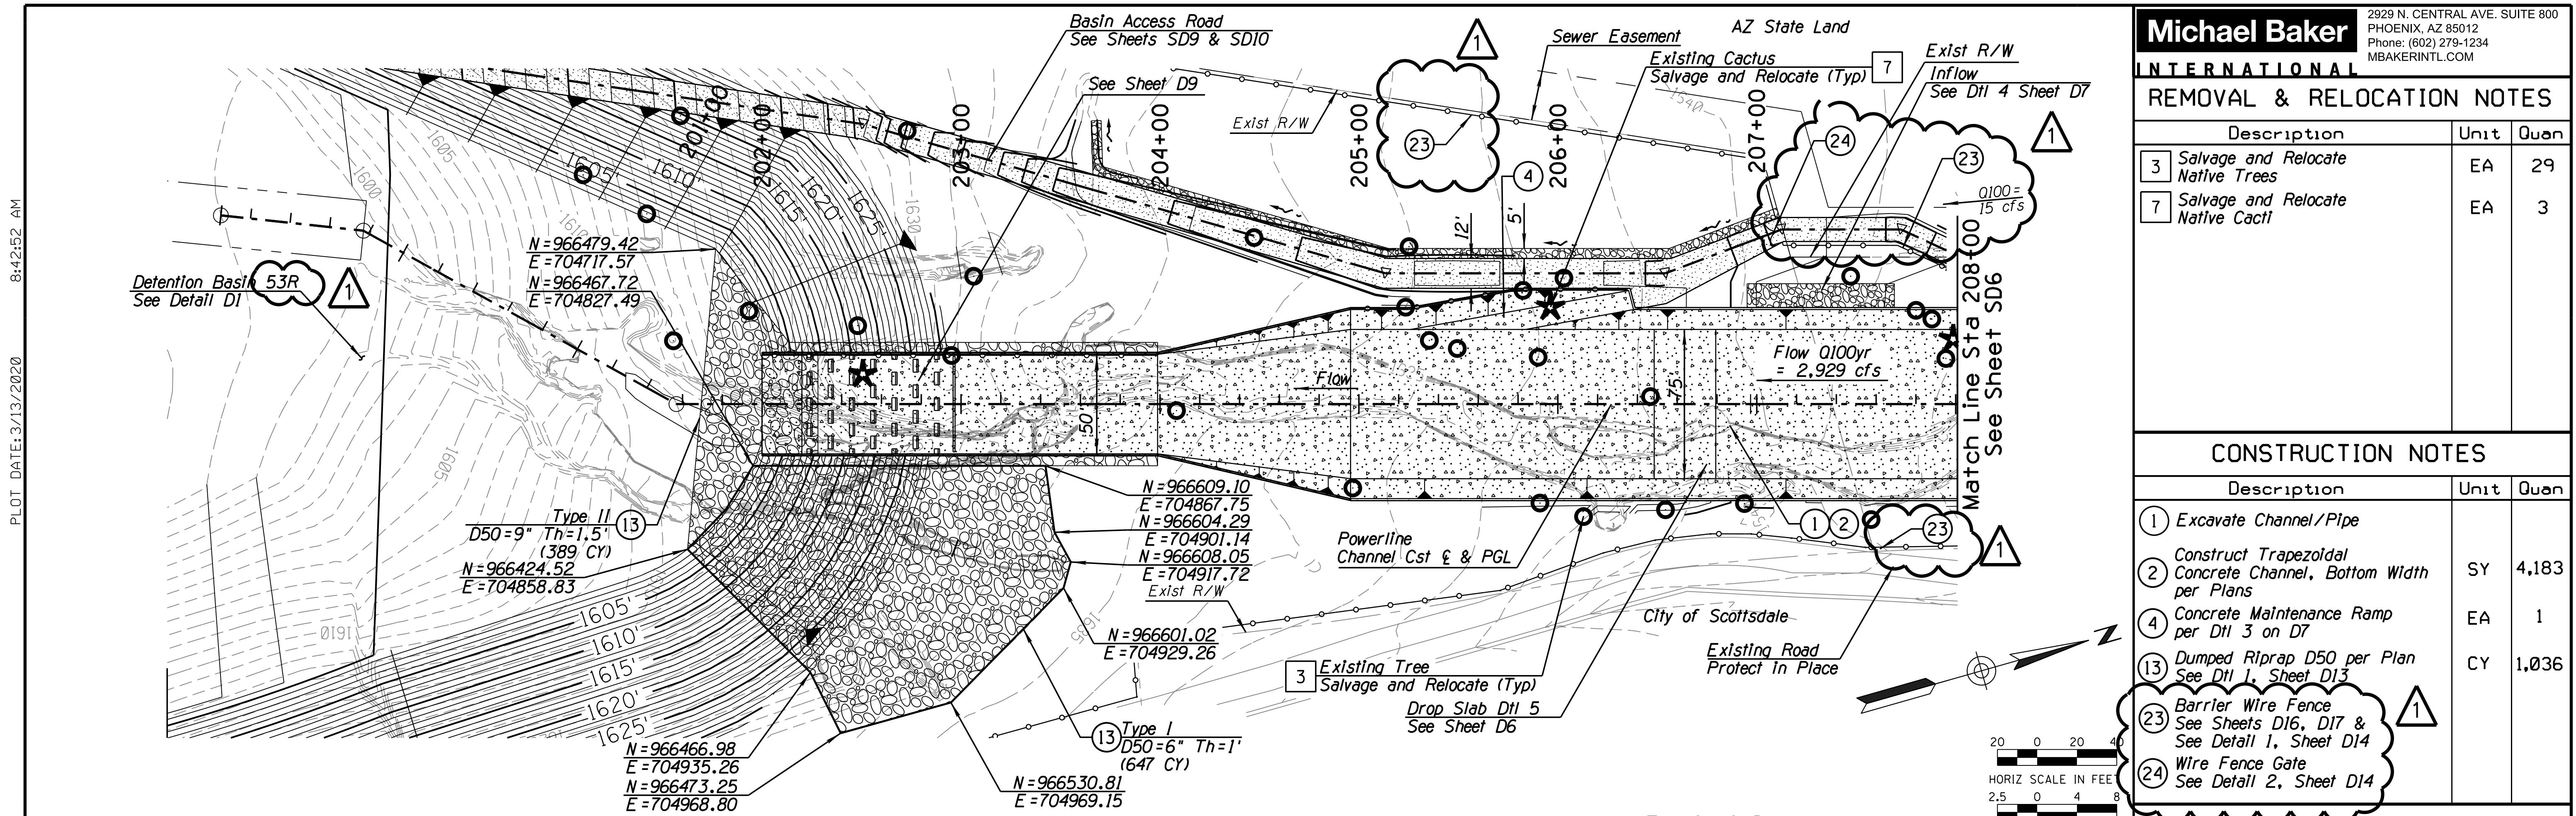

Michael Baker

INTERNATIONAL

REMOVAL & RELOCATION NOTES

Description	Unit	Quan
3 Salvage and Relocate Native Trees	EA	4
7 Salvage and Relocate Native Cacti	EA	5

CONSTRUCTION NOTES

Description	Unit	Quan
① Excavate Channel/PIPE		
② Construct Trapezoidal Concrete Channel, Width per Plans	SY	6,233
⑯ 6" AB Access Road per Section on Sheet G4, Width per plan	SY	841
⑳ Barrier Wire Fence See Sheets D16, D17 & See Detail 1, Sheet D14		
㉔ Wire Fence Gate See Detail 2, Sheet D14		



20 0 20
HORIZ SCALE IN FEET
2.5 0 2.5 5
VERT SCALE IN FEET



Contact Arizona 811 at least two full working days before you begin excavation

Call 811 or click Arizona811.com

DATE: 3/13/20	REVISION:	CITY COMMENTS	BY: A.S.N.
PUBLIC WORKS CAPITAL PROJECT MANAGEMENT 7447 E. INDIAN SCHOOL RD. SCOTTSDALE, ARIZONA 85251			
SHEET TITLE : POWERLINE CHANNEL PLAN & PROFILE PROJECT TITLE : CROSSROADS EAST DRAINAGE INFRASTRUCTURE			
SCALE: HORIZ. 1"=40' VERT. 1"=8'	DESIGNED AC DRAWN JJP	DATE 07/19 AS-BUILT XX/XX	BID NO. XXXX PROJECT NO. 400-FB53B-56047

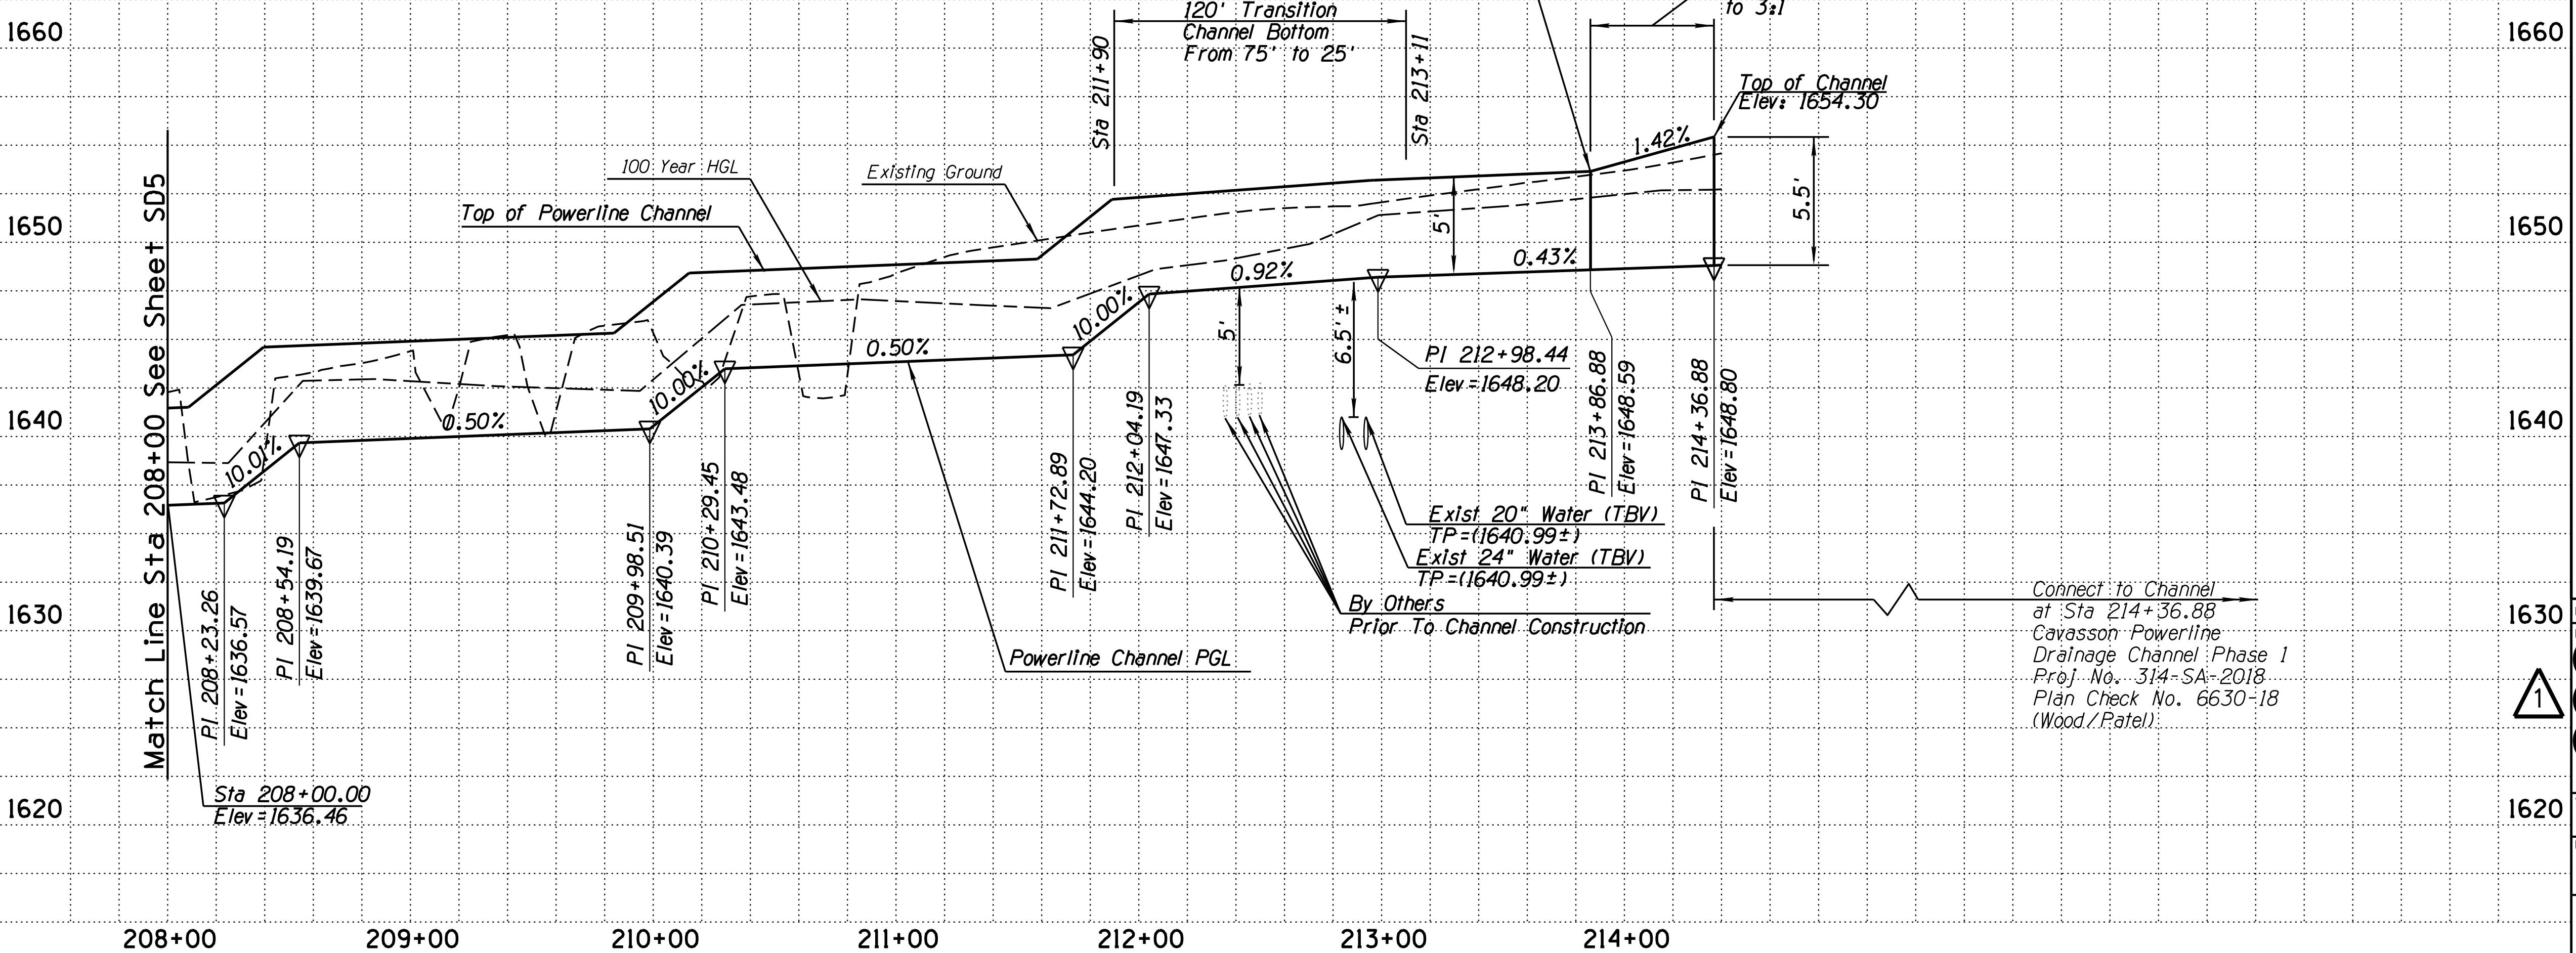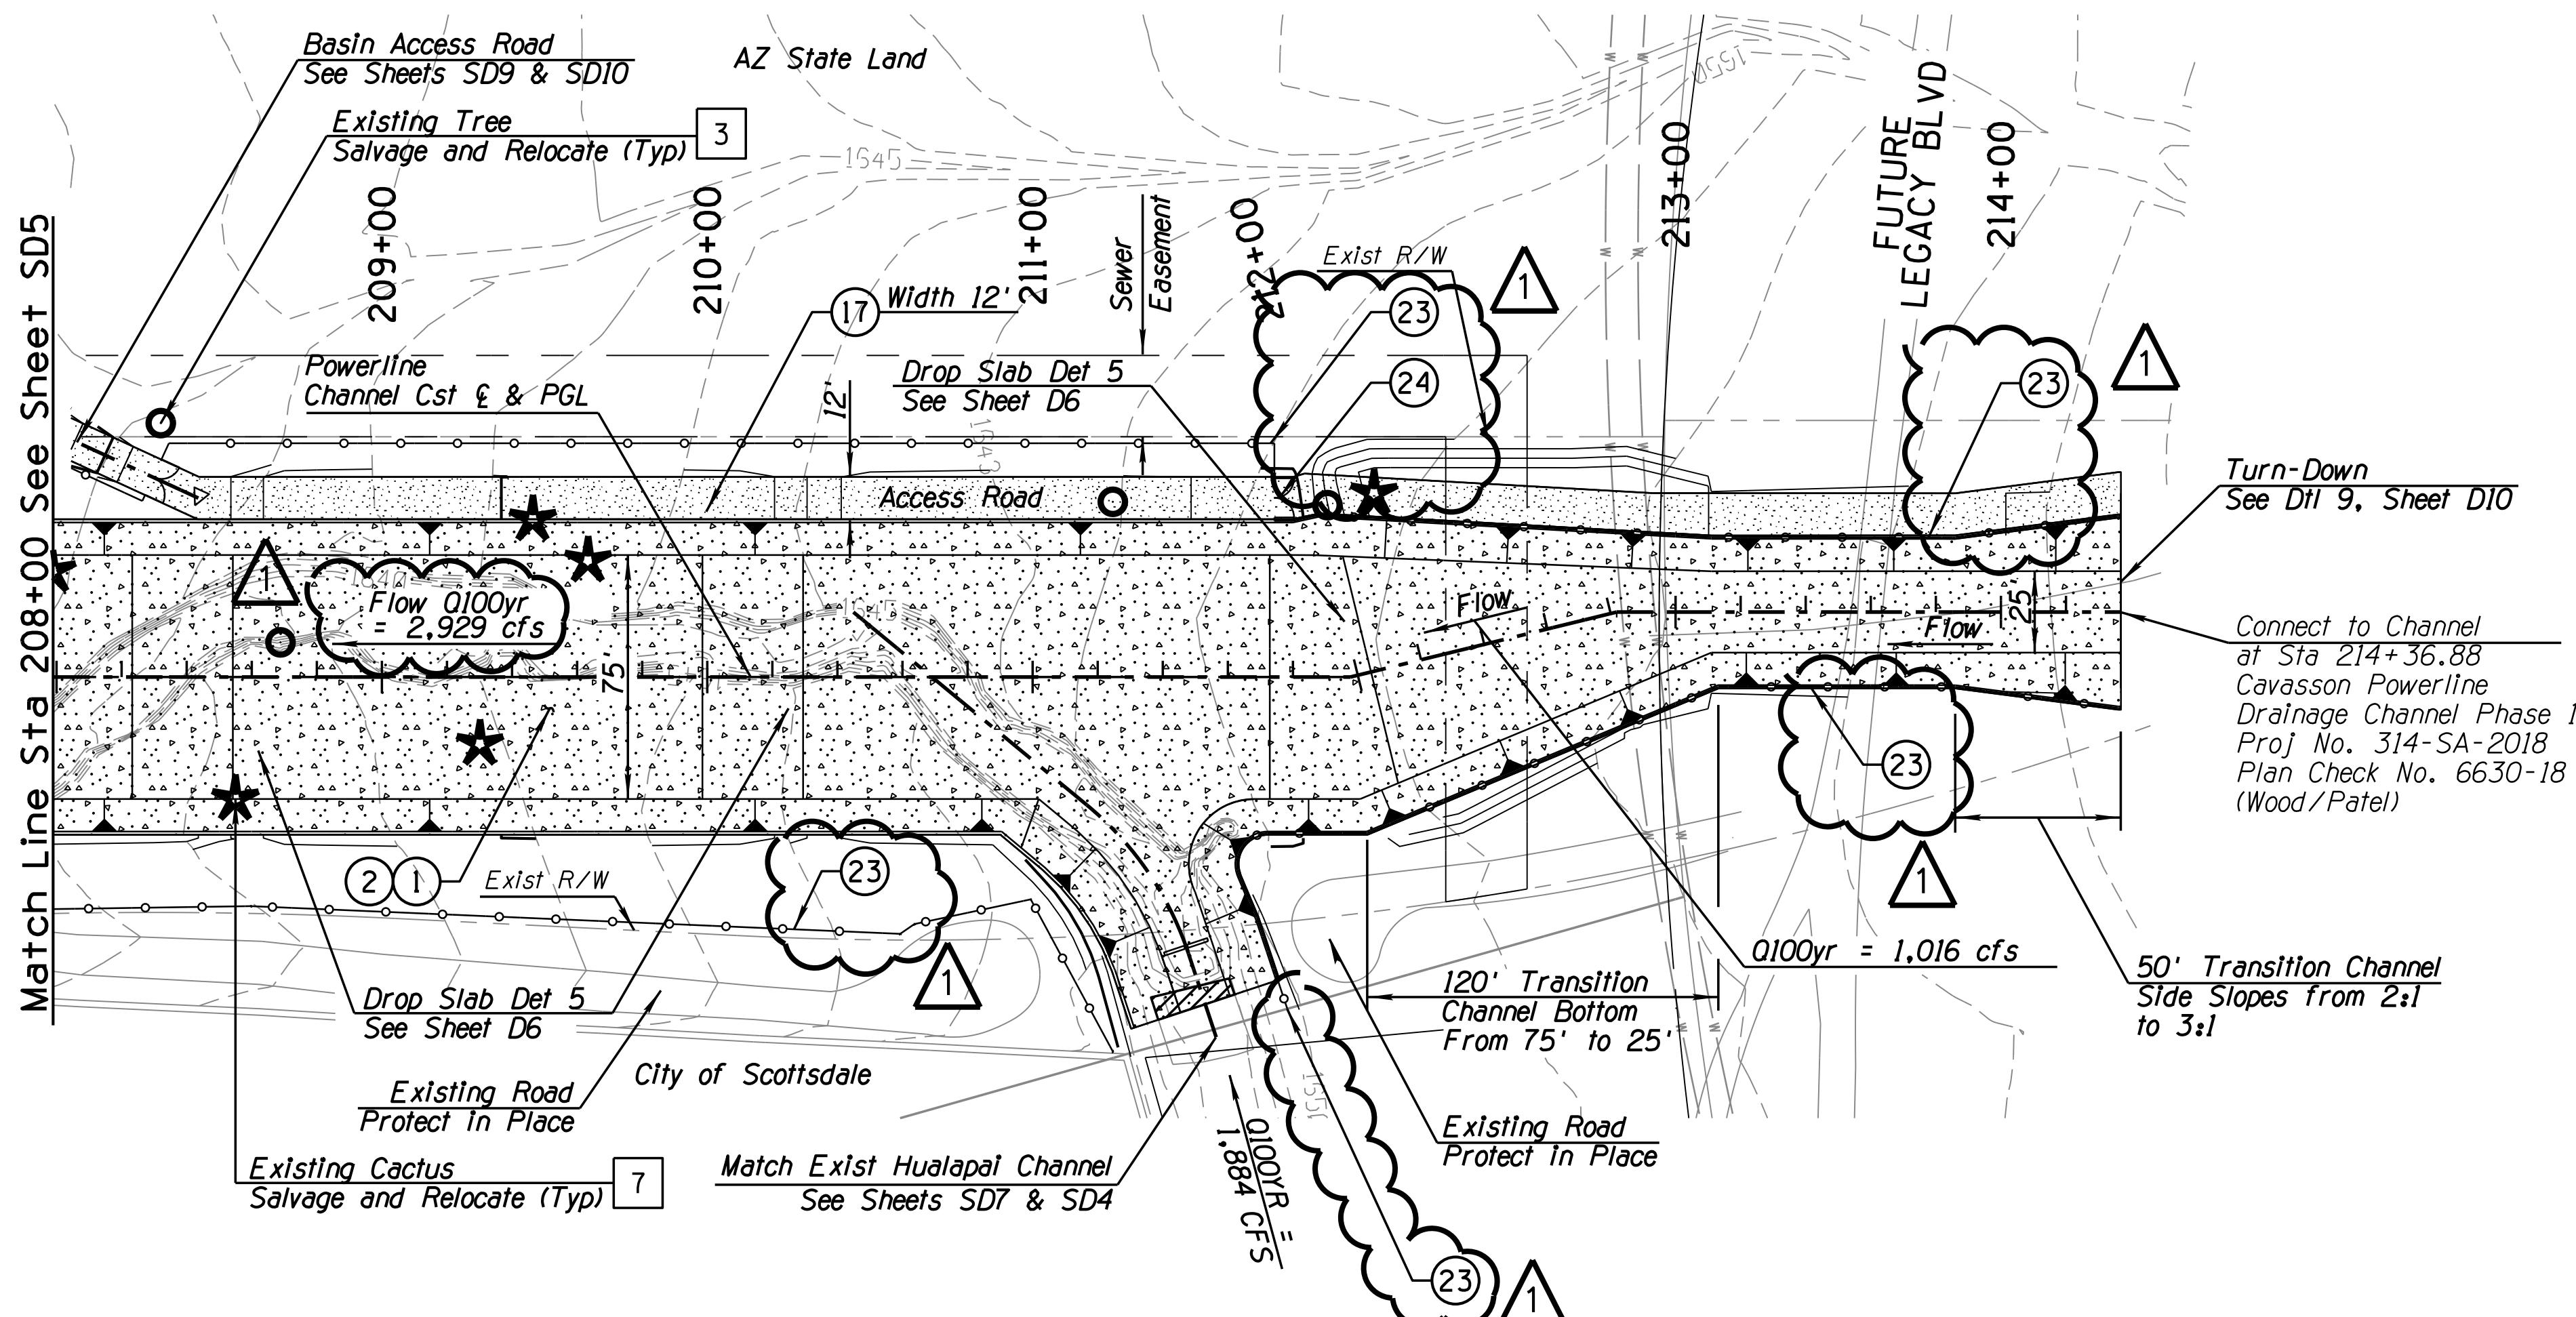

Connect to Channel at Sta 214+36.88
 Cavasson Powerline
 Drainage Channel Phase 1
 Proj No. 314-SA-2018
 Plan Check No. 6630-18
 (Wood/Patel)

Michael Baker

REMOVAL & RELOCATION NOTES

Description	Unit	Quan
<input type="checkbox"/> <i>Sawcut and Remove to Clean Edge</i>	SY	18
<input type="checkbox"/> <i>Salvage and Relocate Native Trees</i>		
<input type="checkbox"/> <i>Salvage and Relocate Native Cacti</i>		
<input type="checkbox"/> <i>Salvage and Relocate Exist. Riprap</i>	SY	140



CONSTRUCTION NOTES

Description	Unit	Quan
Excavate Channel/Pipe		
Construct Trapezoidal Concrete Channel, Width per Plans		
Construct Concrete Weir Wall See Details 1 and 2, Sheet D4	LS	1
Barrier Wire Fence		

Hualapai Channel Curve Data Table

<i>Curve No.</i>	<i>Radius</i>	<i>Delta</i>	<i>Length</i>	<i>Tangent</i>
(C30)	100.00'	32°06'58"	56.05'	28.78'

The image contains two scale bars. The top scale bar is labeled "HORIZ SCALE IN FEET" and has tick marks at 0, 20, and 40. The bottom scale bar is labeled "VERT SCALE IN FEET" and has tick marks at 0, 4, and 8. Each scale bar consists of a series of black and white squares.

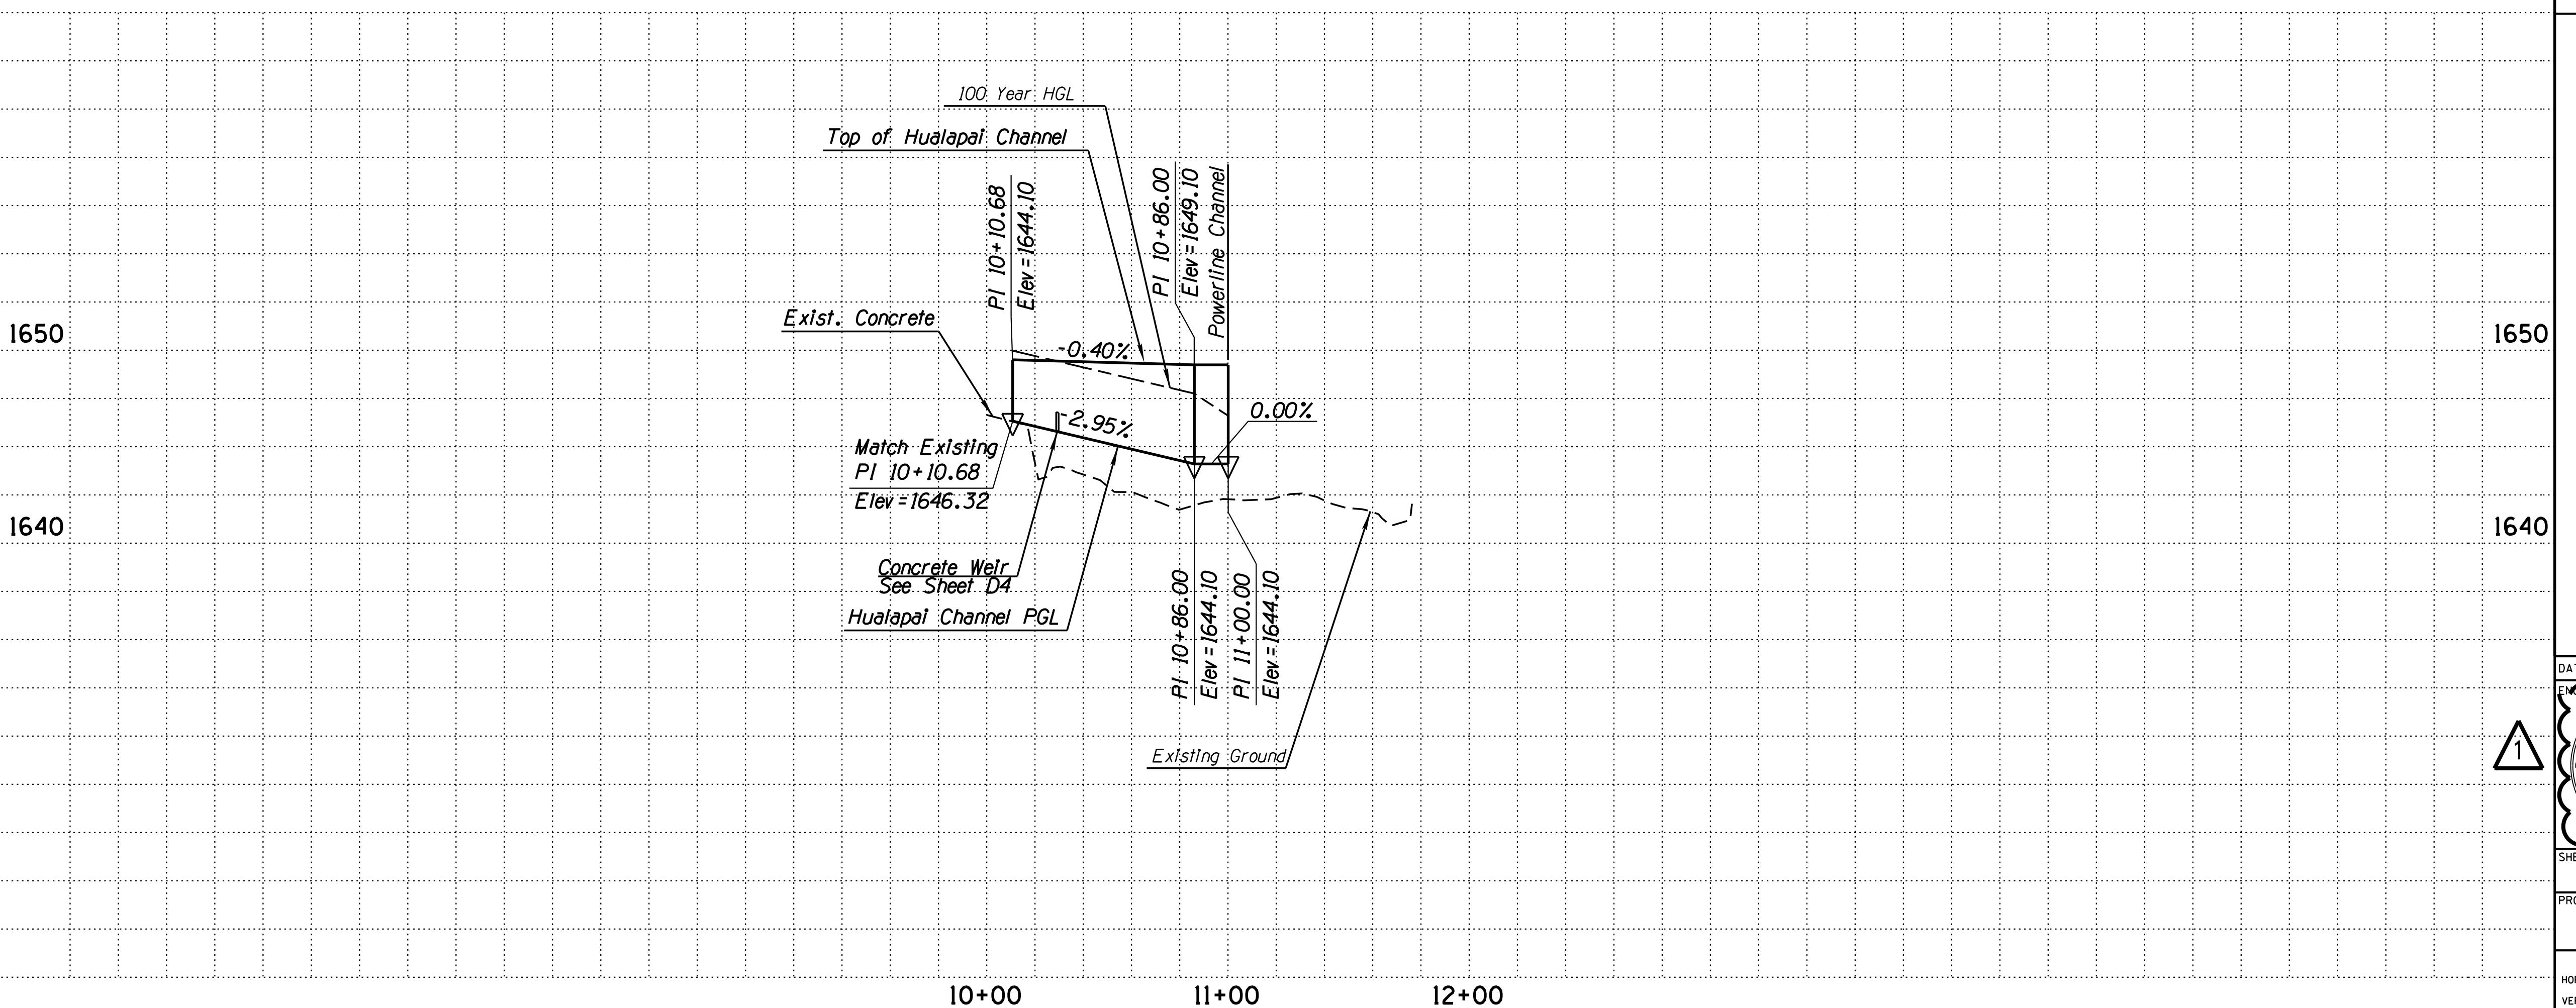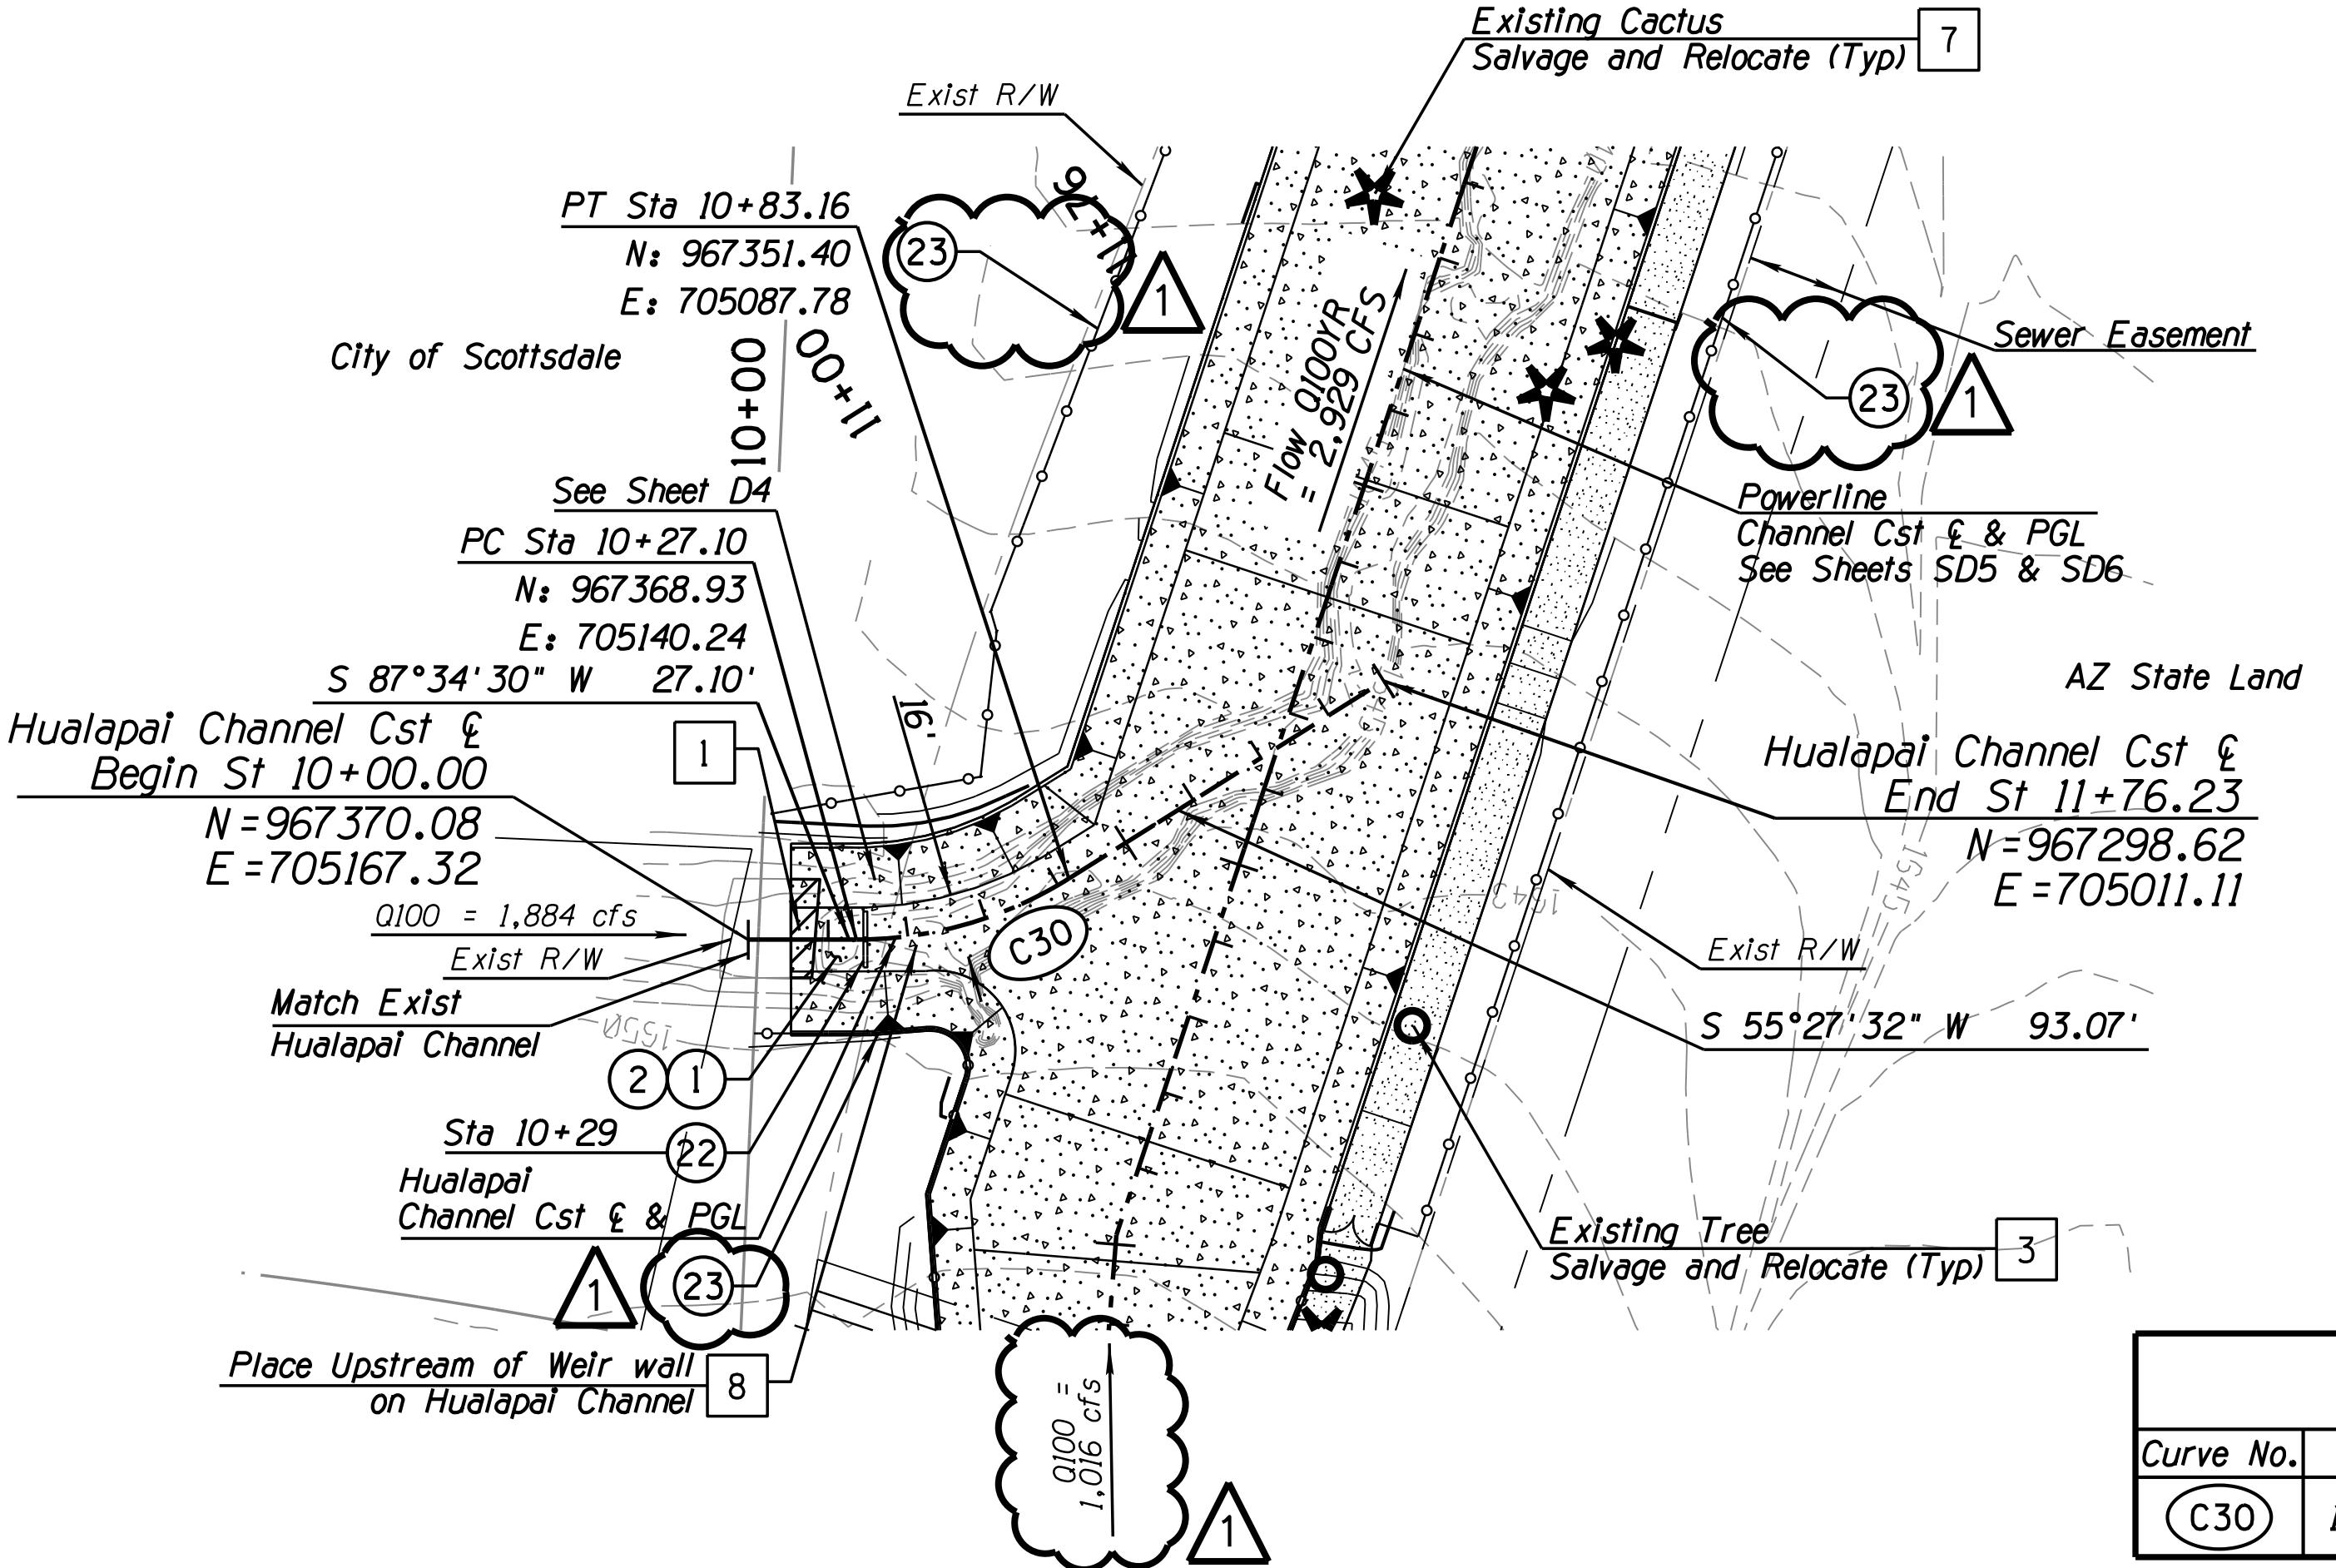

3/13/20	REVISION:	CITY COMMENTS	BY: A.S.N.	
		<p>PUBLIC WORKS</p> <p>CAPITAL PROJECT MANAGEMENT</p> <p>7447 E. INDIAN SCHOOL RD. SCOTTSDALE, ARIZONA 85251</p>		
<h1>HUALAPAI CHANNEL PLAN & PROFILE</h1> <h2>CROSSROADS EAST DRAINAGE INFRASTRUCTURE</h2>				
SCALE 1"=40' 1"=8'	DESIGNED AC DRAWN JJP	DATE 07/19 AS-BUILT XX/XX	BID NO. XXXX PROJECT NO. 400-FB53B-56047	SHT. SD7 15 OF 38

Michael Baker
INTERNATIONAL

REMOVAL & RELOCATION NOTES									
<table border="1"> <thead> <tr> <th>Description</th> <th>Unit</th> <th>Quan</th> </tr> </thead> <tbody> <tr> <td></td> <td></td> <td></td> </tr> <tr> <td></td> <td></td> <td></td> </tr> </tbody> </table>	Description	Unit	Quan						
Description	Unit	Quan							

CONSTRUCTION NOTES

Description	Unit	Quan
(17) 6" AB Access Road, Per Section on Sheet G4, Width per Plan.	SY	588



DATE: 3/13/20 REVISION: CITY COMMENTS BY: A.S.N.

ENGINEER: *[Signature]* REGISTRATION NO. 5986
ZEEZ SALIBA
ARIZONA, USA
EXPLORATION

PUBLIC WORKS
CITY OF SCOTTSDALE
7447 E. INDIAN SCHOOL RD.
SCOTTSDALE, ARIZONA 85251

CAPITAL PROJECT MANAGEMENT




SHEET TITLE: BASIN ACCESS ROAD PLAN & PROFILE
PROJECT TITLE: CROSSROADS EAST DRAINAGE INFRASTRUCTURE

SCALE: HORIZ. 1"=40'	DESIGNED AC	DATE 07/19	BID NO. XXXX	SH. SD8
VERT. 1"=8'	DRAWN JJP	AS-BUILT XX/XX	PROJECT NO. 400-FB53B-56047	16 of 38

6:53:34 AM

PLOT DATE: 3/13/2020

DESIGN FILE: W:\P\JO\169678-Crossroads-East\CAD\Sheet Files\Drainage\169678_SD8-Basin south access road.dwg

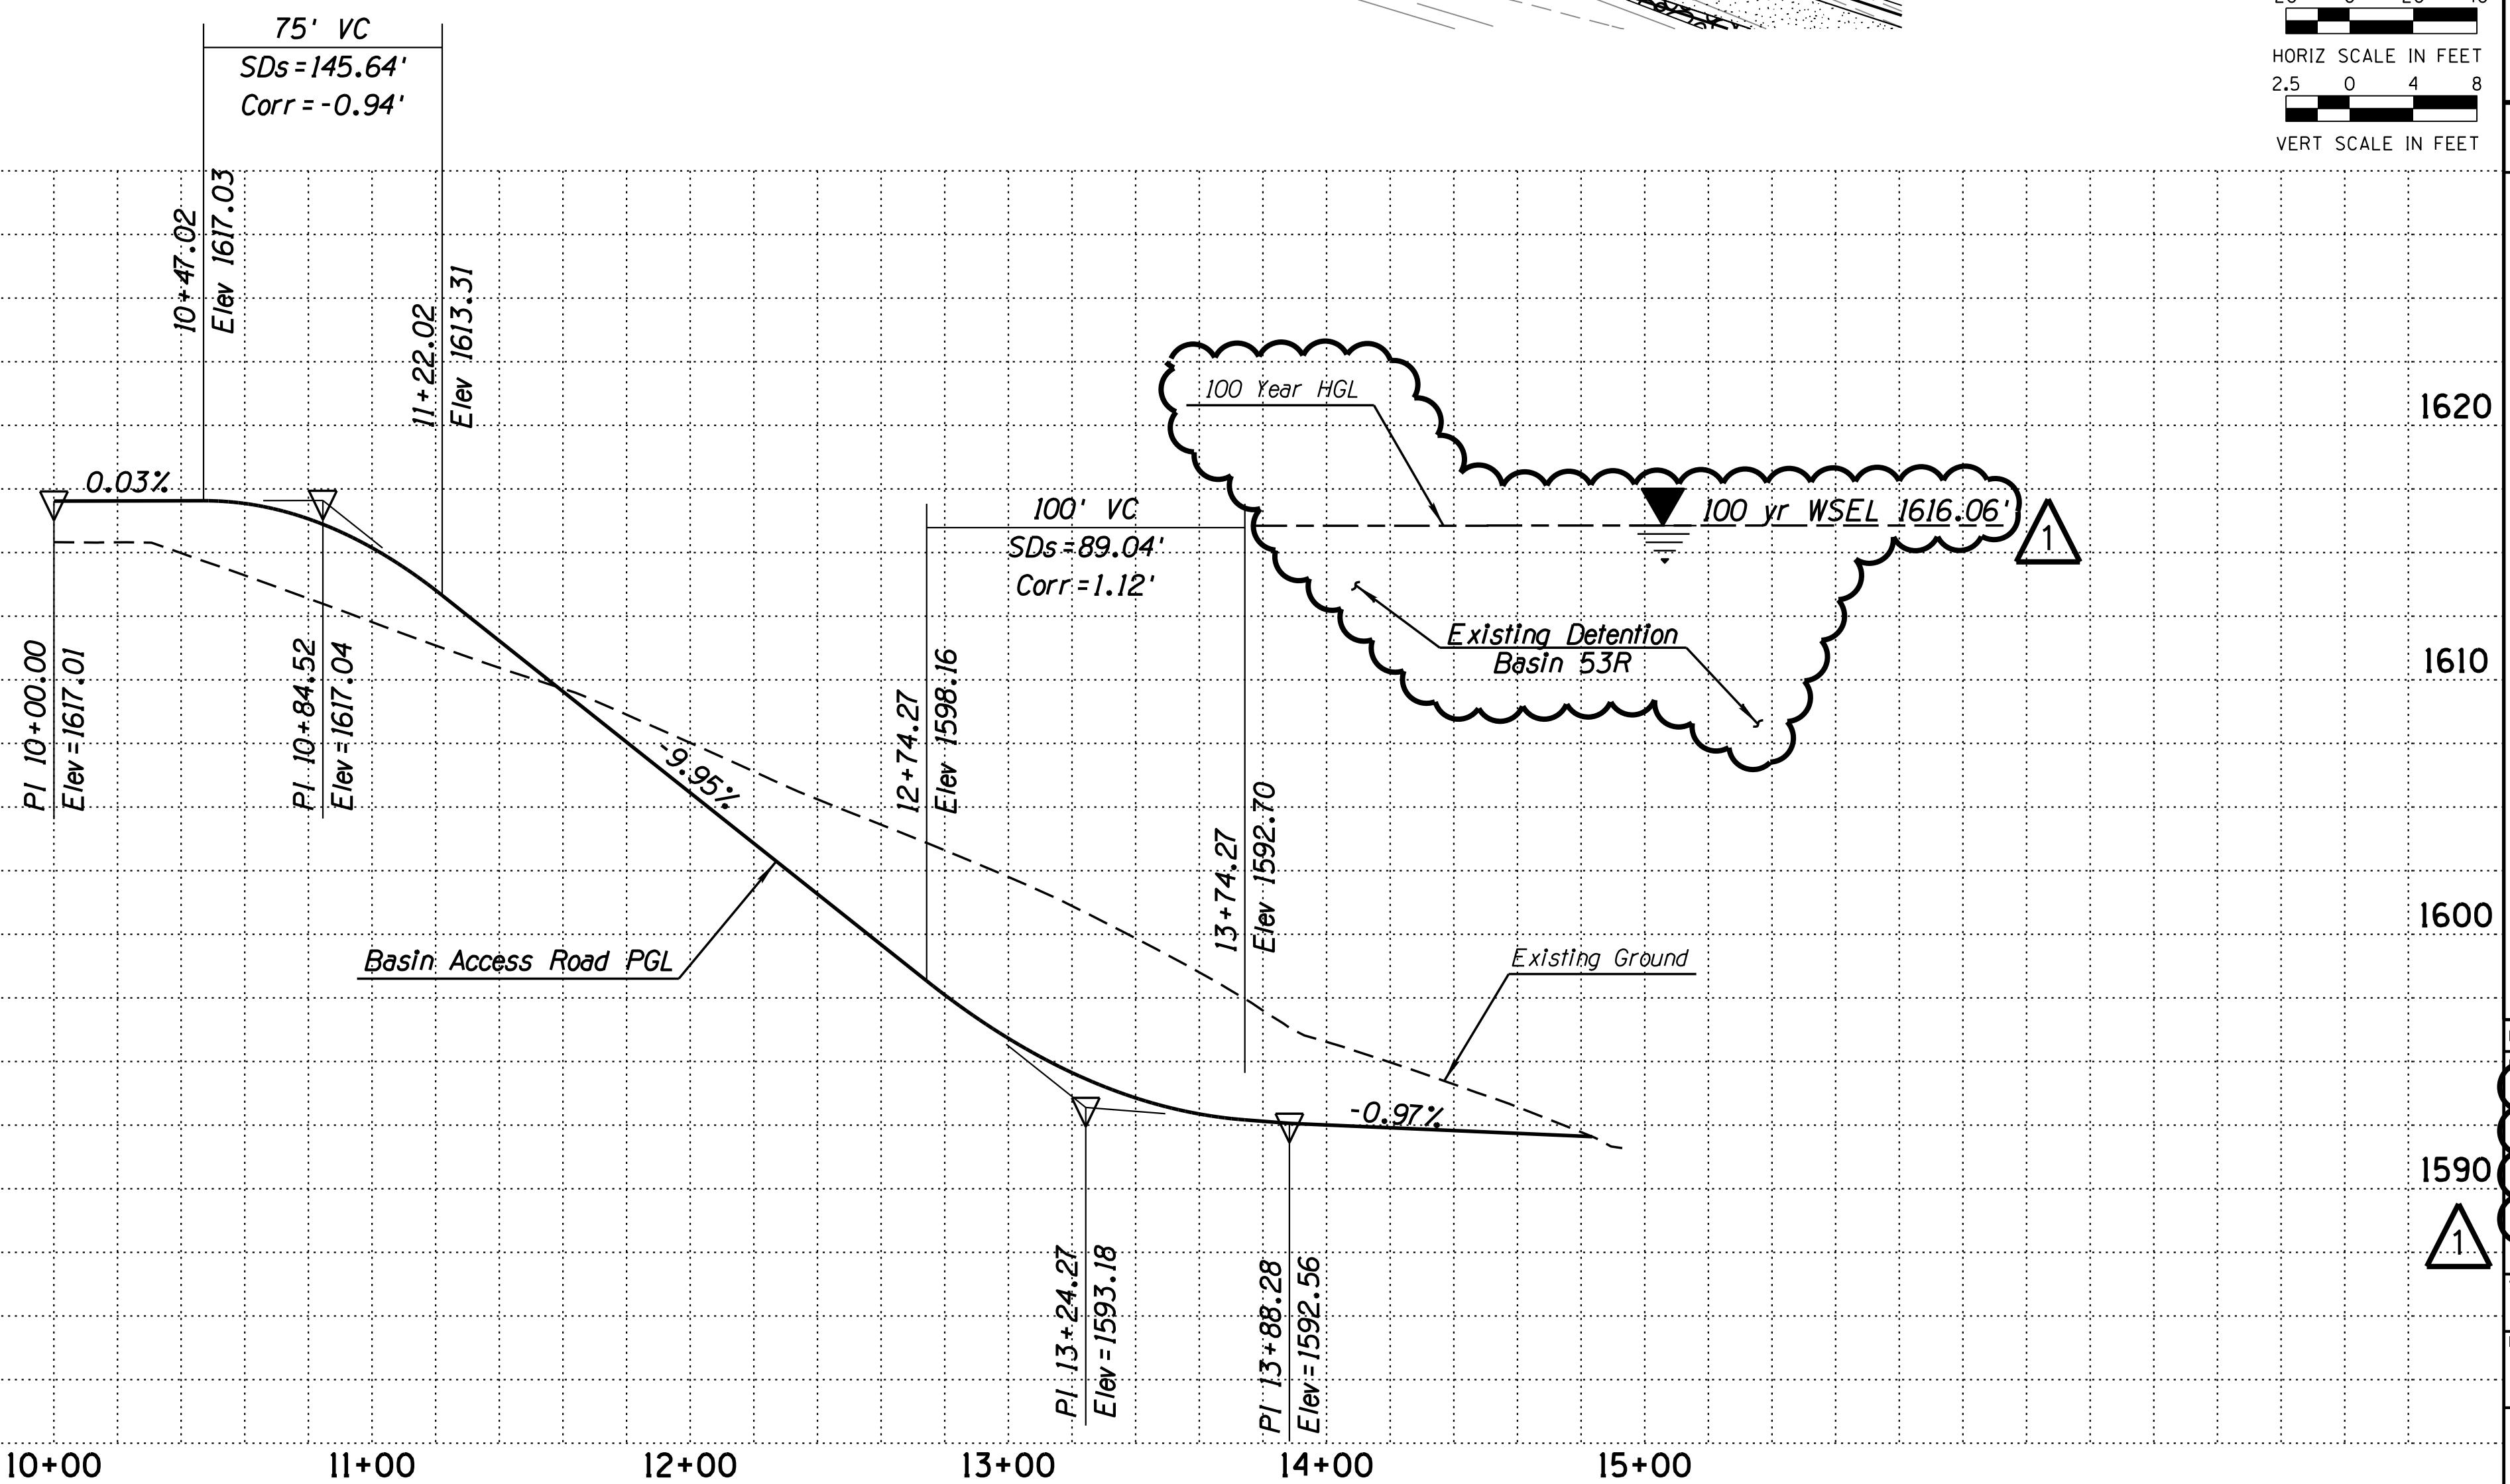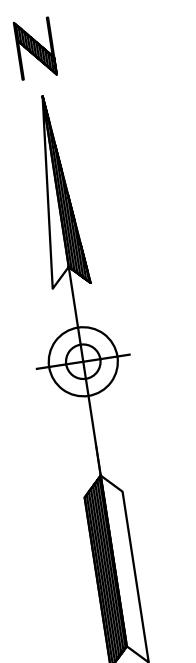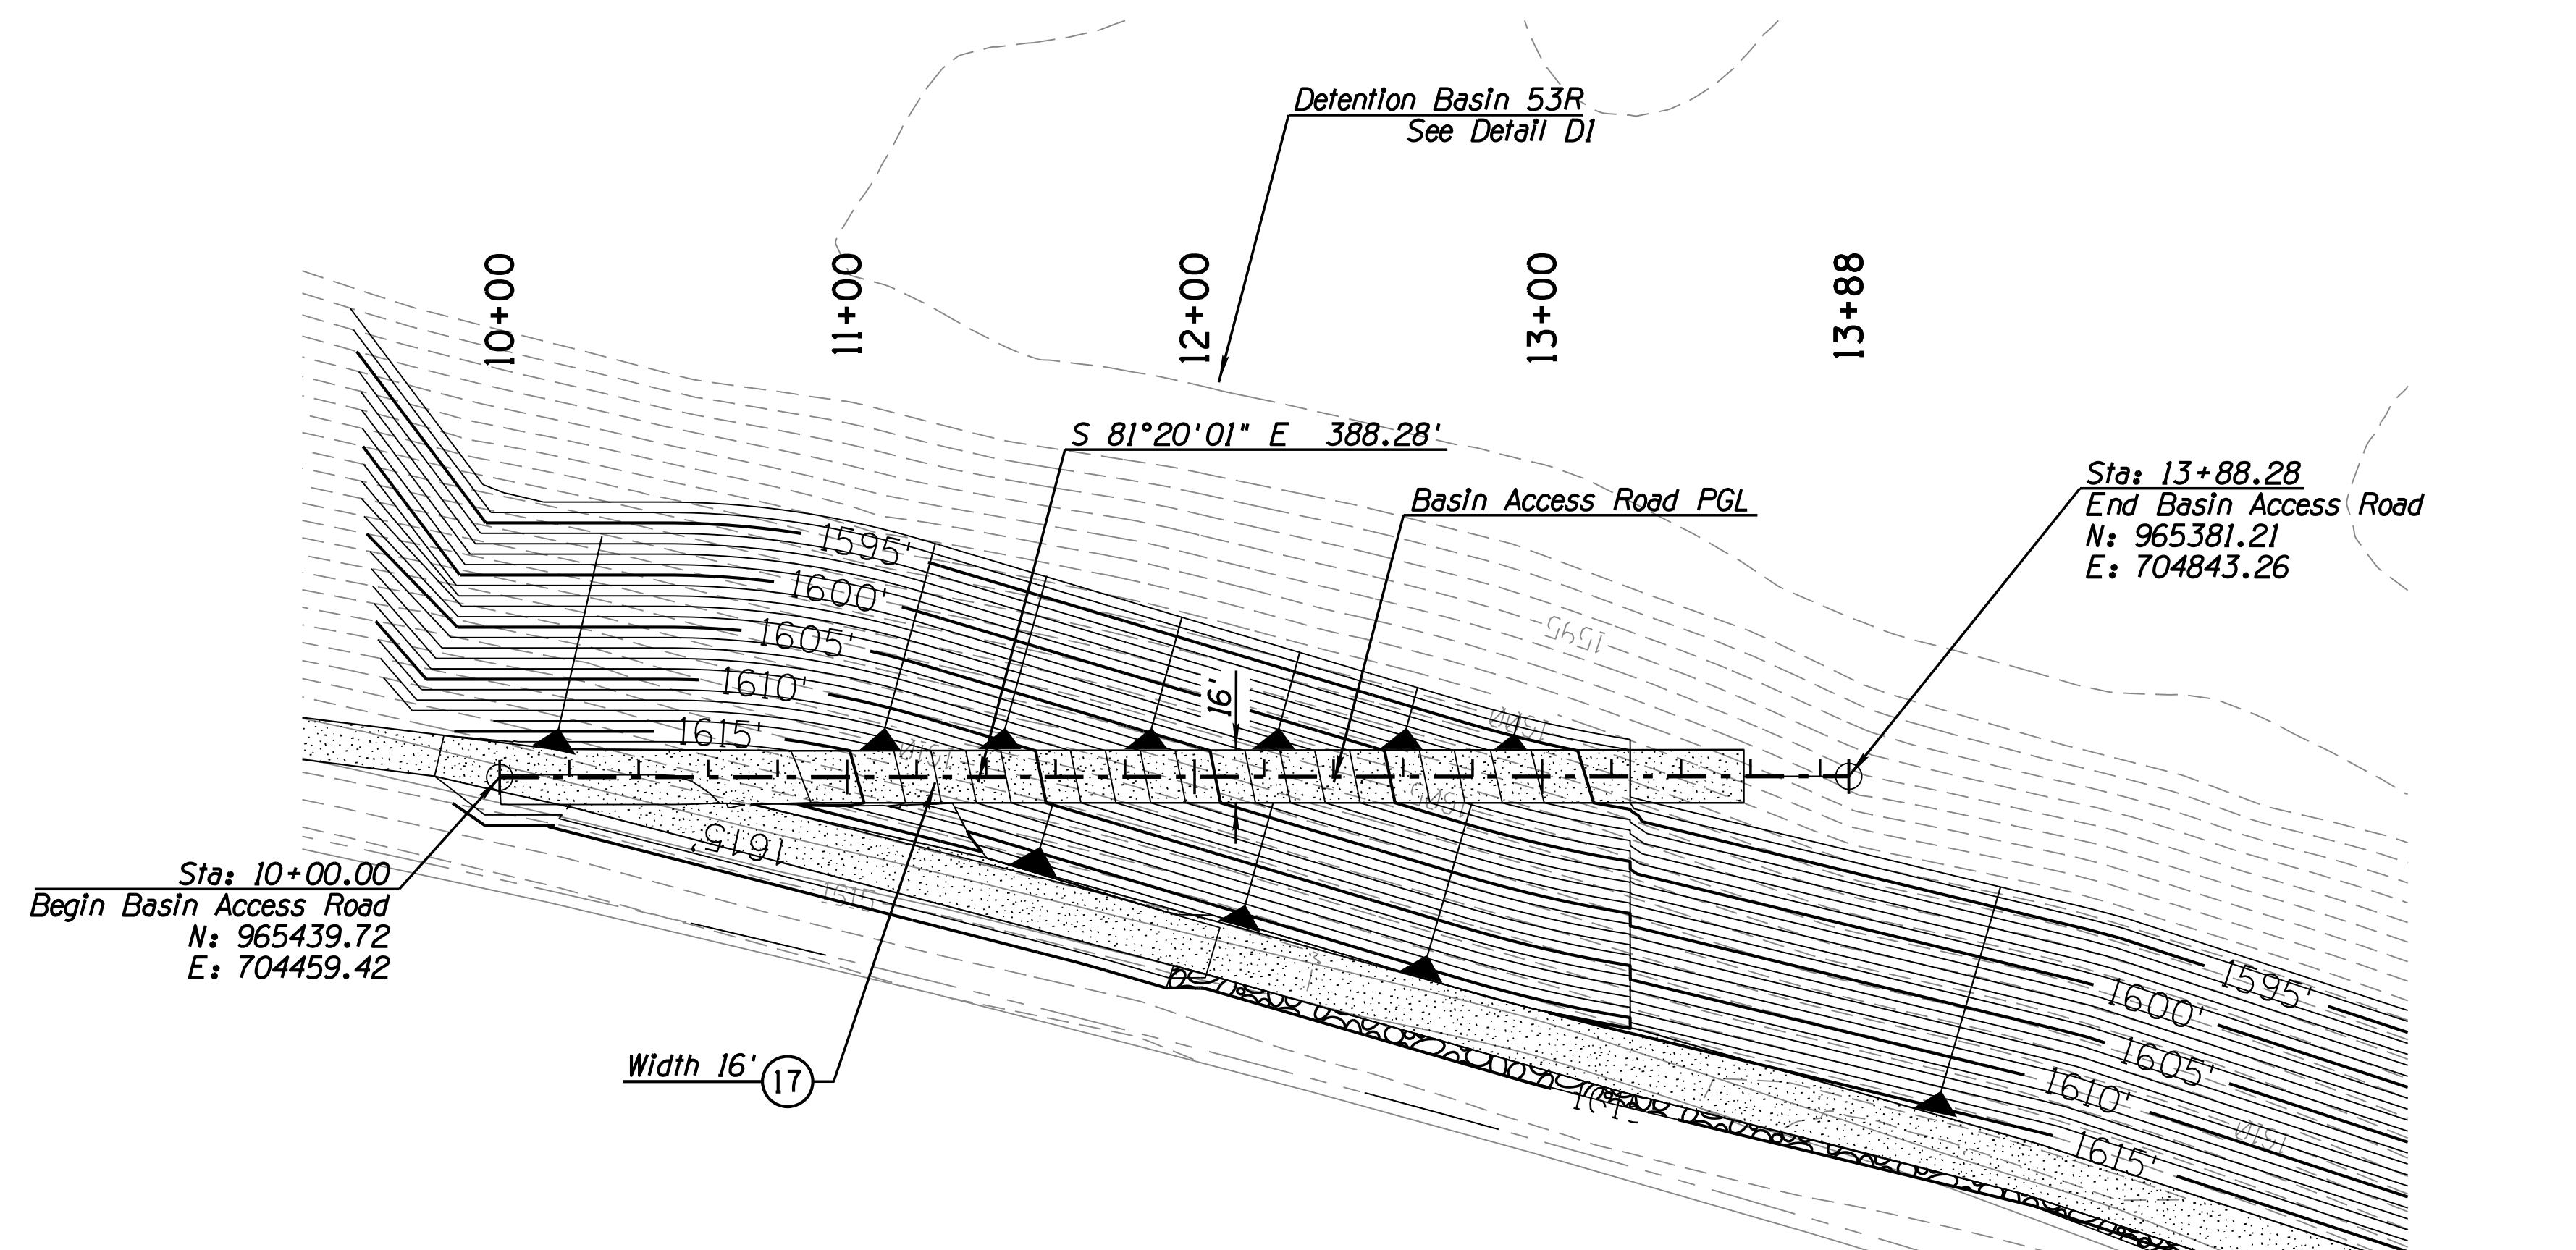

2929 N. CENTRAL AVE. SUITE 800
PHOENIX, AZ 85012
Phone: (602) 279-1234
MBAKERINTL.COM

REMOVAL & RELOCATION NOTES

Description	Unit	Quan
3 Salvage and Relocate Native Trees		
7 Salvage and Relocate Native Cacti		

CONSTRUCTION NOTES

Description	Unit	Quan
(13) Dumped Riprap D50 per Plan See Dtl 1, Sheet D14	CY	55
(17) 6" AB Access Road per Section on Sheet G4, Width per Plan	SY	588
(23) Barrier Wire Fence See Sheets D16, D17 & See Detail 1, Sheet D14.		
(24) Wire Fence Gate See Detail 2, Sheet D14		

GENERAL NOTES

Basin Access Road Point Table			
Point	Northing	Easting	Station
1	967114.61	704922.27	8+61.72
2	967055.19	704871.31	9+40.00
3	966997.48	704854.88	10+00.00
4	966935.26	704860.07	10+62.44
5	966799.86	704821.52	12+03.22



DATE: 3/13/20	REVISION:	CITY COMMENTS	BY: A.S.N.
PROJECT TITLE: CROSSROADS EAST DRAINAGE INFRASTRUCTURE			
SHEET TITLE: BASIN ACCESS ROAD PLAN & PROFILE			
DESIGNED BY:	DESIGNED AC	DATE: 07/19	BID NO. XXXX
ENGINEERED BY:	DRAWN JJP	AS-BUILT XX/XX	SH. SHT. SD9
SCALE: HORIZ. 1"=40' VERT. 1"=8'	PROJECT NO. 400-FB53B-56047	17 of 38	

Michael Baker

INTERNATIONAL

REMOVAL & RELOCATION NOTES

Description	Unit	Quan
3 Salvage and Relocate Native Trees		
7 Salvage and Relocate Native Cacti		

CONSTRUCTION NOTES

Description	Unit	Quan
(13) Dumped Riprap D50 per Plan See Dtl 1, Sheet D13	CY	15
(17) 6" AB Access Road per Section on Sheet G4, Width per Plan	SY	818
(23) Barrier Wire Fence See Sheets D16, D17 & See Detail 1, Sheet D14		

Basin Access Road Point Table			
Point	Northing	Easting	Station
6	966567.72	704677.42	14+76.45
7	966169.63	704497.75	19+13.20



DATE: 3/13/20	REVISION:	CITY COMMENTS	BY: A.S.N.
ENGINEER	DESIGNER	REVIEWED BY	APPROVED BY
REG. PROJ. NO. 5986	REG. PROJ. NO. 5986	31-3120	31-3120
ZEEZ	ZEEZ	SCOTTSDALE	SCOTTSDALE
SALIBA	SALIBA	ARIZONA	ARIZONA
Expt. 3/3/21	Expt. 3/3/21	7447 E. INDIAN SCHOOL RD.	7447 E. INDIAN SCHOOL RD.
CITY OF SCOTTSDALE			
SCOTTSDALE, ARIZONA 85251			

BASIN ACCESS ROAD PLAN & PROFILE

PROJECT TITLE	CROSSROADS EAST DRAINAGE INFRASTRUCTURE		
SCALE	DESIGNED	DATE	BID NO.
HORIZ. 1"=40'	AC	07/19	XXX
VERT. 1"=8'	DRAWN	AS-BUILT	SHT. SD10
	JJP	XX/XX	PROJECT NO. 400-FB53B-56047

8:55:42 AM

PLOT DATE: 3/13/2020

Match Line Sta 13+00 See Sheet SD09

1640

1630

1620

1610

1600


13+00

Powerline Channel
See Sheets SD5 & SD6

Existing Cactus
Salvage and Relocate (Typ) 7

Existing Tree
Salvage and Relocate (Typ) 3

Match Line Sta 13+00 See Sheet SD09

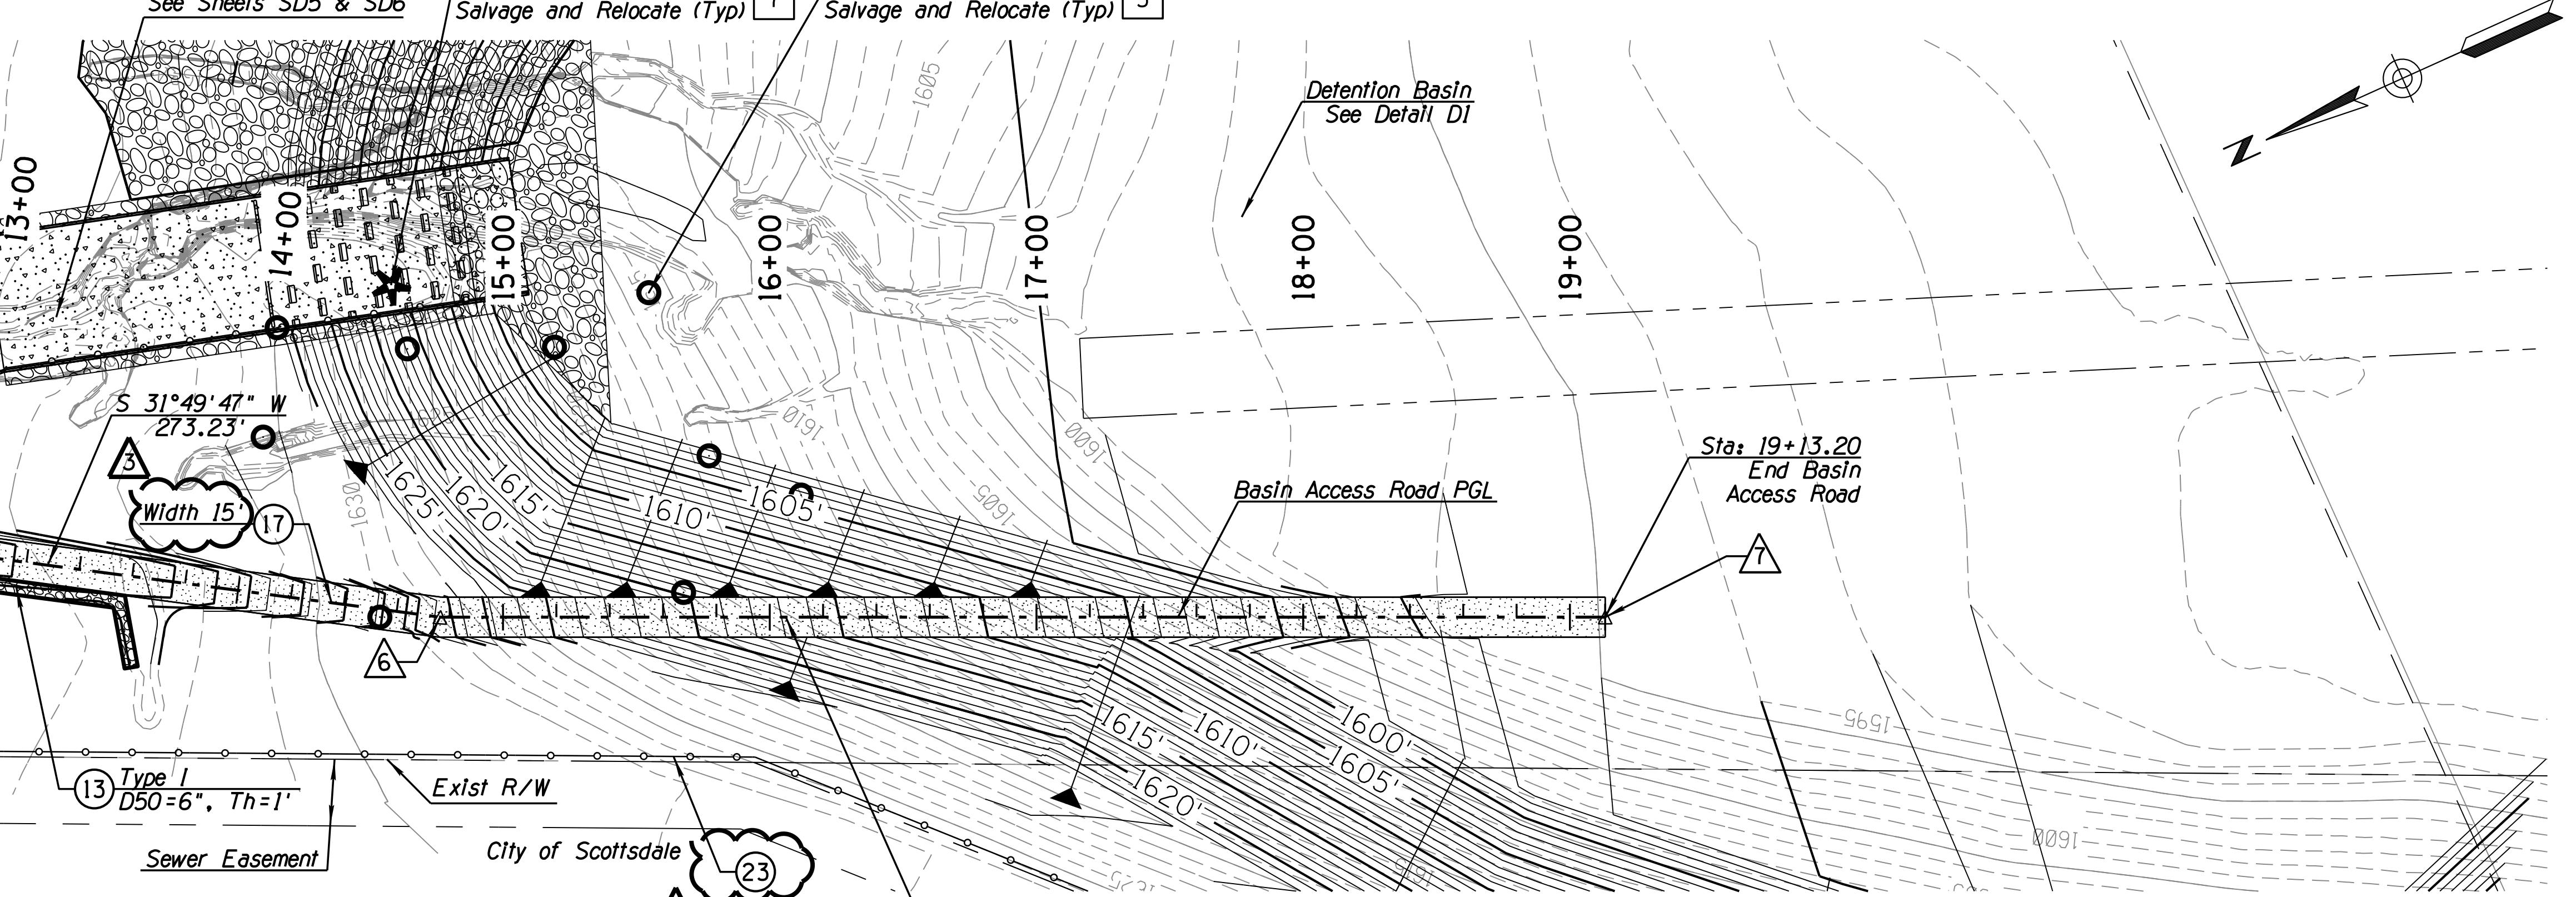

DESIGN FILE: W:\P\JO\169678-Crossroads-East\CAD\Sheet Files\Drainage\169678 SD10-Basin west access road.dgn

1640


1630

1620

1610

1600

13+00

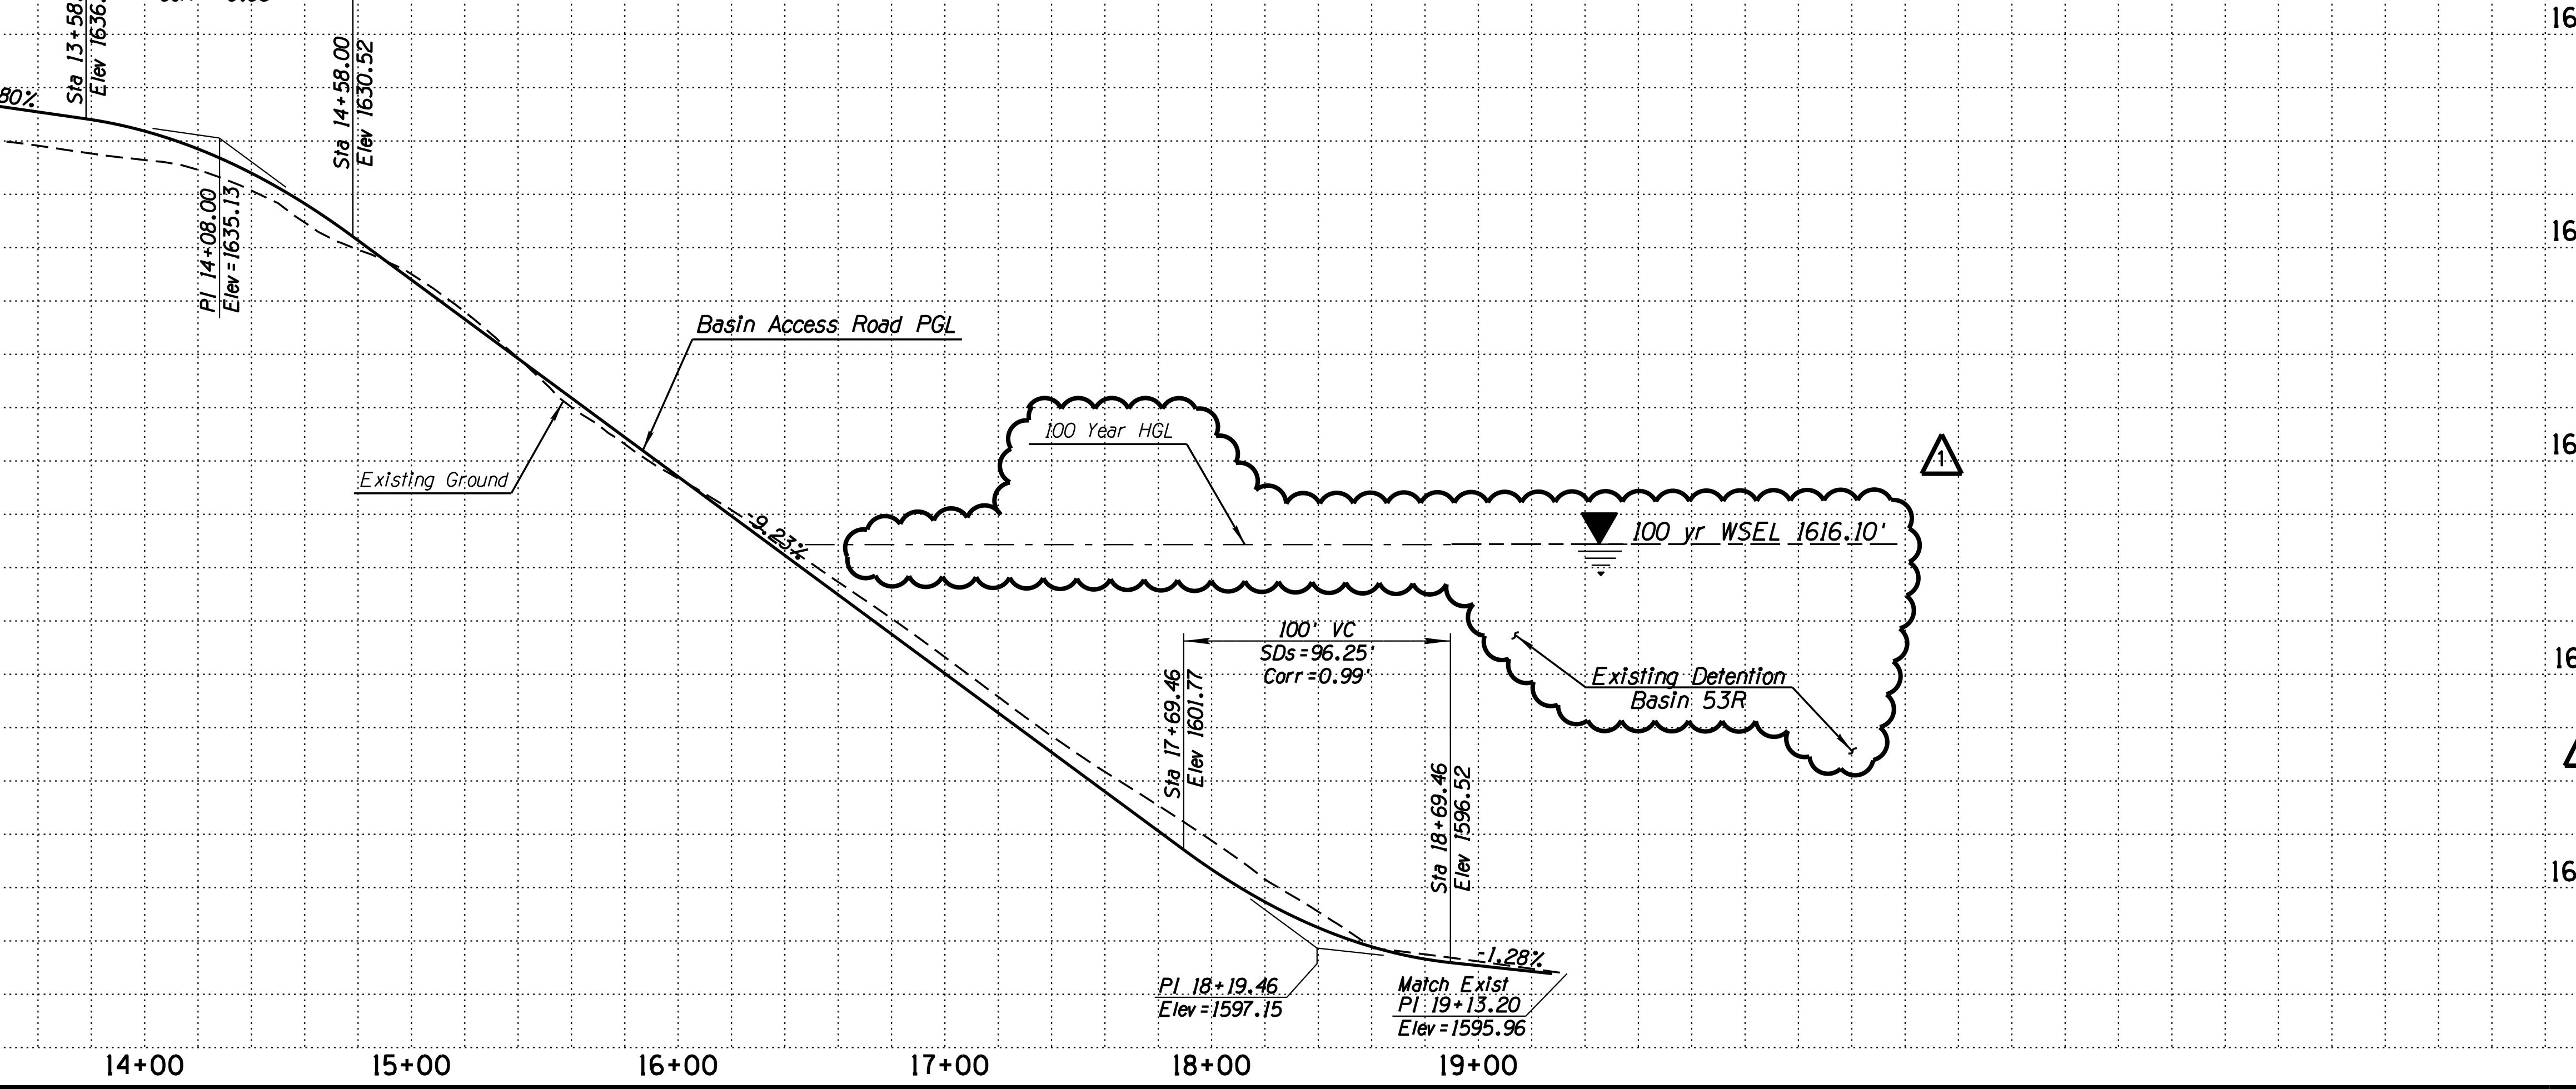

124-SA-2018

Plan Check No: 4817-18-6

REMOVAL & RELOCATION NOTES

Description	Unit	Quan
3 Salvage and Relocate Native Trees		
7 Salvage and Relocate Native Cacti		



CONSTRUCTION NOTES

Description	Unit	Quan
(17) 6" AB Access Road, Per Section on Sheet G4 Width per Plan.	SY	262
(23) Barrier Wire Fence		
(23) See Sheets D16, D17 & See Detail 1, Sheet D14		
(24) Wire Fence Gate		
(24) See Detail 2, Sheet D14		

20 0 20 40
HORIZ SCALE IN FEET
2.5 0 4 8
VERT SCALE IN FEET




DATE: 3/13/20	REVISION:	CITY COMMENTS	BY: A.S.N.
ENGINEERED BY:			
CITY OF SCOTTSDALE			
5986 ZEEZ SALIBA			
7447 E. INDIAN SCHOOL RD., SCOTTSDALE, ARIZONA 85251			
CAPITAL PROJECT MANAGEMENT			
SHEET TITLE: BASIN ACCESS ROAD PLAN & PROFILE			
PROJECT TITLE: CROSSROADS EAST DRAINAGE INFRASTRUCTURE			
SCALE: 1"=40'	DESIGNED AC	DATE 07/19	BID NO. XXXX
HORIZ. 1"=8'	DRAWN JJP	AS-BUILT XX/XX	SH. SDII
PROJECT NO. 400-FB53B-56047			

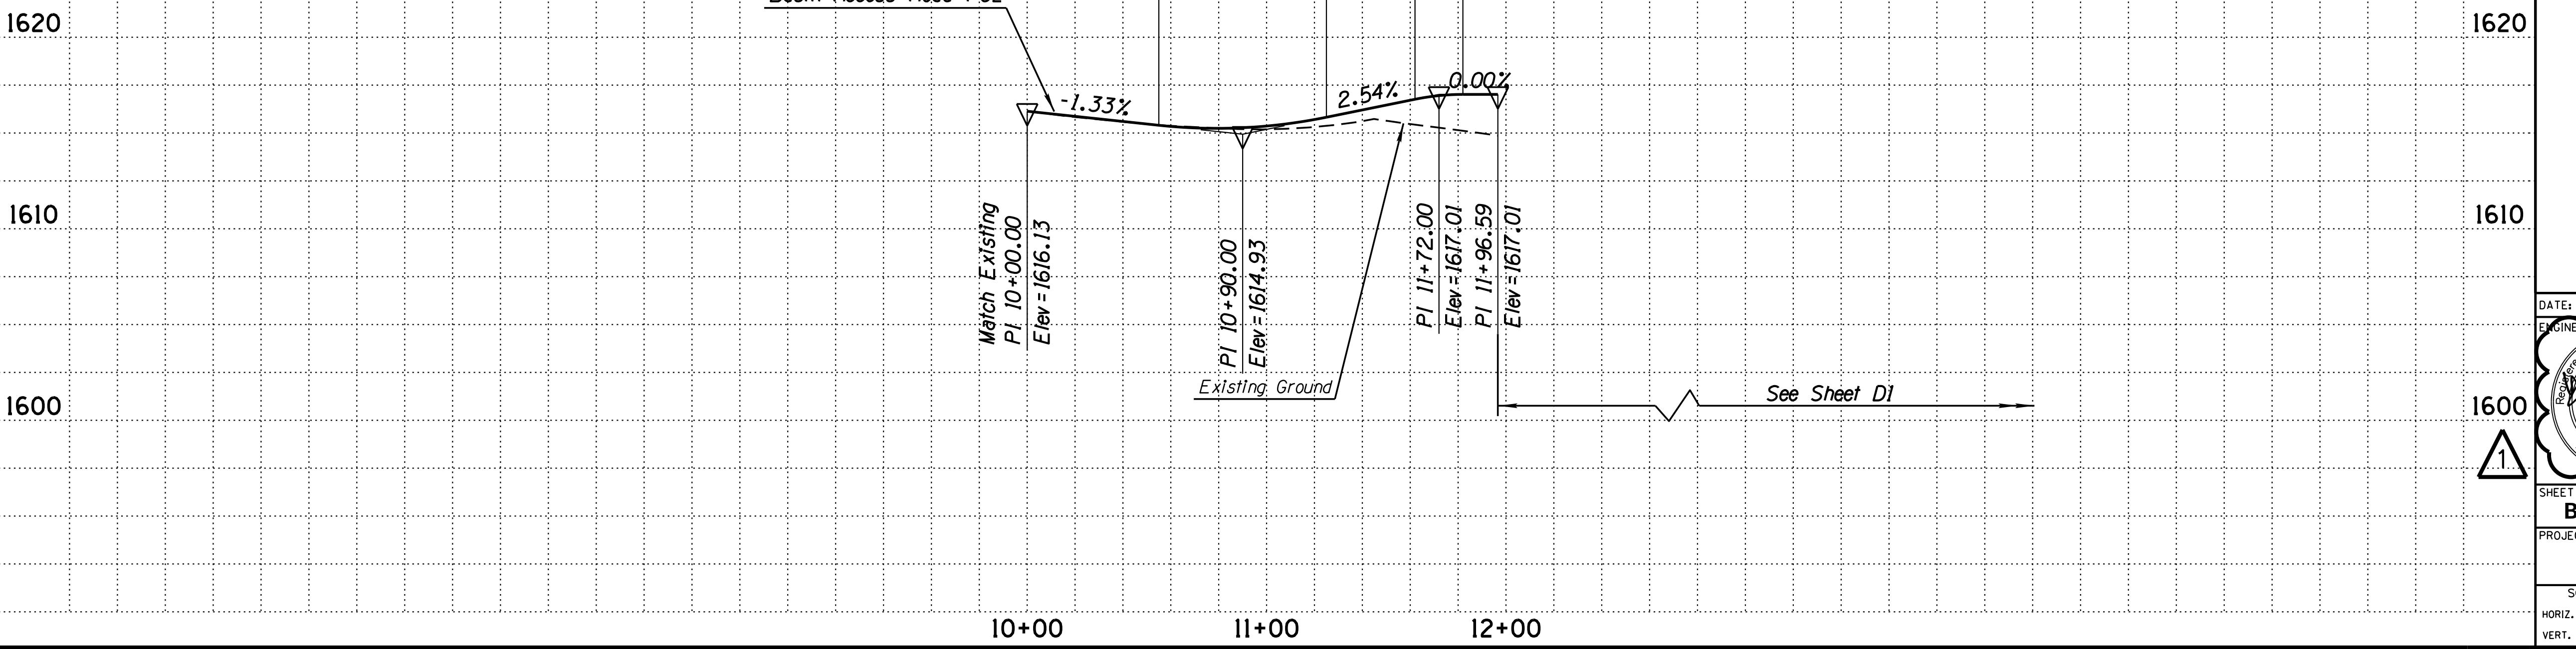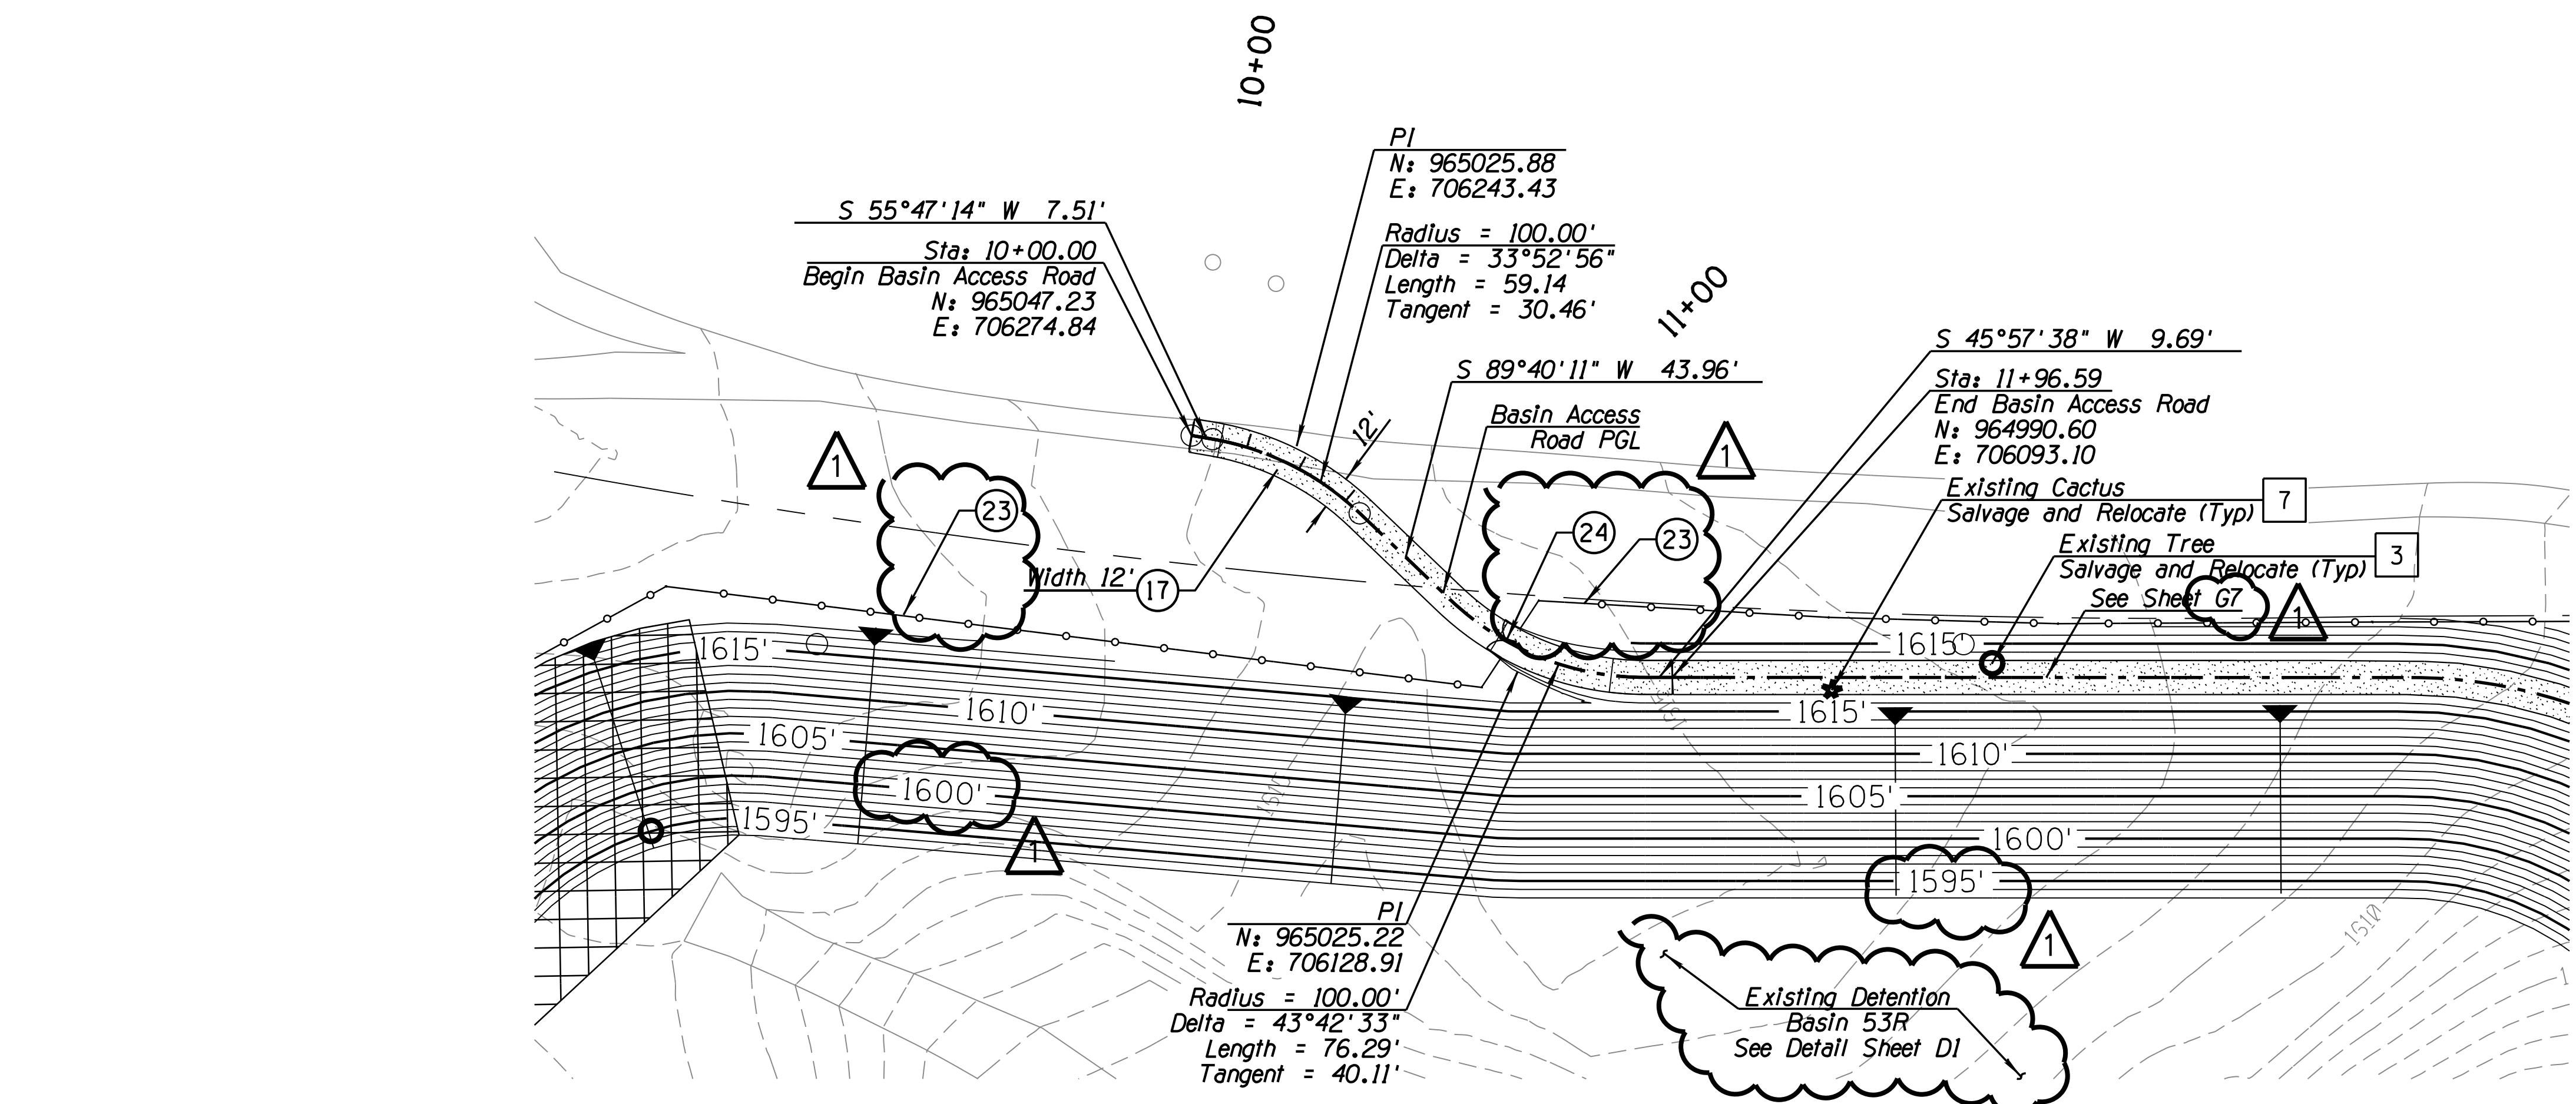

PLOT DATE: 3/13/2020

DESIGN FILE: W:\P\POJ\169678-Crossroads.East\CAD\Sheet Files\Drainage\169678-D1-BASIN.DWG

12:16:46 PM



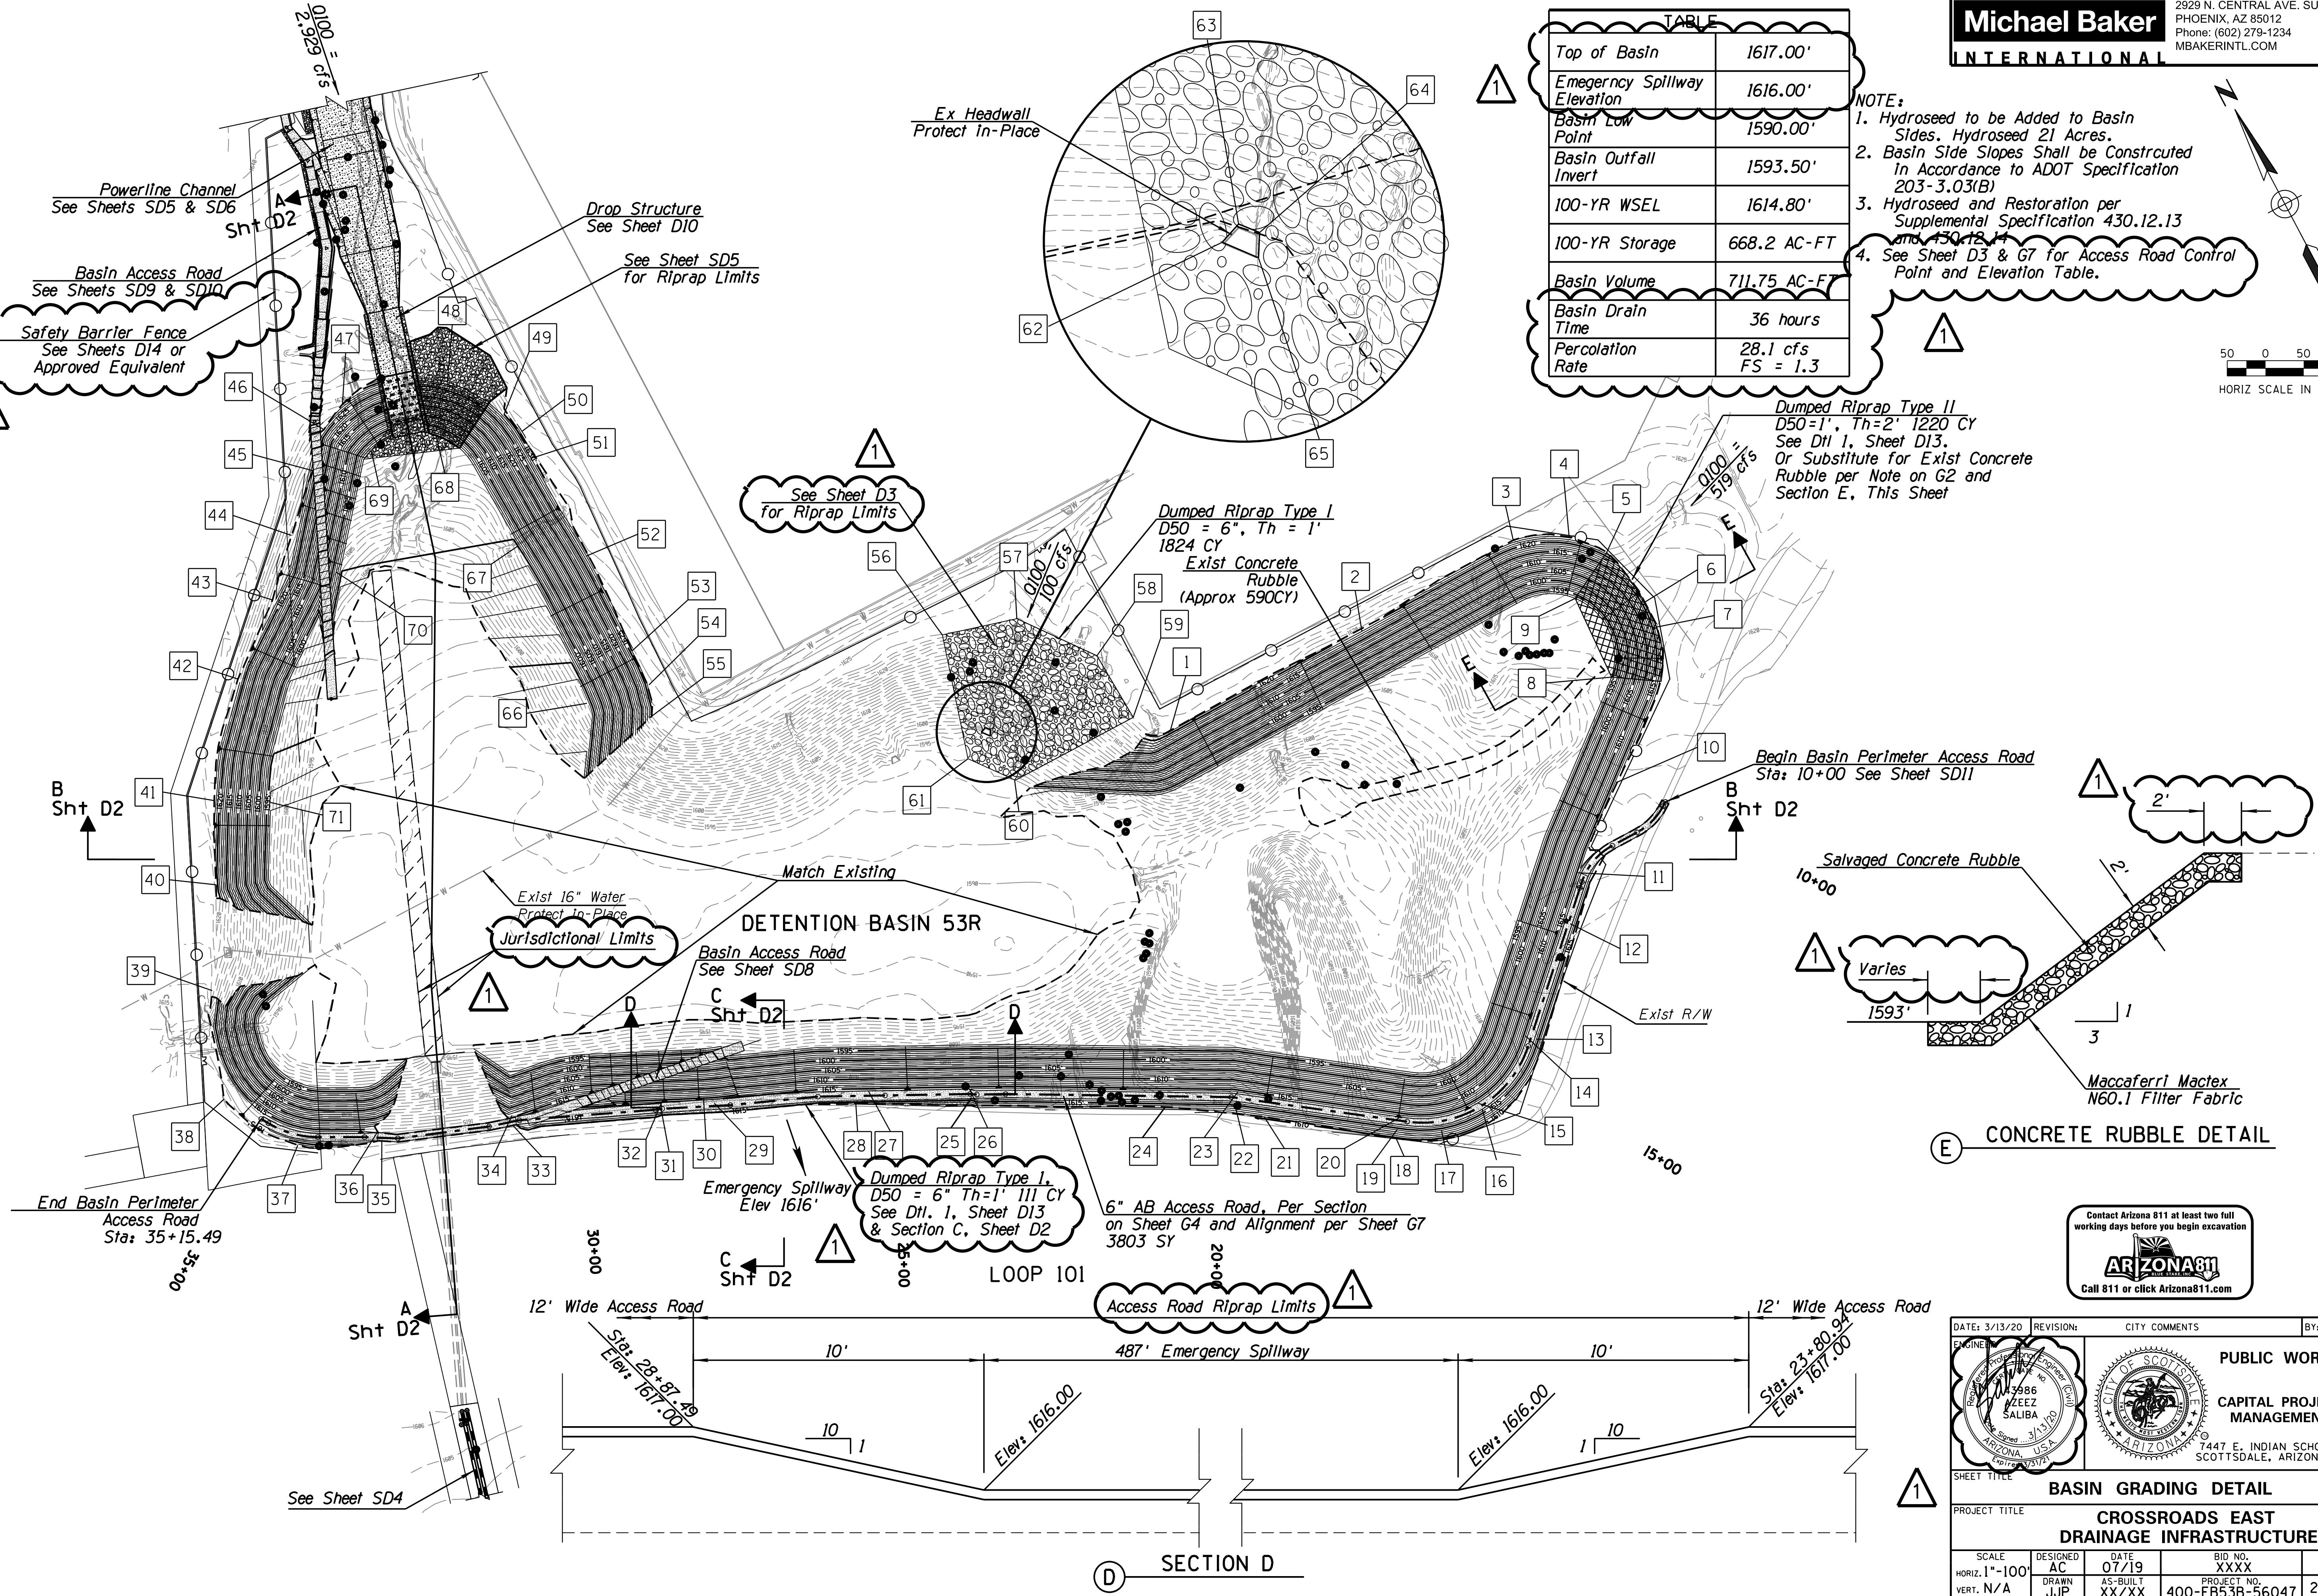


DATE: 3/13/20	REVISION:	CITY COMMENTS	BY: A.S.N.
PUBLIC WORKS			
CROSSROADS EAST DRAINAGE INFRASTRUCTURE			
BASIN GRADING DETAIL			
PROJECT TITLE			
SCALE HORIZ. 1"-100' VERT. N/A	DESIGNED AC DRAWN JJP	DATE 07/19 AS-BUILT XX/XX	BID NO. XXXX PROJECT NO. 400-FB53B-56047
SHT. D			

REGULAR PROJECT
 PROJECT NO. 5986
 ZEEZ SALIBA
 ARIZONA, USA
 7447 E. INDIAN SCHOOL RD.
 SCOTTSDALE, ARIZONA 85251
 SHEET TITLE
 PUBLIC WORKS
 CAPITAL PROJECT MANAGEMENT
 CITY OF SCOTTSDALE
 ARIZONA
 124-SA-2018 Plan Check No: 4817-18-6

PLOT DATE: 3/13/2020

DESIGN FILE: W:\P\PJ\169678-Crossroads.East\CAD\Sheet.F1s\Drainage\169678-D2-BASIN-DETAIL.dwg

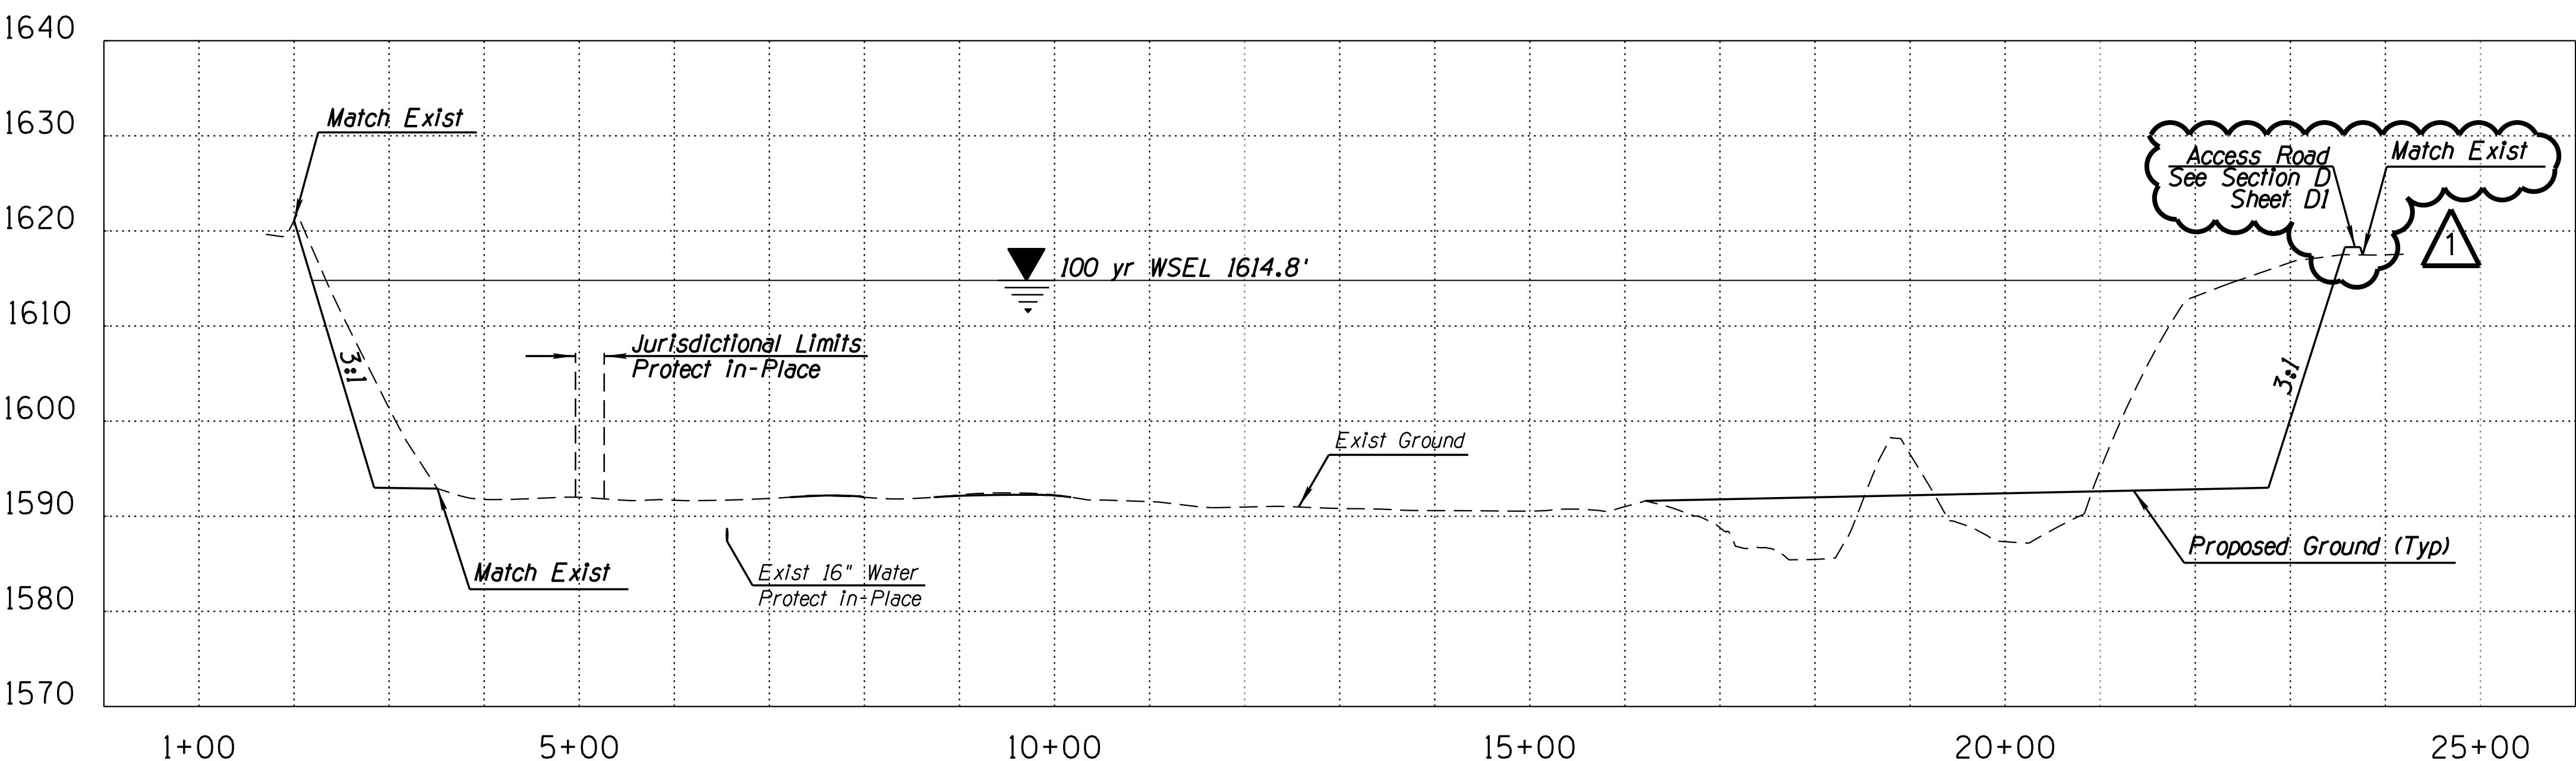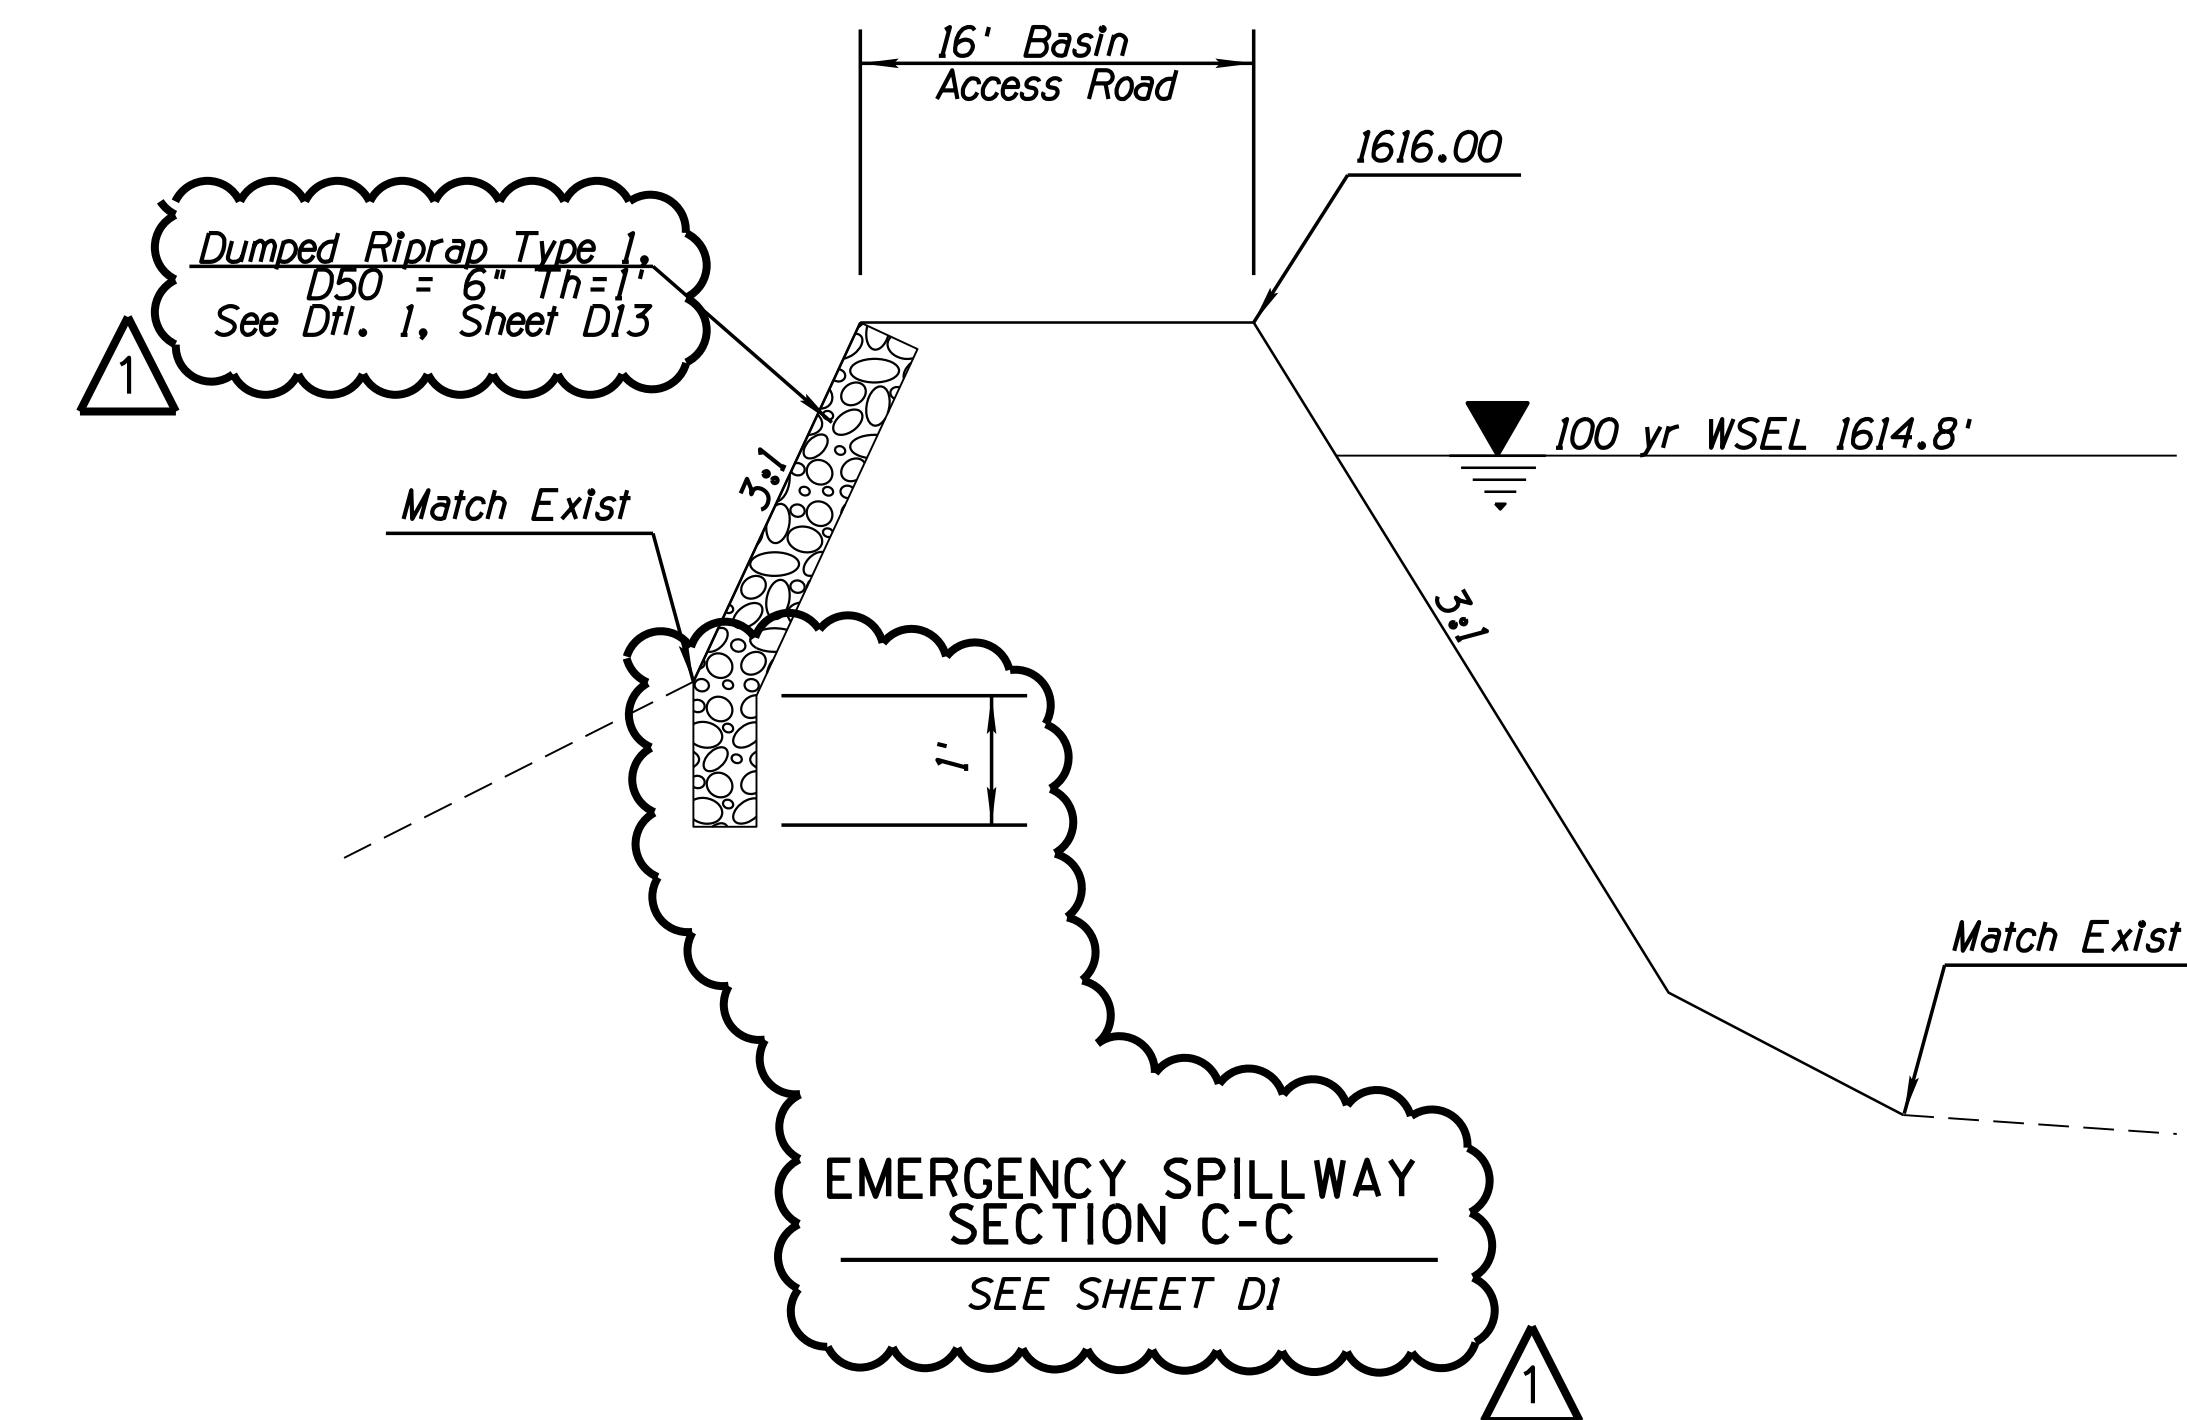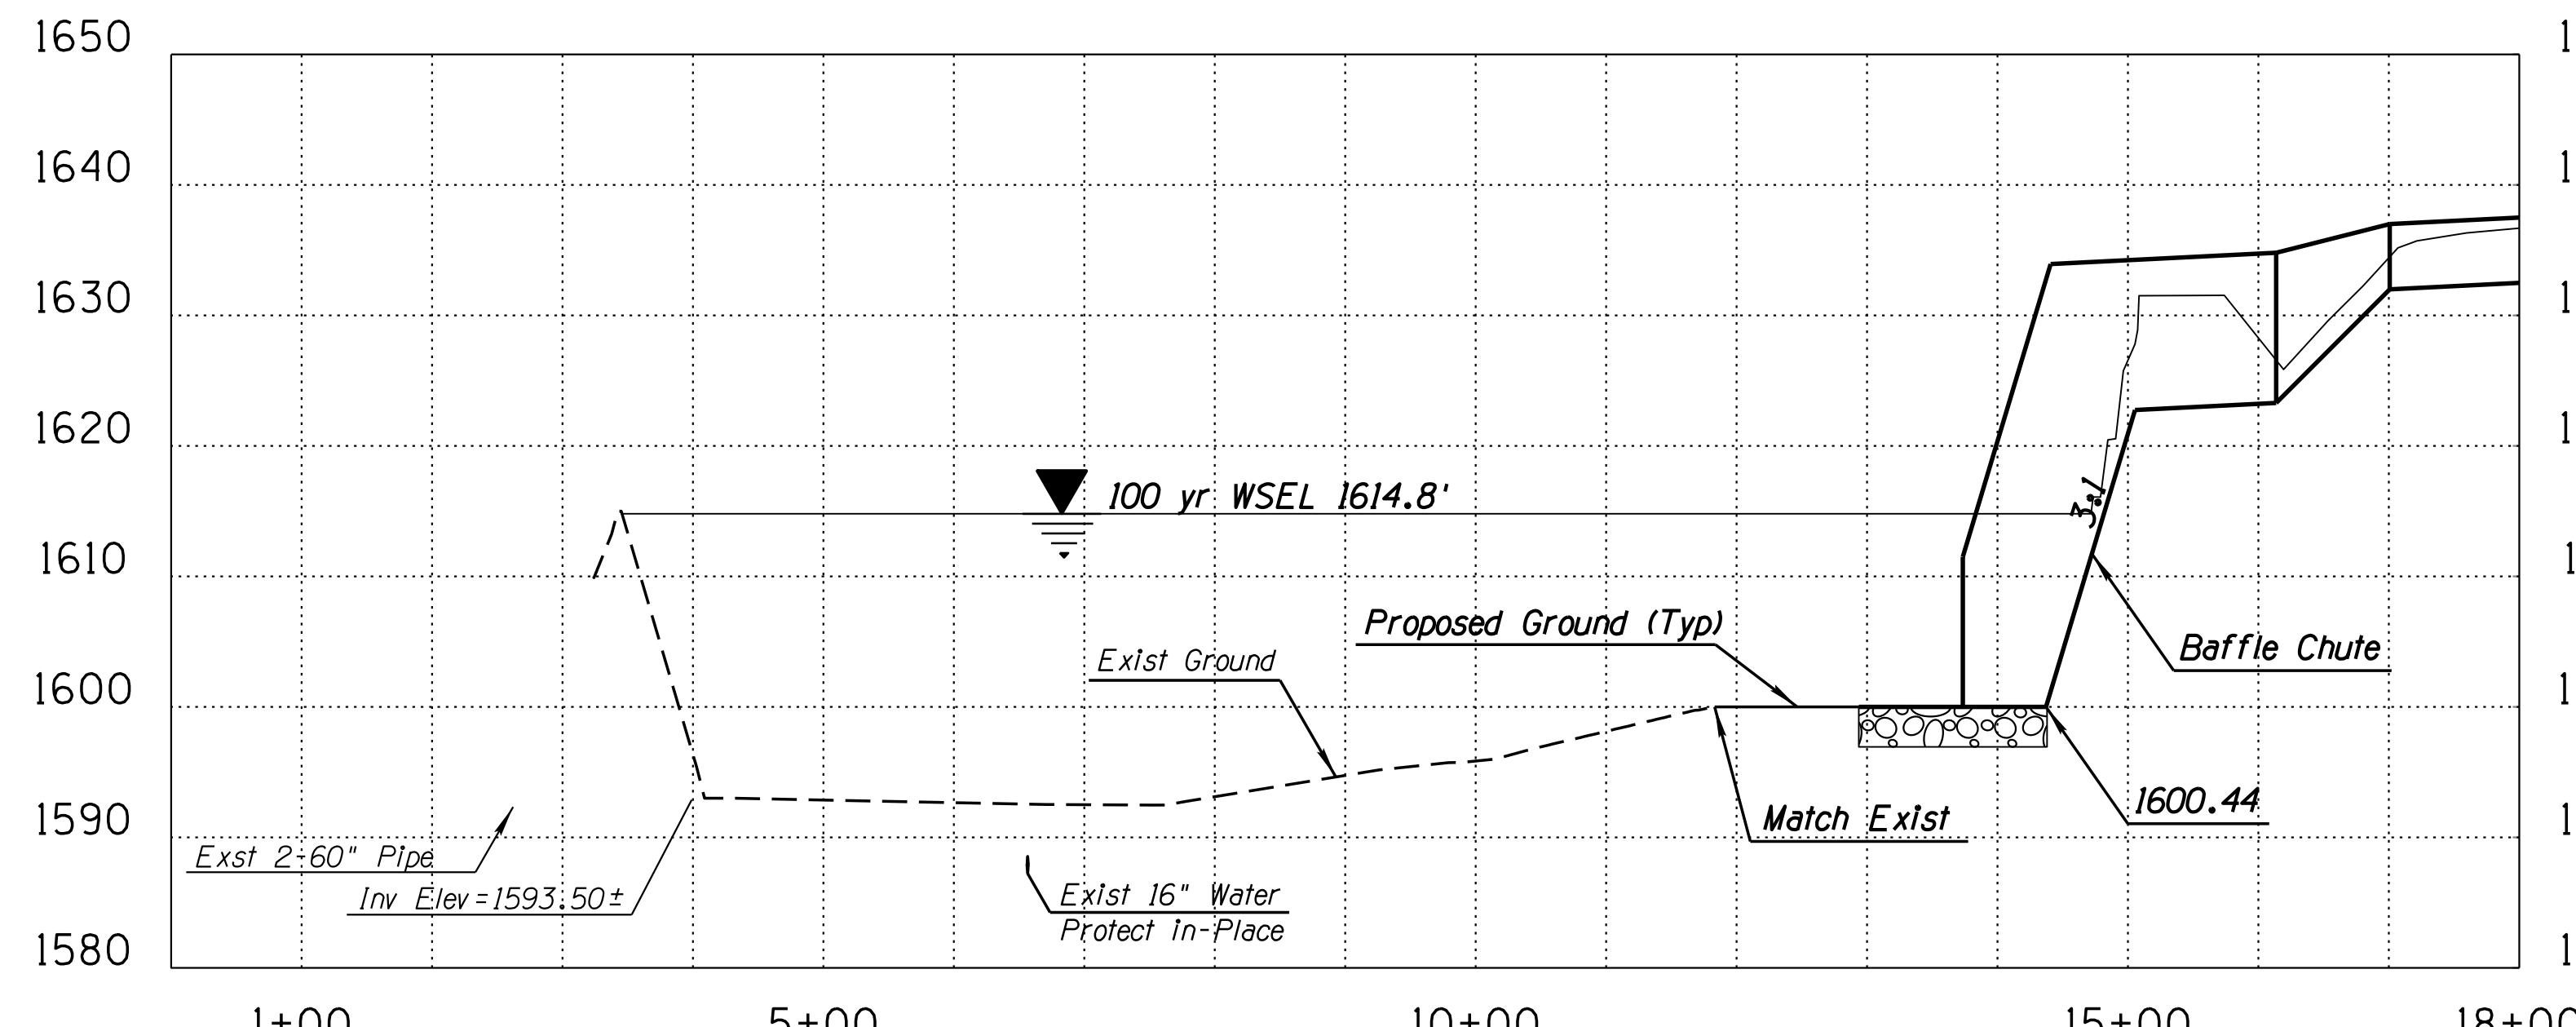

DATE: 3/13/20		REVISION:	CITY COMMENTS		BY: A.S.N.
ENGINEERED BY:	REVIEWED BY:	APPROVED BY:	INITIALS:	INITIALS:	INITIALS:
J. ZEEZ SALIBA		3/13/20	CITY OF SCOTTSDALE		PUBLIC WORKS
ARIZONA, USA		7447 E. INDIAN SCHOOL RD.	CROSSROADS EAST		CAPITAL PROJECT MANAGEMENT
		SCOTTSDALE, ARIZONA 85251	DRAINAGE INFRASTRUCTURE		
BASIN GRADING DETAIL					
PROJECT TITLE: CROSSROADS EAST DRAINAGE INFRASTRUCTURE					
SCALE: HORIZ. 1"=10"	DESIGNED AC	DATE 07/19	BID NO. XXXX	SHT. D2	
VERT. 1"=10"	DRAWN JJP	AS-BUILT XX/XX	PROJECT NO. 400-FB53B-56047	21 of 38	

PLOT DATE: 3/13/2020

7:01:20 AM

DESIGN FILE: W:\P-OJ\169678-Crossroads-East\CAD\Sheet Files\Drainage\169678-D3-BASIN-DETAIL.dwg


POINT	NORTHING	EASTING	ELEVATION
1	965509.35	705638.61	1621.06
2	965507.57	705978.66	1619.08
3	965522.75	706255.72	1624.02
4	965485.39	706335.47	1623.10
5	965436.87	706376.34	1621.64
6	965339.92	706392.54	1617.00
7	965217.70	706357.31	1617.01
8	965305.41	706318.62	1593.03
9	965416.27	706276.18	1593.00
10	965110.25	706220.52	1617.00
11	965013.00	706101.34	1615.30
12	964947.93	706053.08	1617.00
13	964812.53	705921.01	1617.00
14	964825.38	705908.42	1617.00
15	964766.72	705792.79	1617.00
16	964754.64	705794.52	1617.00
17	964763.11	705724.75	1617.00
18	964777.45	705653.64	1609.37
19	964793.13	705670.17	1617.00
20	964803.85	705672.61	1617.00
21	964904.70	705486.01	1609.54
22	964945.19	705454.85	1617.00
23	964958.63	705468.46	1617.00
24	964990.56	705355.62	1611.29
25	965145.02	705092.22	1616.00
26	965159.38	705096.95	1616.00
27	965223.64	704928.65	1616.00
28	965229.73	704954.94	1616.00
29	965327.15	704731.93	1616.00
30	965342.24	704720.69	1616.00
31	965352.39	704651.80	1616.00
32	965366.16	704658.35	1616.00
33	965443.86	704435.80	1617.00
34	965458.92	704441.93	1617.00
35	965518.59	704241.88	1617.00

Note: See sheet D1 for point labels.
All units are in feet.



POINT	NORTHING	EASTING	ELEVATION
36	965535.42	704244.08	1617.00
37	965574.90	704122.21	1617.00
38	965693.02	704053.41	1617.00
39	965852.09	704116.27	1618.30
40	965996.68	704199.97	1620.51
41	966115.05	704259.20	1622.56
42	966266.53	704381.43	1622.96
43	966351.03	704487.56	1620.00
44	966426.65	704561.46	1621.25
45	966500.82	704638.78	1622.35
46	966549.89	704684.26	1626.97
47	966571.50	704728.47	1629.13
48	966512.36	704891.27	1626.37
49	966438.89	704945.58	1630.00
50	966402.17	704958.77	1632.26
51	966357.86	704950.83	1629.09
52	966181.51	704955.90	1628.64
53	966016.25	704950.03	1626.81
54	965956.45	704948.31	1626.67
55	965910.98	704929.18	1625.01
56	965810.35	705392.67	1623.74
57	965778.15	705508.14	1622.91
58	965667.84	705592.167	1623.03
59	965555.54	705597.339	1622.05
60	965554.76	705387.367	1592.79
61	965619.46	705337.36	1592.72
62	965646.65	705375.39	1593.00
63	965649.99	705384.42	1593.00
64	965643.16	705390.14	1593.00
65	965634.59	705385.11	1593.00
66	965976.42	704848.66	1593.00
67	966245.63	704866.99	1600.02
68	966458.29	704835.32	1600.44
69	966484.40	704734.10	1600.44
70	966343.22	704596.31	1603.56
71	966071.04	704336.19	1593.00

Note: See sheet D1 for point labels.
All units are in feet.

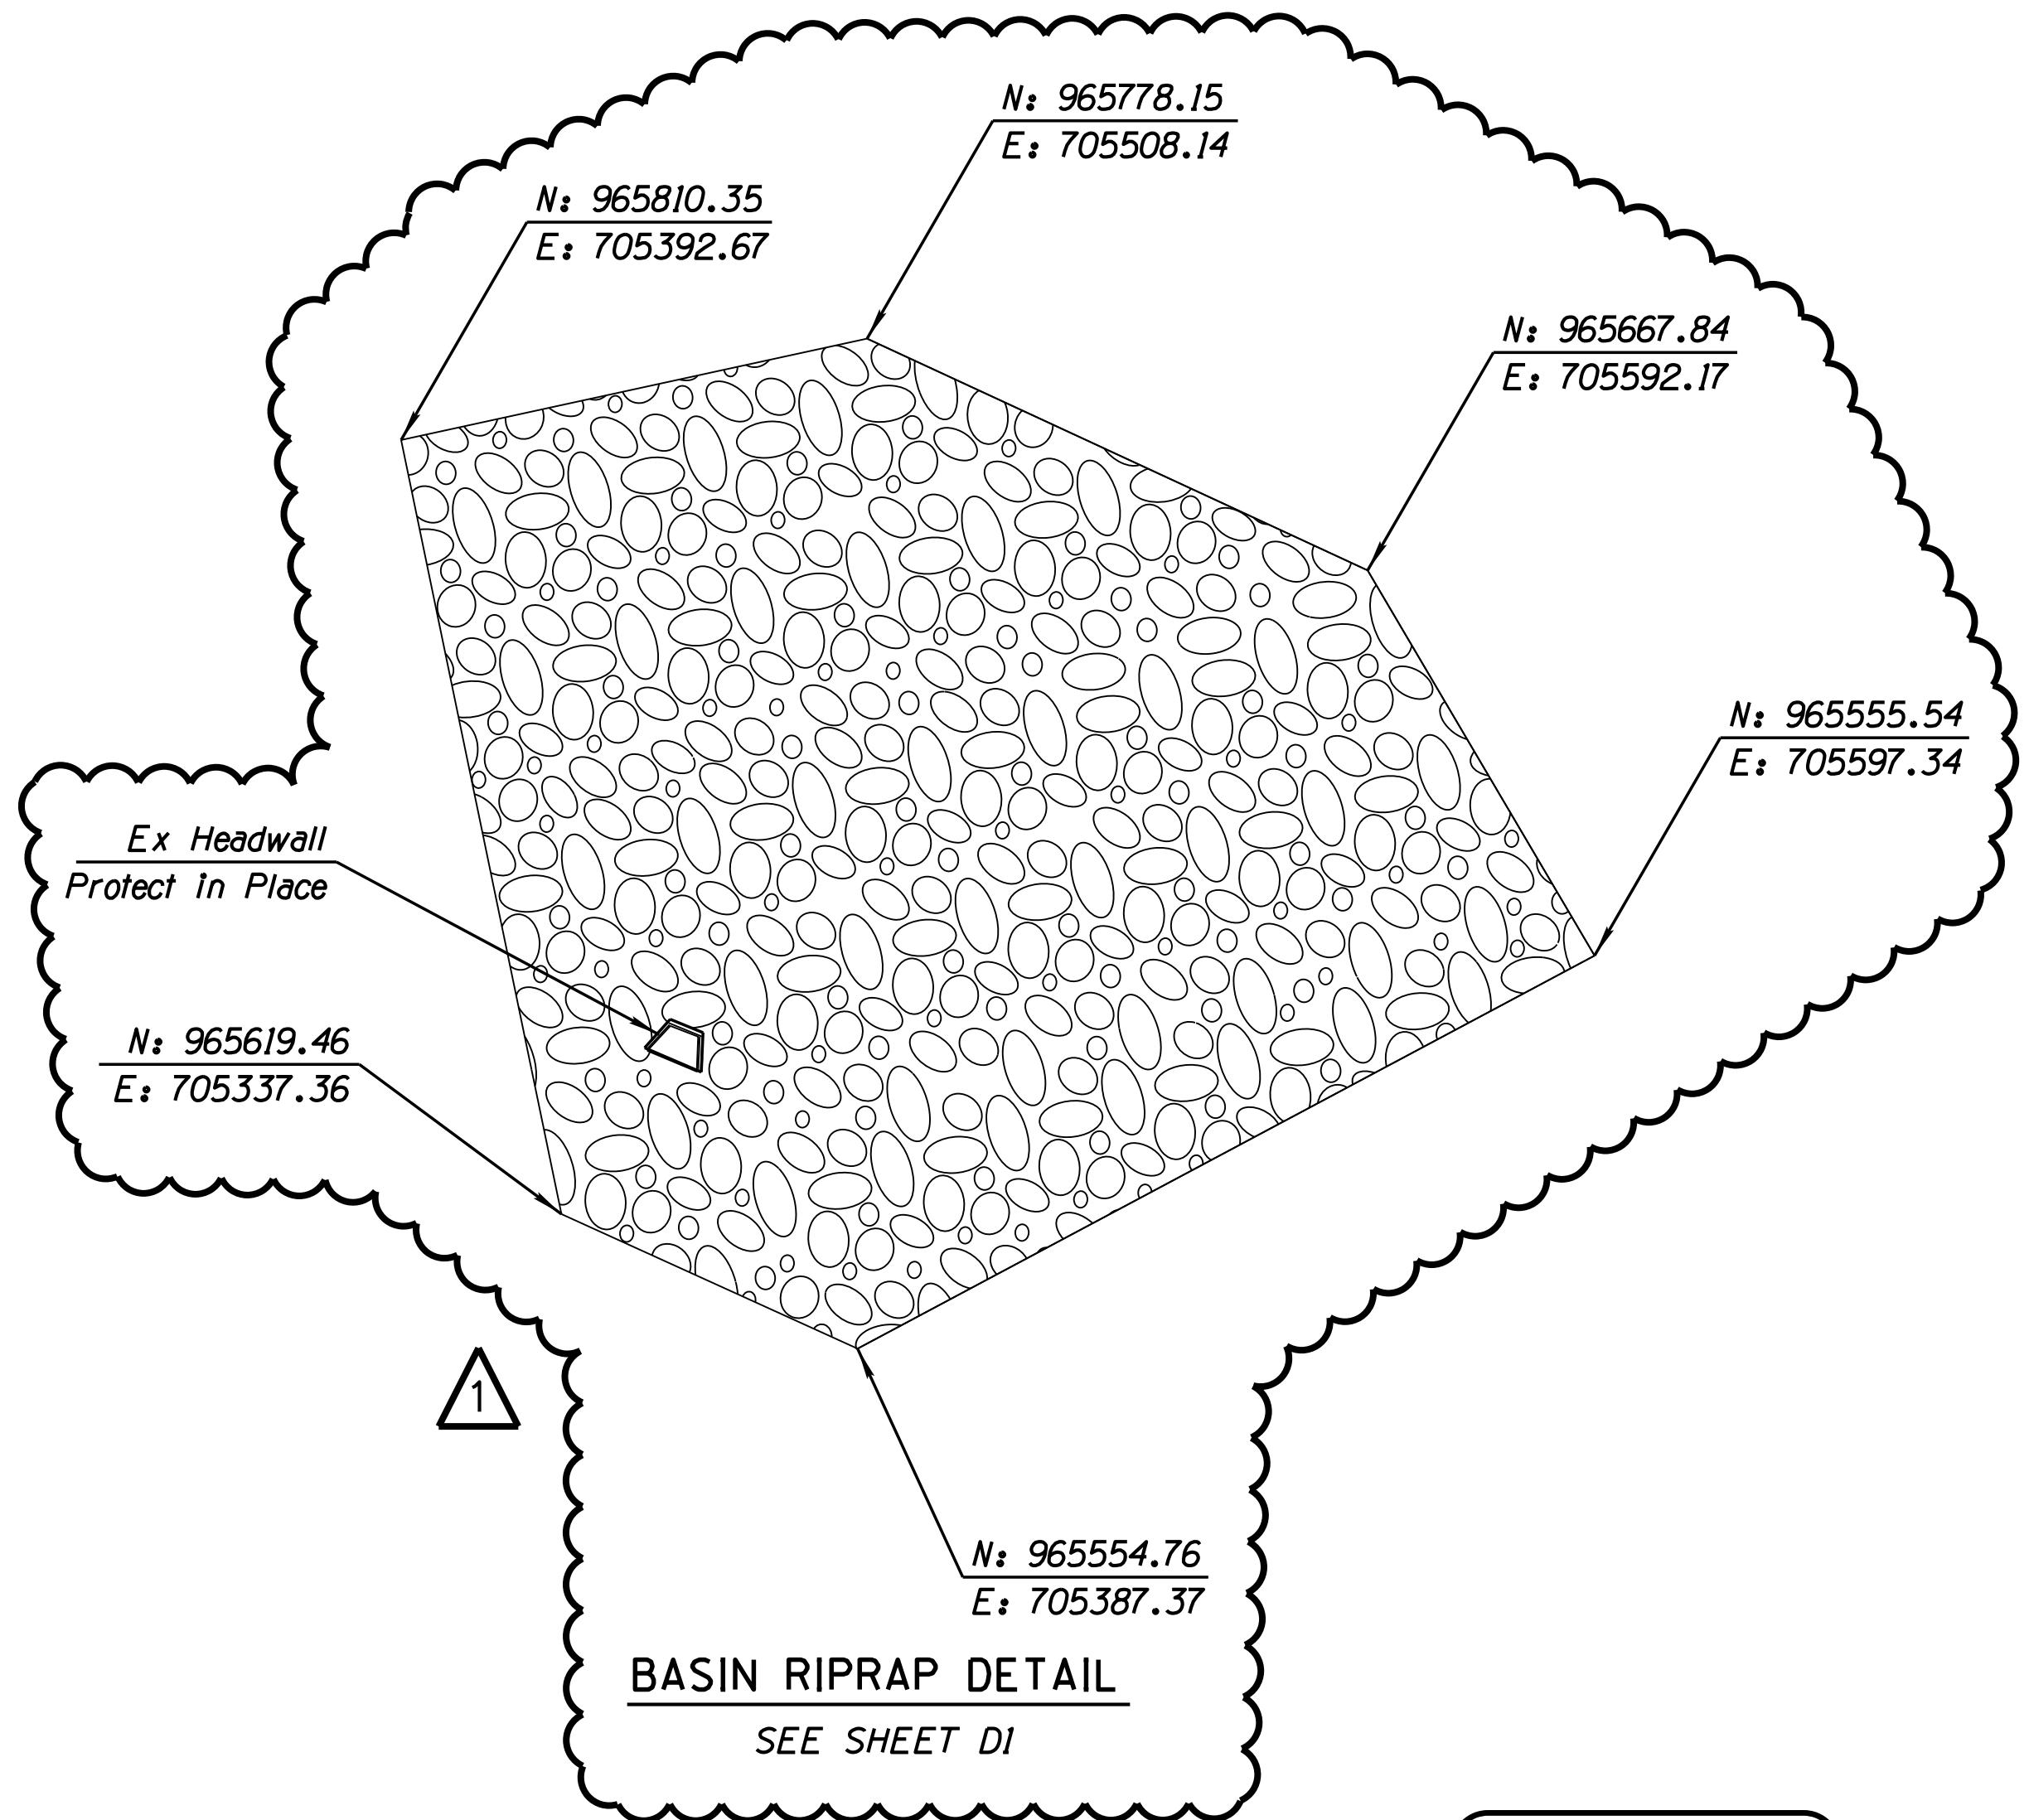


DATE: 3/13/20		REVISION:	CITY COMMENTS	BY: A.S.N.
ENG/INSR:		PUBLIC WORKS		
REG. NO. 5986 ZEEZ SALIBA EPA Signed 3/13/20		CITY OF SCOTTSDALE ARIZONA, USA		
SHEET TITLE PROJECT TITLE CROSSROADS EAST DRAINAGE INFRASTRUCTURE		CAPITAL PROJECT MANAGEMENT 7447 E. INDIAN SCHOOL RD. SCOTTSDALE, ARIZONA 85251		
SCALE HORIZ N/A VERT. N/A	DESIGNED AC DRAWN JJP	DATE 07/19 AS-BUILT XX/XX	BID NO. XXX PROJECT NO. 400-FB53B-56047	SHT. D3

PLOT DATE: 3/13/2020 8:49:03 AM

DESIGN FILE: W:\Proj\169678-Crossroads-East\CAD\Sheet Files\Drainage\169678-D4_Haulupai channel detail.dwg

PLOT DATE: 3/13/2020 8:49:03 AM

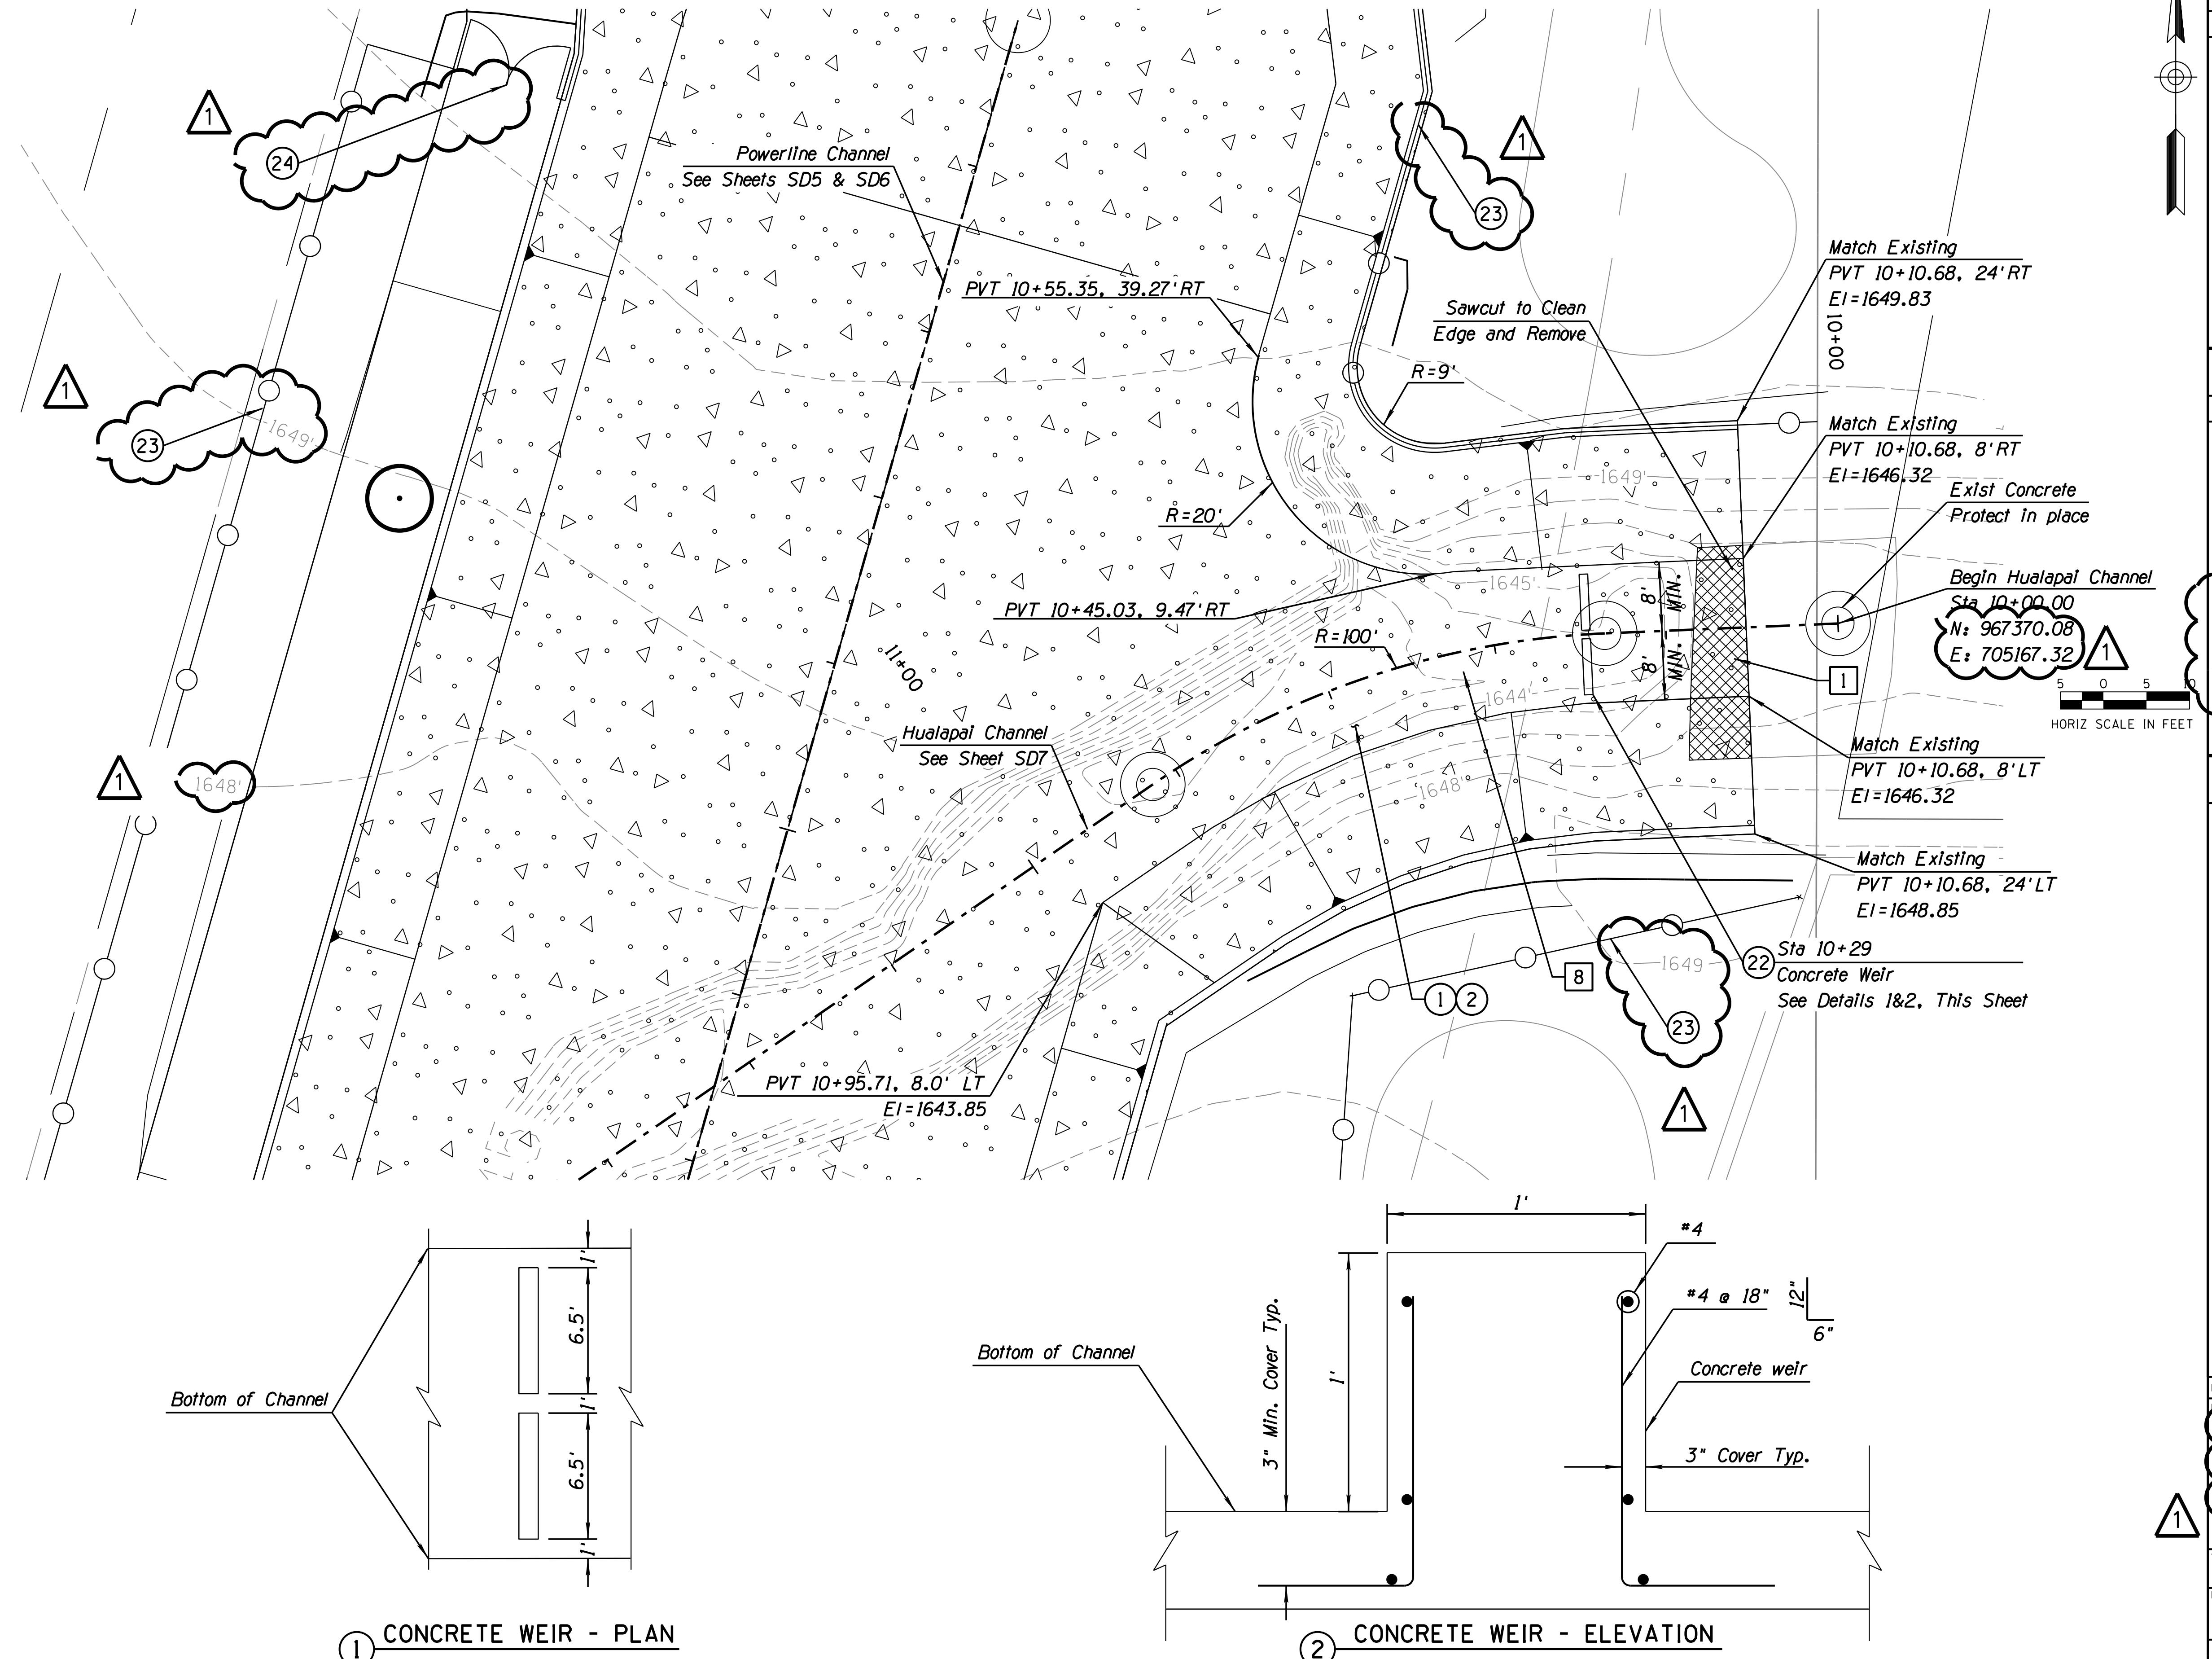

3/13/20	REVISION:	CITY COMMENTS	BY: A.S.N.
 <p>ED PROFESSIONAL ENGINEER CERTIFICATE NO. 3986 AZEEZ SALIBA Date Signed 3/13/20 Arizona, U.S.A. Expires 3/31/21</p>		 <p>CITY OF SCOTTSDALE THE WEST'S MOST WESTERN TOWN ARIZONA</p>	
PUBLIC WORKS CAPITAL PROJECT MANAGEMENT 7447 E. INDIAN SCHOOL RD. SCOTTSDALE, ARIZONA 85251			
HUALAPAI CHANNEL WEIR DETAIL CROSSROADS EAST DRAINAGE INFRASTRUCTURE			
SCALE 1"=10' 1"=8'	DESIGNED AC	DATE 07/19 AS-BUILT XX/XX	BID NO. XXXX PROJECT NO. 400-FB53B-56047
			SHT. D4 23 OF 38


Michael Baker
INTERNATIONAL
REMOVAL & RELOCATION NOTES

2929 N. CENTRAL AVE. SUITE 800
PHOENIX, AZ 85012
Phone: (602) 279-1234
MBAKERINTL.COM

DATE: 3/13/20	REVISION:	CITY COMMENTS	BY: A.S.N.
 Signature over seal		PUBLIC WORKS CAPITAL PROJECT MANAGEMENT 7447 E. INDIAN SCHOOL RD. SCOTTSDALE, ARIZONA 85251	
 1		UNION HILLS CHANNEL TRANSITION CROSSROADS EAST DRAINAGE INFRASTRUCTURE	
SCALE HORIZ. 1"=10' VERT. 1"=8'	DESIGNED AC	DATE 07/19	BID NO. XXXX
	DRAWN JJP	AS-BUILT XX/XX	PROJECT NO. 400-FB53B-56047
			SHT. D5 24 OF 38







Construction Notes:

1. Joints shall be constructed to a minimum depth of 1". They shall be filled to the surface with a premium-grade high performance, moisture cured, single component, polyurethane-based non-sag elastomeric sealant, ASTM C-920, Type S, grade NS, Class 25; Sikaflex-1a or approved equal.
2. Concrete Shall Have $f'c = 4000$ psi.
3. Fiber reinforcement shall be Euclid Chemical Company TUF-STRAND SF Synthetic Macro-Fiber, polypropylene/polyethylene copolymer 2-inch long; or approved equivalent at 5lb per CY. Fibers shall comply with the material specifications and performance requirements of ASTM C1116. Fibers to be added at plant during batching.
4. Concrete Shall be Colored to Best Match Davis Colors San Diego Buff.
5. All Concrete Channel Surfaces to Remain Rough (Unfinished) using heavy rake or transverse steel tines before initial concrete to produce a rough anti skateboarding/rollerblading texture.

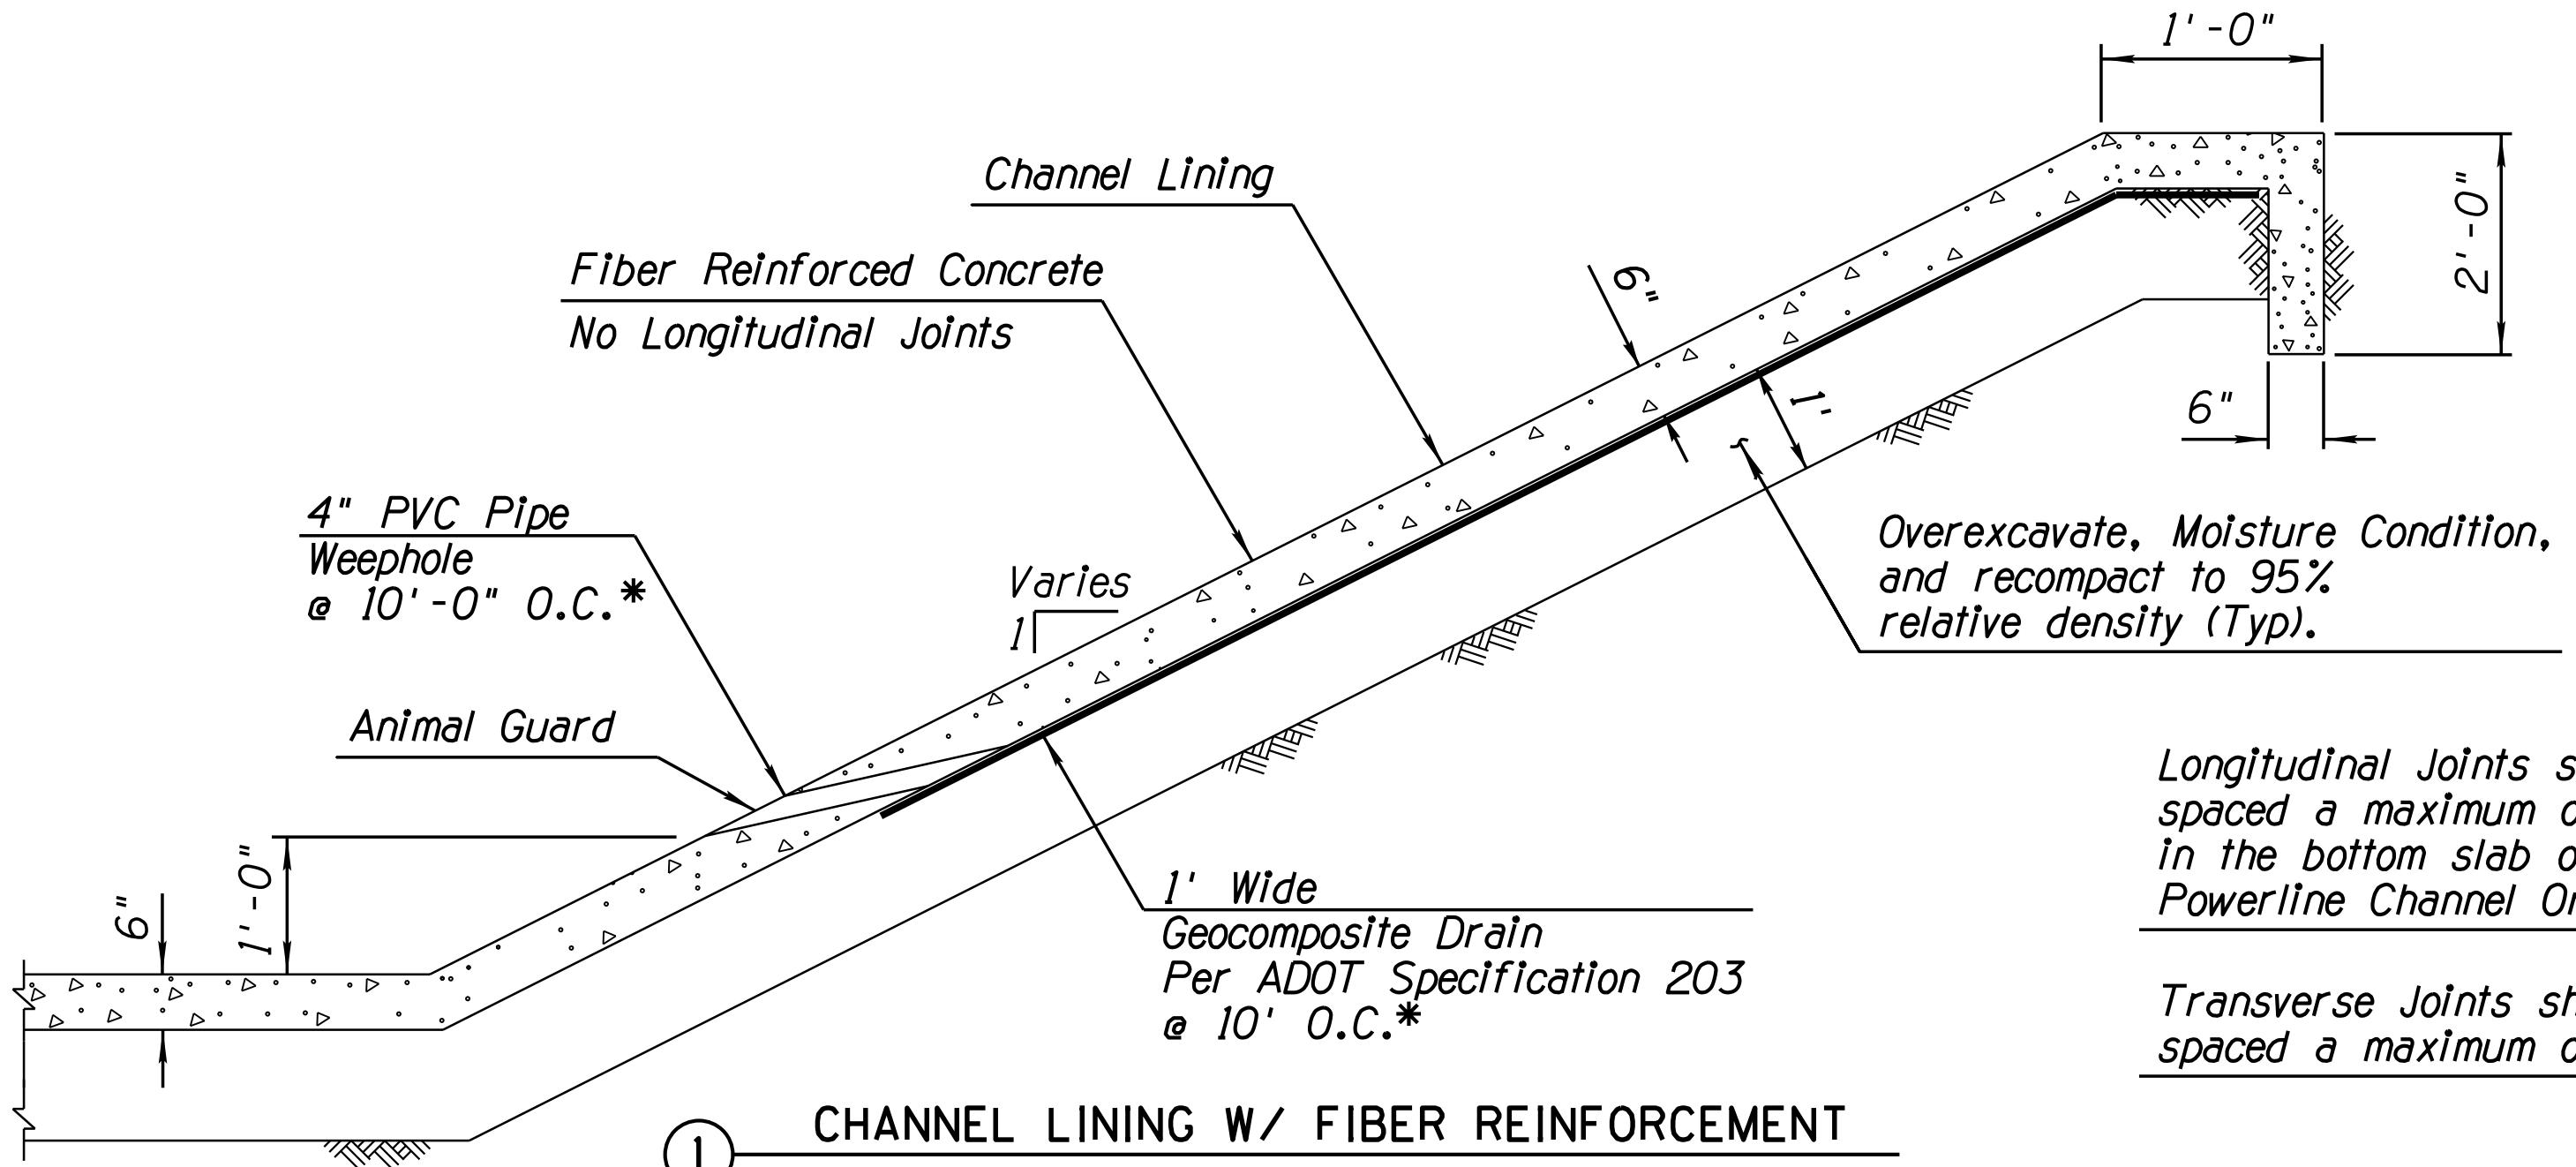

Longitudinal Joints shall be spaced a maximum of 25' in the bottom slab of Powerline Channel Only (Typ)

Transverse Joints shall be spaced a maximum of 15' (Typ)

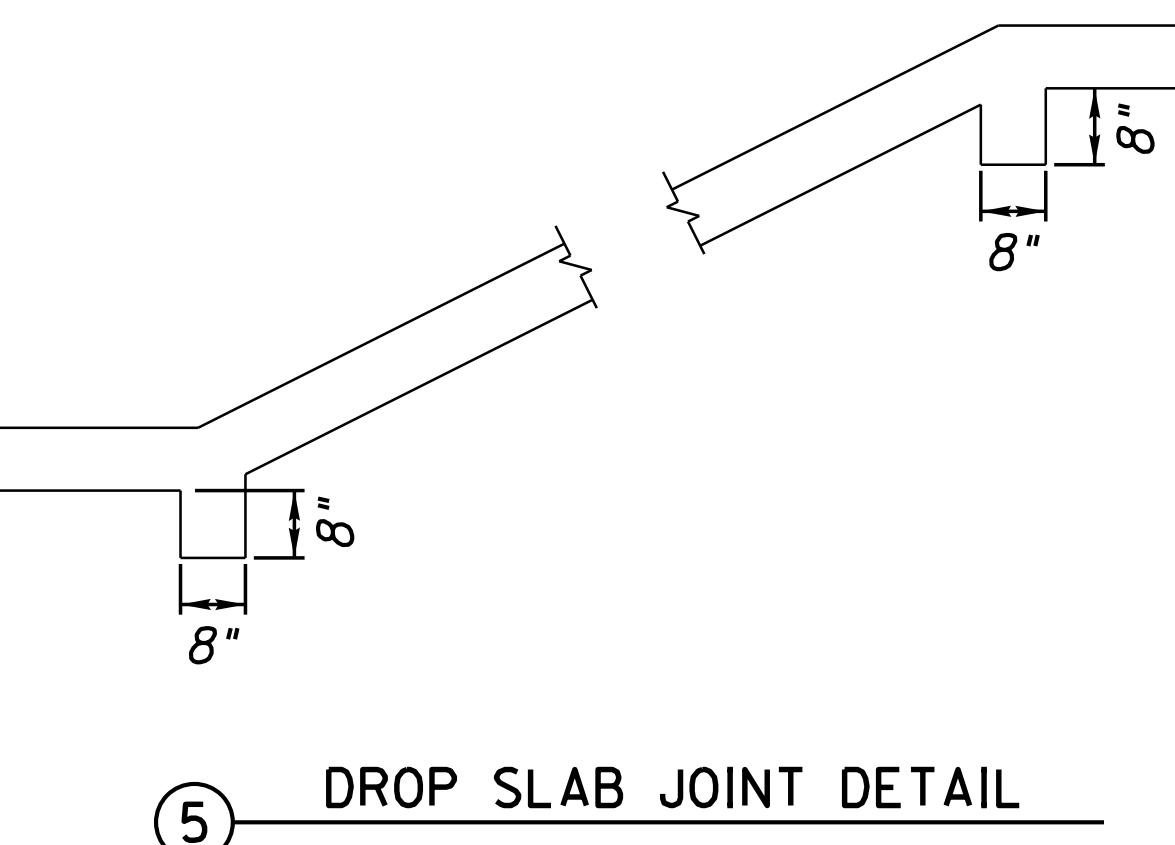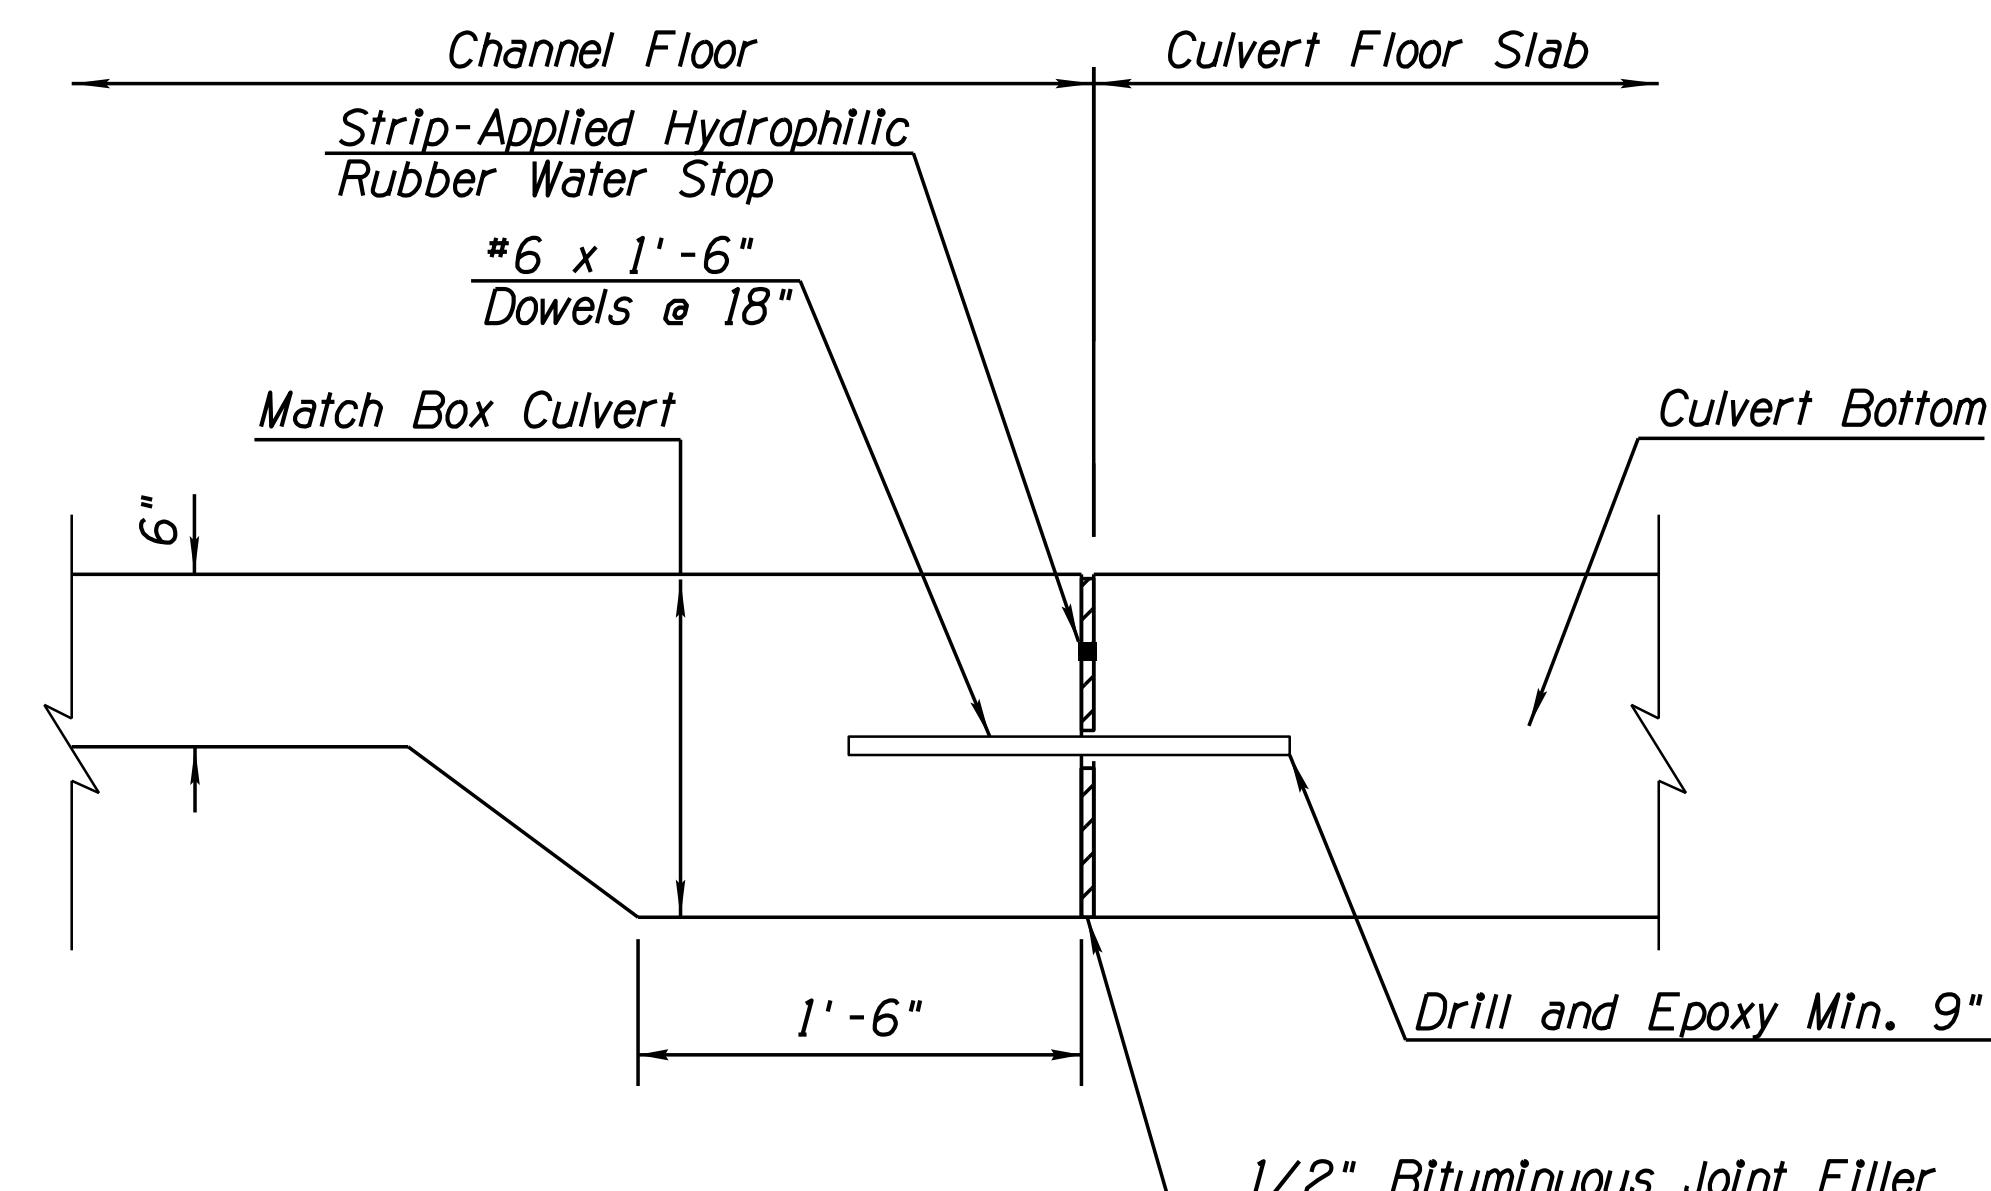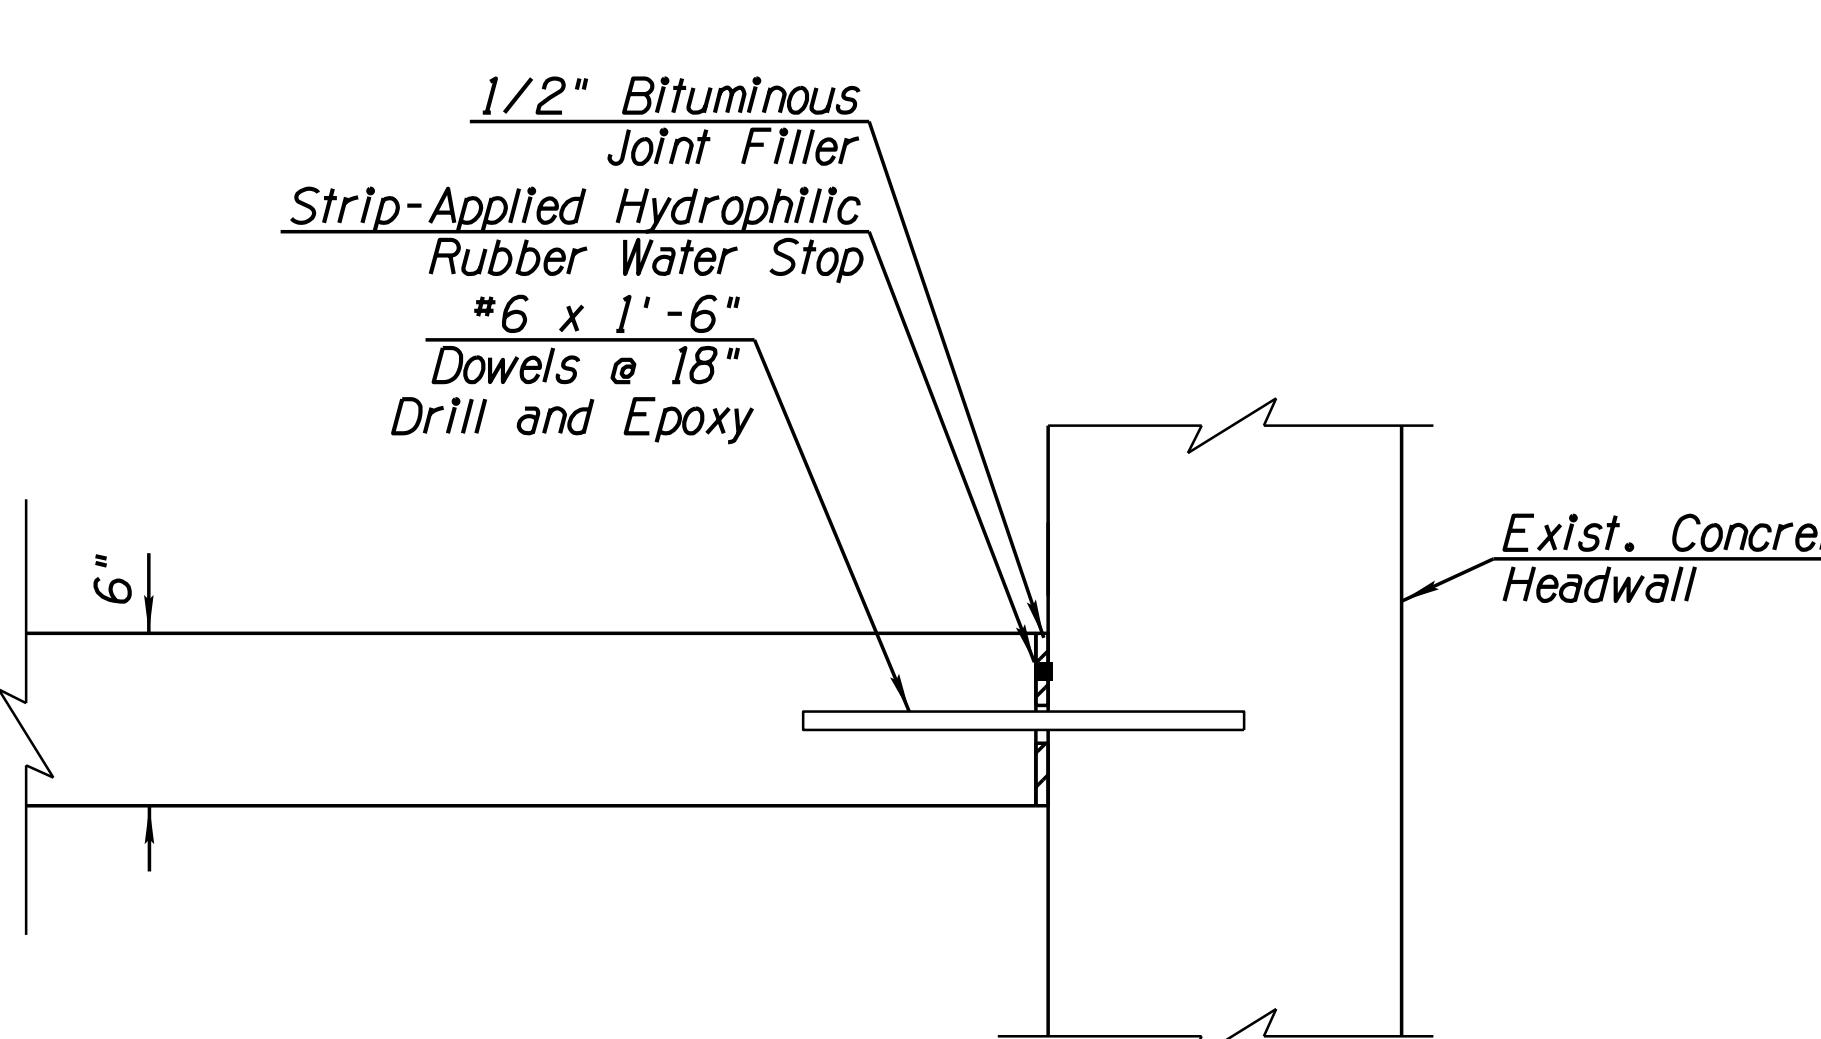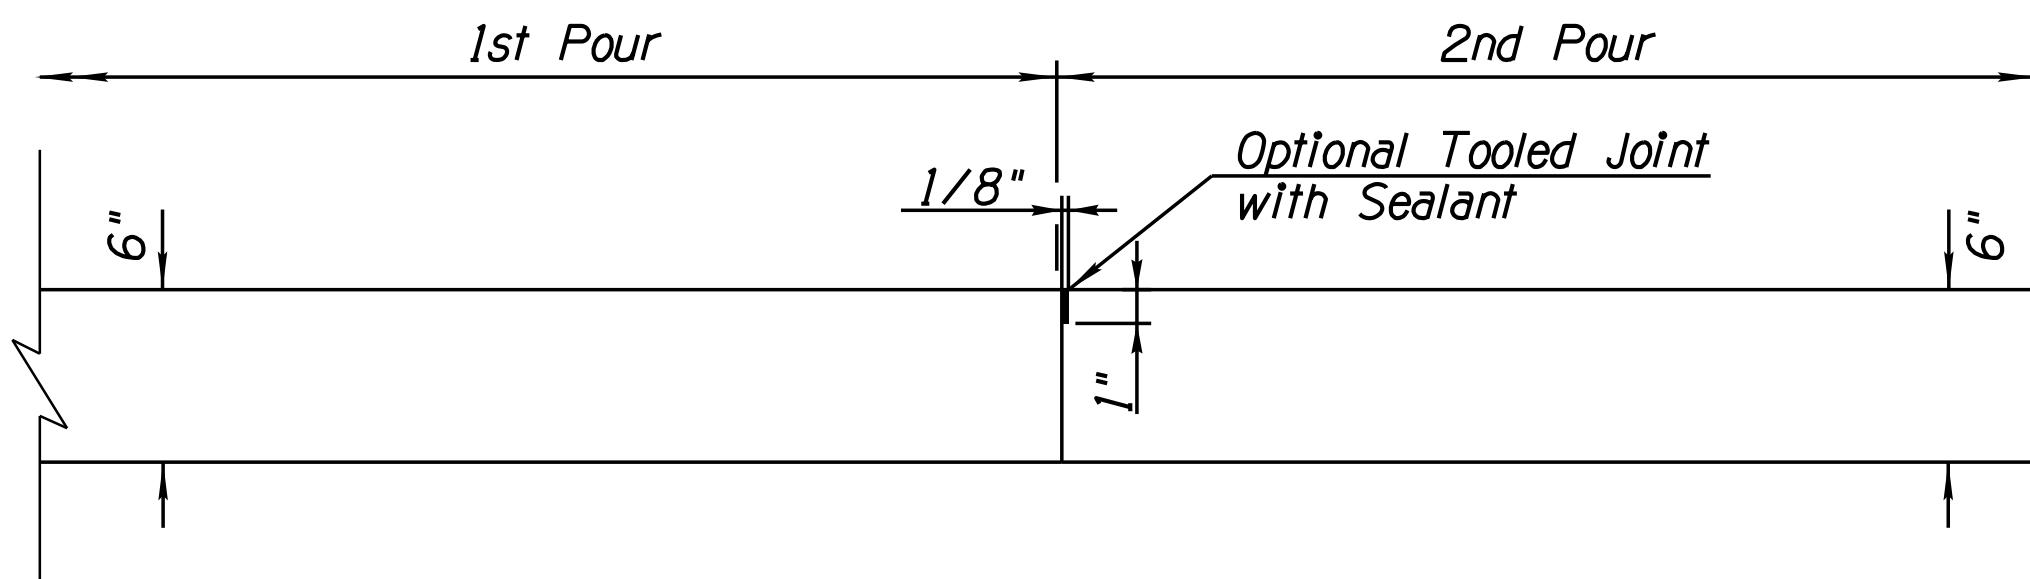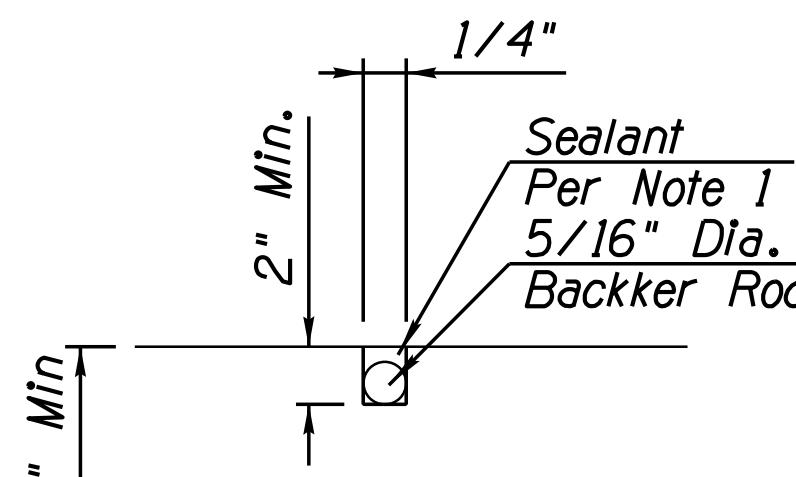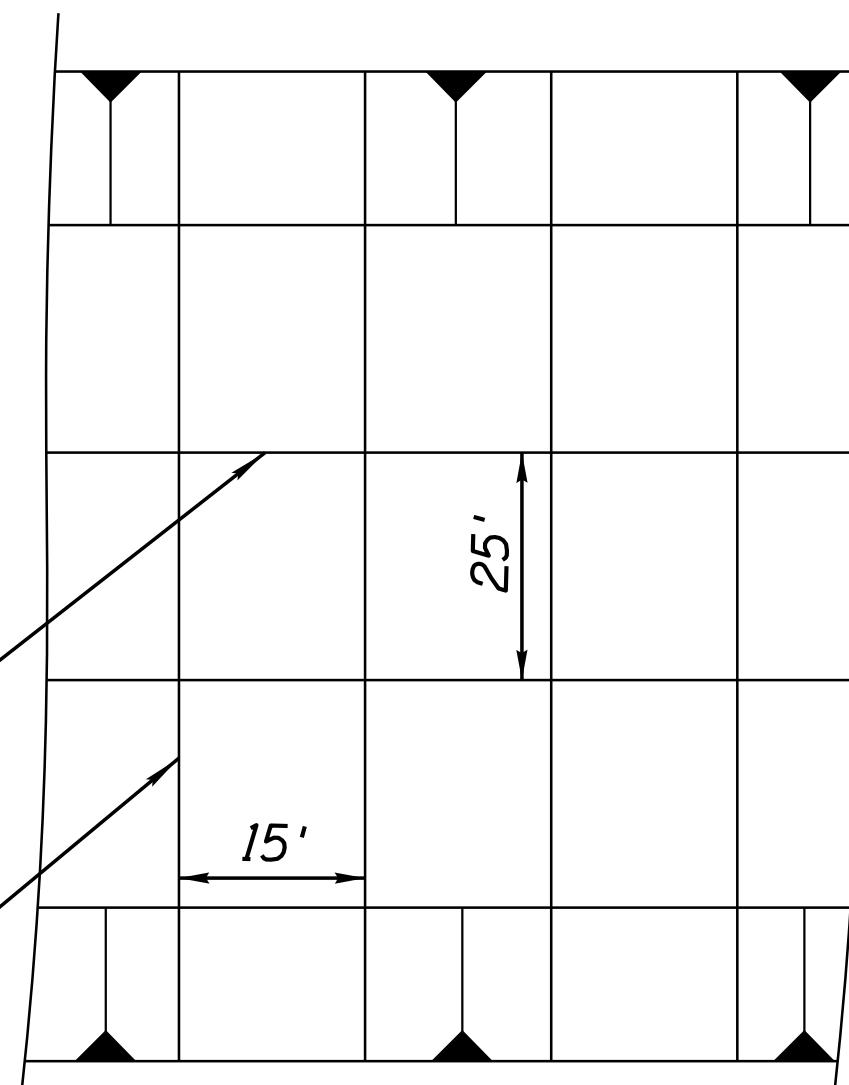


DATE: 7-10-19	REVISION: 0	BY:
PUBLIC WORKS		
CITY OF SCOTTSDALE, ARIZONA		
CAPITAL PROJECT MANAGEMENT		
7447 E. INDIAN SCHOOL RD., SCOTTSDALE, ARIZONA 85251		
SHEET TITLE: CHANNEL DETAILS		
PROJECT TITLE: CROSSROADS EAST DRAINAGE INFRASTRUCTURE		
SCALE: N/A	DESIGNED BY: AC	DATE: 07/19
VERT. N/A	DRAWN BY: WDF	BID NO. XXXX
	AS-BUILT BY: XX/XX	SH. D6
	PROJECT NO. 400-FB53B-56047	25 of 38

PLOT DATE: 3/13/2020



DETAILS.dwg

DESIGN FILE: W:\P\PJ\169678-Crossroads-East\CAD\Sheet Files\CAD\Sheet F11s\Drainage\169678-D7 CHANNEL

7:02:23 AM

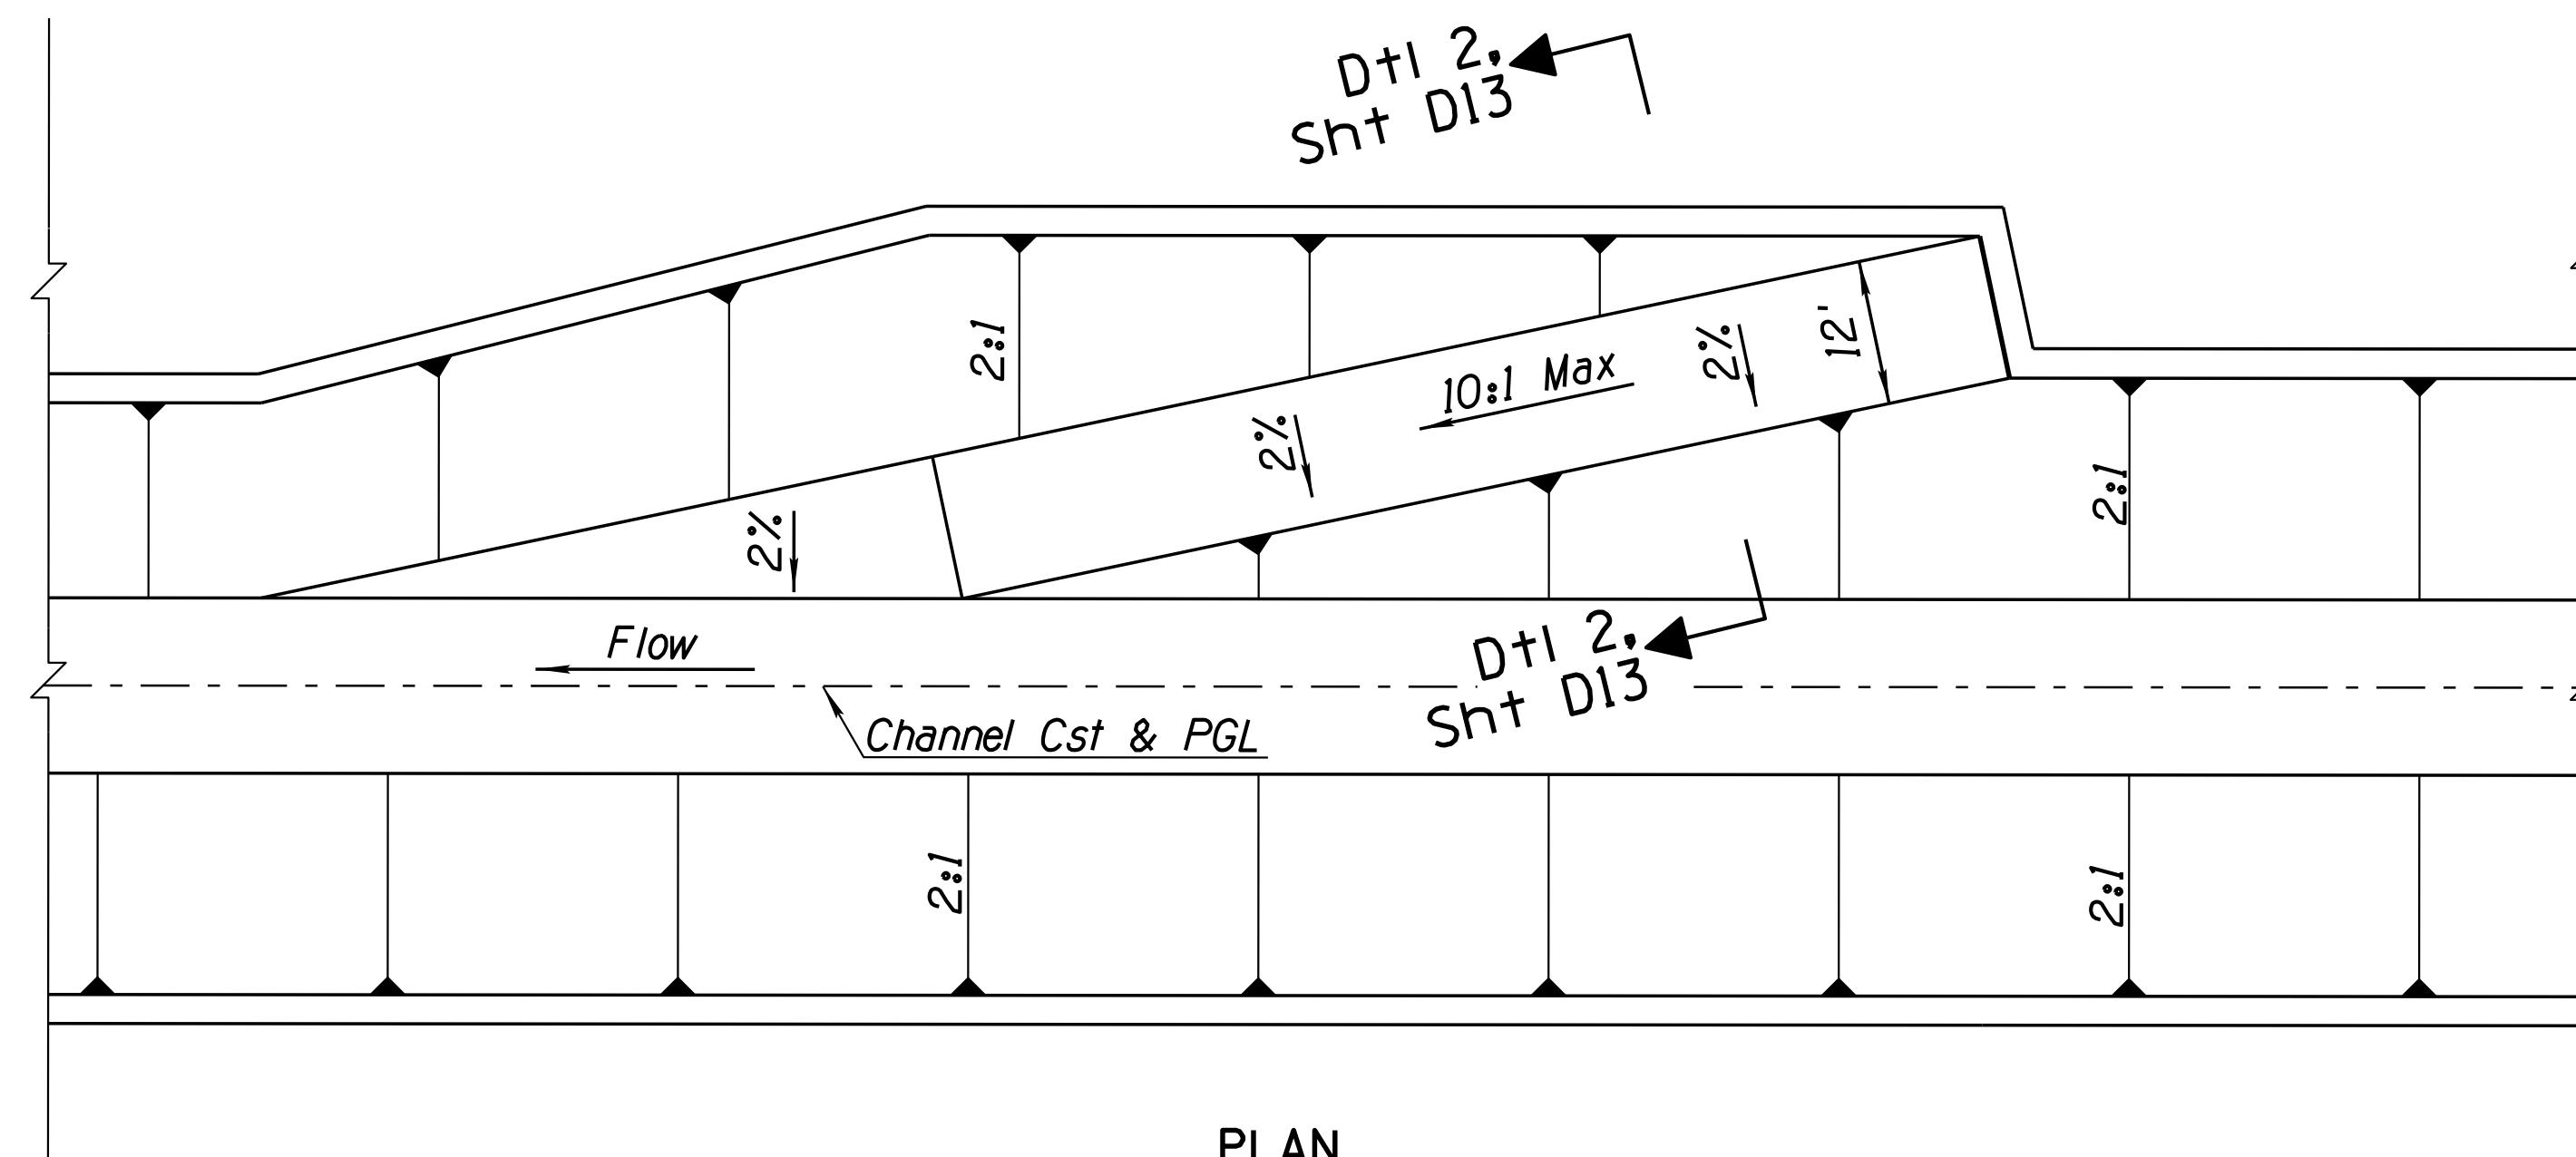

① CONCRETE MAINTENANCE RAMP DETAIL

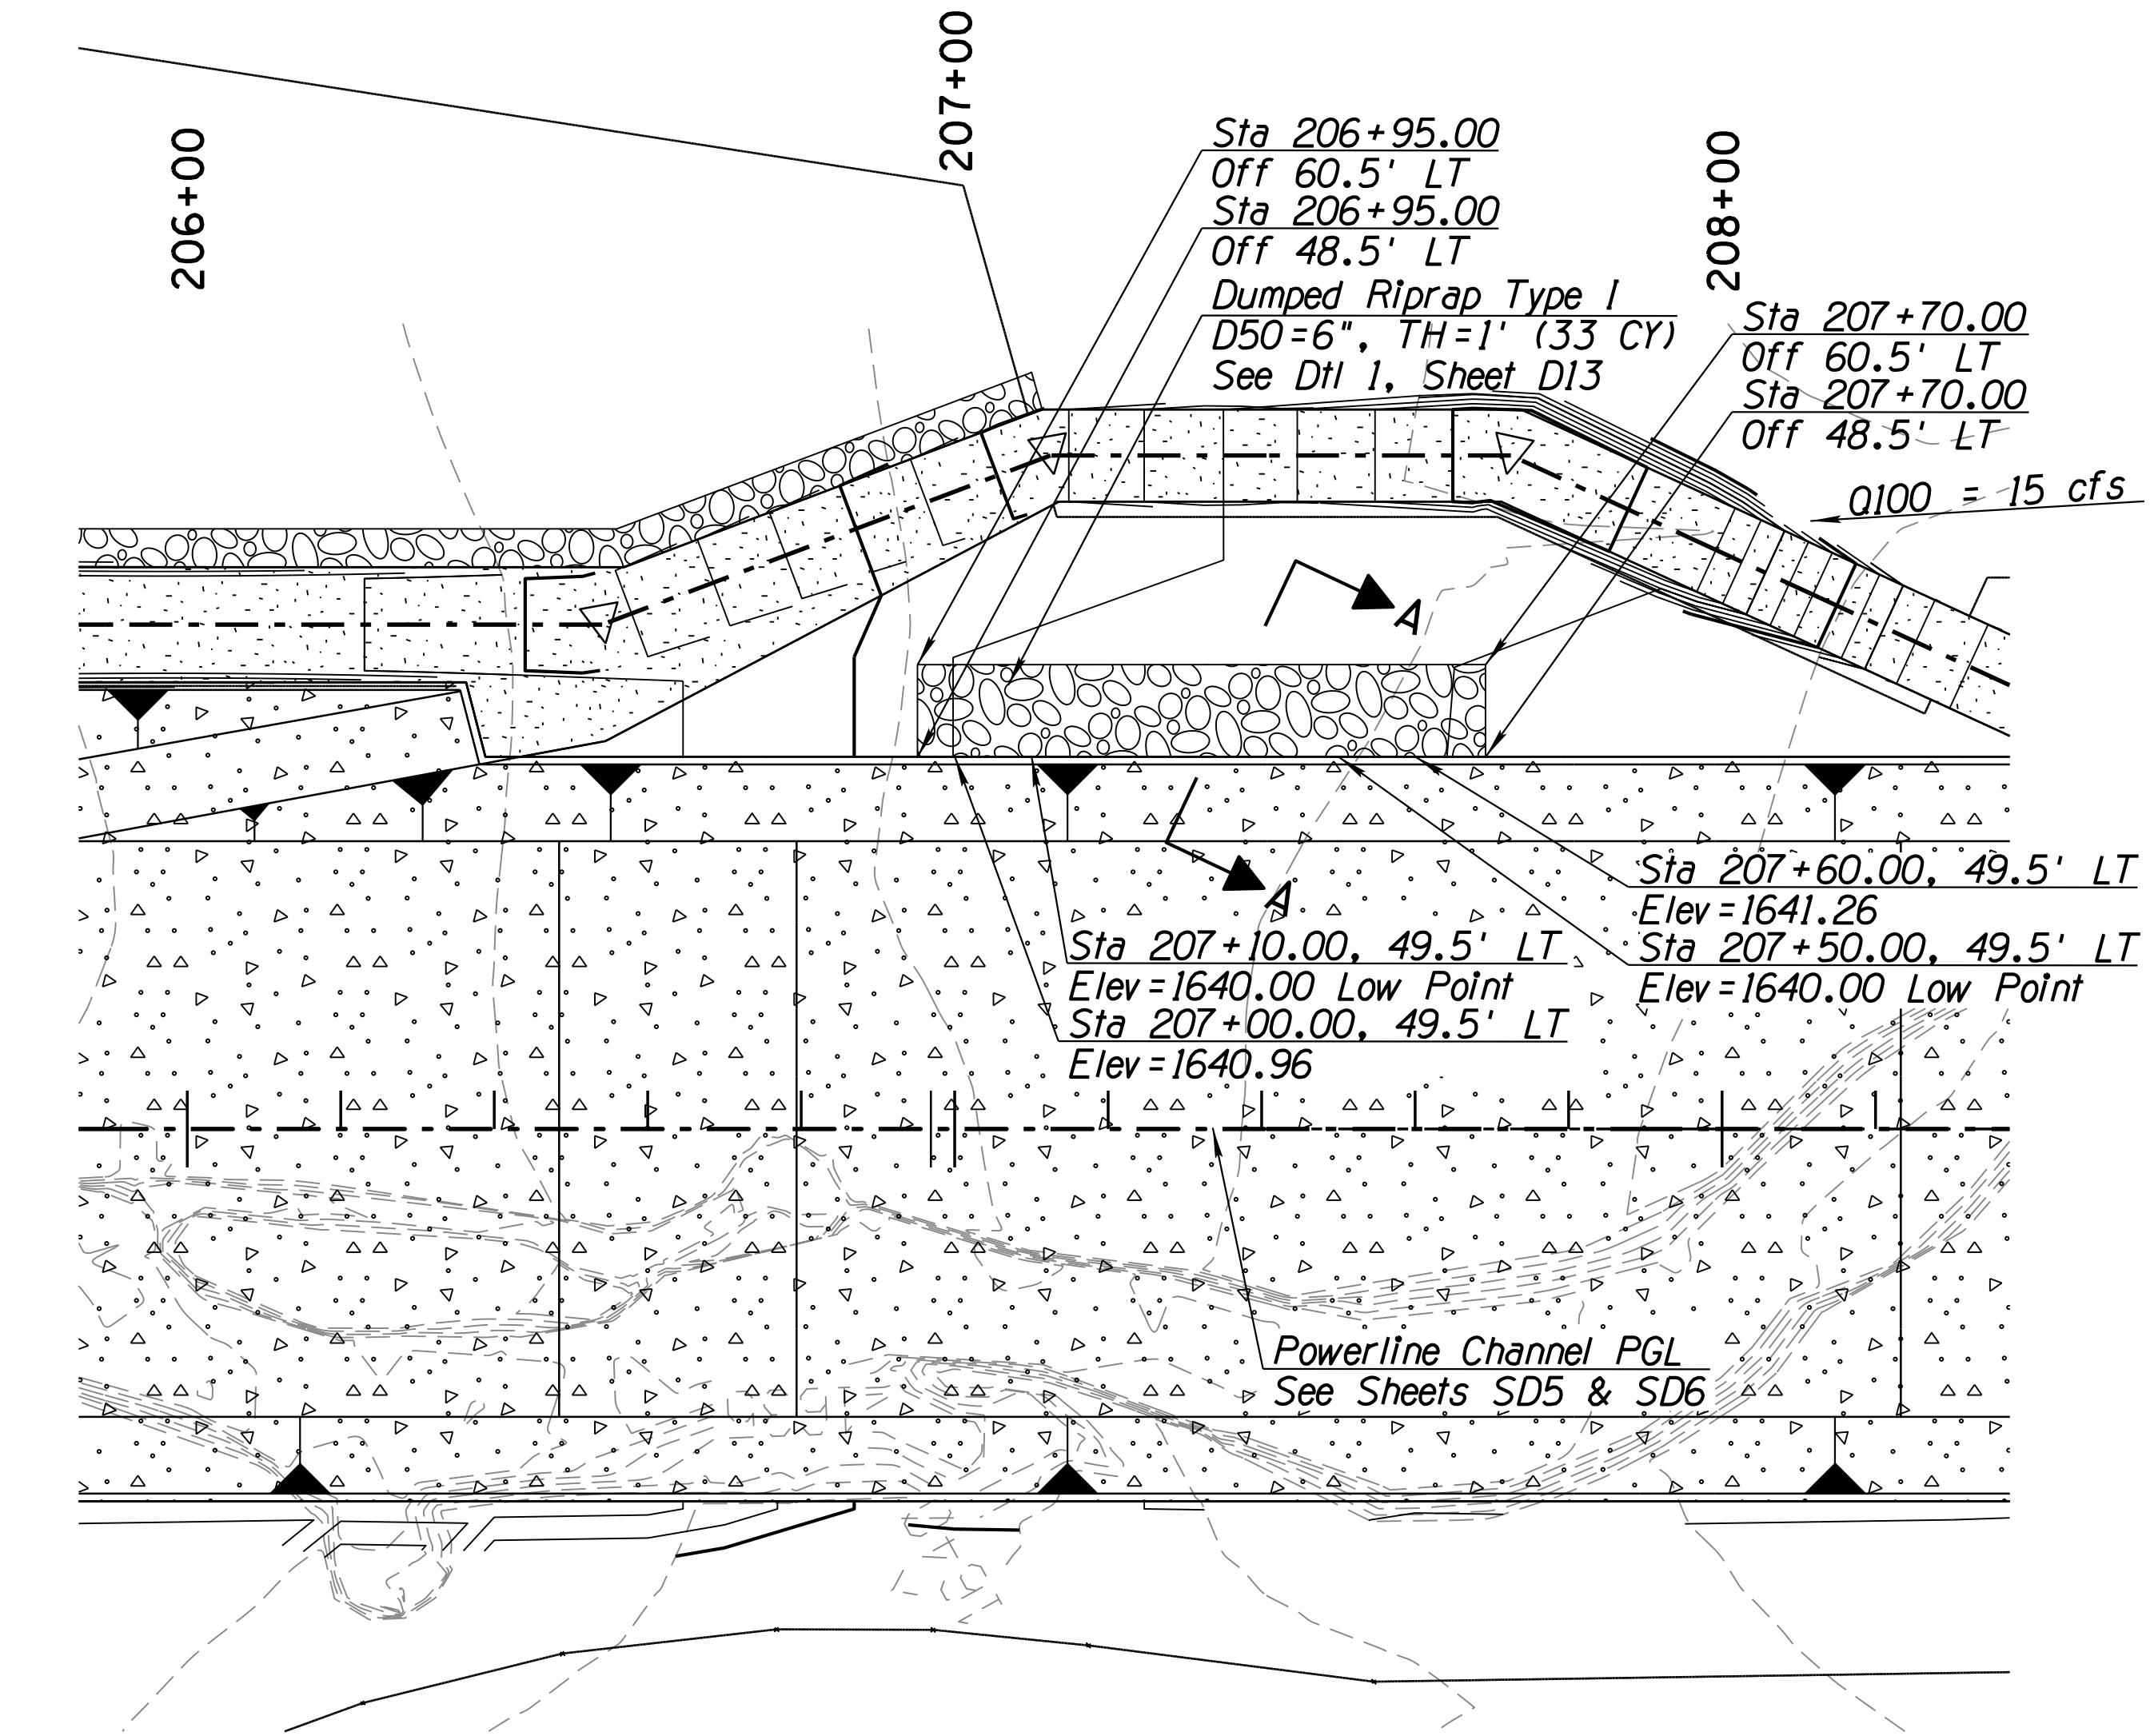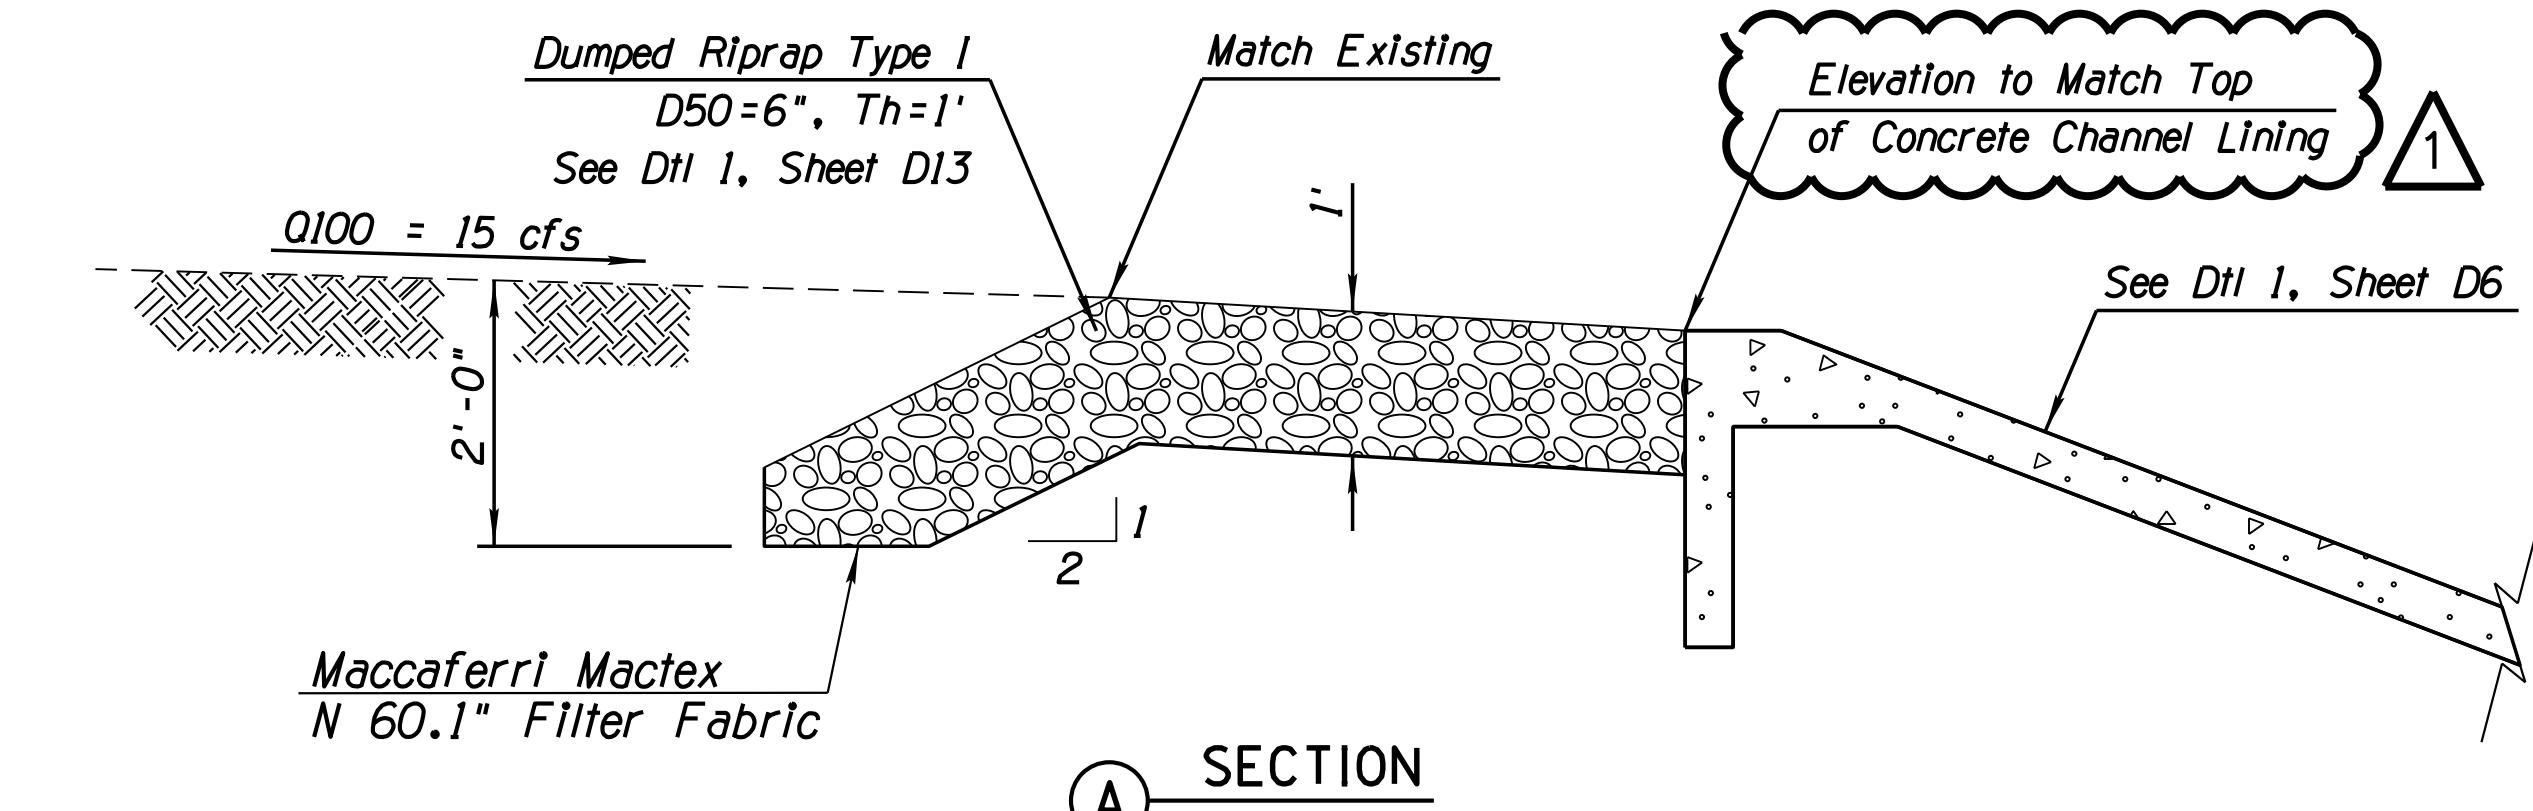

② POWERLINE CHANNEL INFLOW DETAIL





DATE: 3/13/20		REVISION:	CITY COMMENTS		BY: A.S.N.
ENGINEER	PROJECT MANAGER	NO.	STREET	CROSS ST.	UNIT
REG. NO. 5986	ZEEZ SALIBA	313120	SCOTTSDALE, ARIZONA, USA		
CITY OF SCOTTSDALE					
CAPITAL PROJECT MANAGEMENT					
7447 E. INDIAN SCHOOL RD., SCOTTSDALE, ARIZONA 85251					
DETAILS					
PROJECT TITLE: CROSSROADS EAST DRAINAGE INFRASTRUCTURE					
SCALE: HORIZ. DRAWN	DESIGNED AC	DATE: 07/19	BID NO. XXXX	SHT. D7	
VERT.	AS-BUILT XX/XX		PROJECT NO. 400-FB53B-56047	26 OF 38	

12:08:46 PM

PLOT DATE: 3/13/2020

DESIGN FILE: W:\P\PJ\169678_Crossroads_East\CAD\Sheet Files\Drainage\169678-D8-HEADWALL DETAILS.dwg

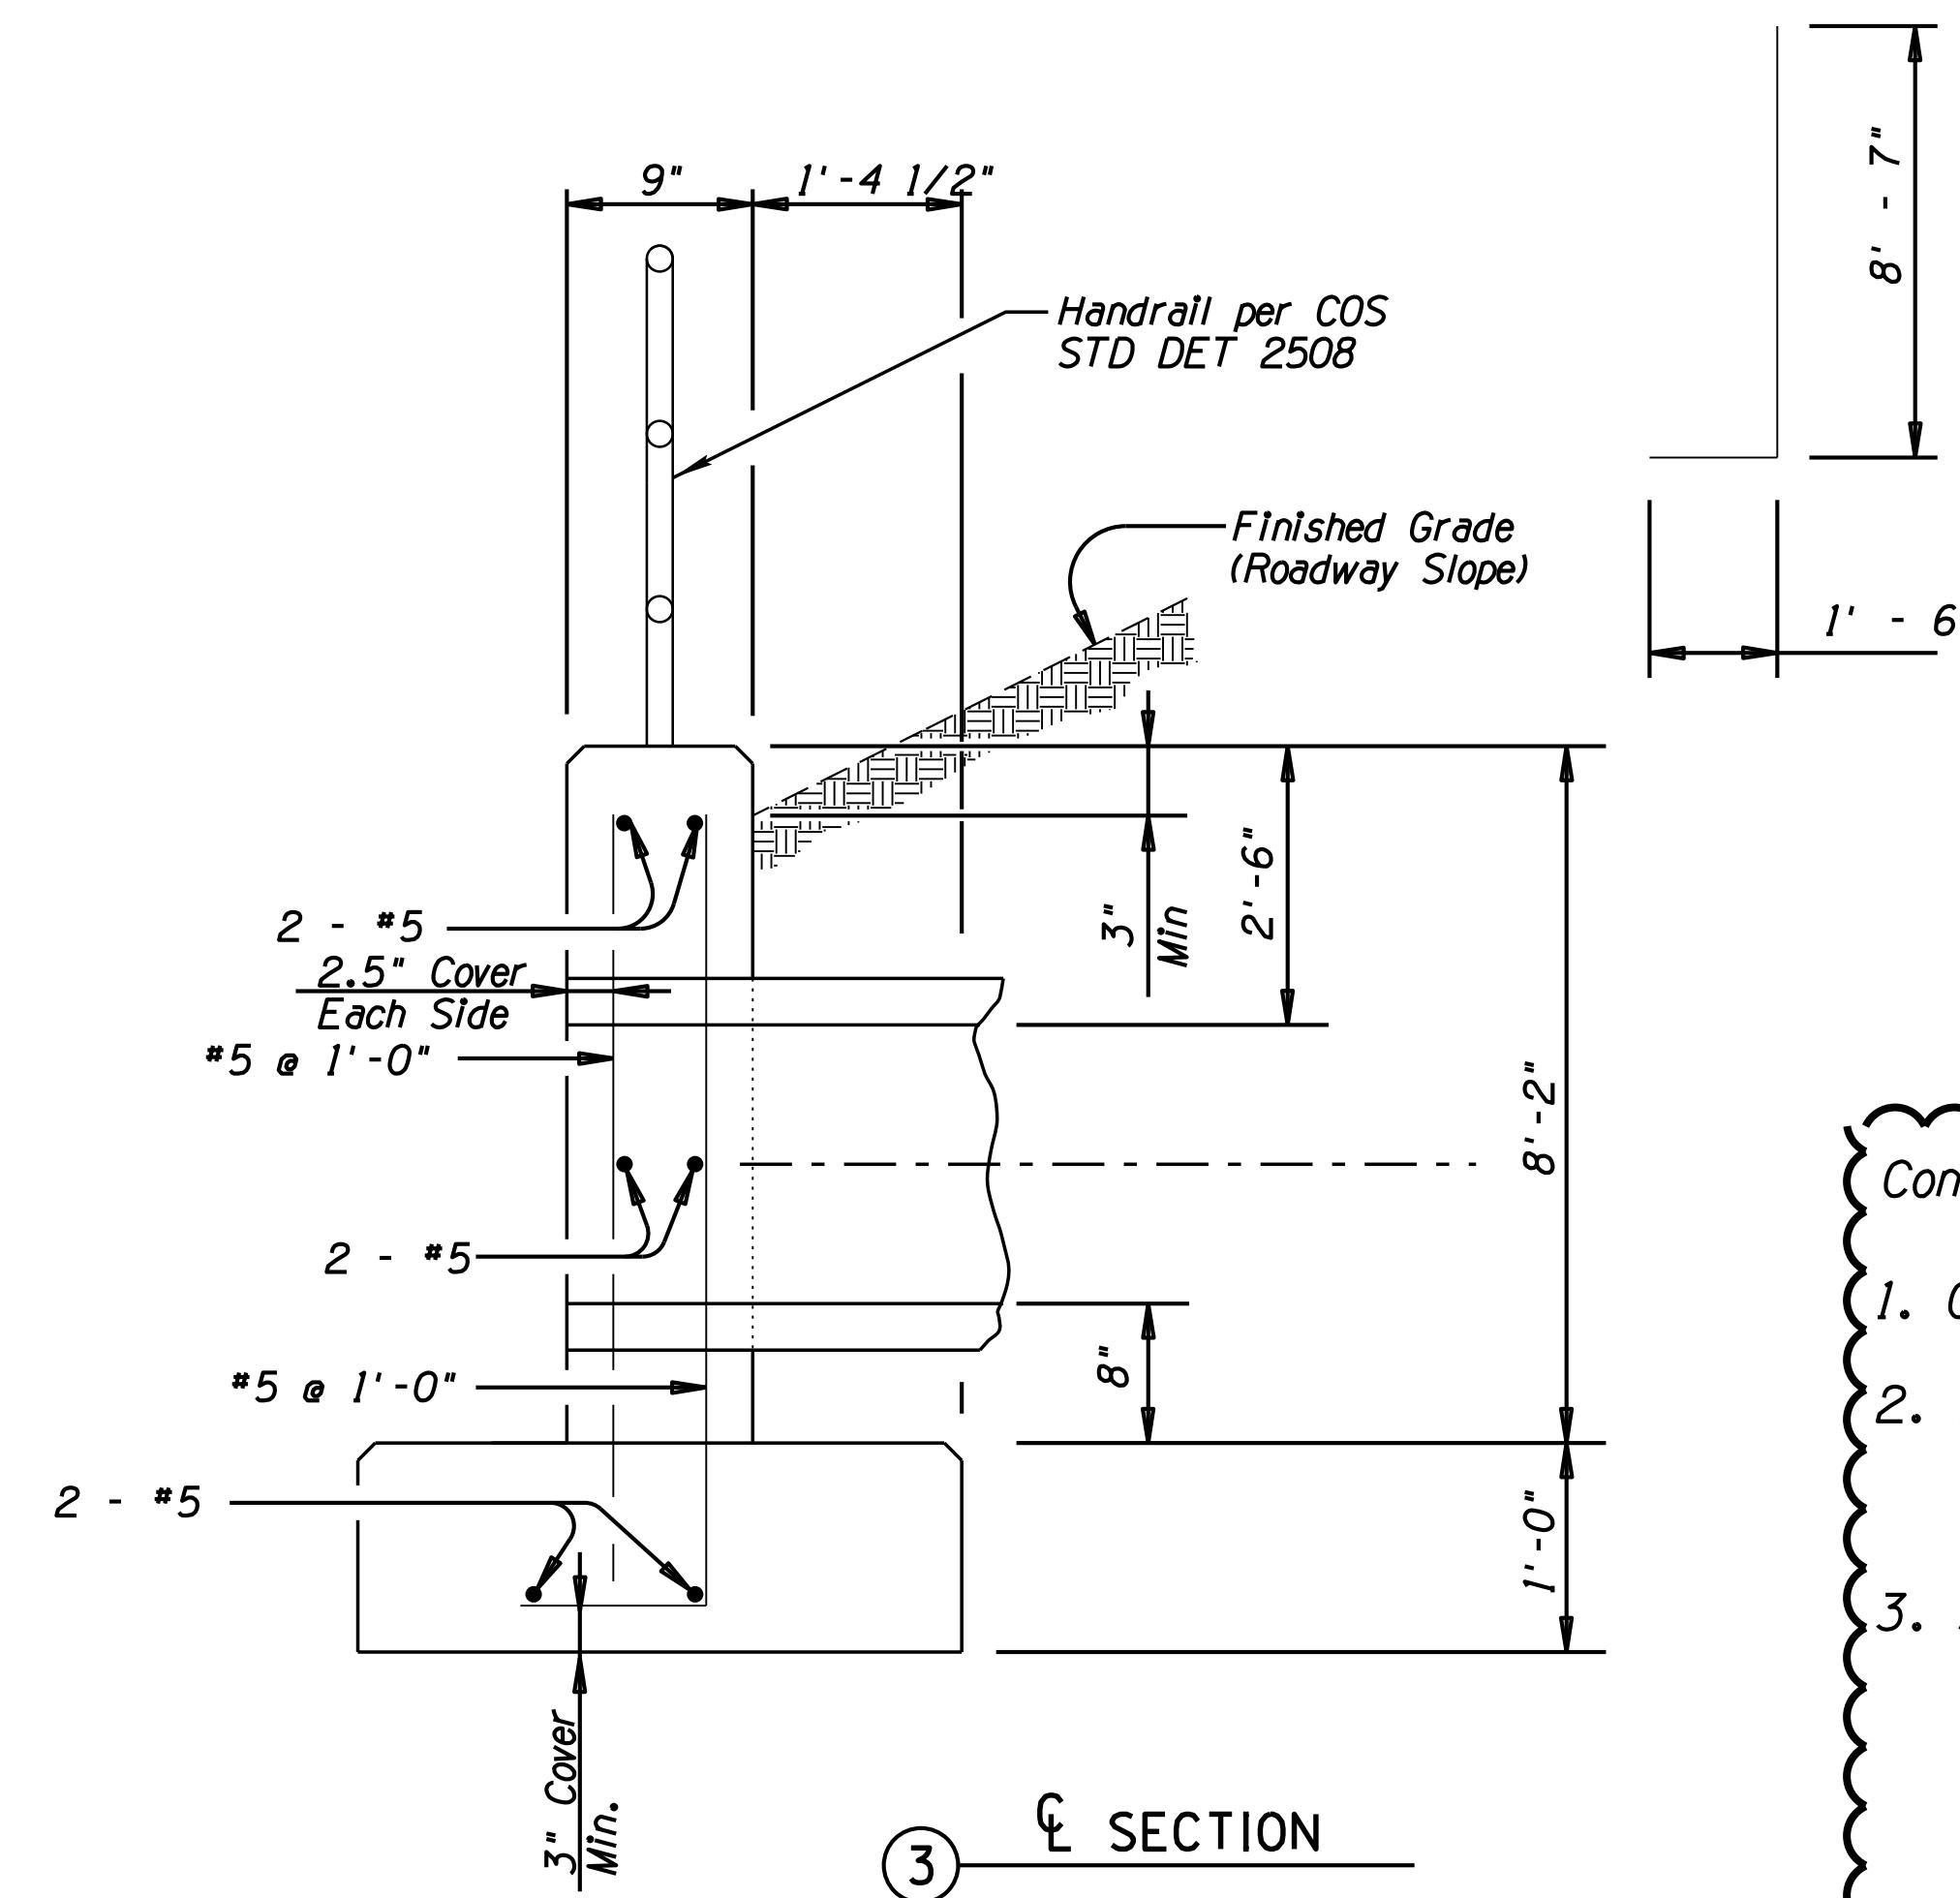
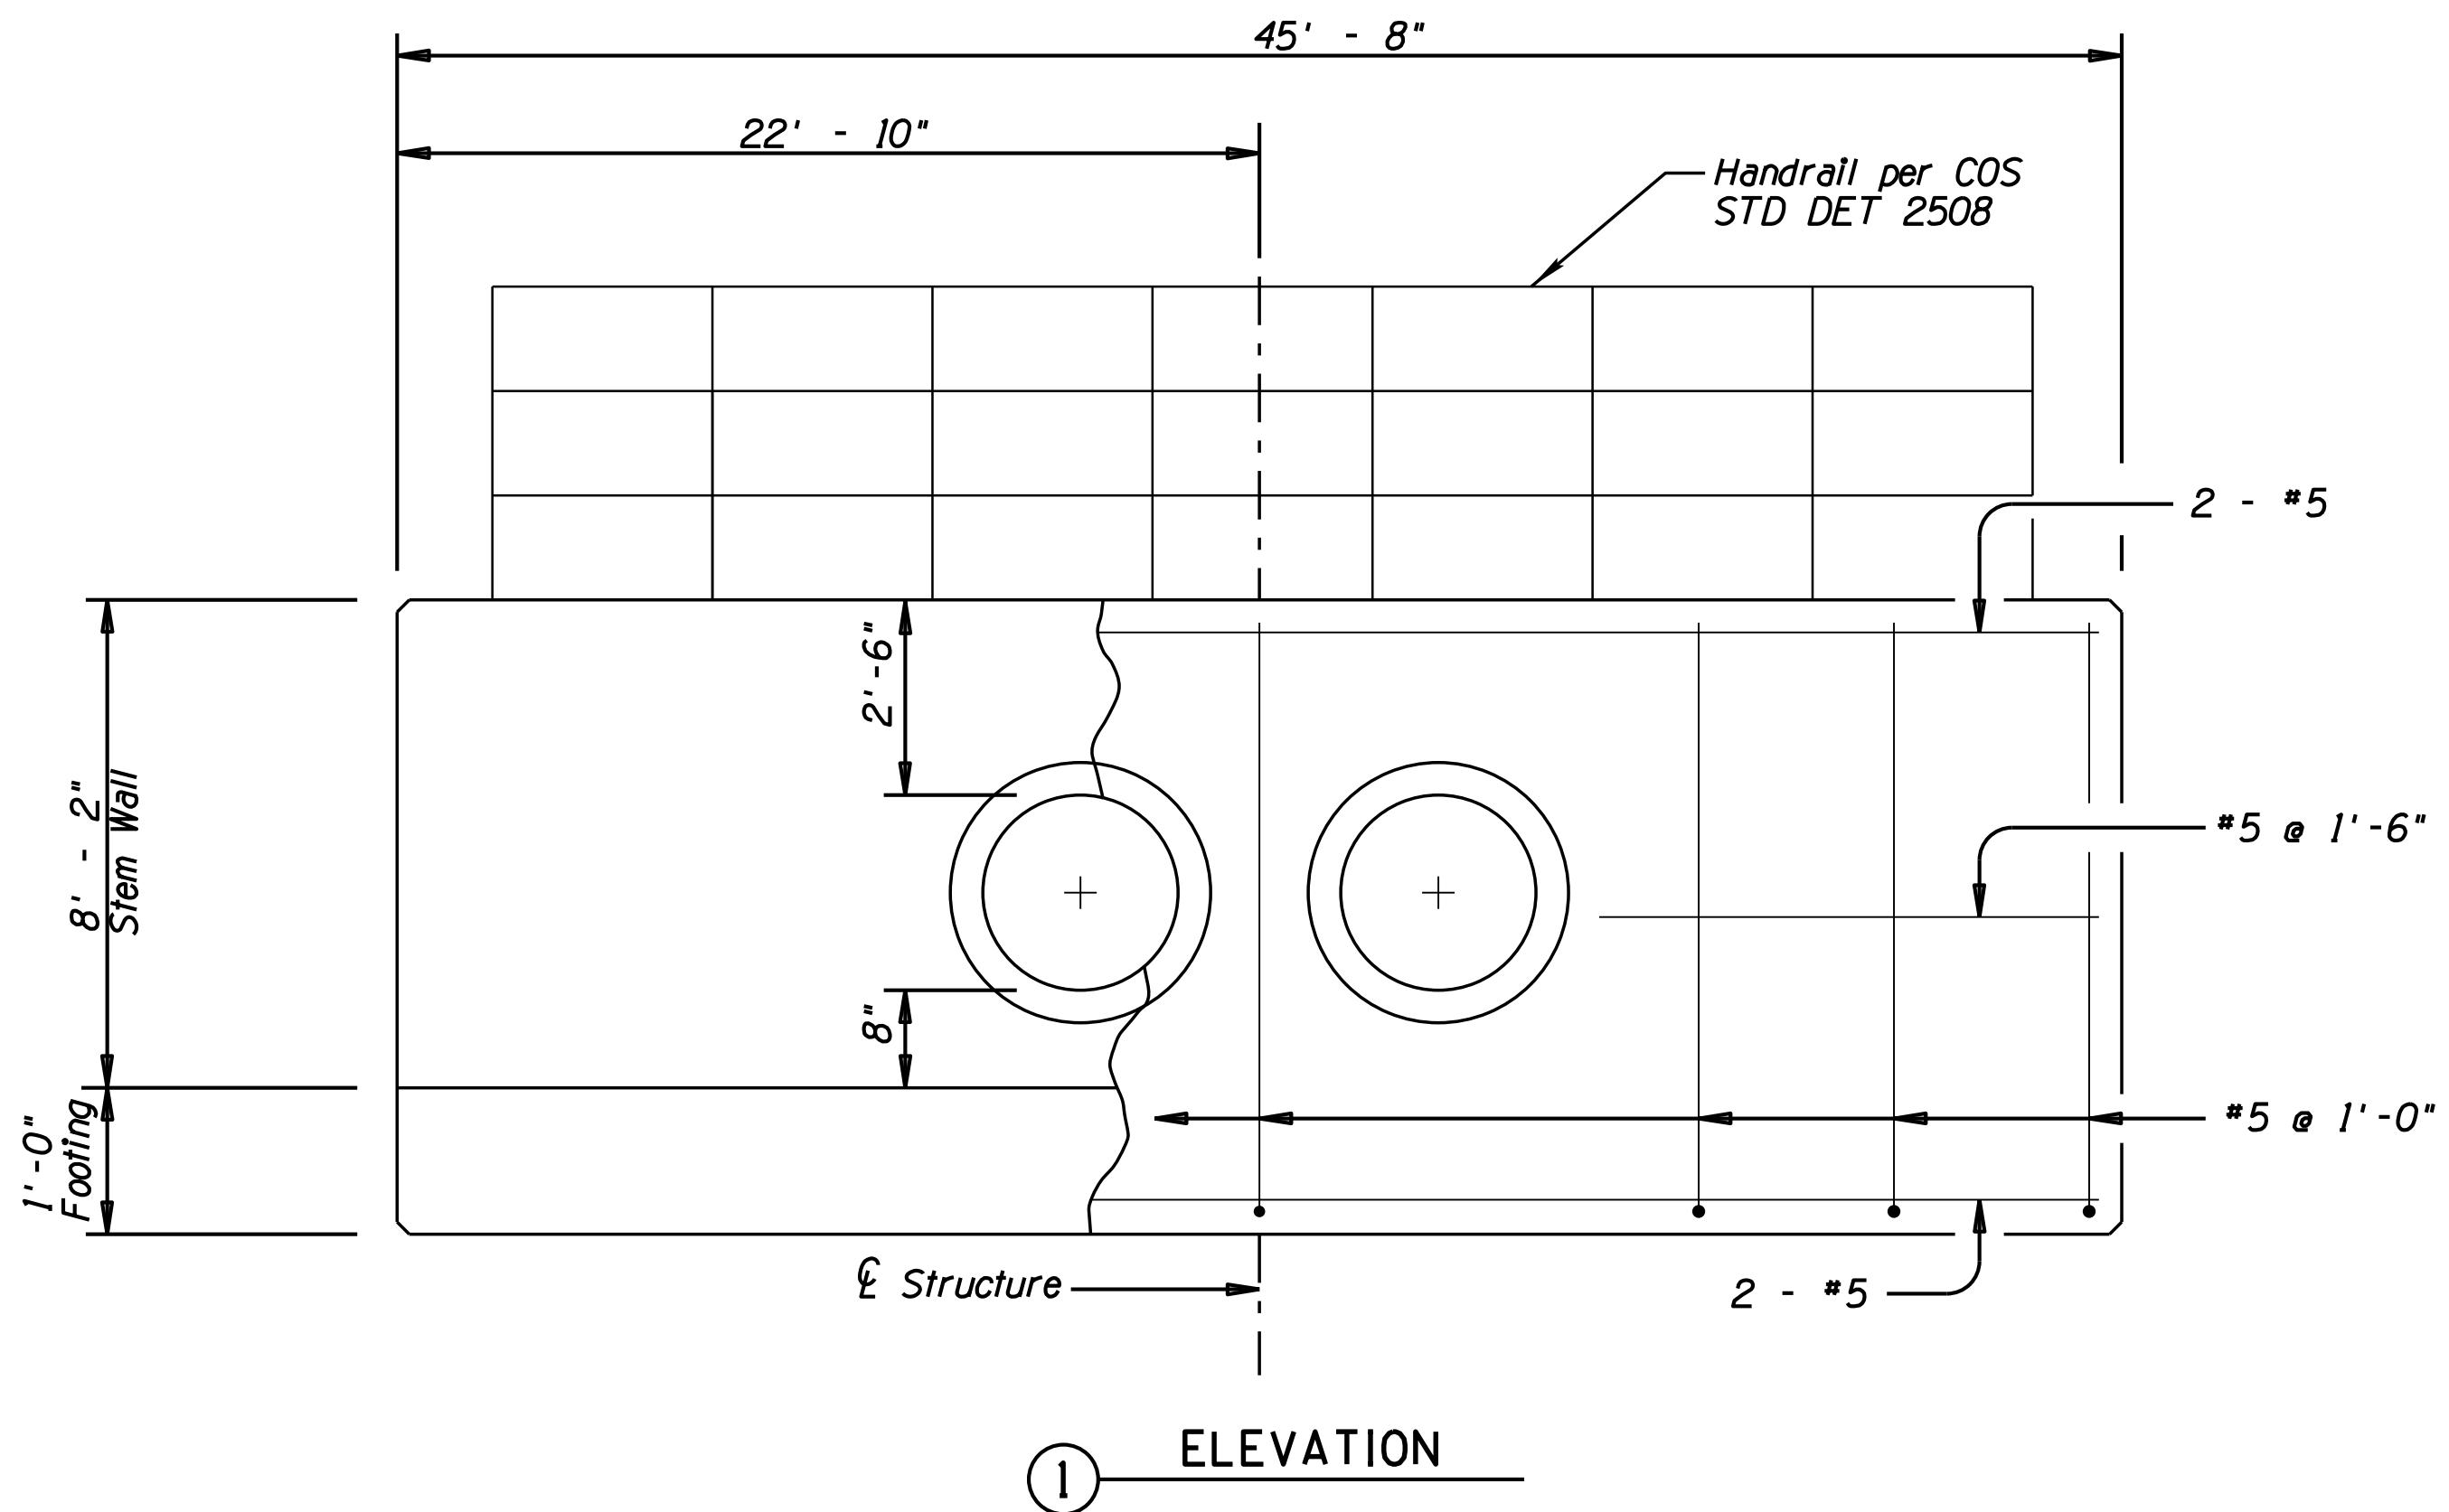


APPROXIMATE QUANTITIES *		
Description	Qty	Units
Reinf. Steel	1,349	LB
Concrete	15	CY

* Quantities shown are for information purposes only.

Construction Notes:

1. Concrete Shall Have $f'_c = 4000$ psi.
2. Reinforcing Steel shall conform to ASTM Specification A615. All reinforcing shall be furnished as Grade 60.
3. All bends and hooks shall meet the requirements of ACI Chapter 25. All bend dimensions for reinforcing steel shall be out-to-out bars. All placement dimensions for reinforcing steel shall be to center of bars unless noted otherwise.
4. Chamfer all exposed corners $3/4"$ unless noted otherwise.
5. Compact backfill for footing and wall base minimum 95 percent of ASTM D698 maximum dry density.
6. Fill PVC Pipe With Nonshrink Grout Complying with Section 1017 of ADOT Standard Specifications.
7. Overexcavate a Min of 1' Below Footing and Compact to 95% Relative Density.
8. Reinforcing Steel shall be placed with the center of the outside layer of bars 3" form the surface of the concrete.

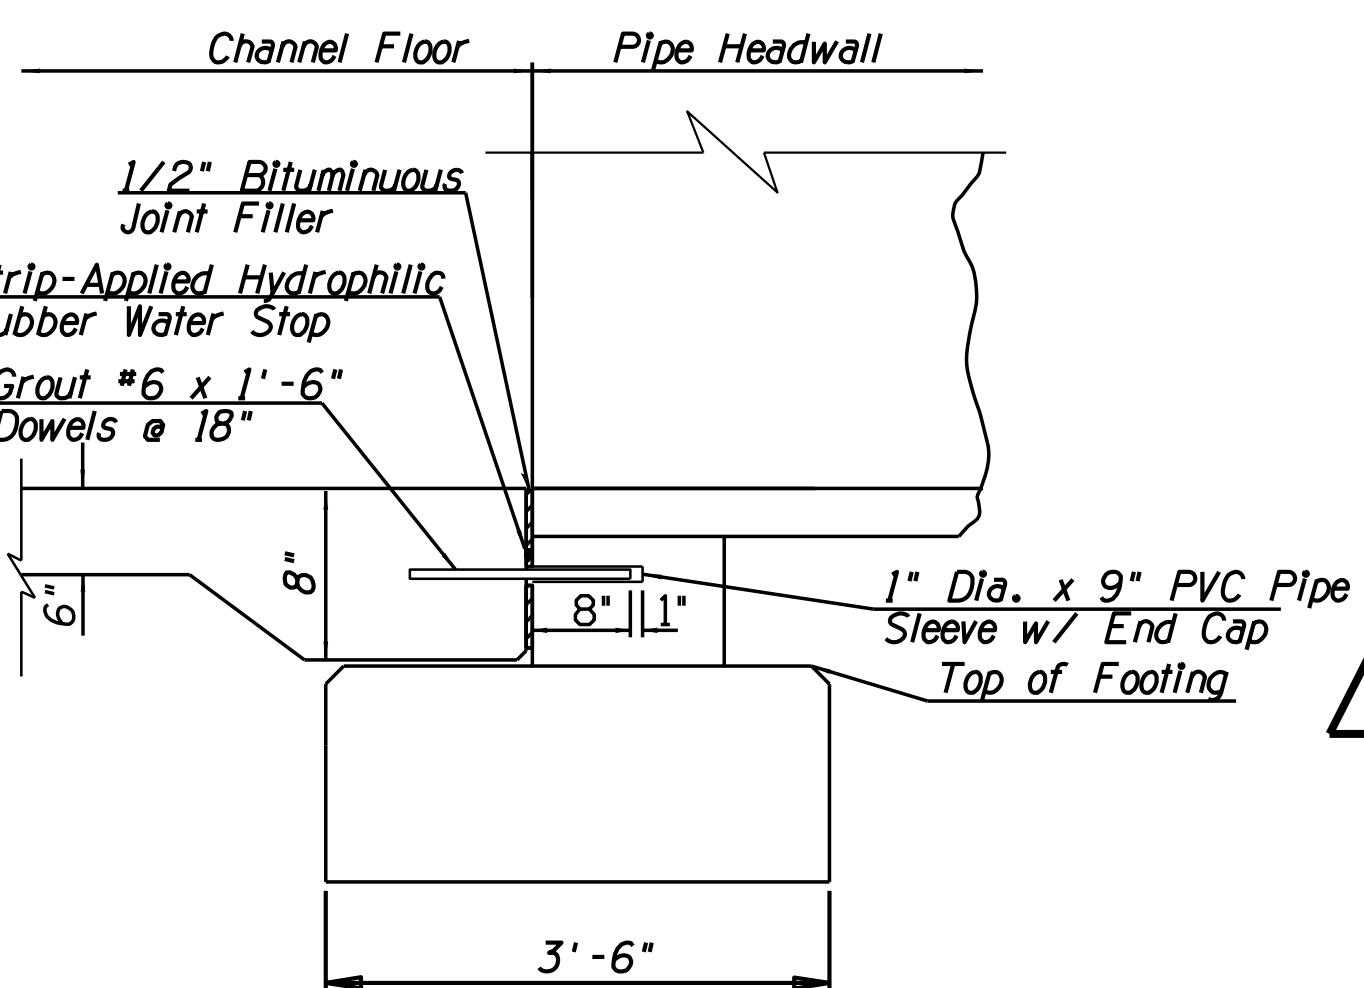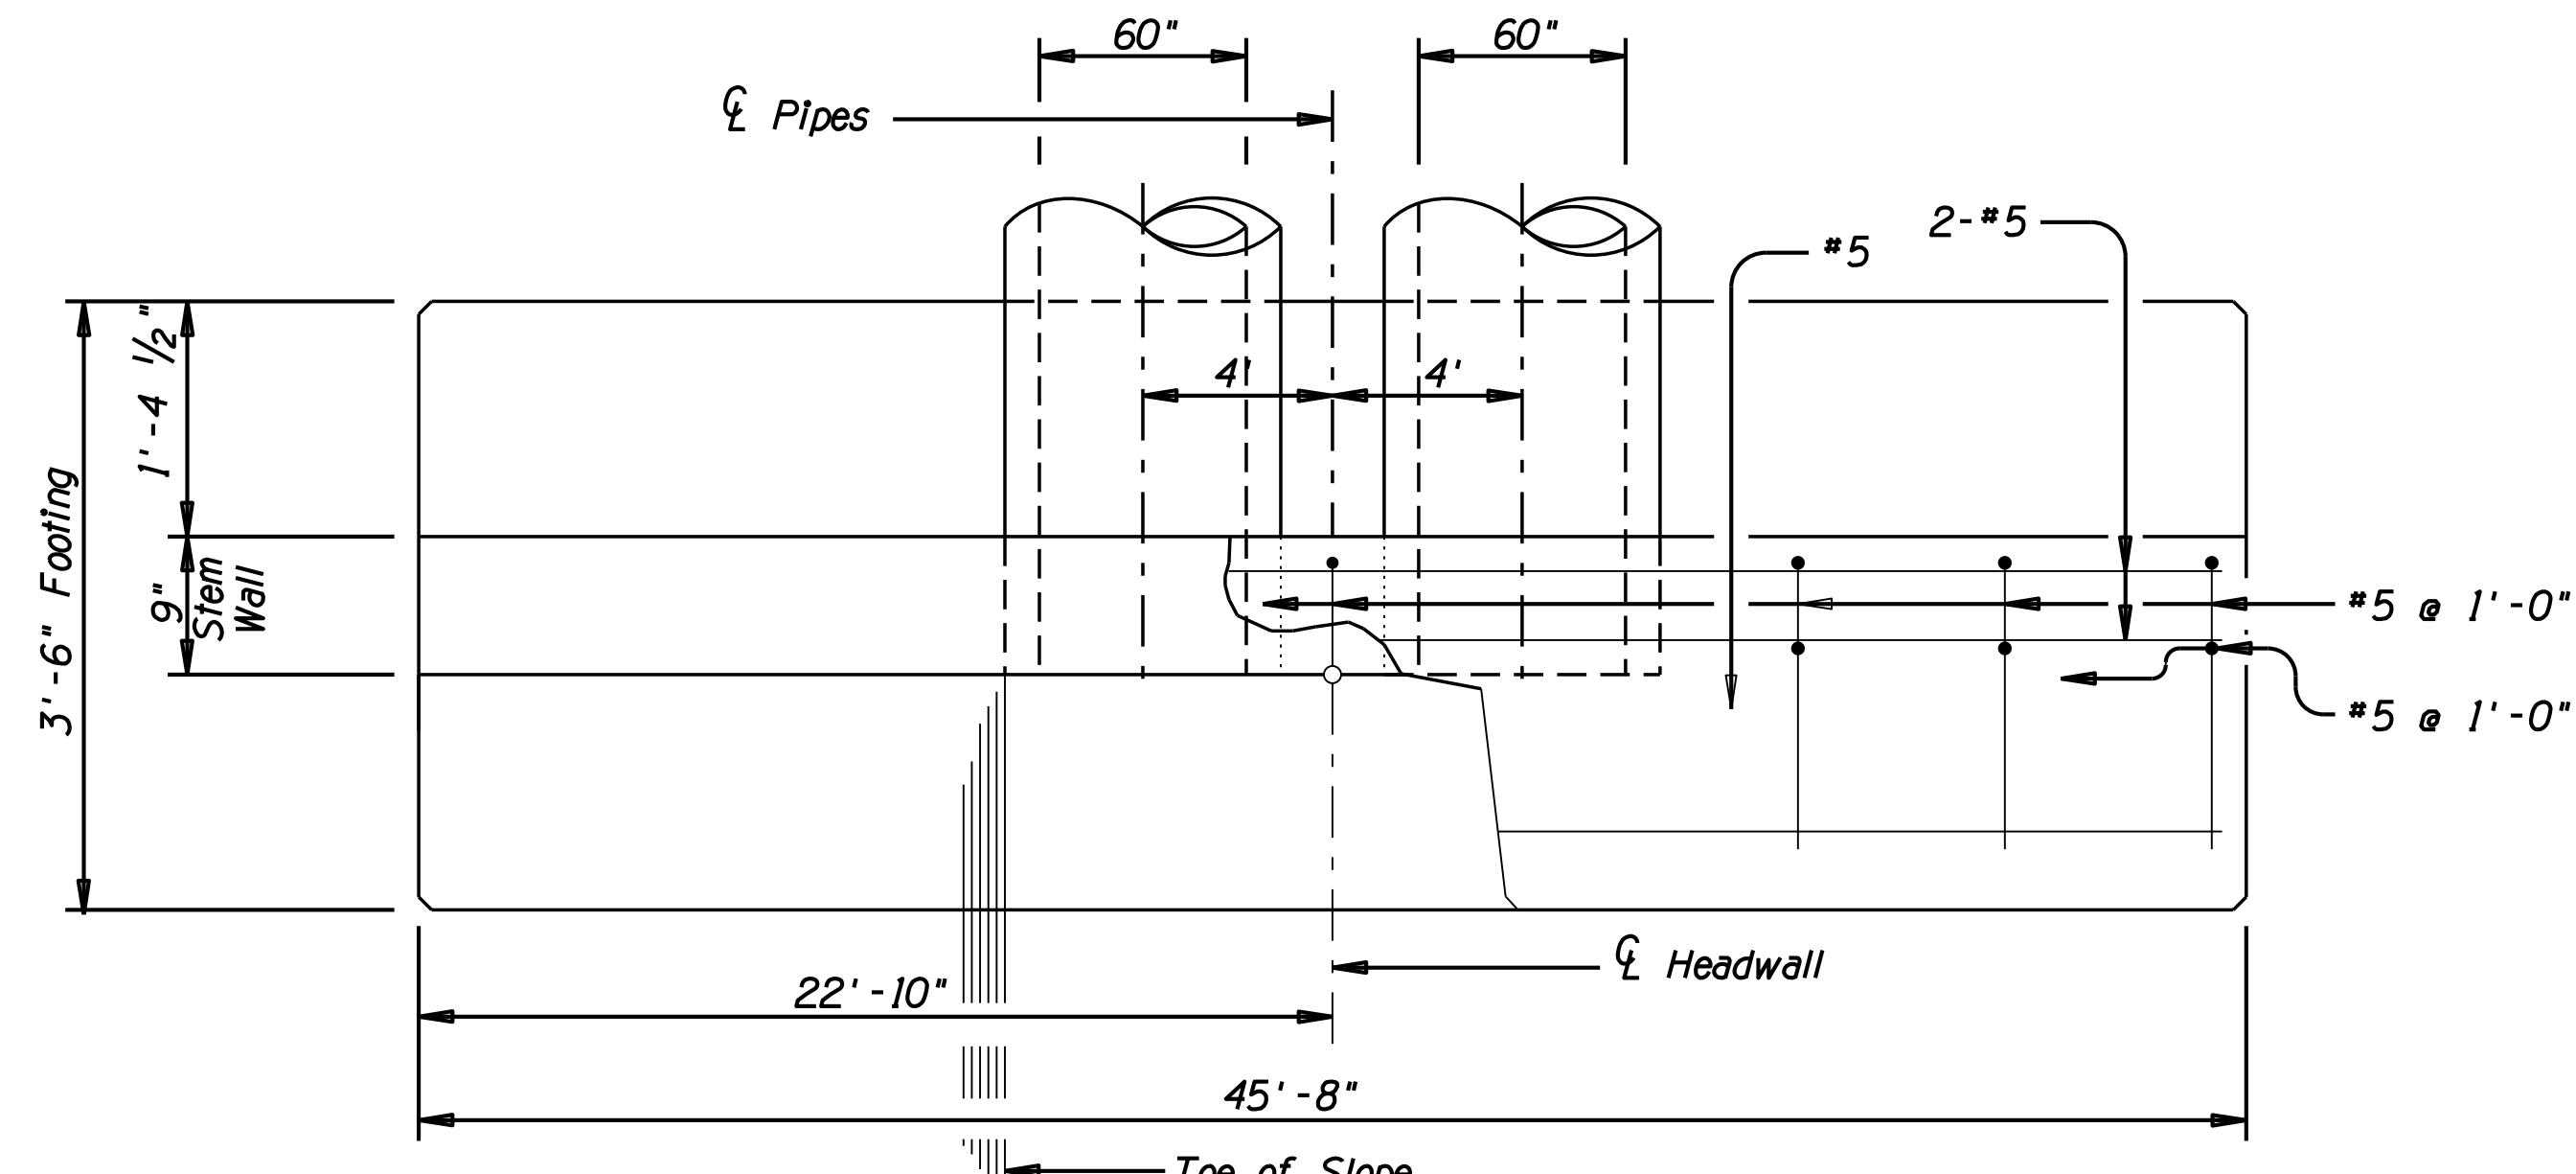


DATE: 3/13/20	REVISION: _____	CITY COMMENTS	BY: A.S.N.
		CROSSROADS EAST DRAINAGE INFRASTRUCTURE	
PROJECT TITLE		PUBLIC WORKS	
CITY OF SCOTTSDALE, ARIZONA		CAPITAL PROJECT MANAGEMENT	
7447 E. INDIAN SCHOOL RD., SCOTTSDALE, ARIZONA 85251		7447 E. INDIAN SCHOOL RD., SCOTTSDALE, ARIZONA 85251	
EXPIRED: 06/30/2022		EXPIRED: 06/30/2022	
SHEET NUMBER		UNION HILLS HEADWALL DETAILS	
SCALE HORIZ. N/A VERT. N/A	DESIGNED AC DRAWN WDF	DATE 07/19 AS-BUILT XX/XX	BID NO. XXXX PROJECT NO. 400-FB53B-56047
		SHT. DB	

12:10:07 PM


PLOT DATE: 3/13/2020

DESIGN FILE: W:\Proj\169678_Crossroads_East\CAD\Sheet Files\Drainage\169678_D9_DROP STRUCTURE.dgn

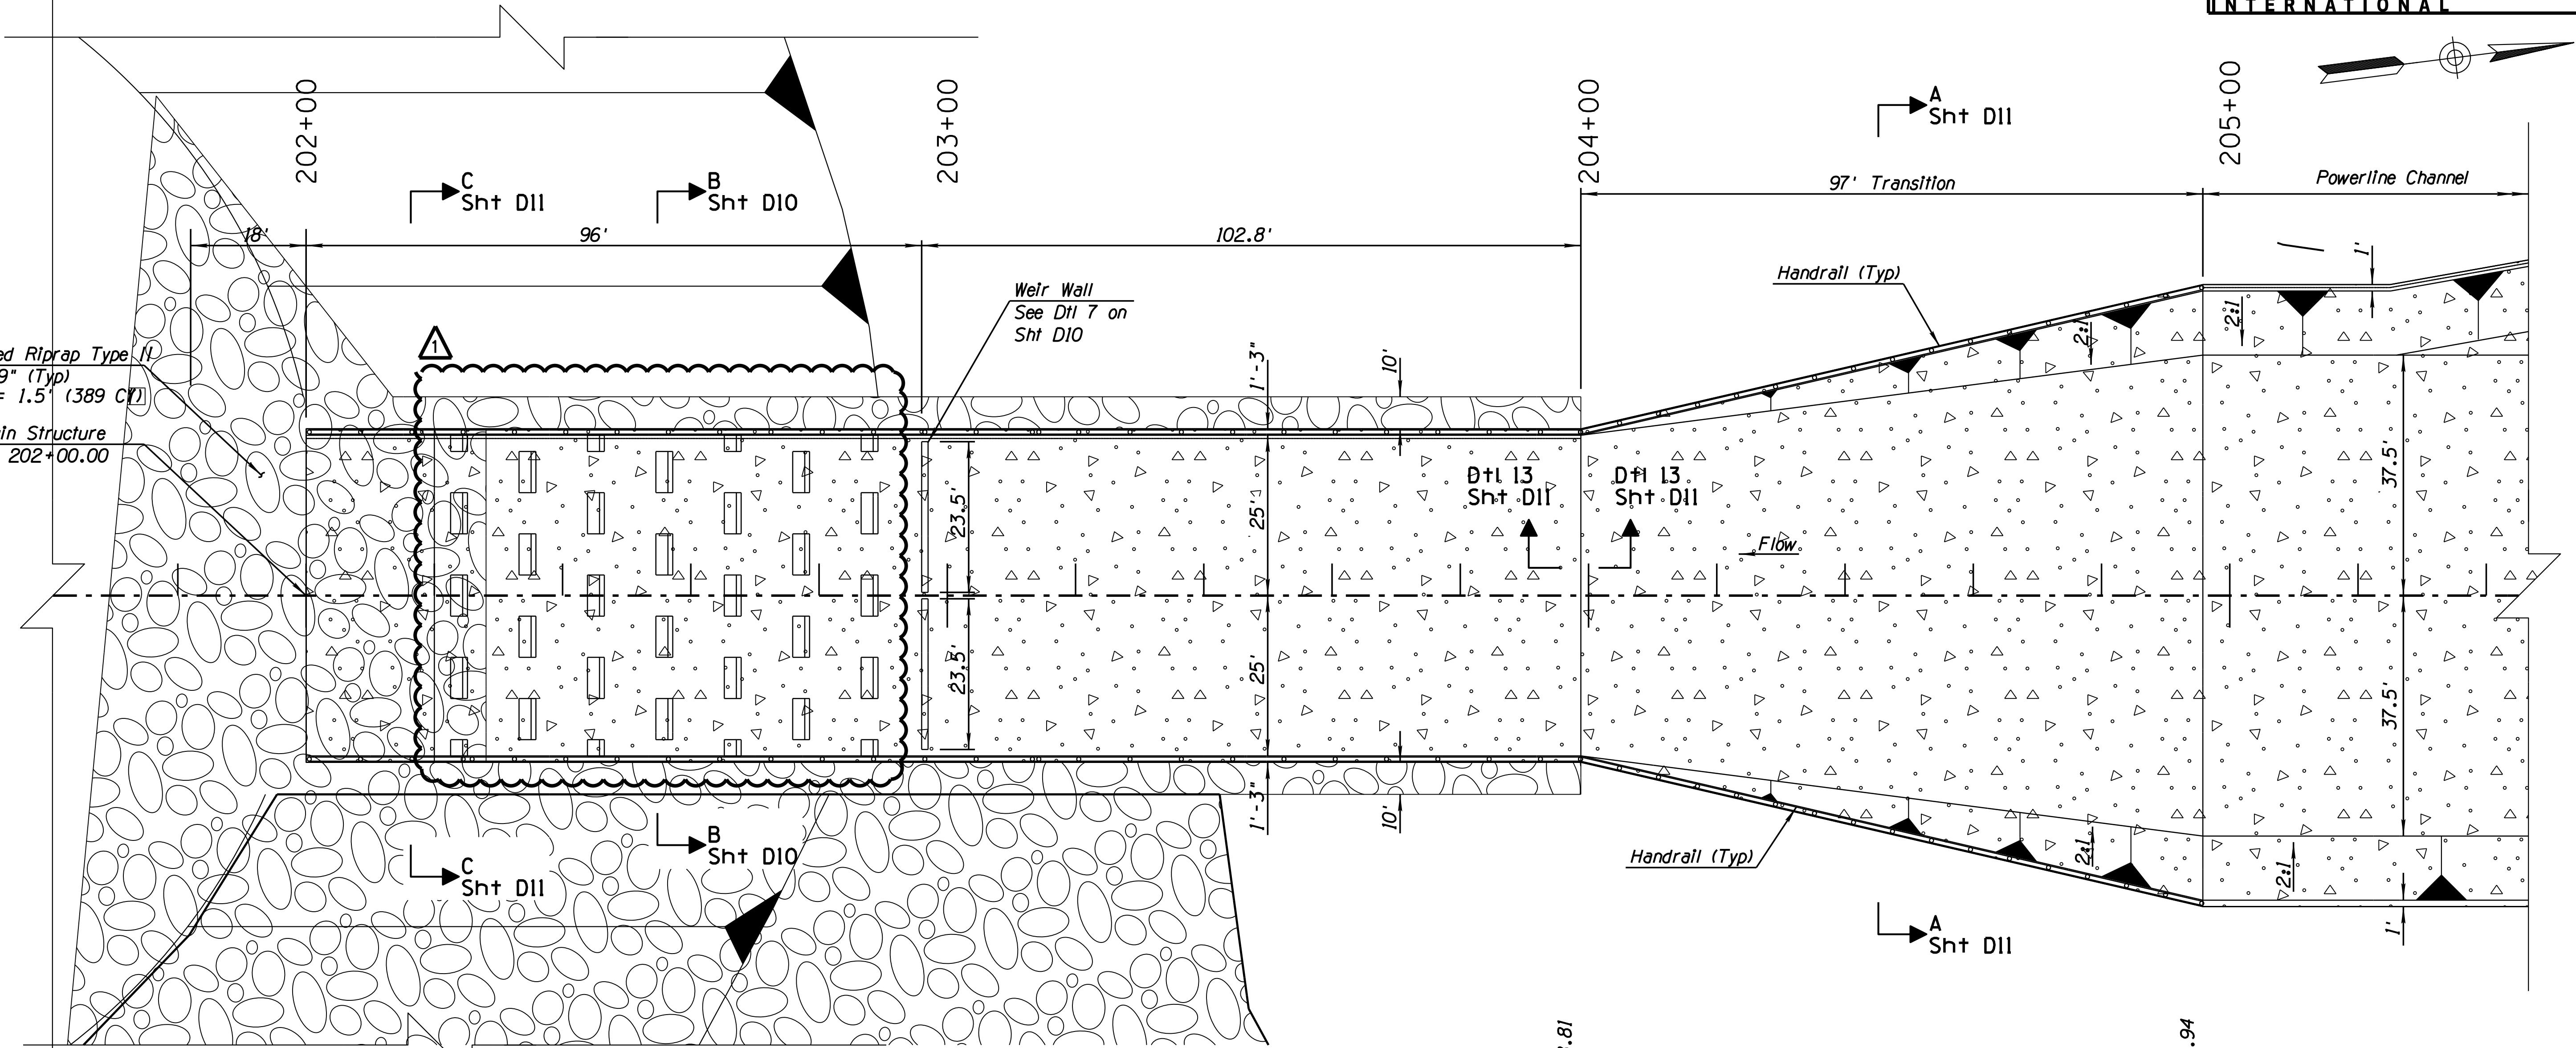

PLAN - BAFFLE CHUTE DROP STRUCTURE

N.T.S.

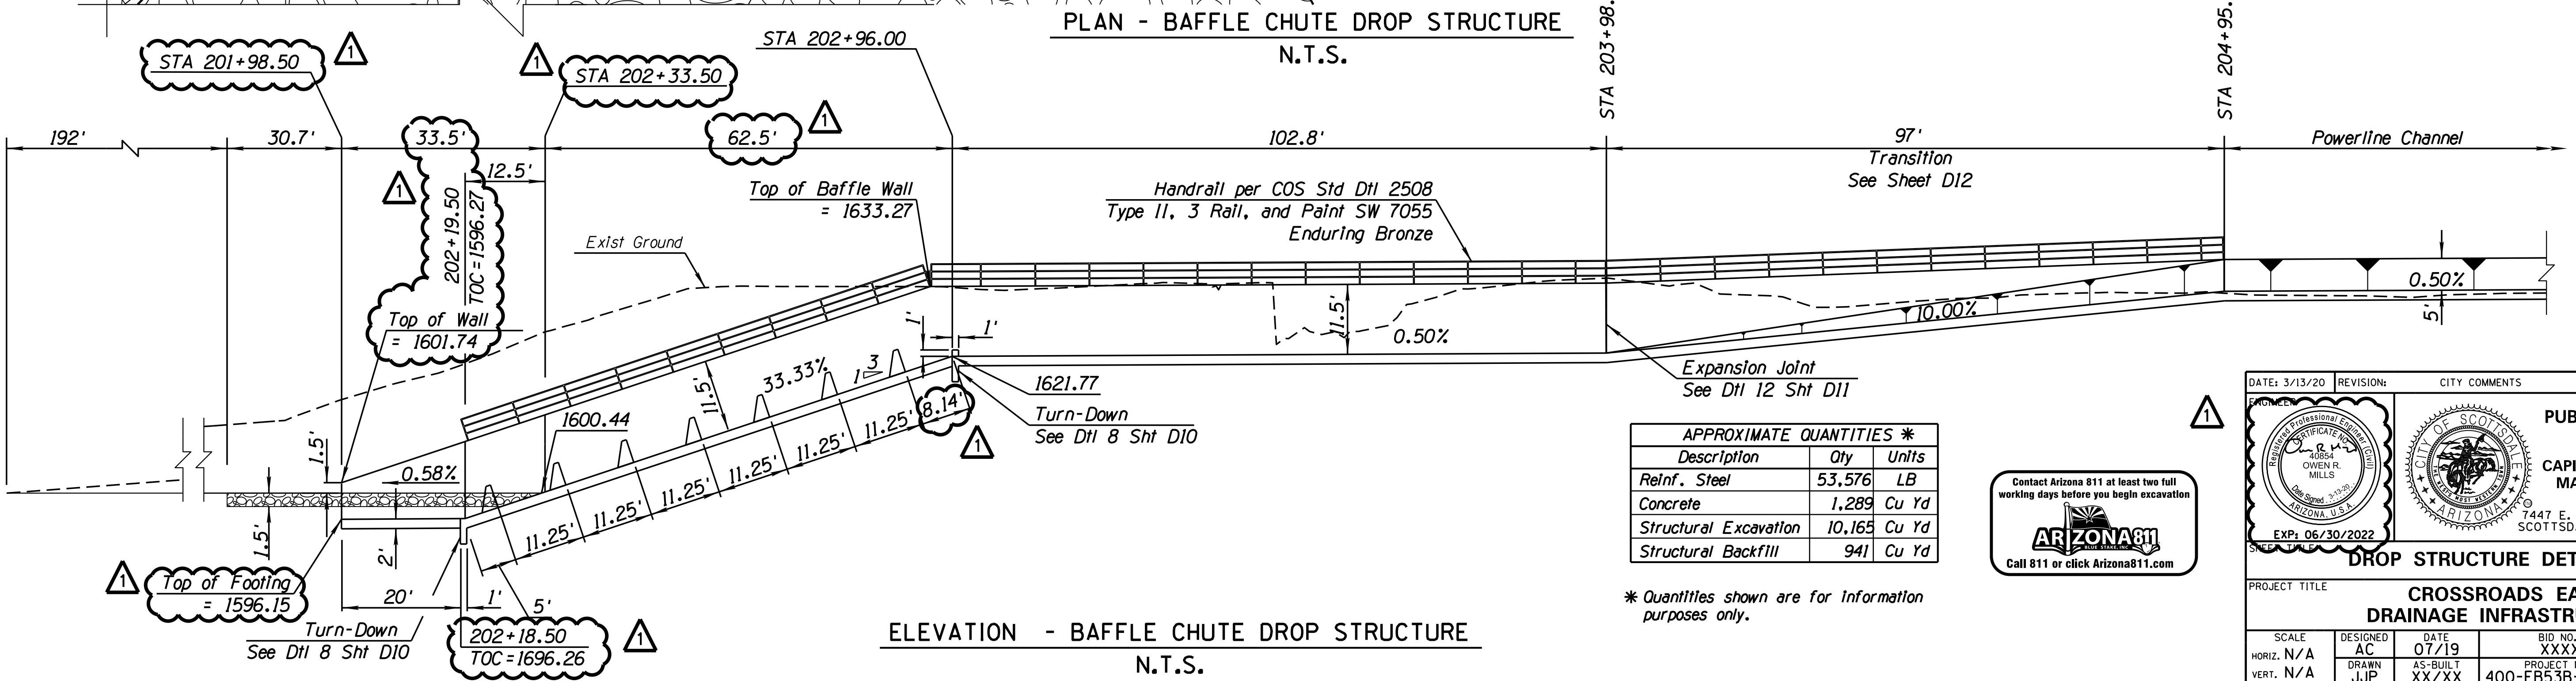

ELEVATION - BAFFLE CHUTE DROP STRUCTURE

N.T.S.

APPROXIMATE QUANTITIES *		
Description	Qty	Units
Reinf. Steel	53.576	LB
Concrete	1.289	Cu Yd
Structural Excavation	10.165	Cu Yd
Structural Backfill	941	Cu Yd


* Quantities shown are for information purposes only.




DATE: 3/13/20	REVISION:	CITY COMMENTS	BY: A.S.N.
 EXP: 06/30/2022		 PUBLIC WORKS CAPITAL PROJECT MANAGEMENT 7447 E. INDIAN SCHOOL RD. SCOTTSDALE, ARIZONA 85251	
DRAFT TITLE: DROP STRUCTURE DETAIL			
PROJECT TITLE: CROSSROADS EAST DRAINAGE INFRASTRUCTURE			
SCALE HORIZ. N/A VERT. N/A	DESIGNED AC	DATE 07/19	BID NO. XXXX
DRAWN JJP	AS-BUILT XX/XX	PROJECT NO. 400-FB53B-56047	SHT. D9 28 OF 38

PLOT DATE: 3/13/2020 12:11:15 PM




DESIGN FILE: W:\P\POJ\169678_Crossroads_East\CAD\Sheet Files\Drainage\169678_D10_DROP_STRUCTURE_DETAILS.dwg

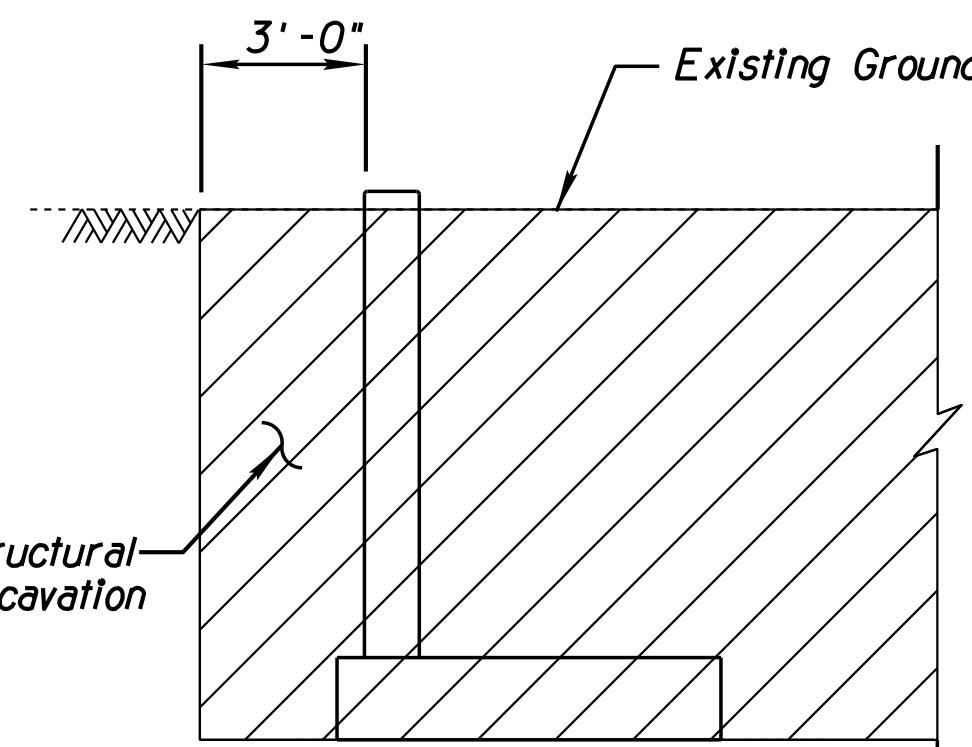

STRUCTURAL EXCAVATION LIMITS

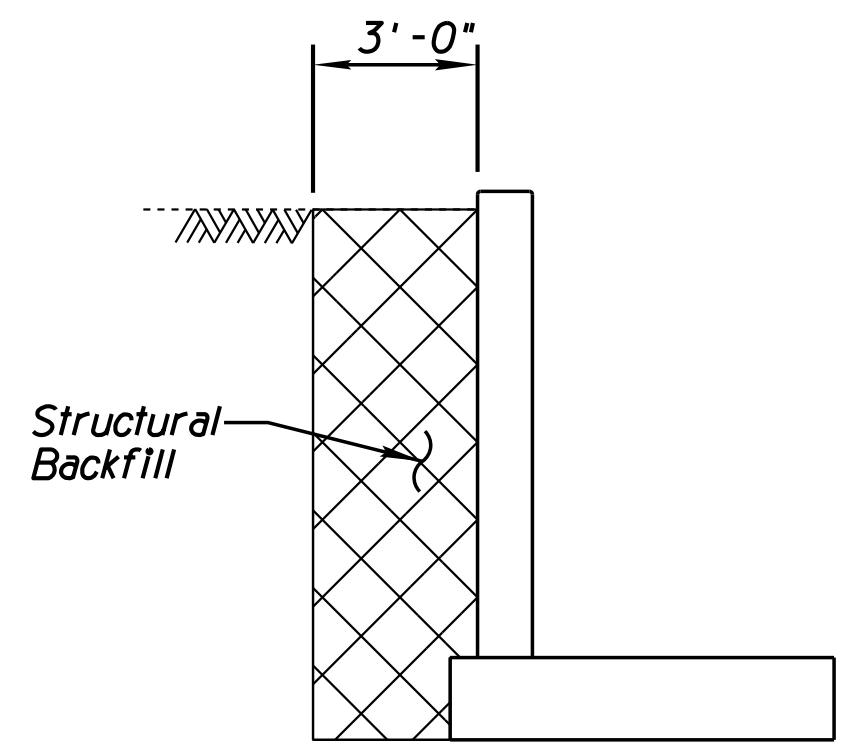

STRUCTURAL BACKFILL LIMITS

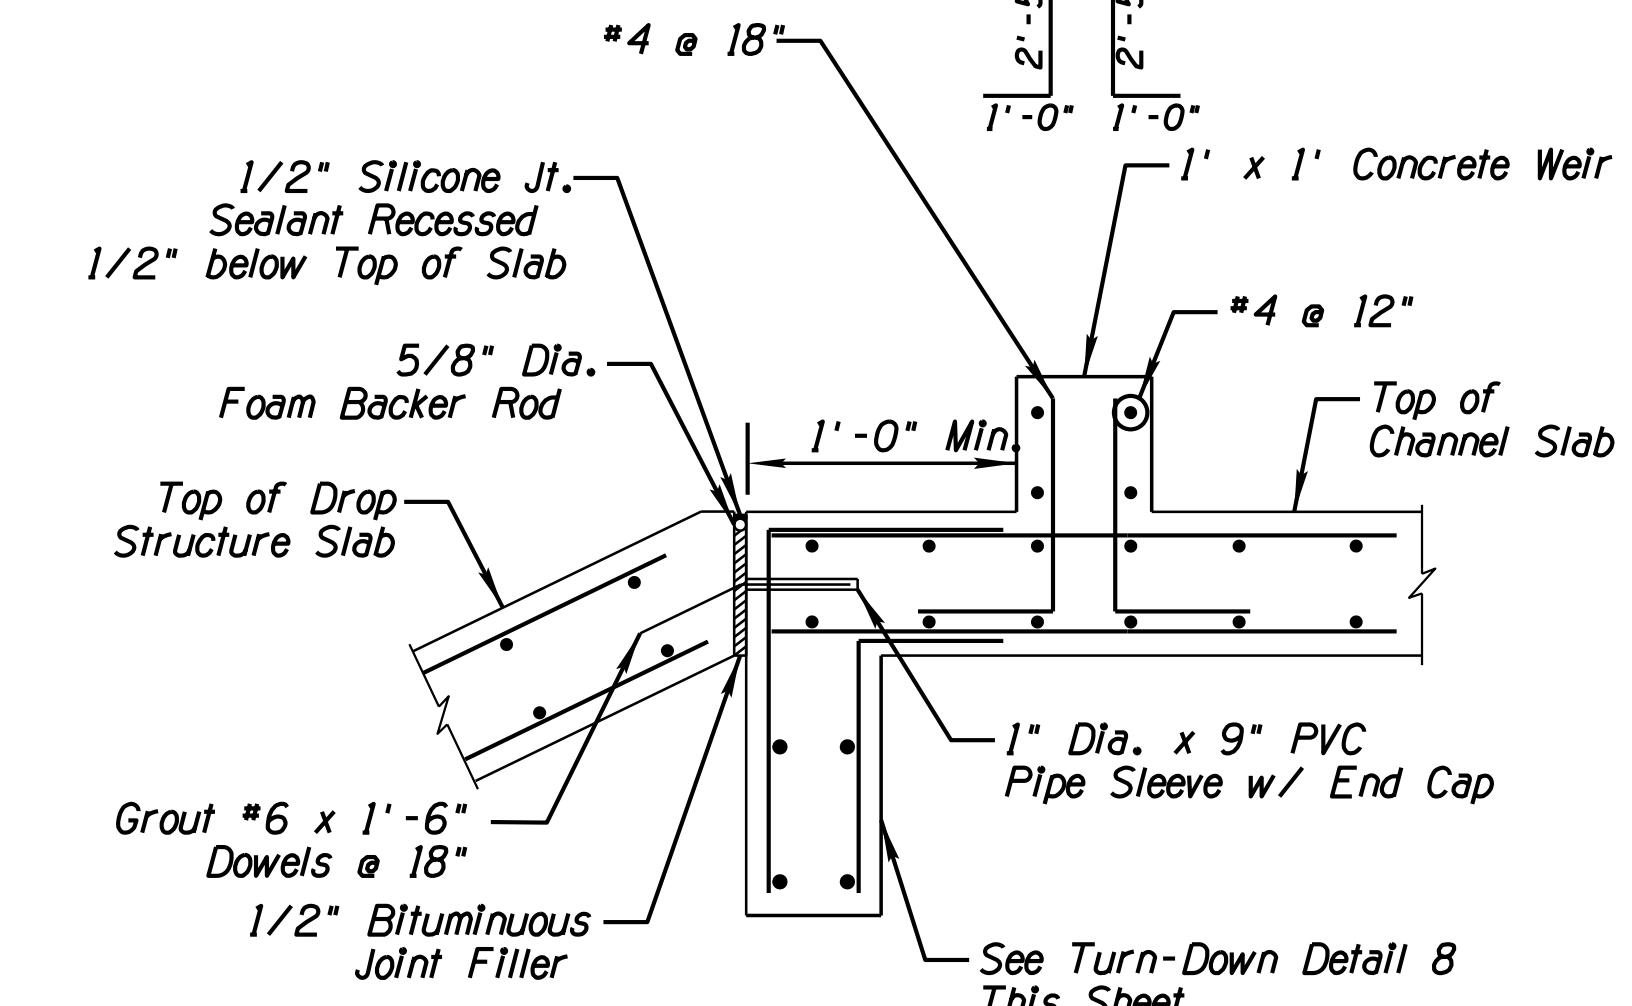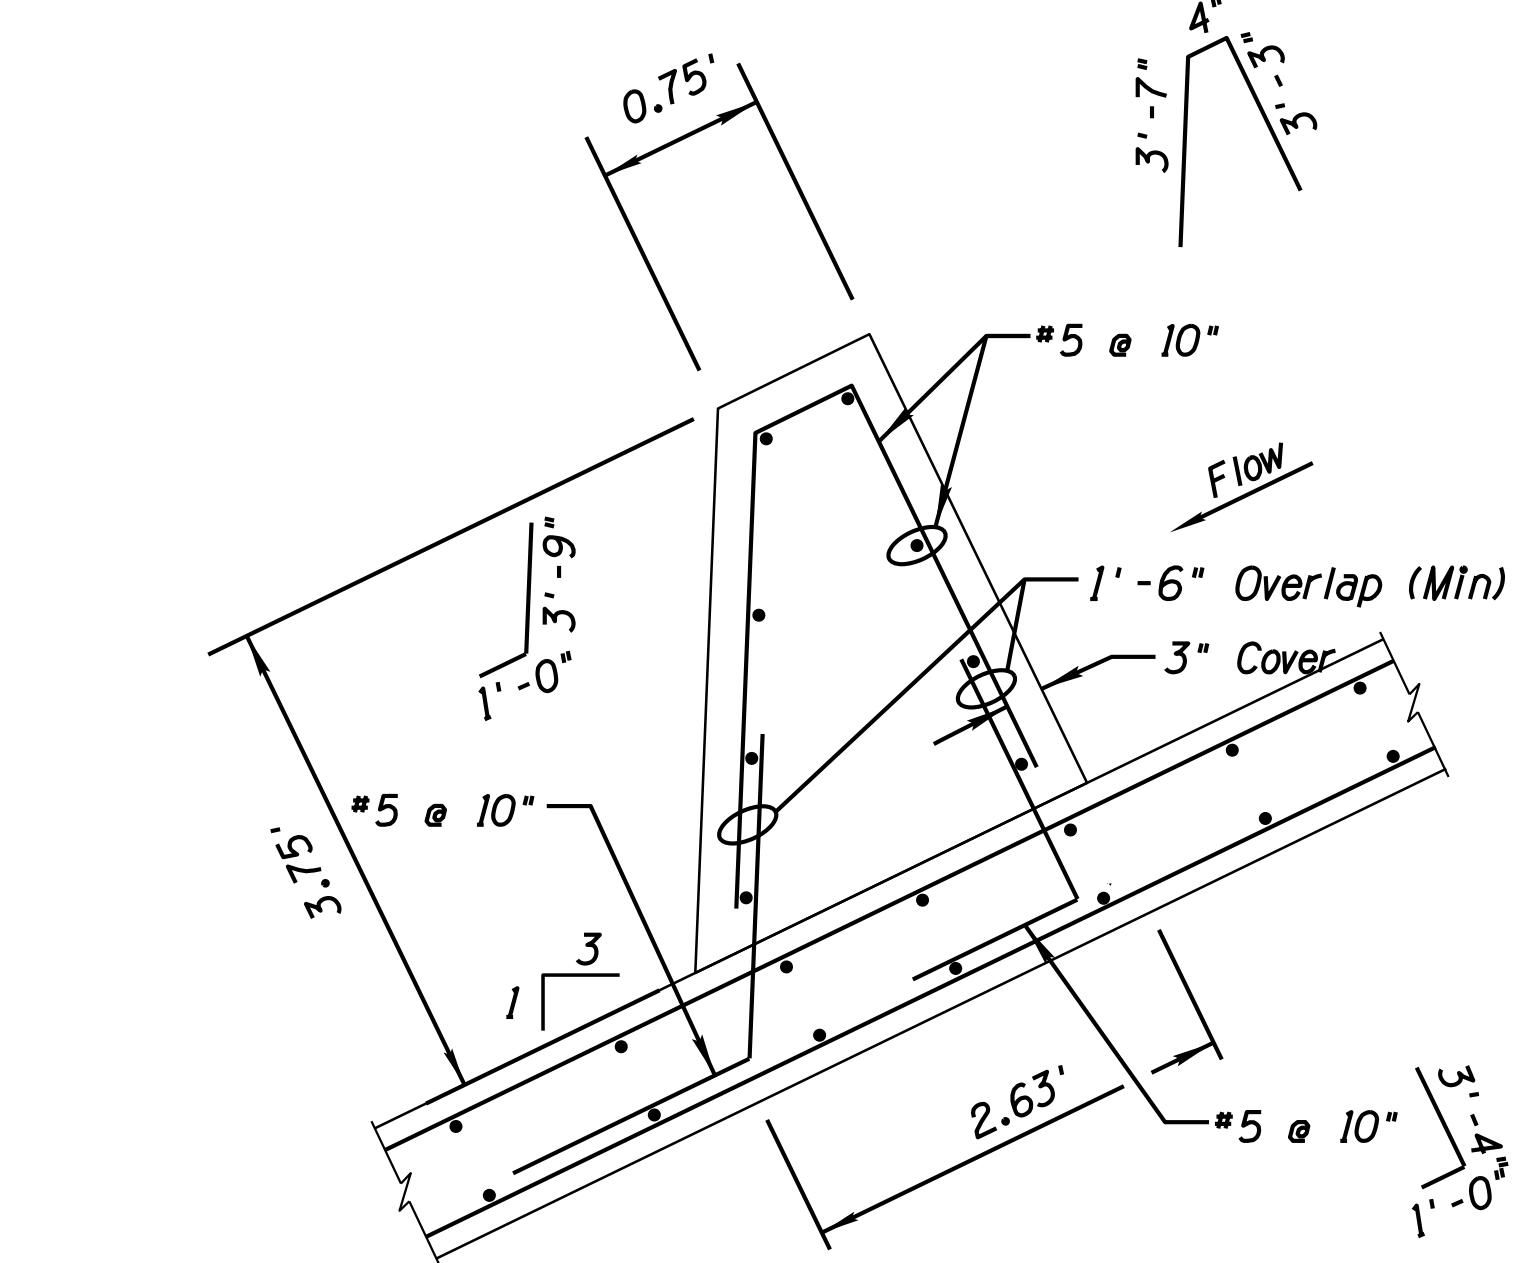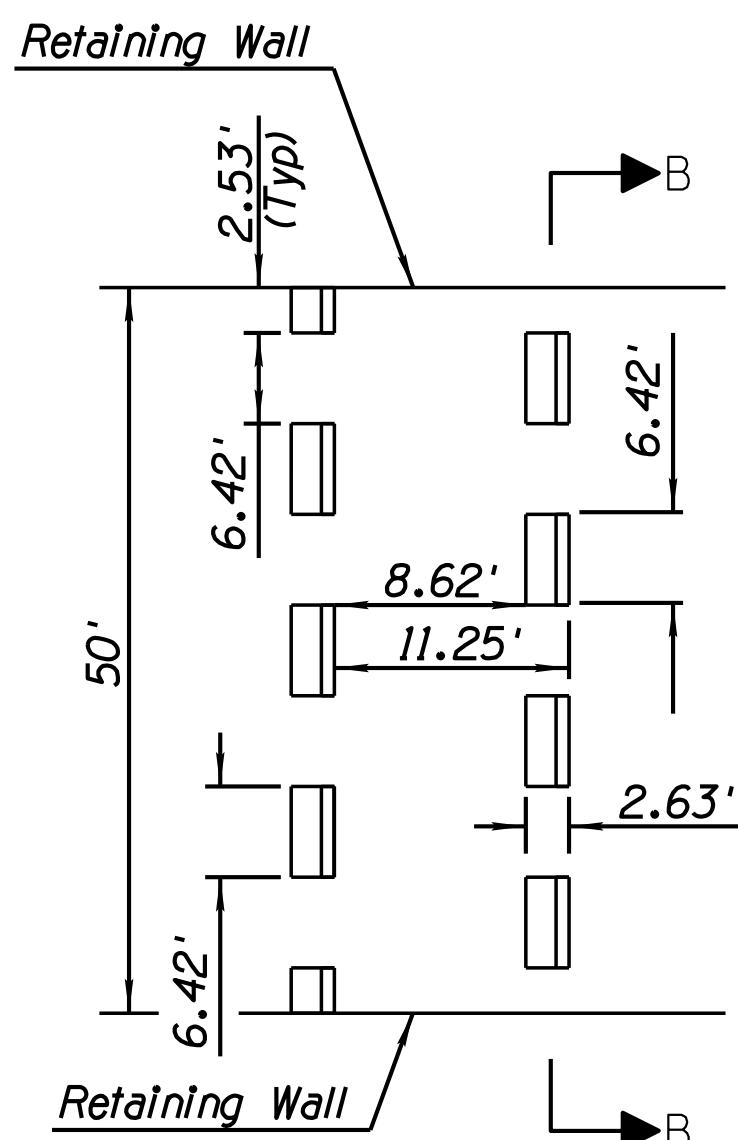

⑦ SLAB JOINT DETAIL


Scale: N.T.S.

④ BAFFLE BLOCK DETAIL

Scale: N.T.S.

⑤ BAFFLE BLOCK DETAIL

Scale: N.T.S.

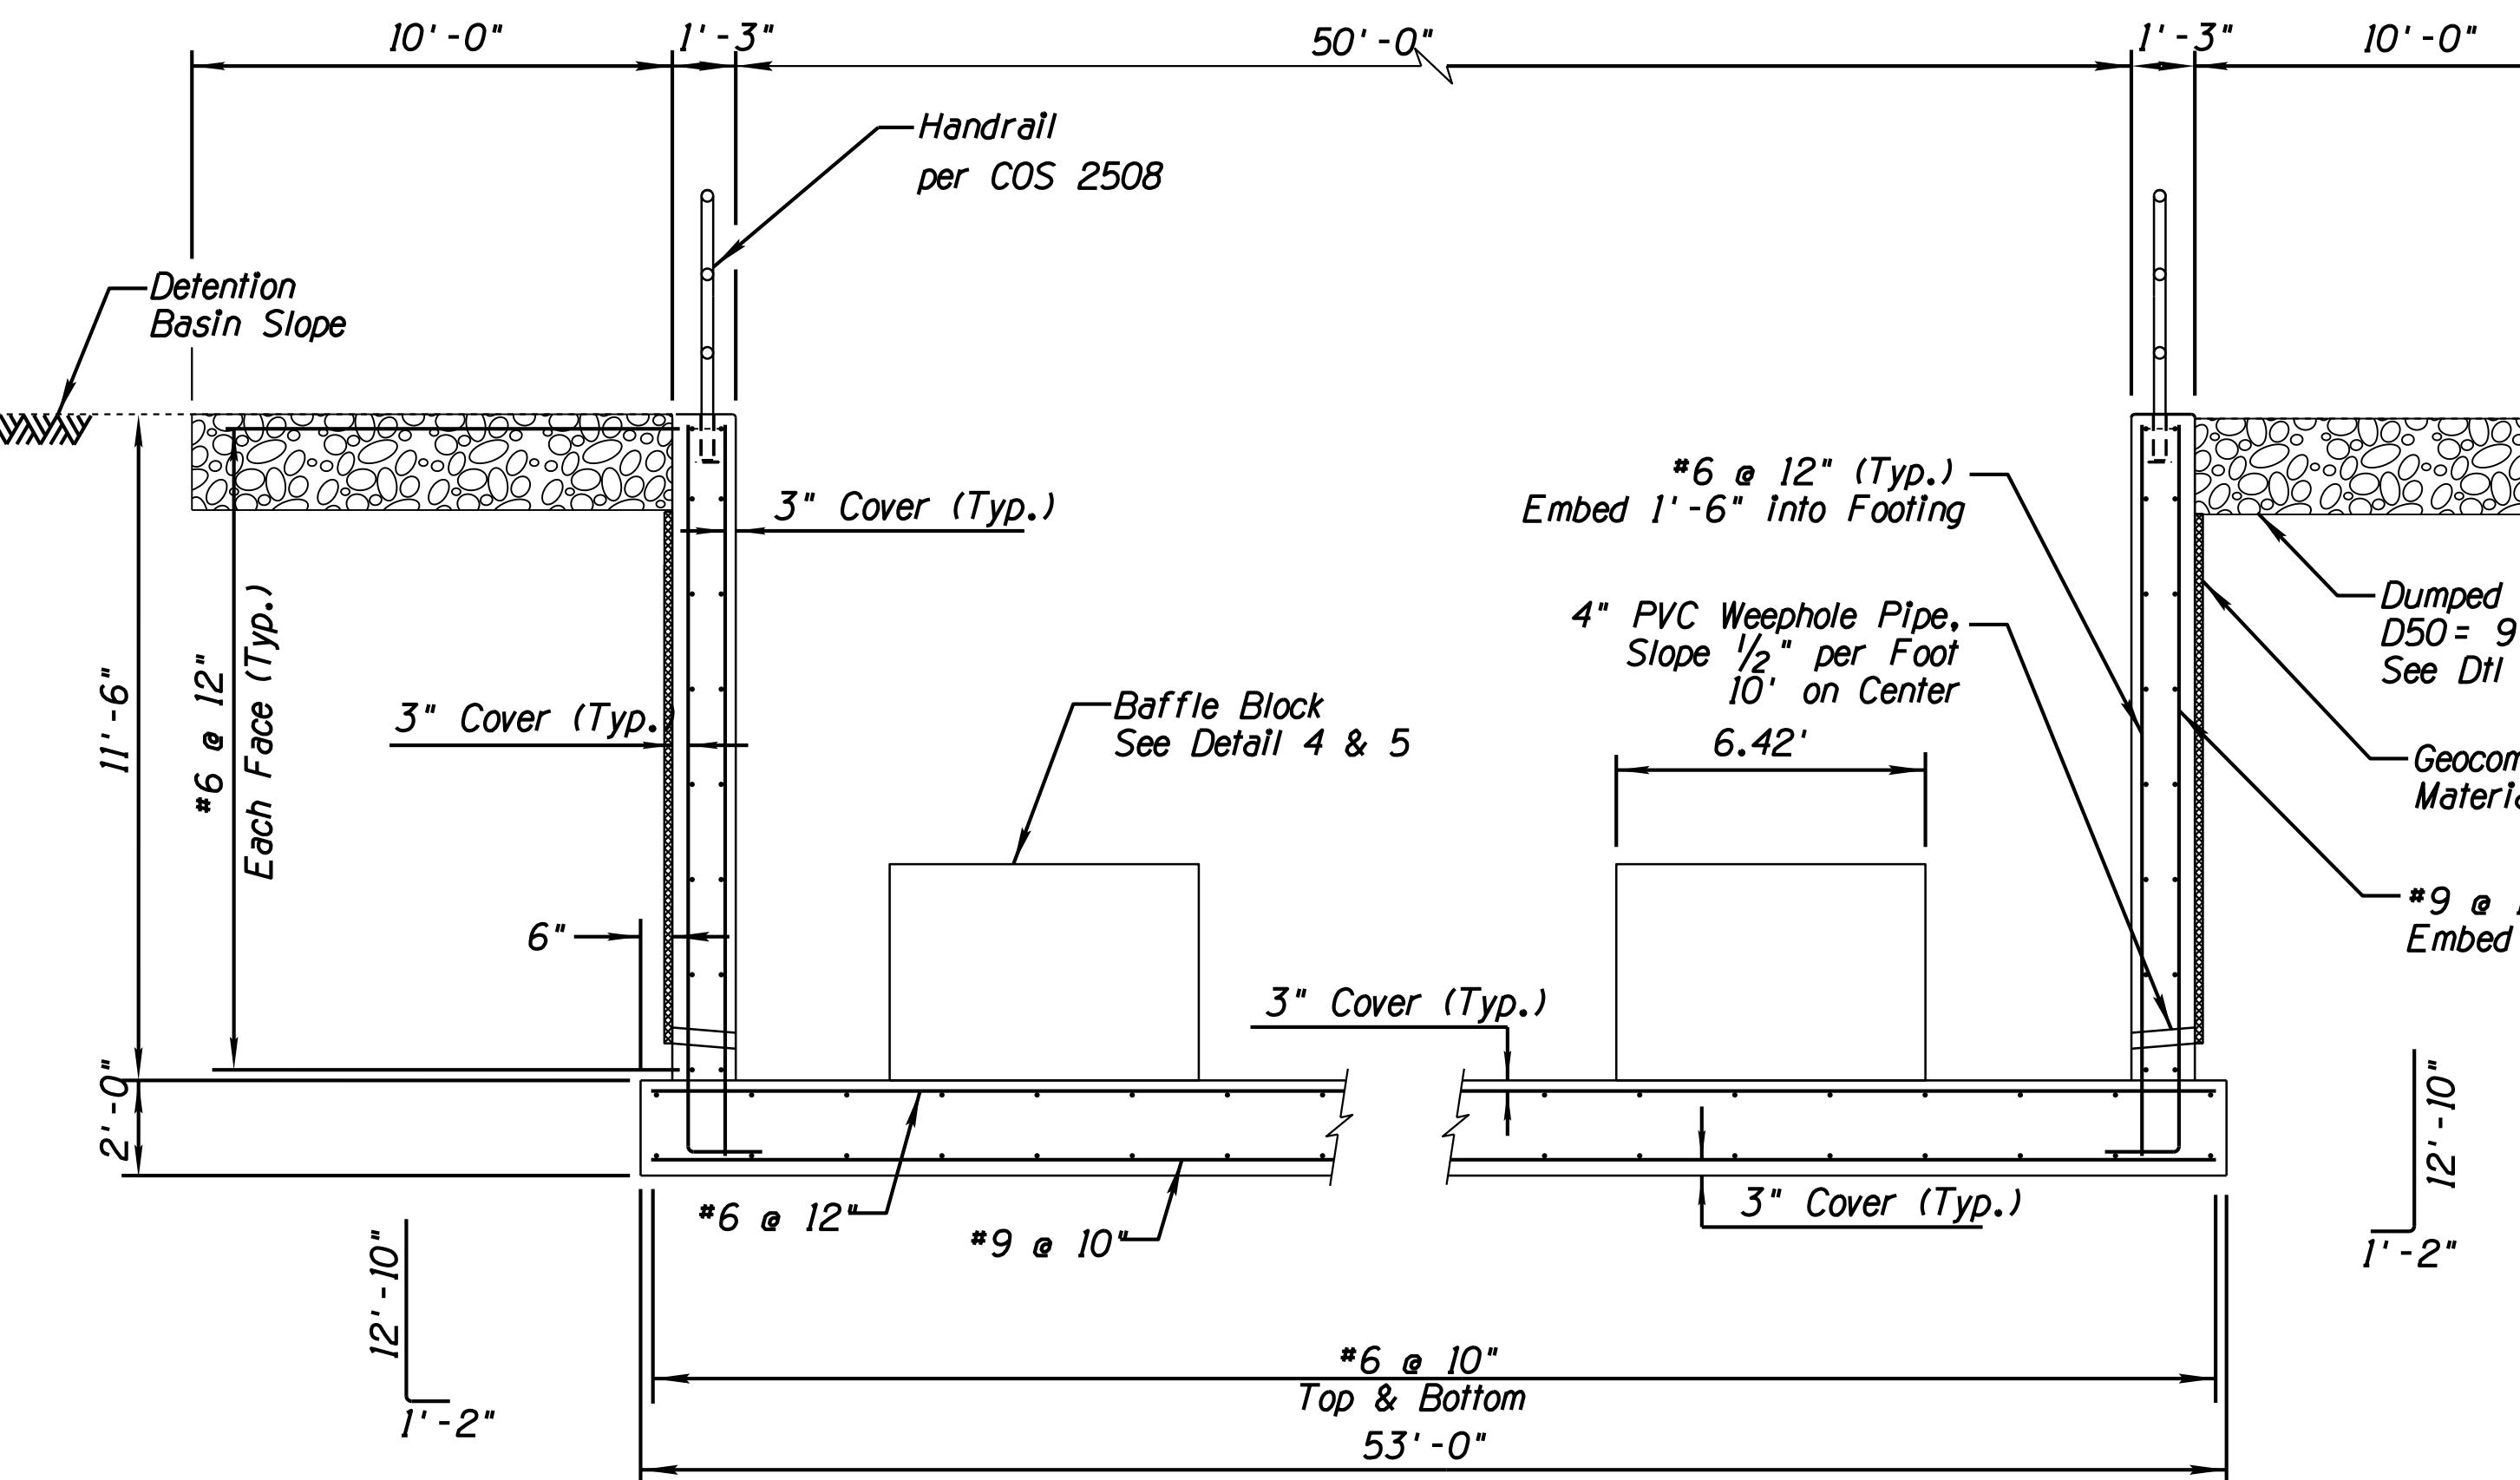

⑥ SECTION B


Scale: N.T.S.

STA 202+18.50 TO STA 203+99
 NO BAFFLE BLOCKS BETWEEN
 STA 202+96 TO STA 203+99



⑧ TURN-DOWN DETAIL

Scale: N.T.S.

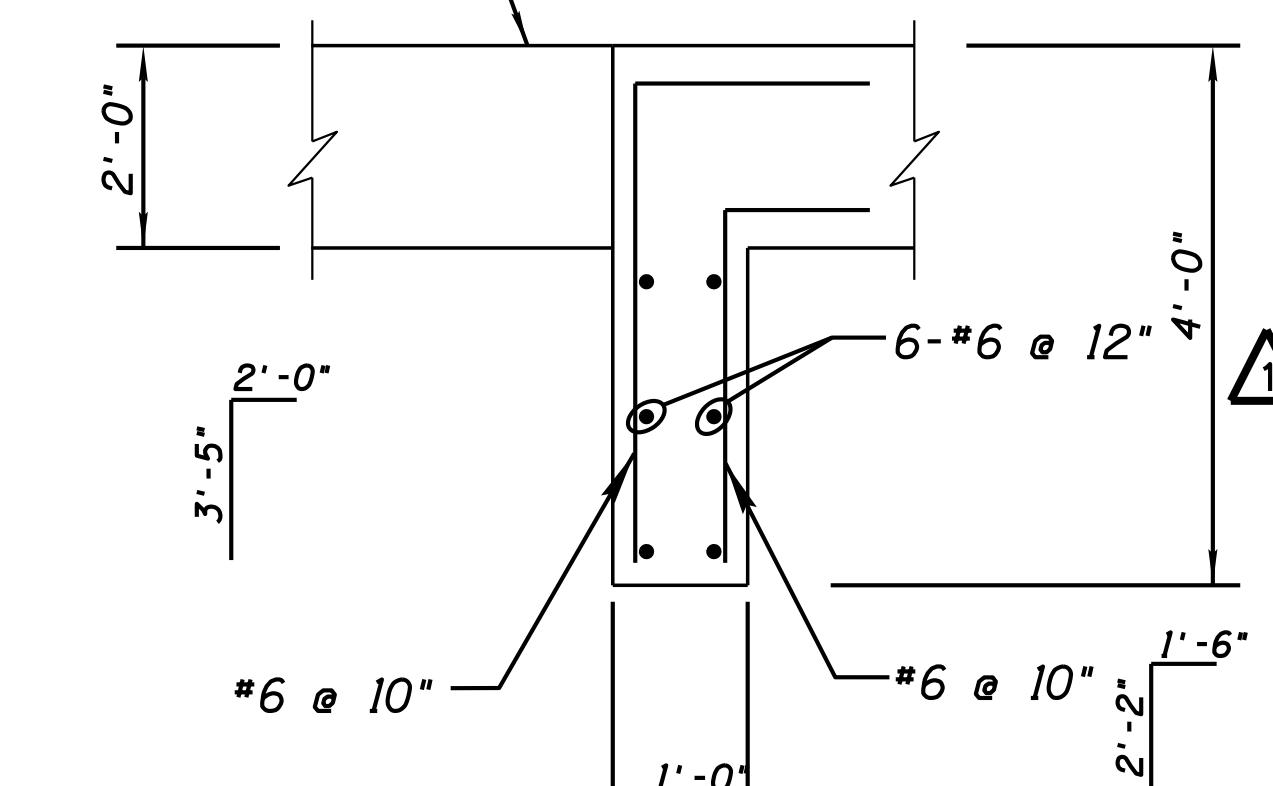

⑨ TURN-DOWN DETAIL

Scale: N.T.S.

Construction Notes:

- Concrete Shall Have $f'c = 4000 \text{ psi}$.
- Reinforcing Steel shall conform to ASTM Specification A615. All reinforcing shall be furnished as Grade 60.
- All bends and hooks shall meet the requirements of ACI Chapter 25. All bend dimensions for reinforcing steel shall be out-to-out bars. All placement dimensions for reinforcing steel shall be to center of bars unless noted otherwise.
- Chamfer all exposed corners $3/4"$ unless noted otherwise.
- Compact backfill for footing and wall base minimum 95 percent of ASTM D698 maximum dry density.
- Fill PVC Pipe With Nonshrink Grout Complying with Section 1017 of ADOT Standard Specifications.
- Overexcavate a Min of 1' Below Footing and Compact to 95% Relative Density.
- Reinforcing Steel shall be placed with the center of the outside layer of bars 3" from the surface of the concrete.



DATE: 3/13/20		REVISION:	CITY COMMENTS		BY: A.S.N.
ENGINEER		CITY OF SCOTTSDALE, ARIZONA			
 Arizona State Engineer OWEN R. MILLS Date Signed: 3/13/20 ARIZONA U.S.A. EXP: 06/30/2022		 CITY OF SCOTTSDALE PUBLIC WORKS CAPITAL PROJECT MANAGEMENT 7447 E. INDIAN SCHOOL RD. SCOTTSDALE, ARIZONA 85251			
SHEET TITLE: DROP STRUCTURE DETAILS					
PROJECT TITLE: CROSSROADS EAST DRAINAGE INFRASTRUCTURE					
SCALE: HORIZ. N/A	DESIGNED BY: AC	DATE: 07/19	BID NO.: XXXX	SHT. NO.: 10	
VERT. N/A	DRAWN BY: WDF	AS-BUILT XX/XX	PROJECT NO.: 400-FB53B-56047	29 OF 38	

Contact Arizona 811 at least two full working days before you begin excavation
ARIZONA 811
 Call 811 or click Arizona811.com

12:12:19 PM

PLOT DATE: 3/13/2020


SECTION DETAILS.dwg

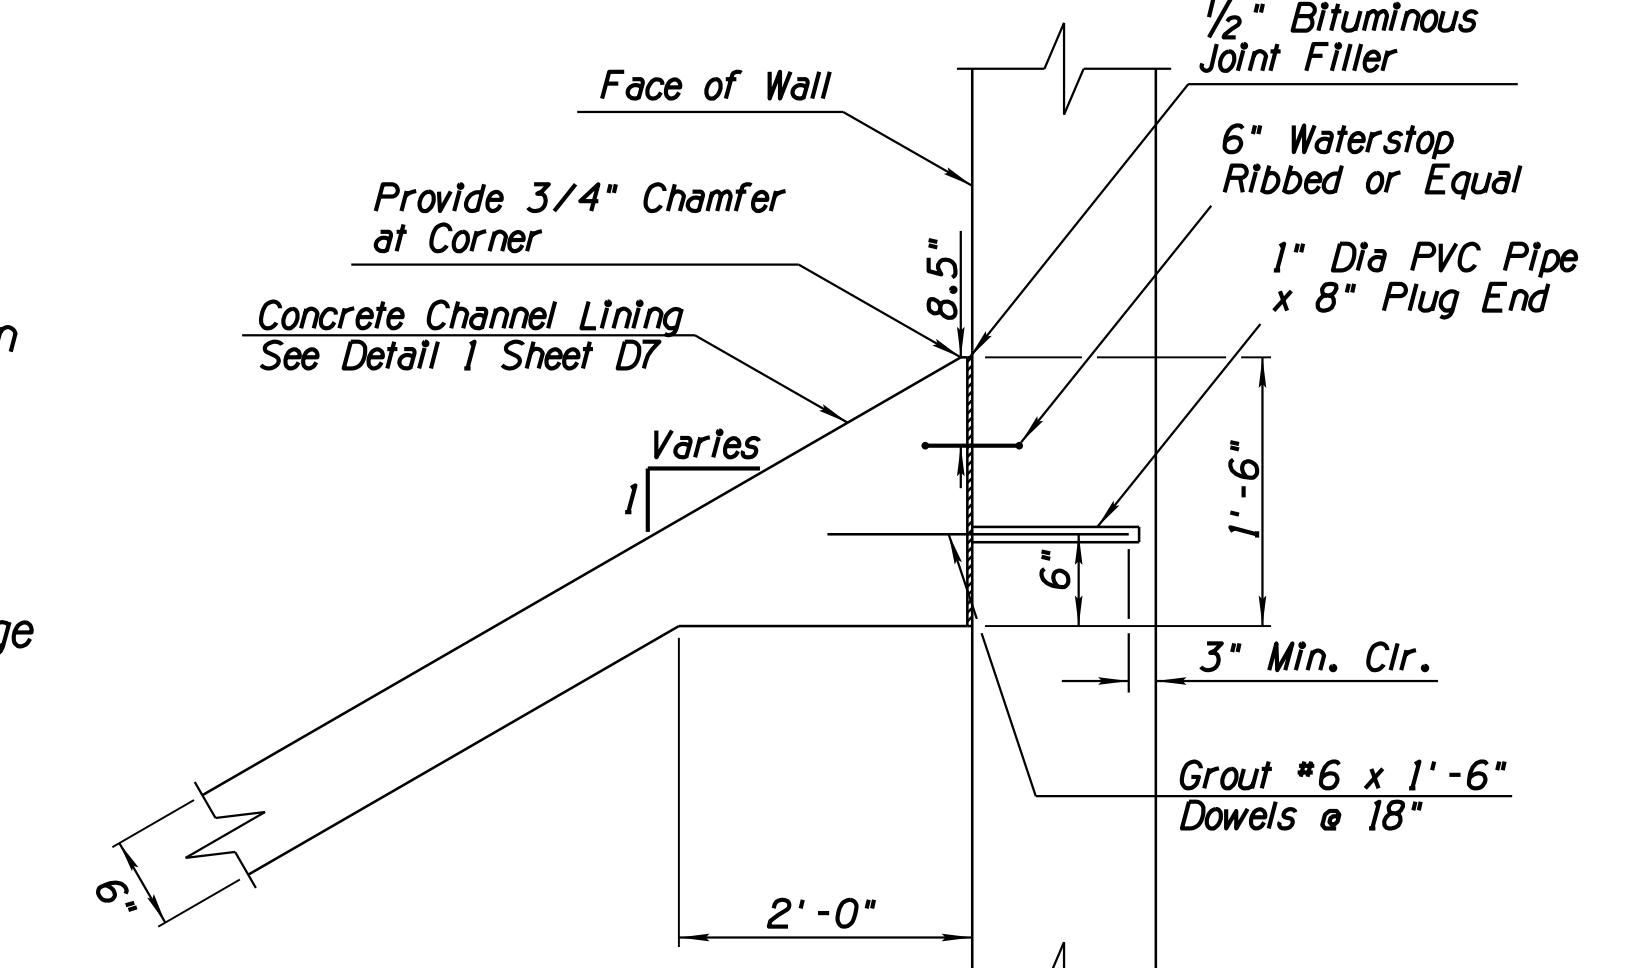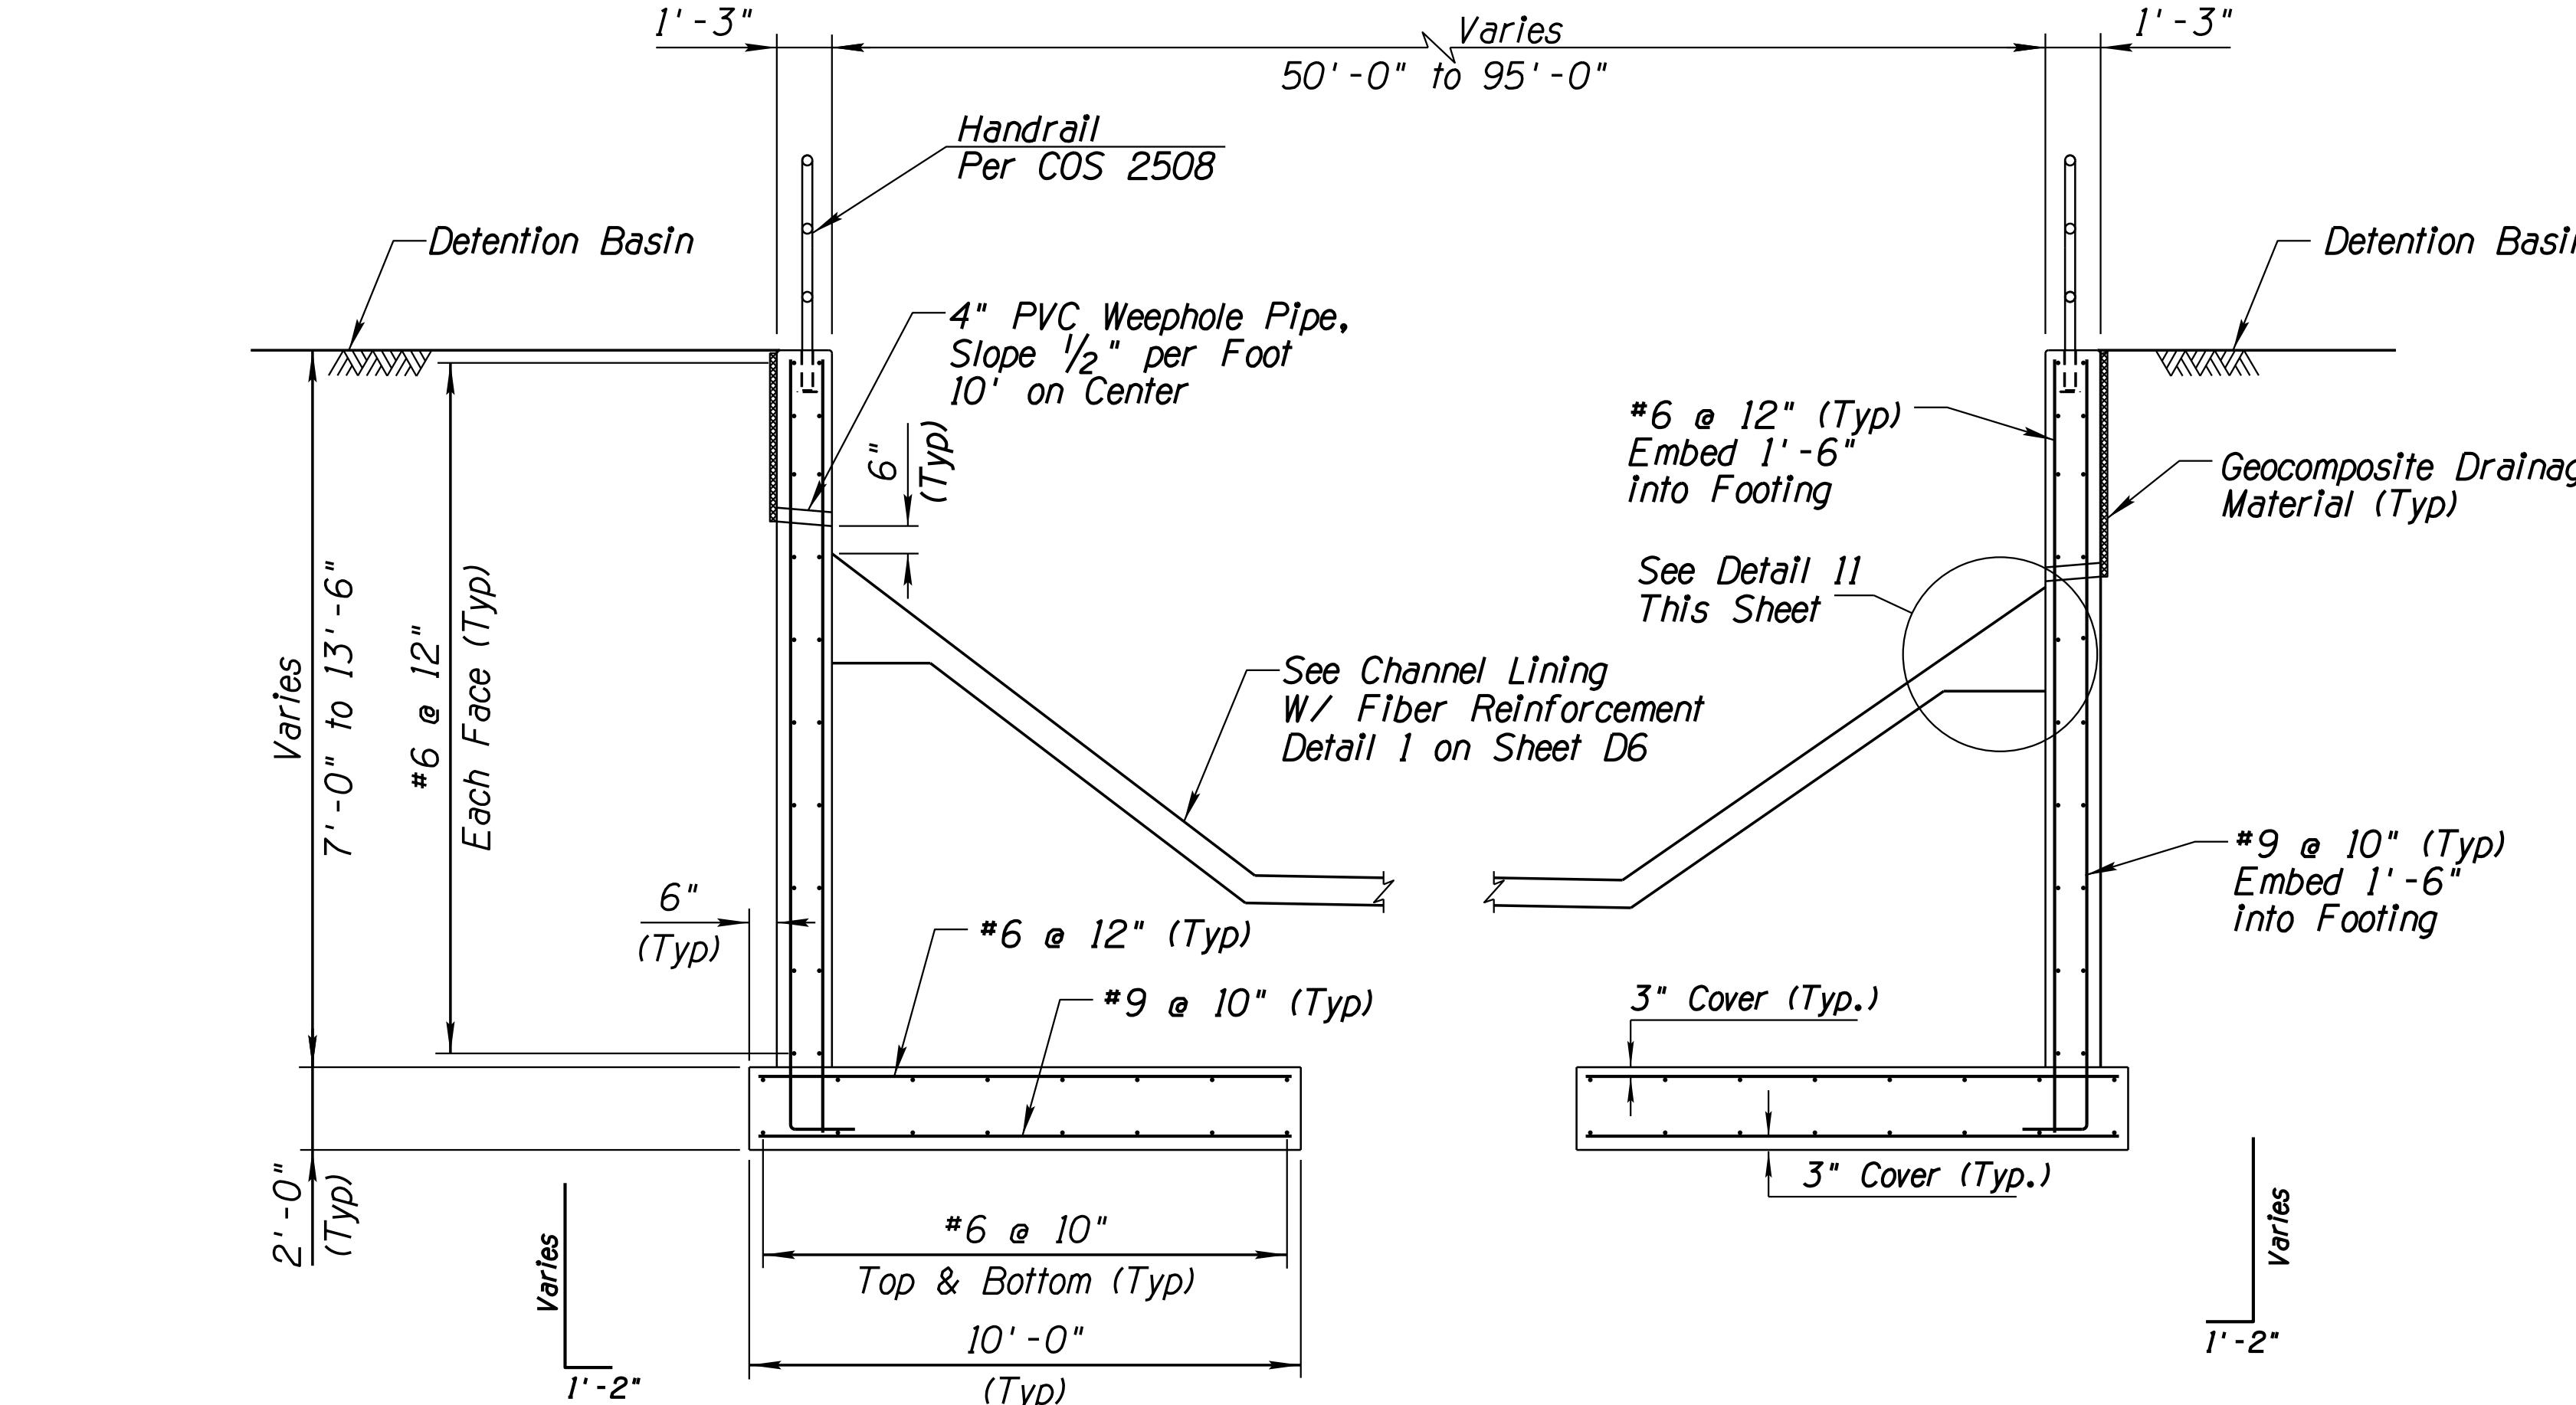

11 JOINT BETWEEN RETAINING WALL AND CHANNEL LINING
Scale: N.T.S.


Construction Notes:

- Concrete Shall Have $f'c = 4000 \text{ psi}$.
- Reinforcing Steel shall conform to ASTM Specification A615. All reinforcing shall be furnished as Grade 60.
- All bends and hooks shall meet the requirements of ACI Chapter 25. All bend dimensions for reinforcing steel shall be out-to-out bars. All placement dimensions for reinforcing steel shall be to center of bars unless noted otherwise.
- Chamfer all exposed corners 3/4" unless noted otherwise.
- Compact backfill for footing and wall base minimum 95 percent of ASTM D698 maximum dry density.
- Fill PVC Pipe With Nonshrink Grout Complying with Section 1017 of ADOT Standard Specifications.
- Overexcavate a Min of 1' Below Footing and Compact to 95% Relative Density.
- Reinforcing Steel shall be placed with the center of the outside layer of bars 3" form the surface of the concrete.

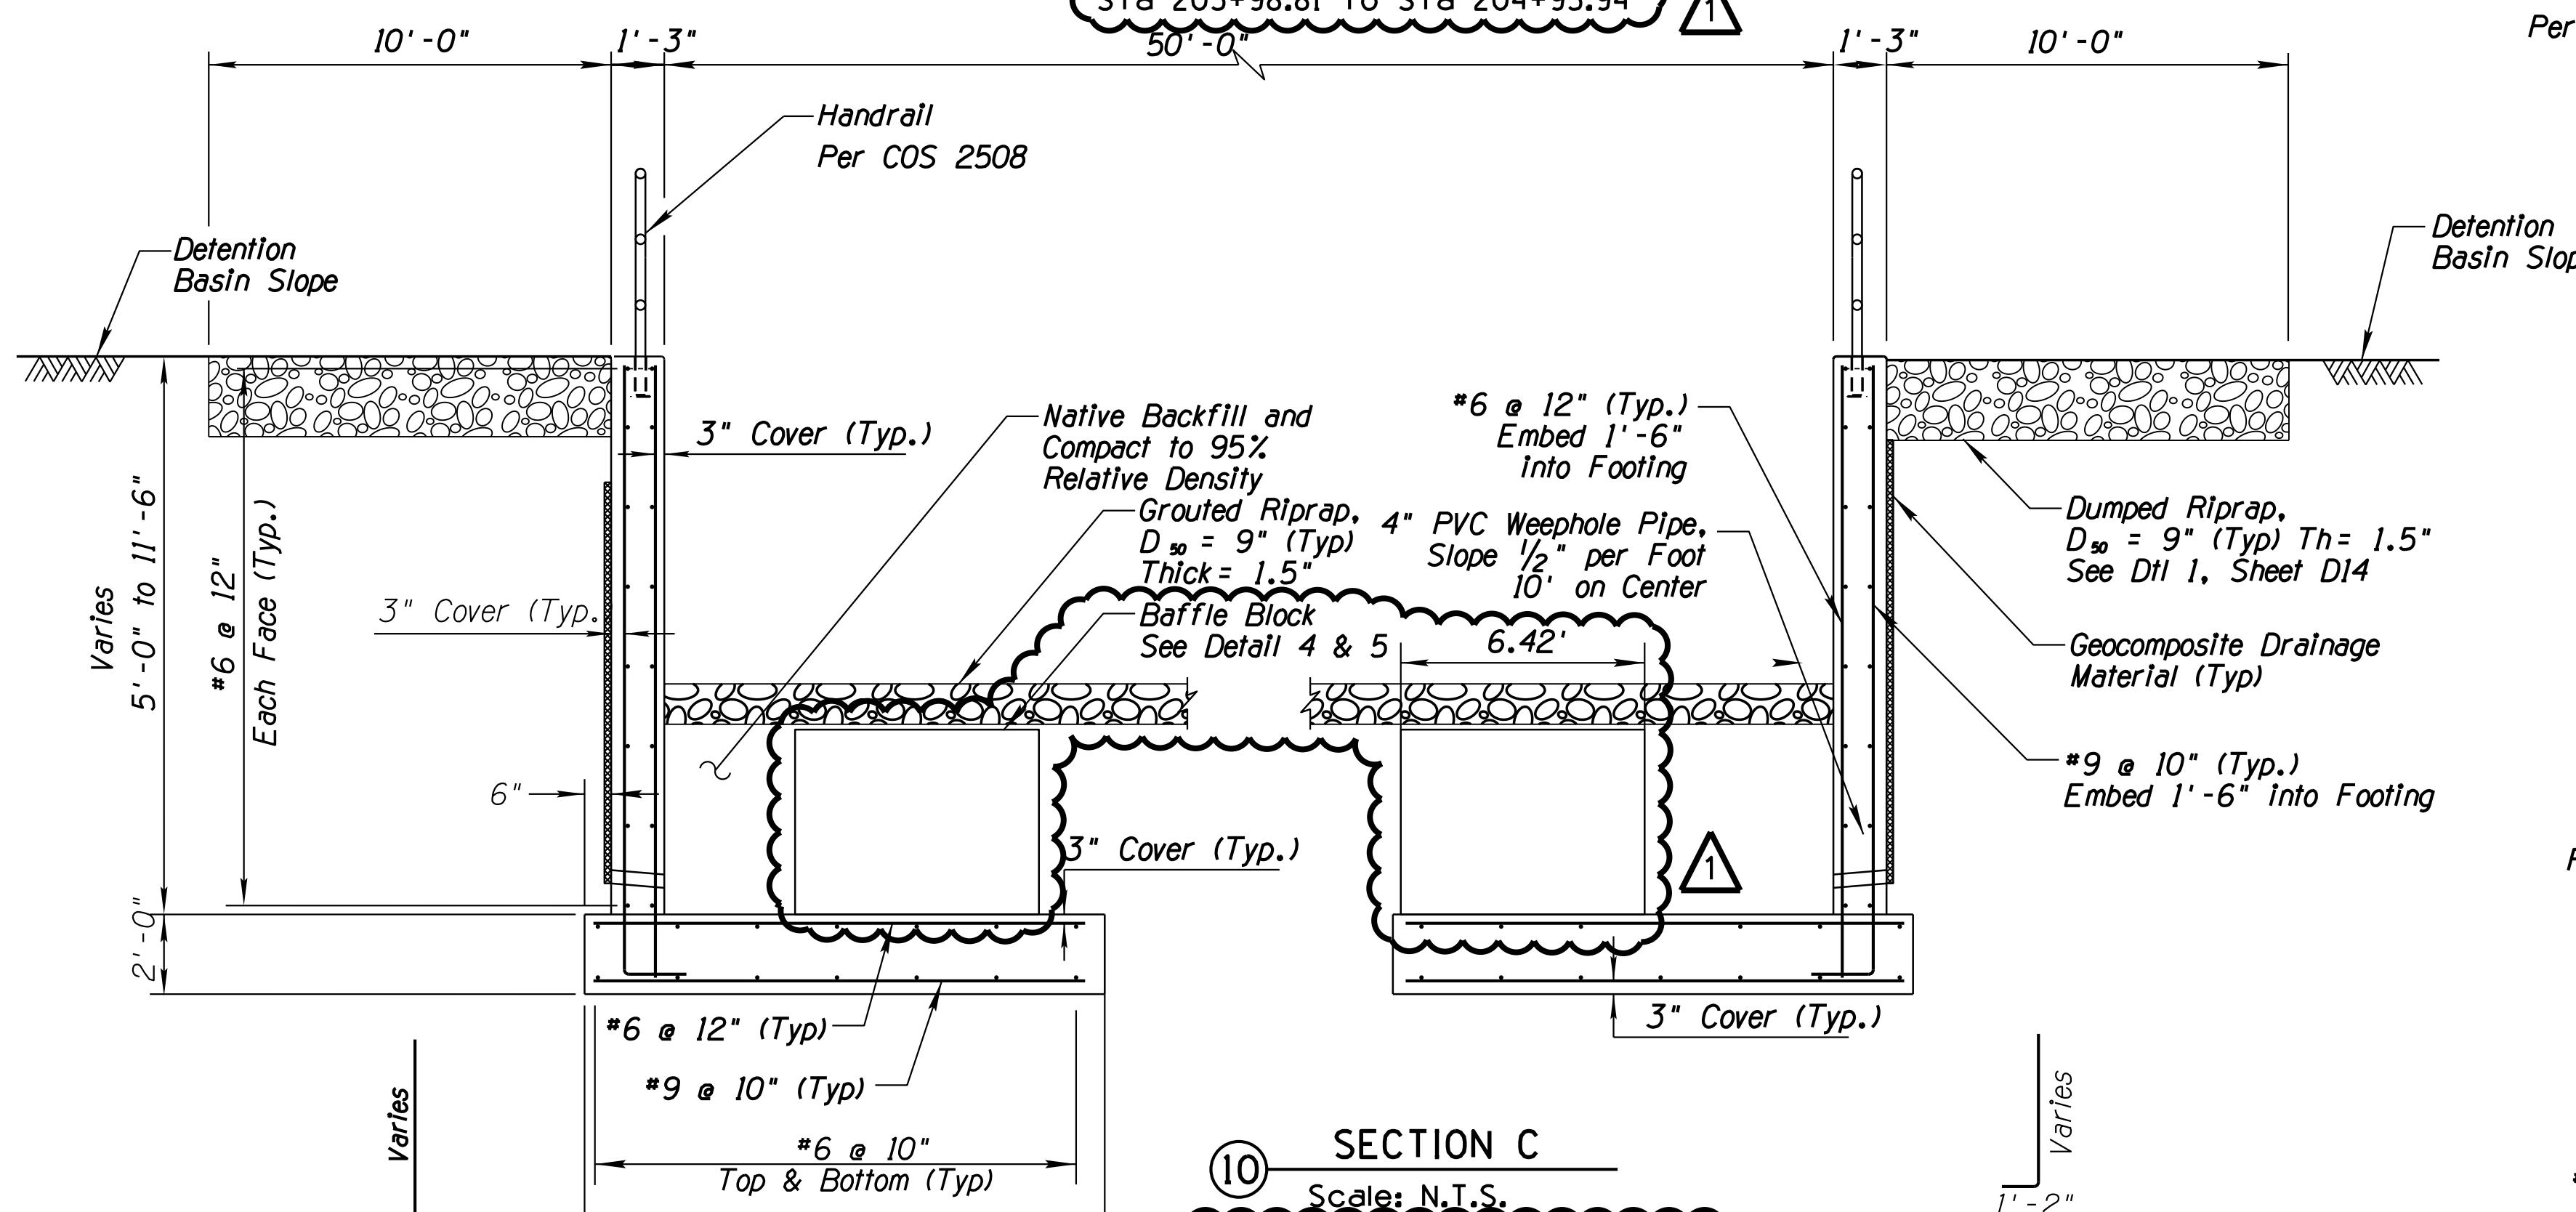


10 SECTION C
Scale: N.T.S.
Sta 201+98.50 to Sta 202+32.00

NO BAFFLE BLOCKS BETWEEN
Sta 201+98.50 to Sta 202+18.50

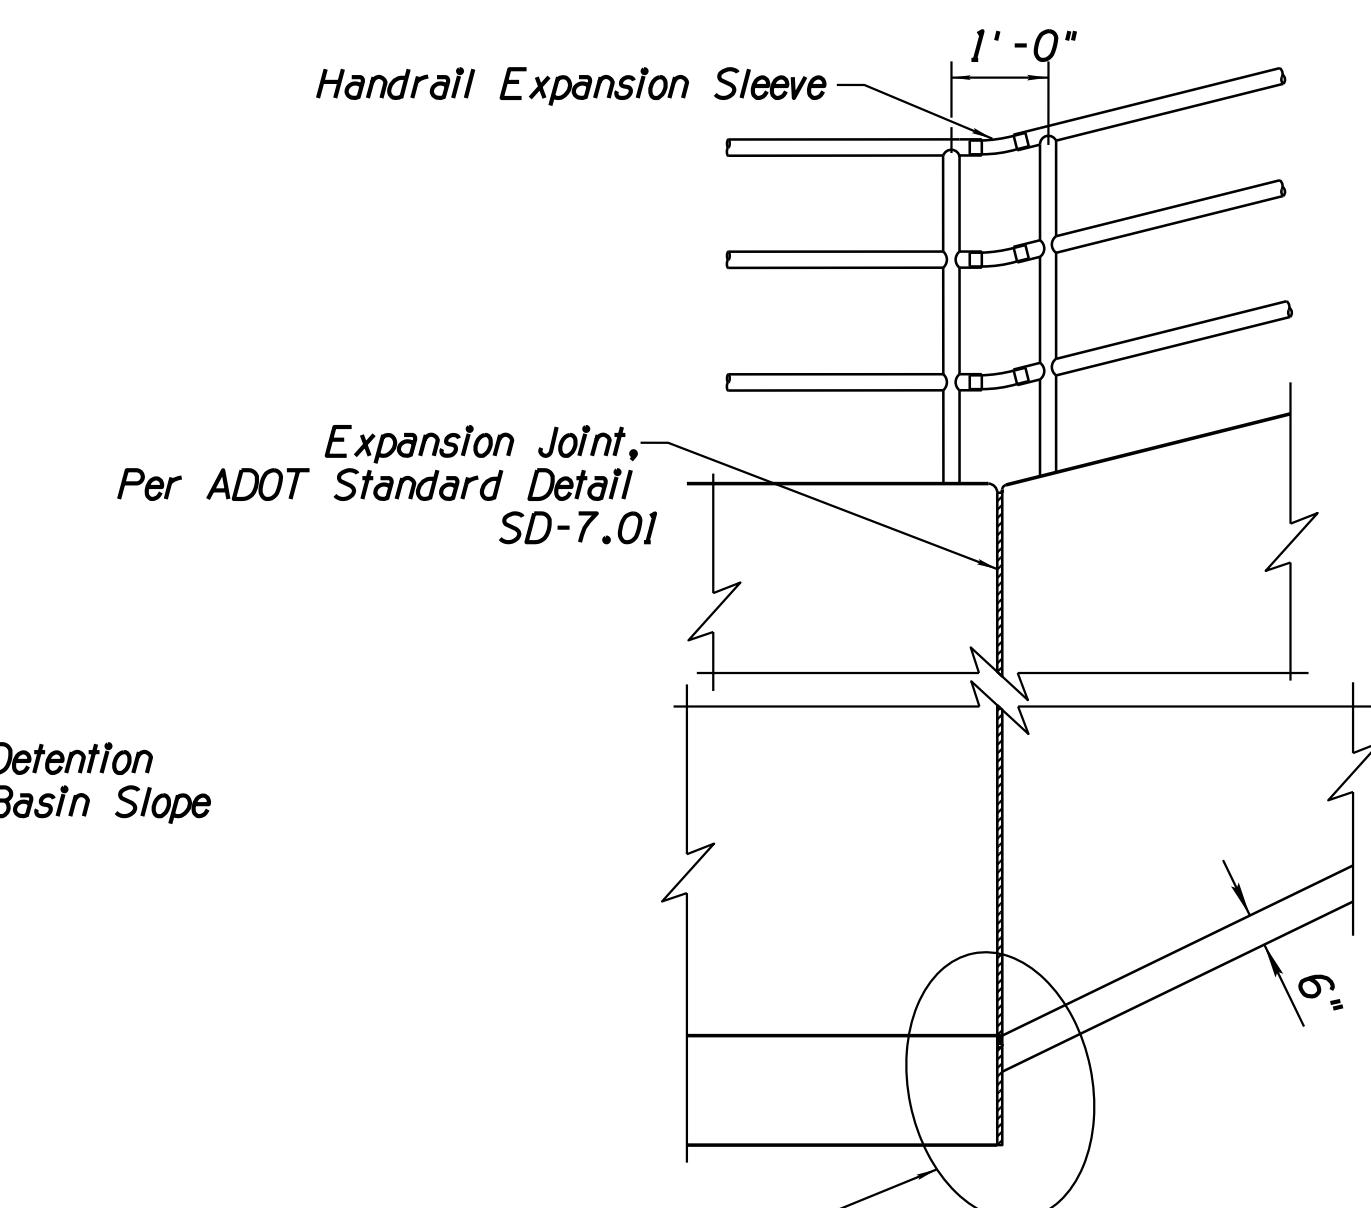

12 SECTION D
Scale: N.T.S.

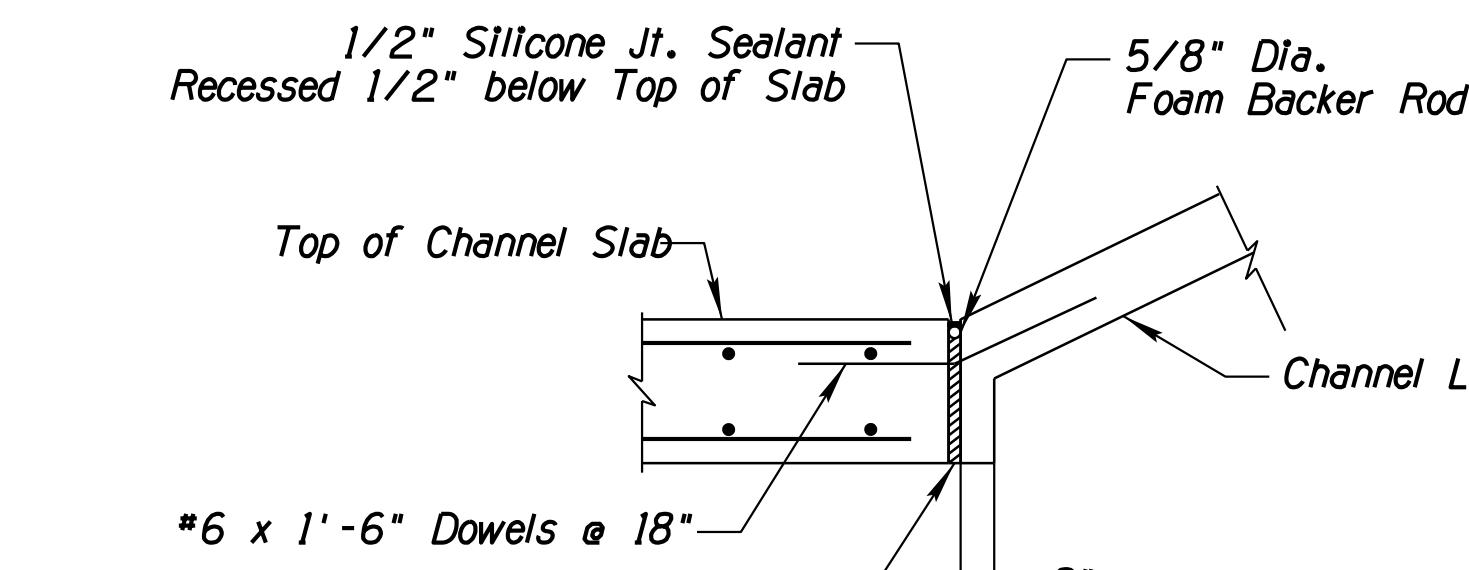

13 SLAB TO CHANNEL JOINT DETAIL
Scale: N.T.S.

DATE: 3/13/20		REVISION:	CITY COMMENTS		BY: A.S.N.
PROJECT TITLE: CROSSROADS EAST DRAINAGE INFRASTRUCTURE		PUBLIC WORKS		CITY OF SCOTTSDALE, ARIZONA	
SCALE: HORIZ. N/A	DESIGNED BY: A.C.	DATE: 07/19	BID NO.: XXXX	SH. D11	
VERT. N/A	DRAWN BY: WDF	AS-BUILT XX/XX	PROJECT NO.: 400-FB53B-56047	30 of 38	




12:13:52 PM

PLOT DATE: 3/13/2020


DETAILS.dwg

DESIGN FILE: W:\P-JO\169678-Crossroads.East\CAD\Sheet F1as\Drainage\169678-D12_RETAINING WALL STEPS.DWG

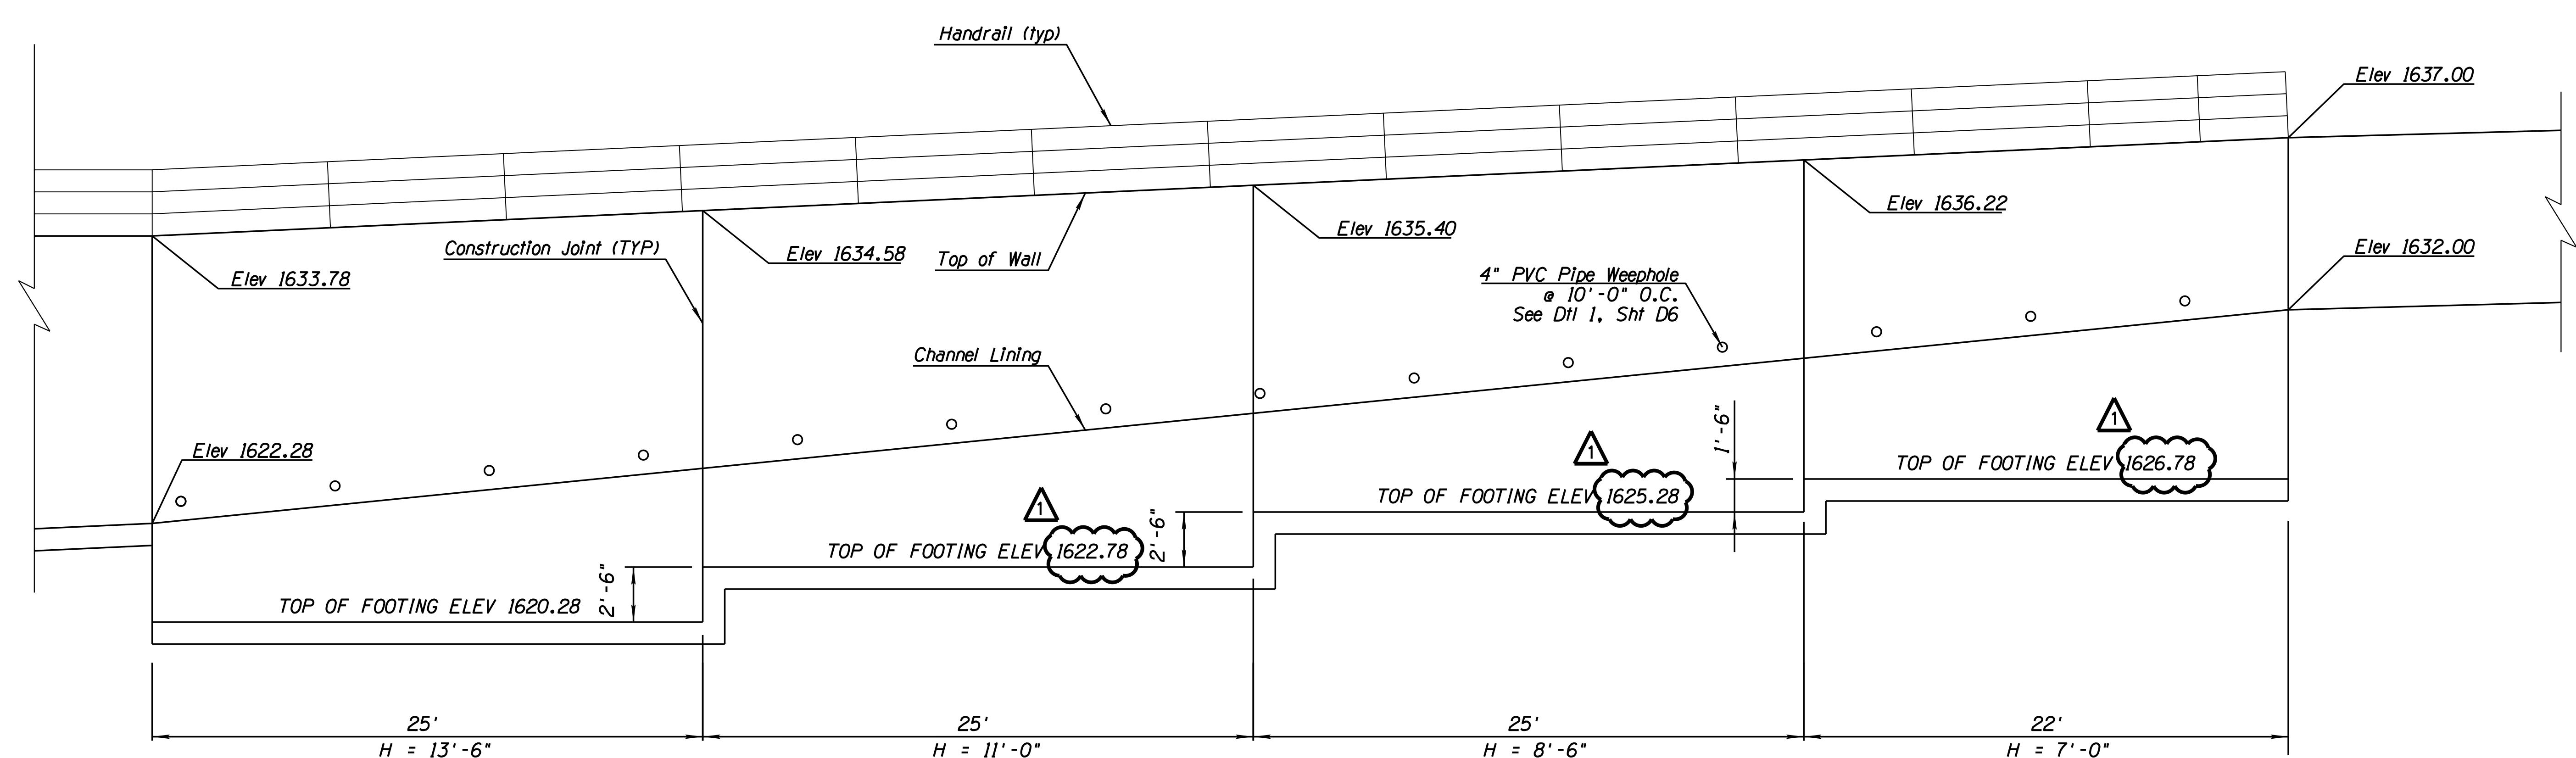


Construction Notes:

1. Concrete Shall Have $f'_c = 4000$ psi.
2. Reinforcing Steel shall conform to ASTM Specification A615. All reinforcing shall be furnished as Grade 60.
3. All bends and hooks shall meet the requirements of ACI Chapter 25. All bend dimensions for reinforcing steel shall be out-to-out bars. All placement dimensions for reinforcing steel shall be to center of bars unless noted otherwise.
4. Chamfer all exposed corners 3/4" unless noted otherwise.
5. Compact backfill for footing and wall base minimum 95 percent of ASTM D698 maximum dry density.
6. Fill PVC Pipe With Nonshrink Grout Complying with Section 1017 of ADOT Standard Specifications.
7. Overexcavate a Min of 1' Below Footing and Compact to 95% Relative Density.
8. Reinforcing Steel shall be placed with the center of the outside layer of bars 3" from the surface of the concrete.

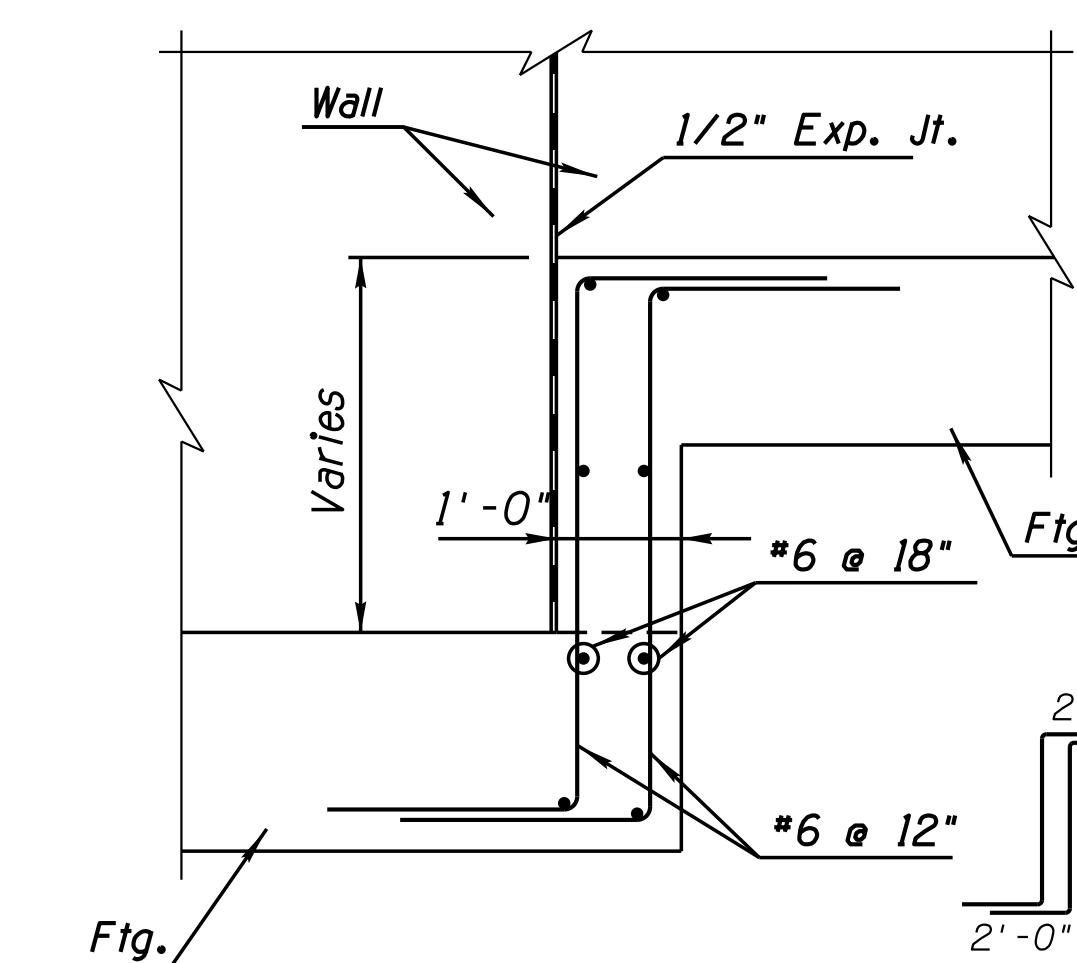

Footing Step Detail

Scale: N.T.S.

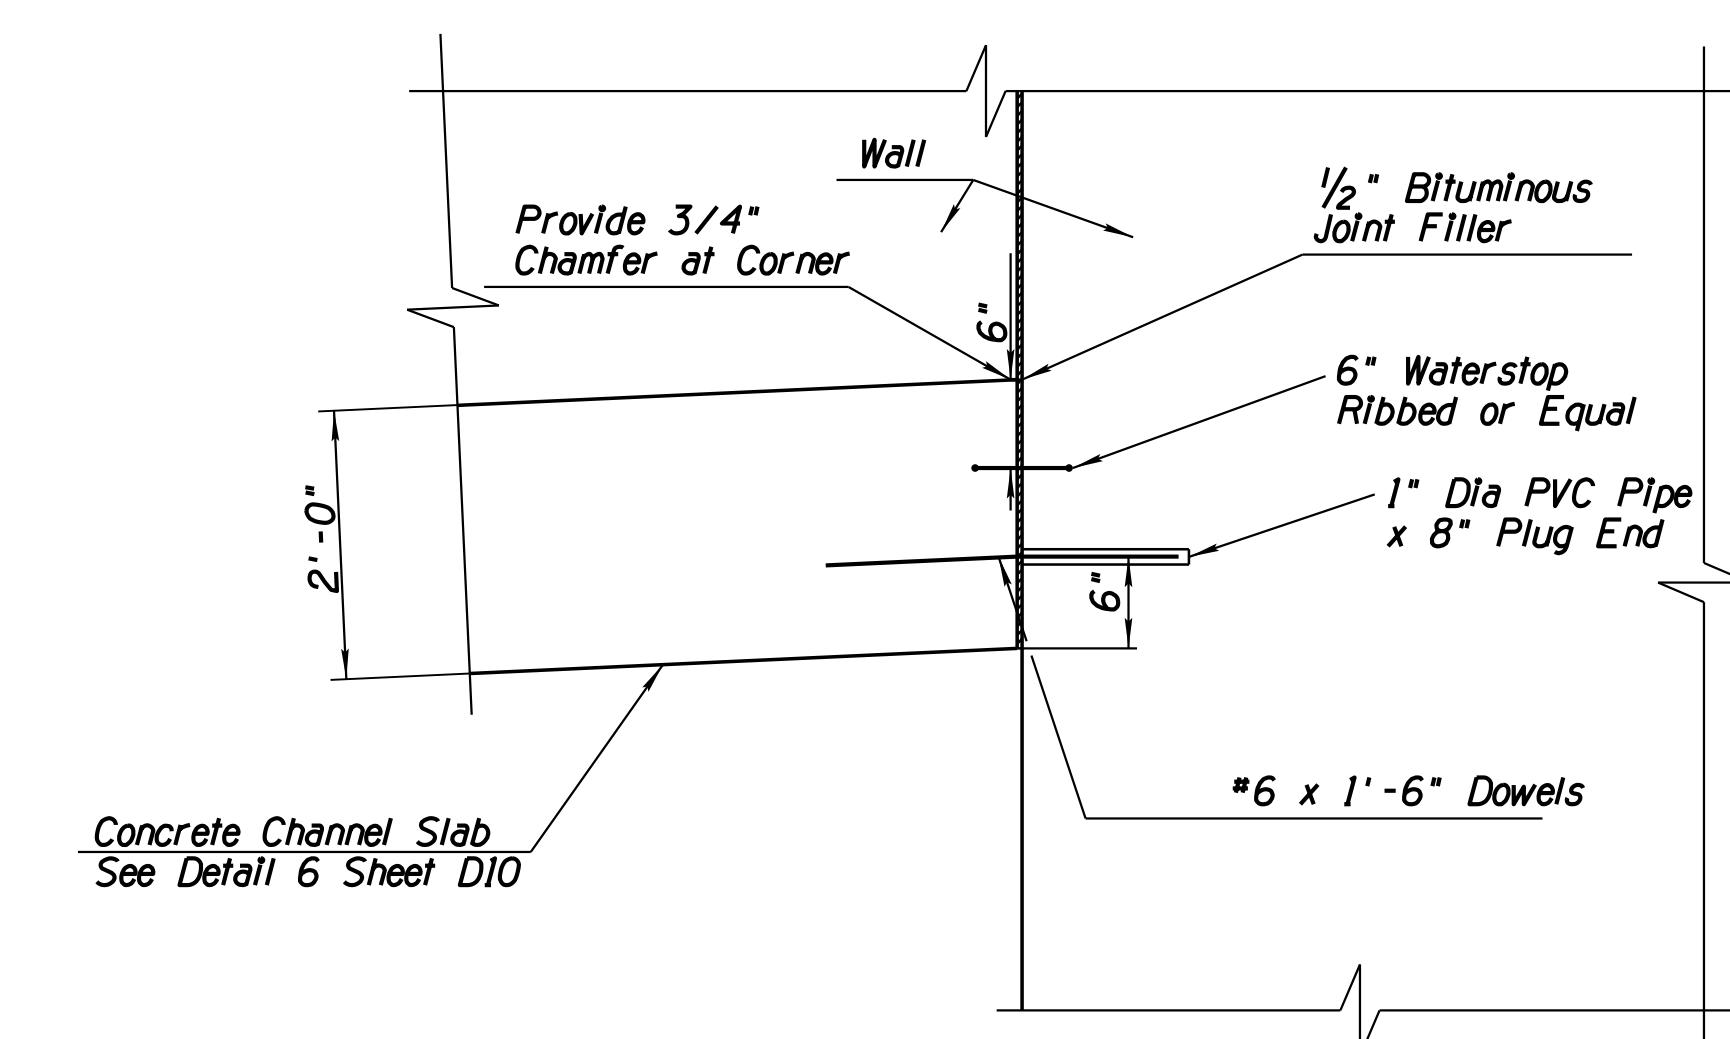

Channel Bottom to Channel Wall Joint Detail

Scale: N.T.S.




DATE: 3/13/20		REVISION:	CITY COMMENTS		BY: A.S.N.
PROJECT NUMBER:		ENGINEERED BY:		PUBLIC WORKS	
SHEET NUMBER:		CERTIFICATE NUMBER:		CAPITAL PROJECT MANAGEMENT	
PROJECT TITLE:		OWNER:		7447 E. INDIAN SCHOOL RD., SCOTTSDALE, ARIZONA 85251	
SHEET NUMBER:		DATE:		EXPIRATION DATE:	
RETAINING WALL FOOTING DETAIL		03/13/20		06/30/2022	
CROSSROADS EAST DRAINAGE INFRASTRUCTURE		DESIGNED BY:		CITY COMMENTS	
SCALE: HORIZ. N/A VERT. N/A	DESIGNED BY: AC DRAWN BY: JJP	DATE: 07/19 AS-BUILT: XX/XX	BID NO.: XXX	SHT. D12	PROJECT NO.: 400-FB53B-56047 31 of 38

7:12:21 AM

PLOT DATE: 3/13/2020

DESIGN FILE: W:\P_OJ\169678_Crossroads_East\CAD\Sheet Files\CAD\Access_Ramp.dwg

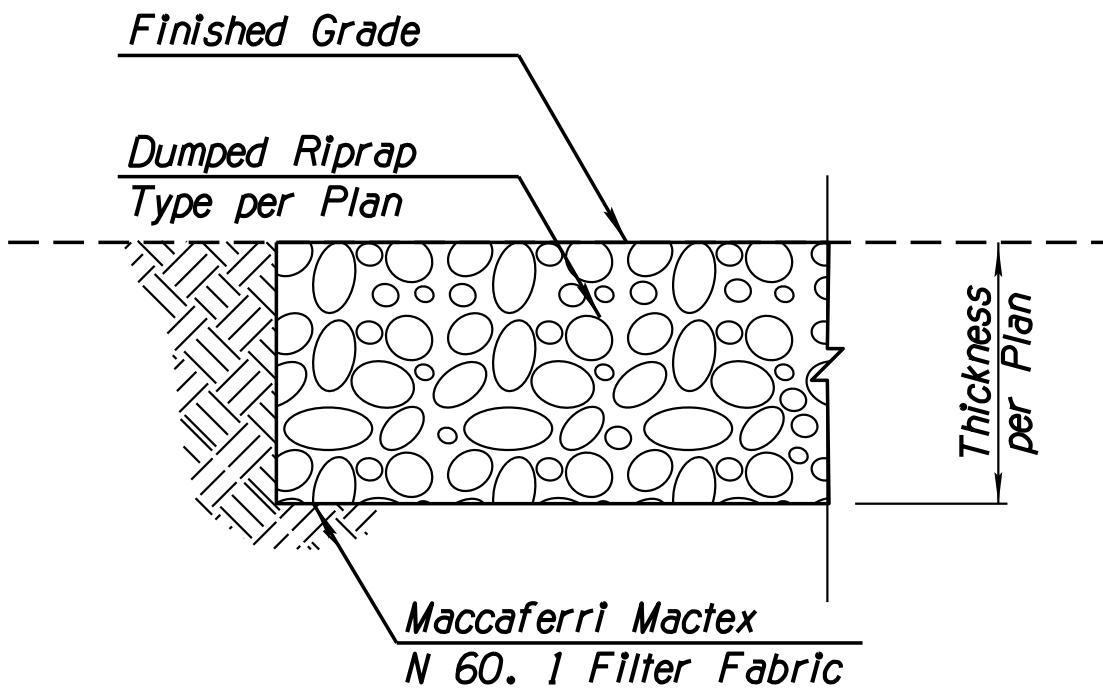


Note: Riprap to be Angular Stone

RIPRAP STONE SIZE			
STONE SIZE	TYPE I	TYPE II	TYPE III
D MINIMUM	2"	4"	4"
D50	6"	9"	12"
D100 (MAXIMUM)	12"	18"	24"

The Minimum Thickness of Riprap Linings Shall be the Greater of D100 or 1.5 Times D50. Install Loose Riprap per M.A.G. Spec. 220. Install "Maccaferri Mactex N 60.1" Filter Fabric or Approved Equal Under All Loose Riprap.

① RIPRAP DETAIL

See Sht D6, Dtl 1
for Typical Channel
Details & Reinforcing

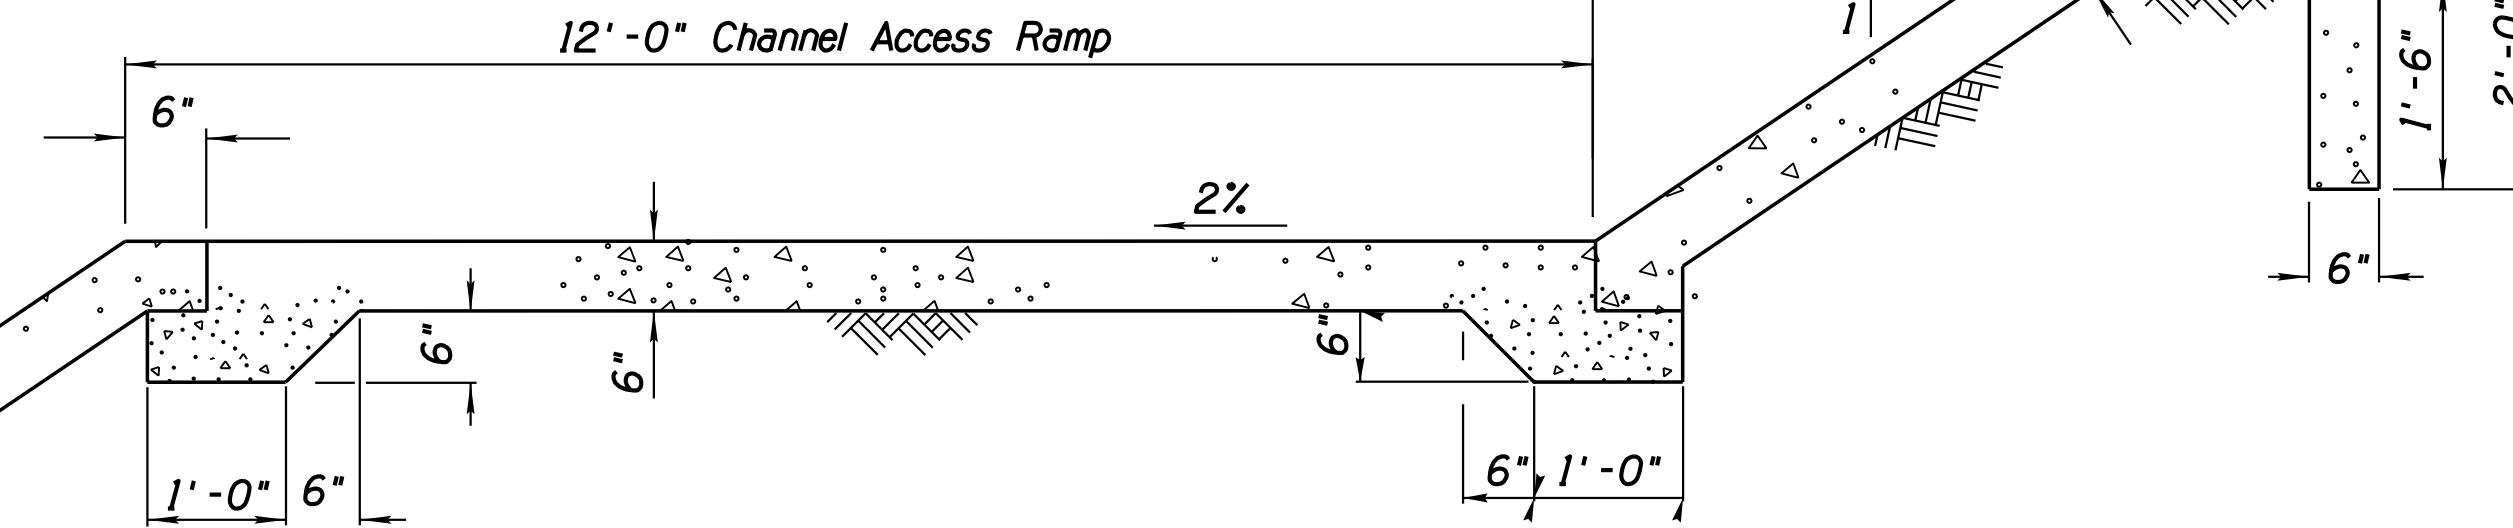

② CONCRETE MAINTENANCE RAMP TYPICAL SECTION
N.T.S.




DATE:		REVISION:	BY:	
ENGINEER		PUBLIC WORKS		
 64462 ANDREW CHILL Date Signed 7-10-19 Expires 3/31/21		 CITY OF SCOTTSDALE ARIZONA 7447 E. INDIAN SCHOOL RD. SCOTTSDALE, ARIZONA 85251		
CAPITAL PROJECT MANAGEMENT				
SHEET TITLE CHANNEL ACCESS RAMP DETAIL				
PROJECT TITLE CROSSROADS EAST DRAINAGE INFRASTRUCTURE				
SCALE HORIZ. N/A VERT. N/A	DESIGNED AC DRAWN JJP	DATE 07/19 AS-BUILT XX/XX	BID NO. XXX	SHL. D13 PROJECT NO. 400-FB53B-56047
32 of 38				

PLOT DATE: 3/13/2020

DESIGN FILE: W:\P\POJ\169678-Crossroads.East\CAD\Sheet Files\CAD\169678-D14-BARRIER WIRE.dwg

7:04:51 AM

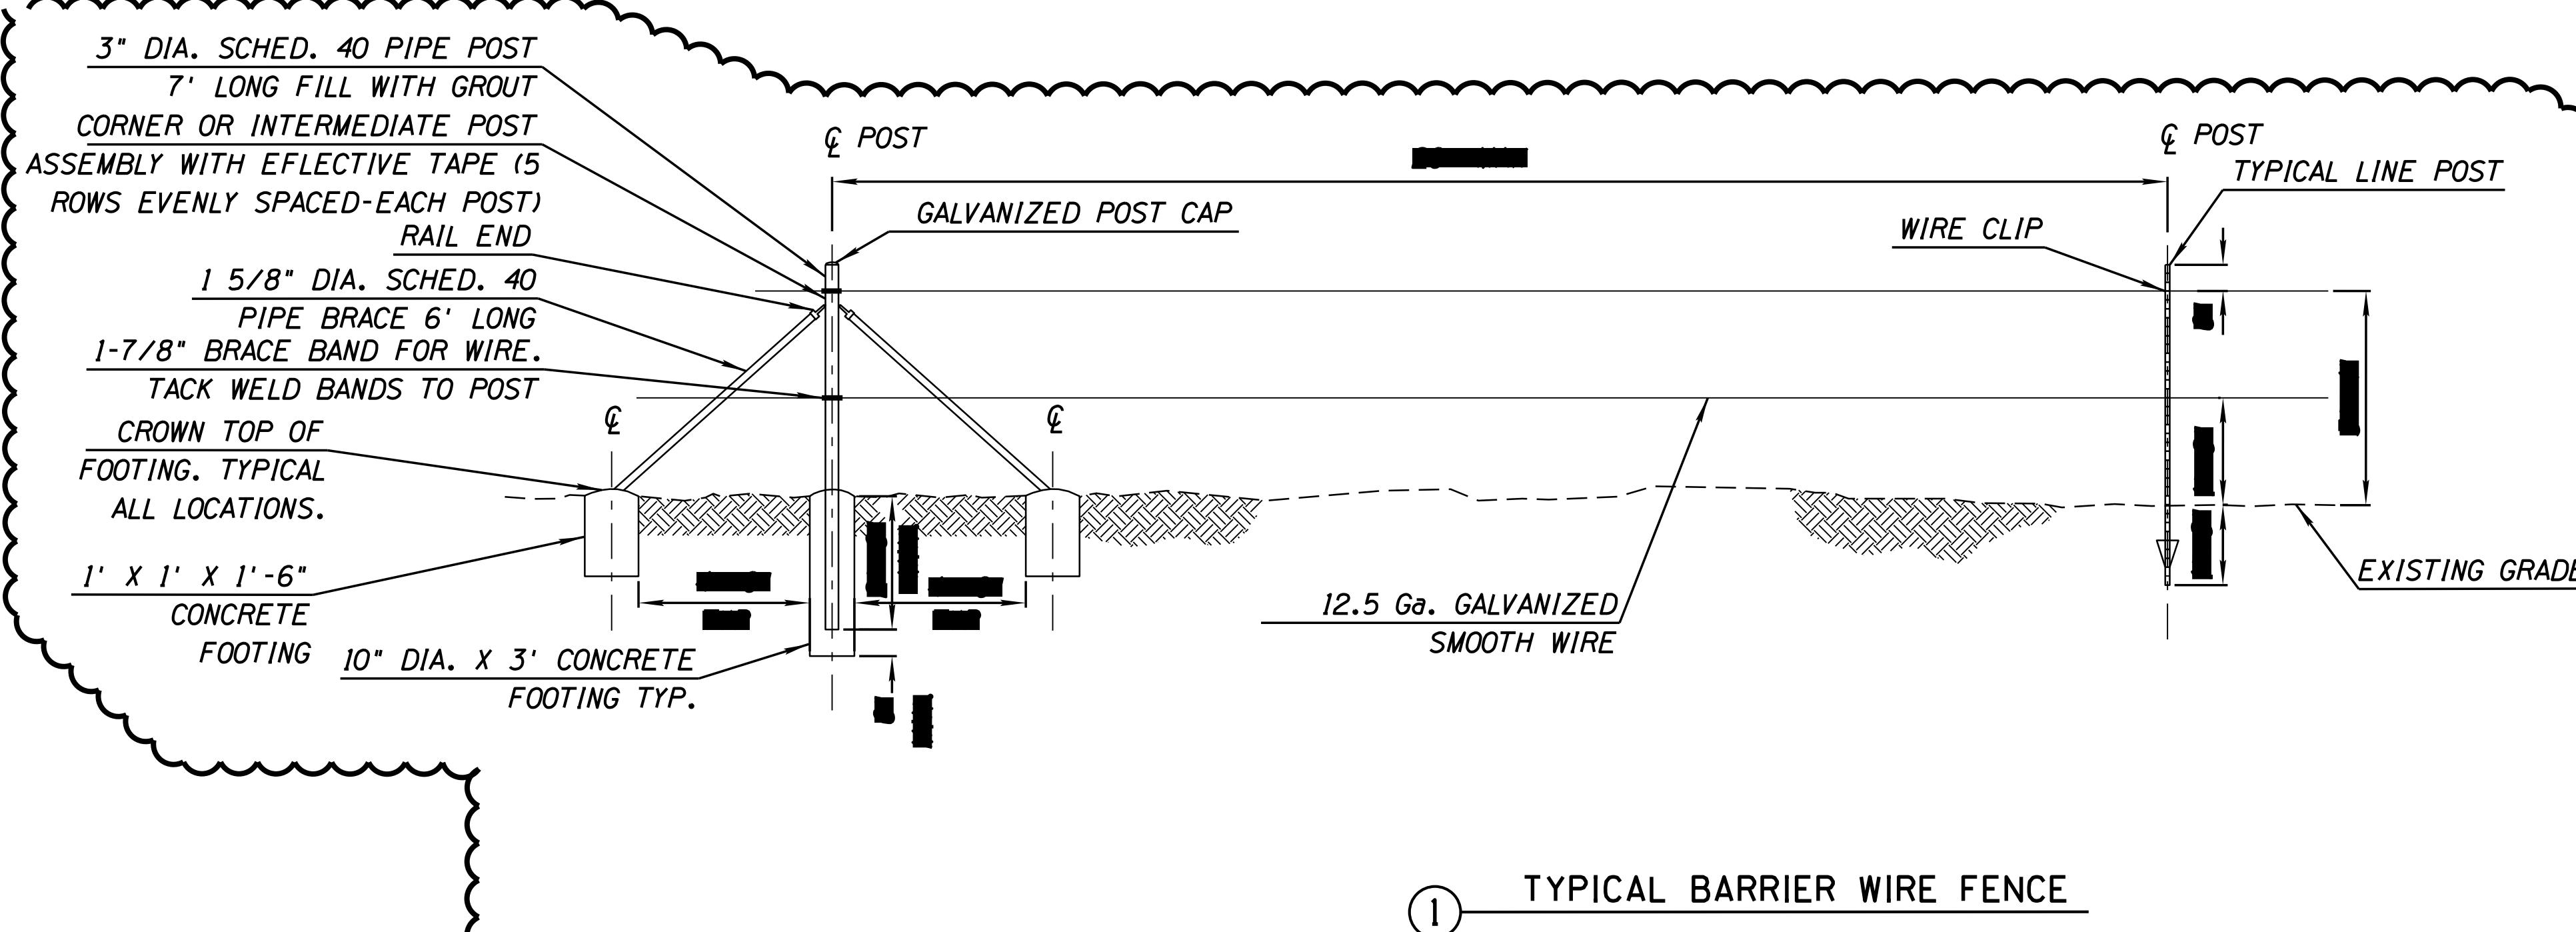


① TYPICAL BARRIER WIRE FENCE

NOTES

ALL WELDED JOINTS SHALL BE COATED WITH ZINC DUST-ZINC OXIDE COATING CONFORMING TO AASHTO M-36 PER MAG 771.4 UNLESS OTHERWISE SPECIFIED. GALVANIZED SURFACES THAT ARE FIELD OR SHOP CUT, BROKEN, BURNED OR ABRADED, THUS BREAKING THE GALVANIZING, SHALL BE REPAIRED AT ALL LOCATIONS WITH ZINC DUST-ZINC OXIDE COATING CONFORMING TO AASHTO M-36 TO THE SATISFACTION OF THE PROJECT ENGINEER.

WIRE NOTES

- PUT SLIGHT SLOPE ON ALL FOOTINTS, USE 1-2-3 CONCRETE MIX.
- WIRE SHALL BE ON OUTSIDE OF POSTS, EXCEPT ON CURVES WHERE WIRE SHALL BE ON OUTSIDE OF CURVE.
- FASTEN WIRE TO LINE POSTS WITH WIRE CLIPS.
- FASTEN WIRE TO CORNER OR INTERMEDIATE POSTS WITH BRACE BANDS WHERE WIRE ENDS AT POST.
- INTERMEDIATE POST ASSEMBLIES SHALL BE LOCATED AT INTERVALS NOT TO EXCEED 650 FEET AND AT ALL ANGLE POINTS EXCEEDING 15 DEGREES.

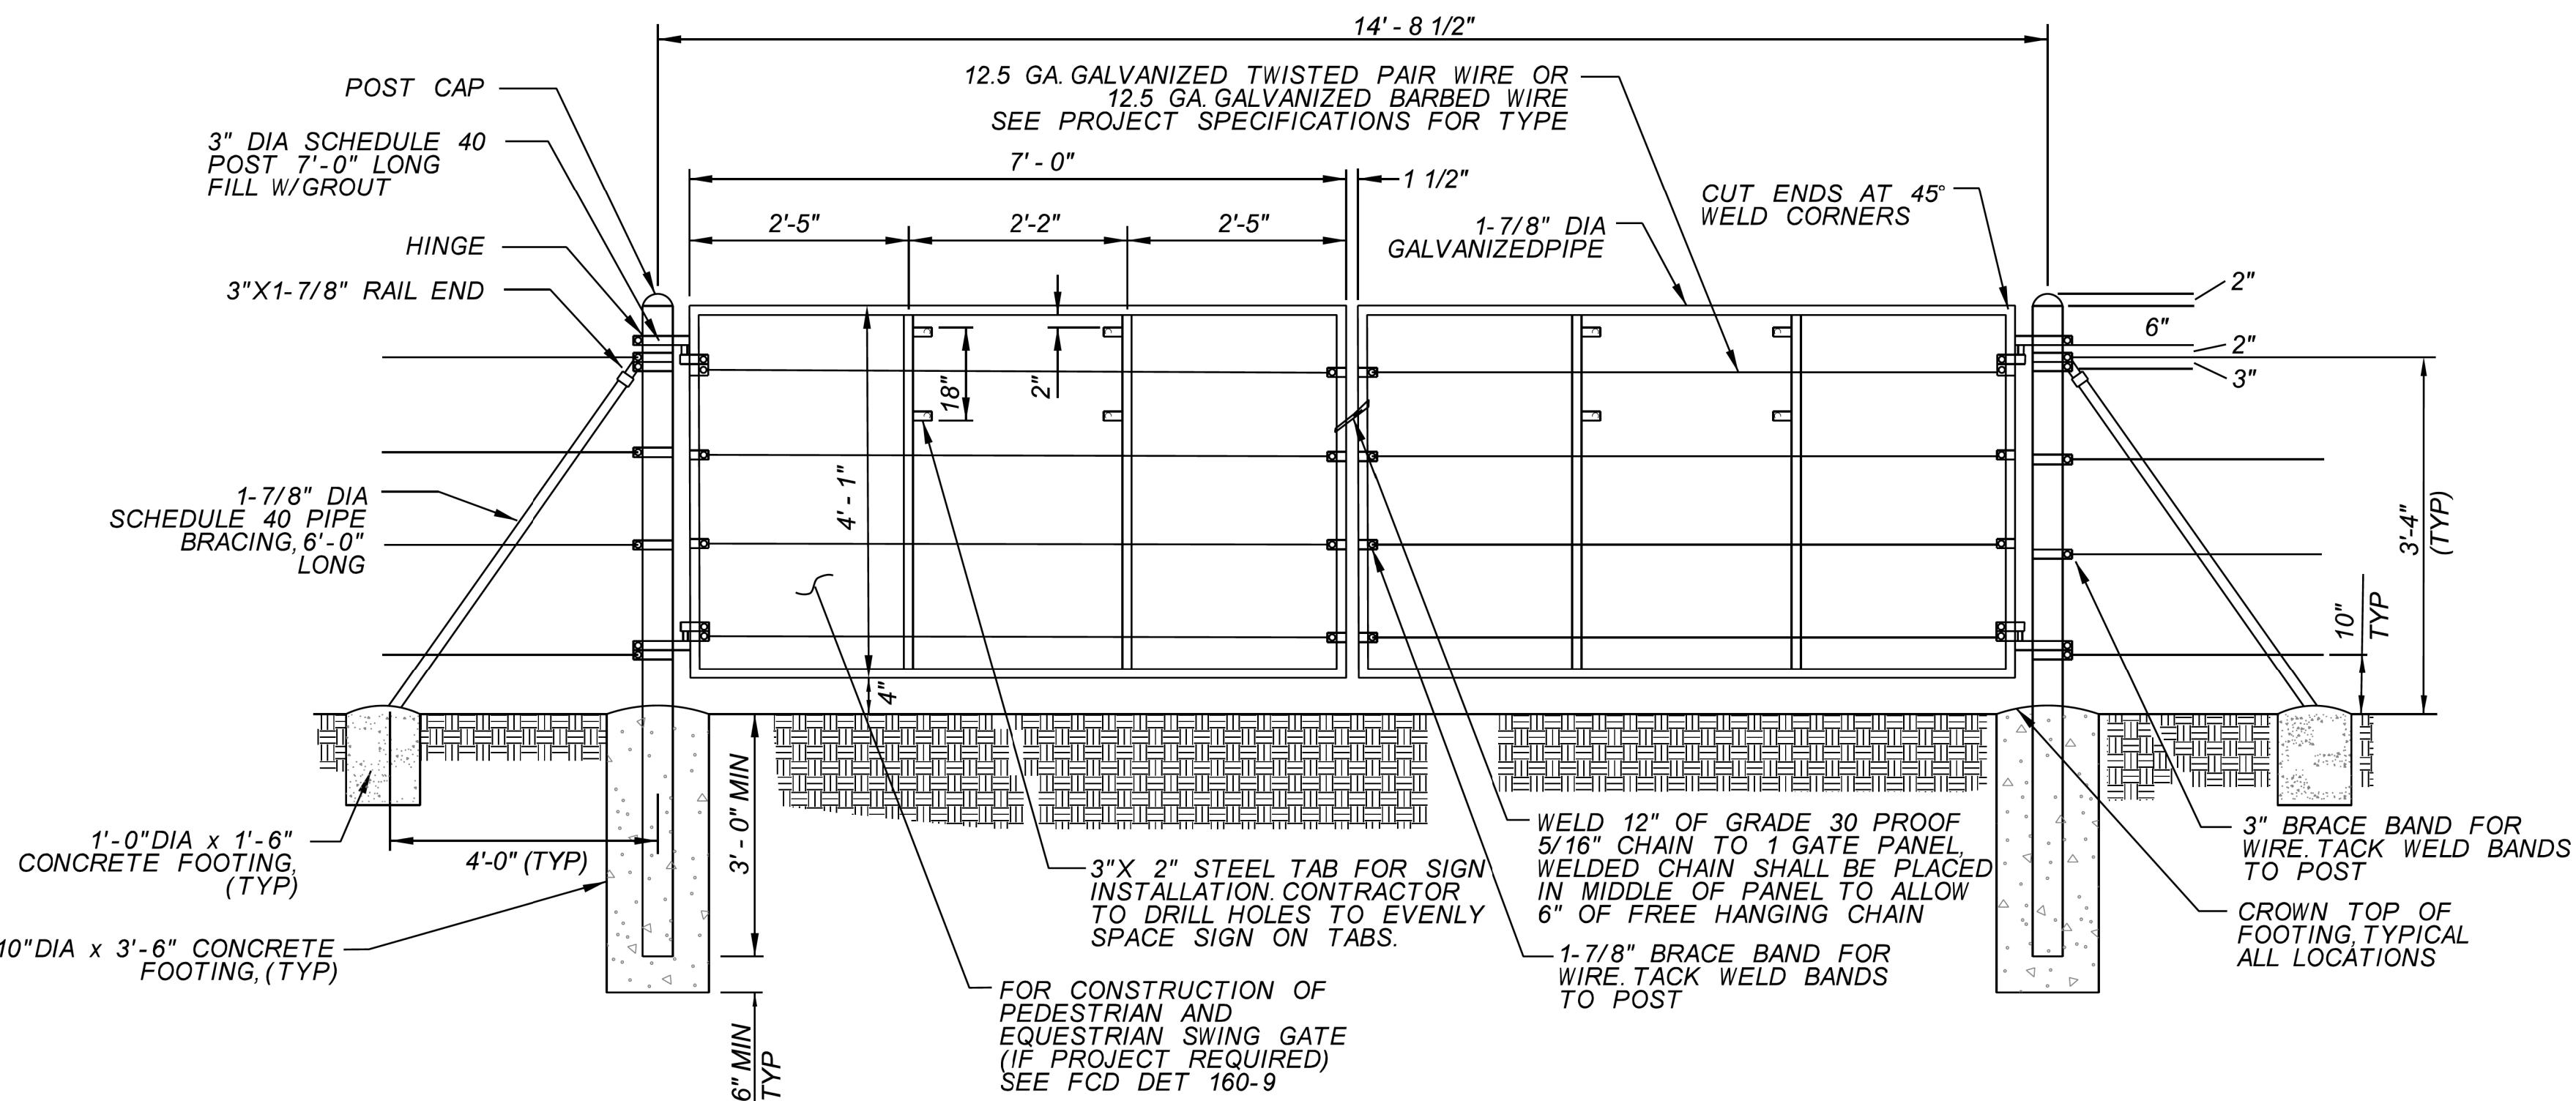

NOTES

- ALL BOLTS, BRACE BANDS AND HINGES SHALL BE WELDED TO POSTS AND/ OR GATE PANELS
- ALL WELDED JOINTS SHALL BE COATED WITH ZINC DUST-ZINC OXIDE COATING CONFORMING TO AASHTO M-36 PER MAG 771.4 UNLESS OTHERWISE SPECIFIED. GALVANIZED SURFACES THAT ARE FIELD OR SHOP CUT, BROKEN, BURNED OR ABRADED, THUS BREAKING THE GALVANIZING, SHALL BE REPAIRED AT ALL LOCATIONS WITH ZINC DUST-ZINC OXIDE COATING CONFORMING TO AASHTO M-36 TO THE SATISFACTION OF THE PROJECT ENGINEER. ALL WIRE SHALL CONFORM TO ADOT SPEC. SECTION 903-2.04 STANDARD FENCING WIRE.

MATERIAL LIST

QTY.	ITEM
2	84" HORIZONTAL POSTS WITH 45° ANGLE CUTS (BOTH ENDS)
2	4'-1" VERTICAL POST OUTER FRAME WITH 45° ANGLE CUTS (BOTH ENDS)
2	3'-9 1/4" INNER VERTICLE POSTS (NOTCH EACH END TO FIT)
4	2"X3"X3/16" STEEL MOUNTING TABS (FOR SIGN ATTACHMENT) HOLES TO BE DRILLED IN FIELD
5	12.5 GA. TWISTED PAIR WIRE OR 12.5 GA. BARBED WIRE

② TYPICAL BARRIER WIRE FENCE





DATE: 3/13/20	REVISION:	CITY COMMENTS	BY: A.S.N.
ENGINEER: [Signature]		PUBLIC WORKS	
PROJECT TITLE: CROSSROADS EAST DRAINAGE INFRASTRUCTURE		CAPITAL PROJECT MANAGEMENT	
SCALE: HORIZ. 1"-100' VERT. N/A	DESIGNED BY: AC DRAWN BY: JJP	DATE: 07/19 AS-BUILT XX/XX	BID NO. XXXX SH. D14 PROJECT NO. 400-FB53B-56047 33 of 38
SHEET TITLE: BARRIER WIRE FENCE DETAIL			


7:05:57 AM

PLOT DATE: 3/13/2020


DESIGN FILE: W:\P\OJ\169678-Crossroads.East\CAD\Sheet.F1\ss\Drainage\169678-D15_TRASH_RACK_DETAIL.dwg

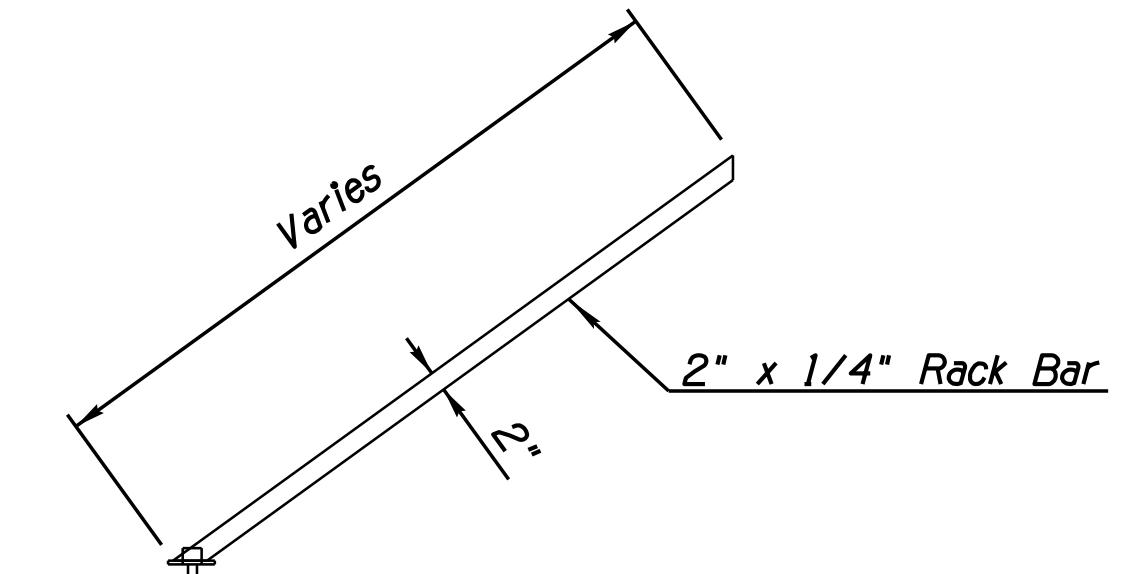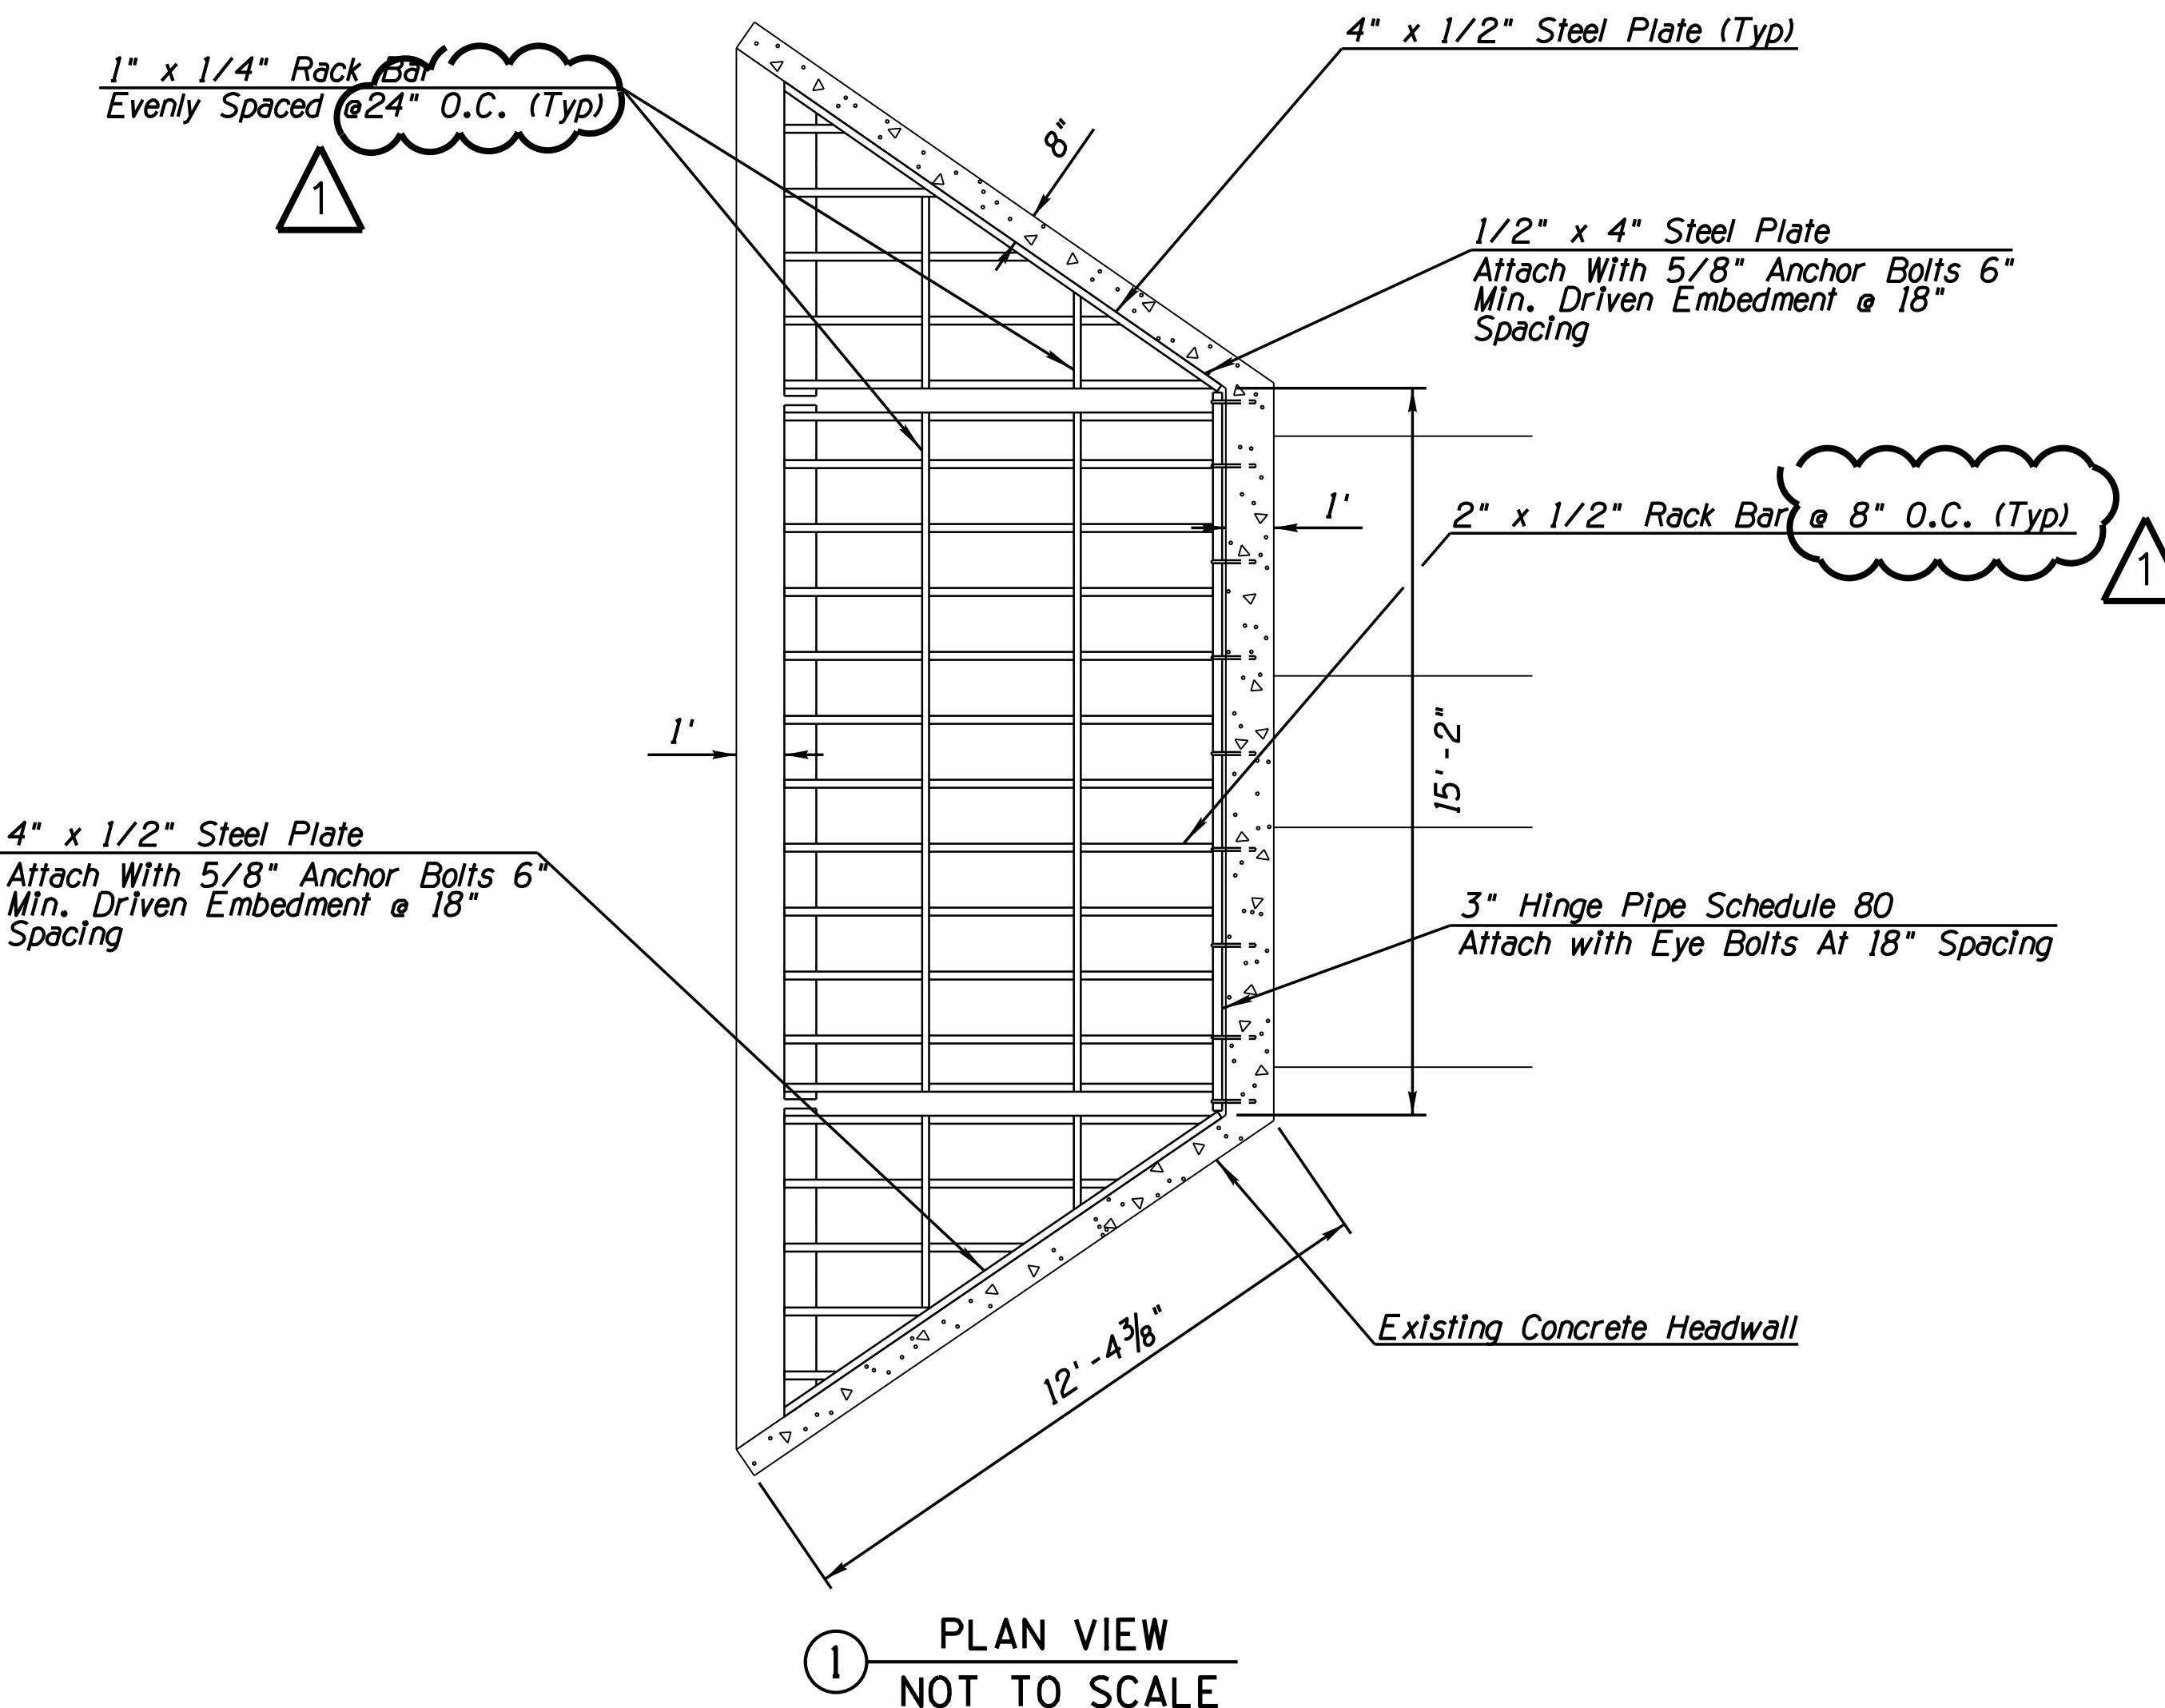


④ RACK BARS
NOT TO SCALE

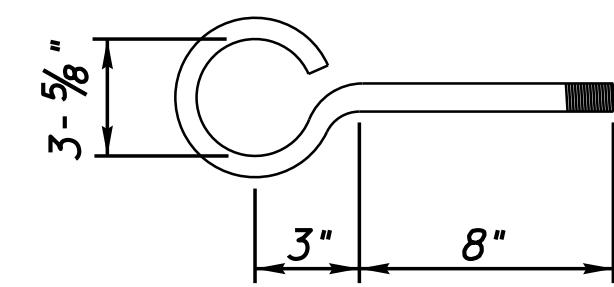


⑤ EYE BOLT
NOT TO SCALE

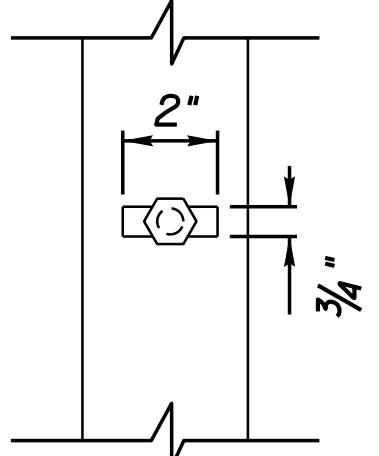

⑥ ANCHOR BOLT SLOT
STEEL BASE PLATE
NOT TO SCALE

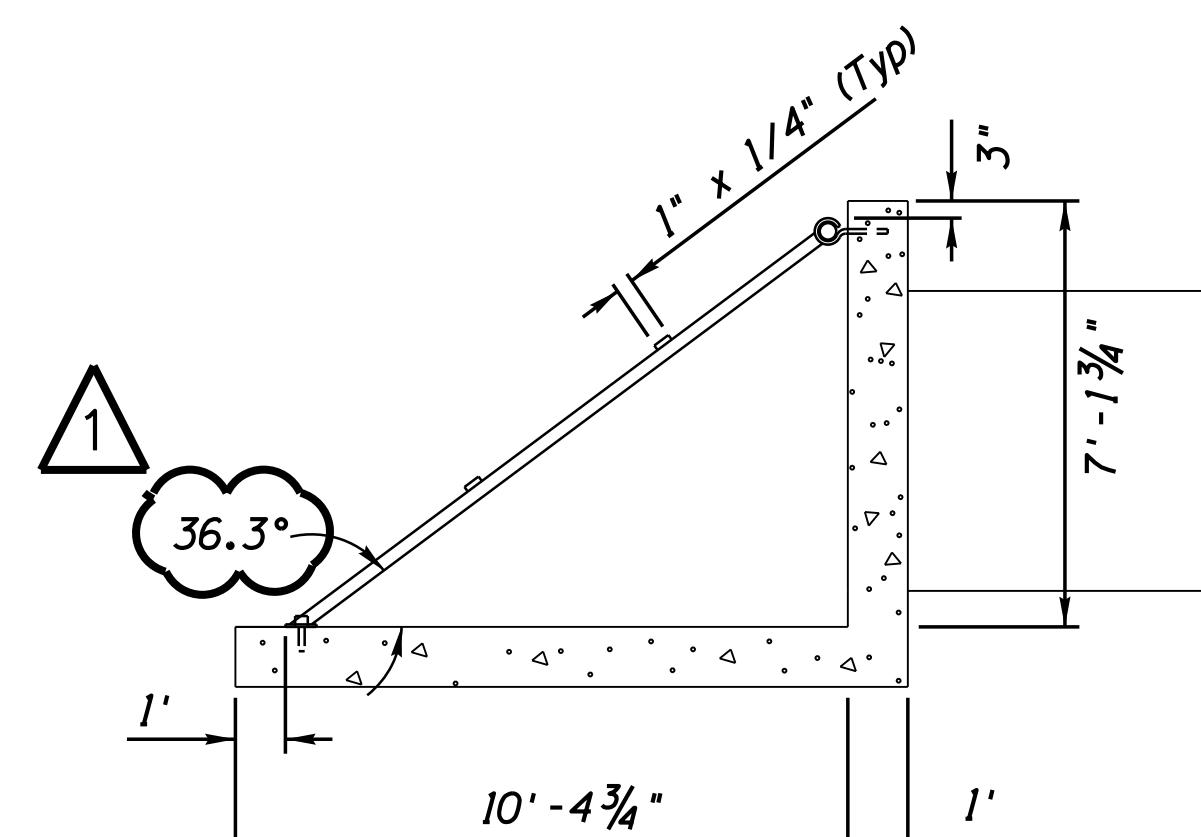

② SECTION VIEW
NOT TO SCALE

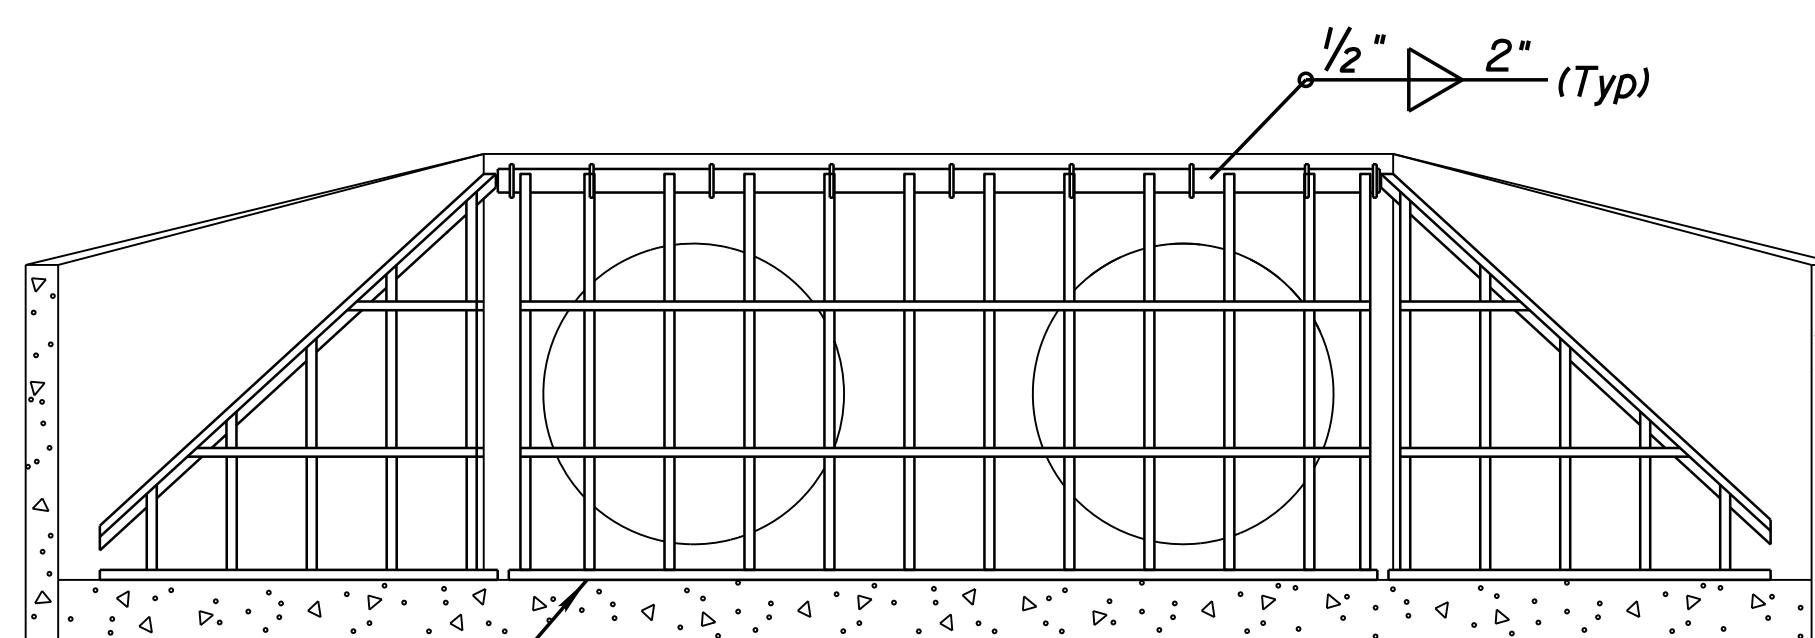

4" x 1/2" Steel Plate
Attach With 5/8" Anchor Bolts 6"
Min. Driven Embedment @ 18" Spacing

③ ELEVATION VIEW
NOT TO SCALE




Contact Arizona 811 at least two full working days before you begin excavation
ARIZONA 811
Call 811 or click Arizona811.com

DATE: 3/13/20	REVISION:	CITY COMMENTS	BY: A.S.N.
PROJECT TITLE: CROSSROADS EAST DRAINAGE INFRASTRUCTURE			
ENGINEER: Registered Professional Engineer No. 5586 ZEEZ SALIBA Signed 3/13/20 Expires 3/31/20	PUBLIC WORKS CITY OF SCOTTSDALE 7447 E. INDIAN SCHOOL RD. SCOTTSDALE, ARIZONA 85251	CAPITAL PROJECT MANAGEMENT	
SCALE: HORIZ. N/A VERT. N/A	DESIGNED AC DRAWN AK	DATE: 07/19 AS-BUILT XX/XX	BID NO. XXXX PROJECT NO. 400-FB53B-56047 SHT. D15

PLOT DATE: 3/13/2020

DESIGN FILE: W:\P-J\169678-Crossroads-East\CAD\Sheet Files\Drainage\169678-DIG_FENCE.GEO 1 OF 2.dwg

7:05:27 AM

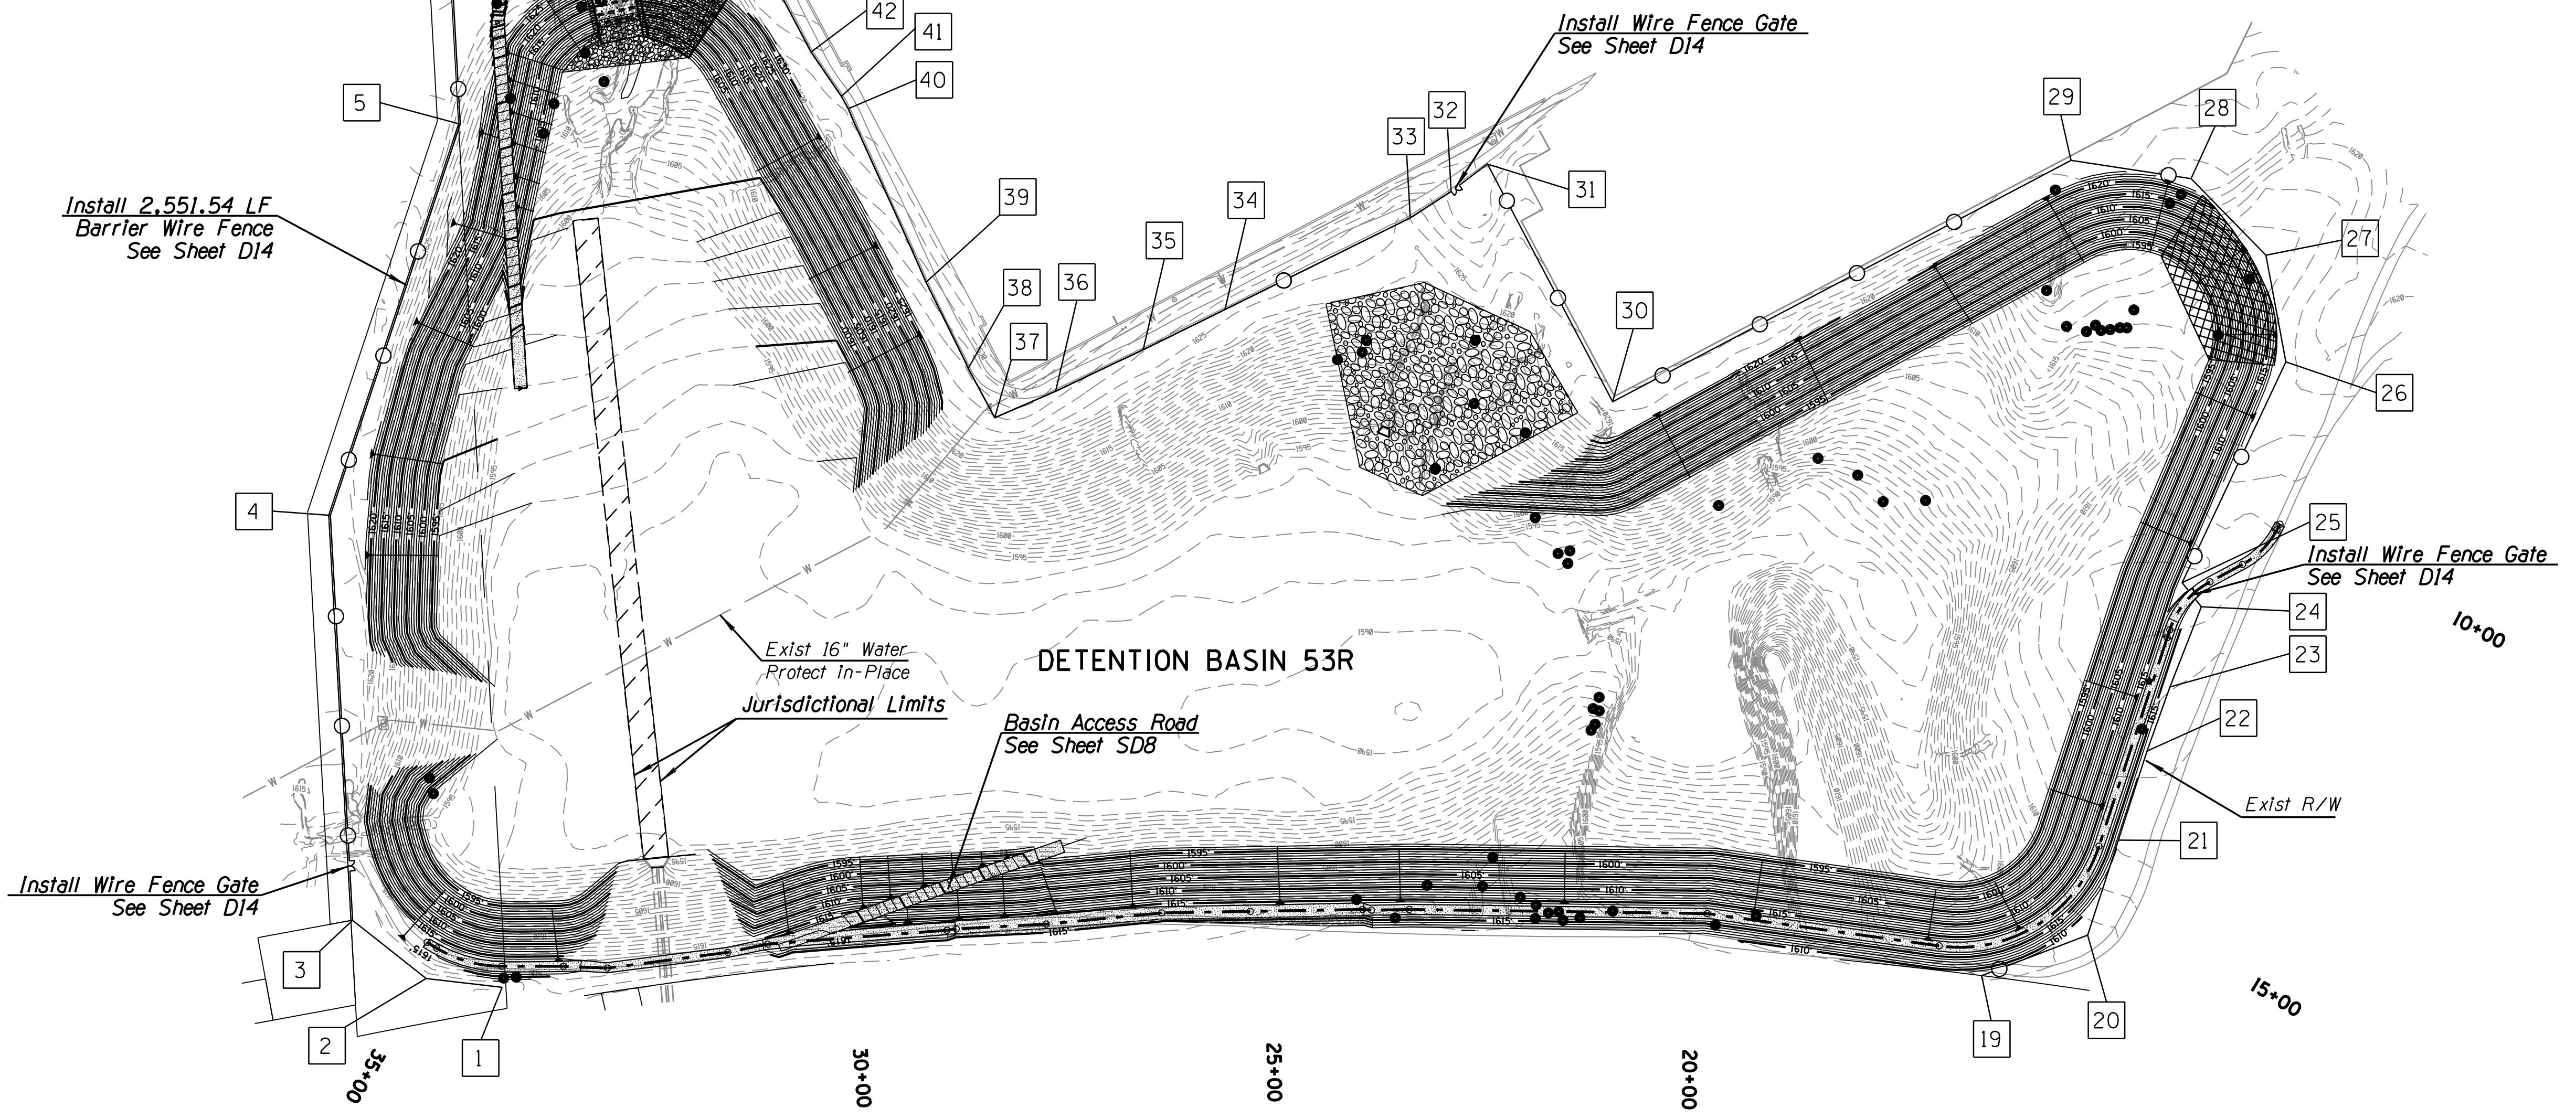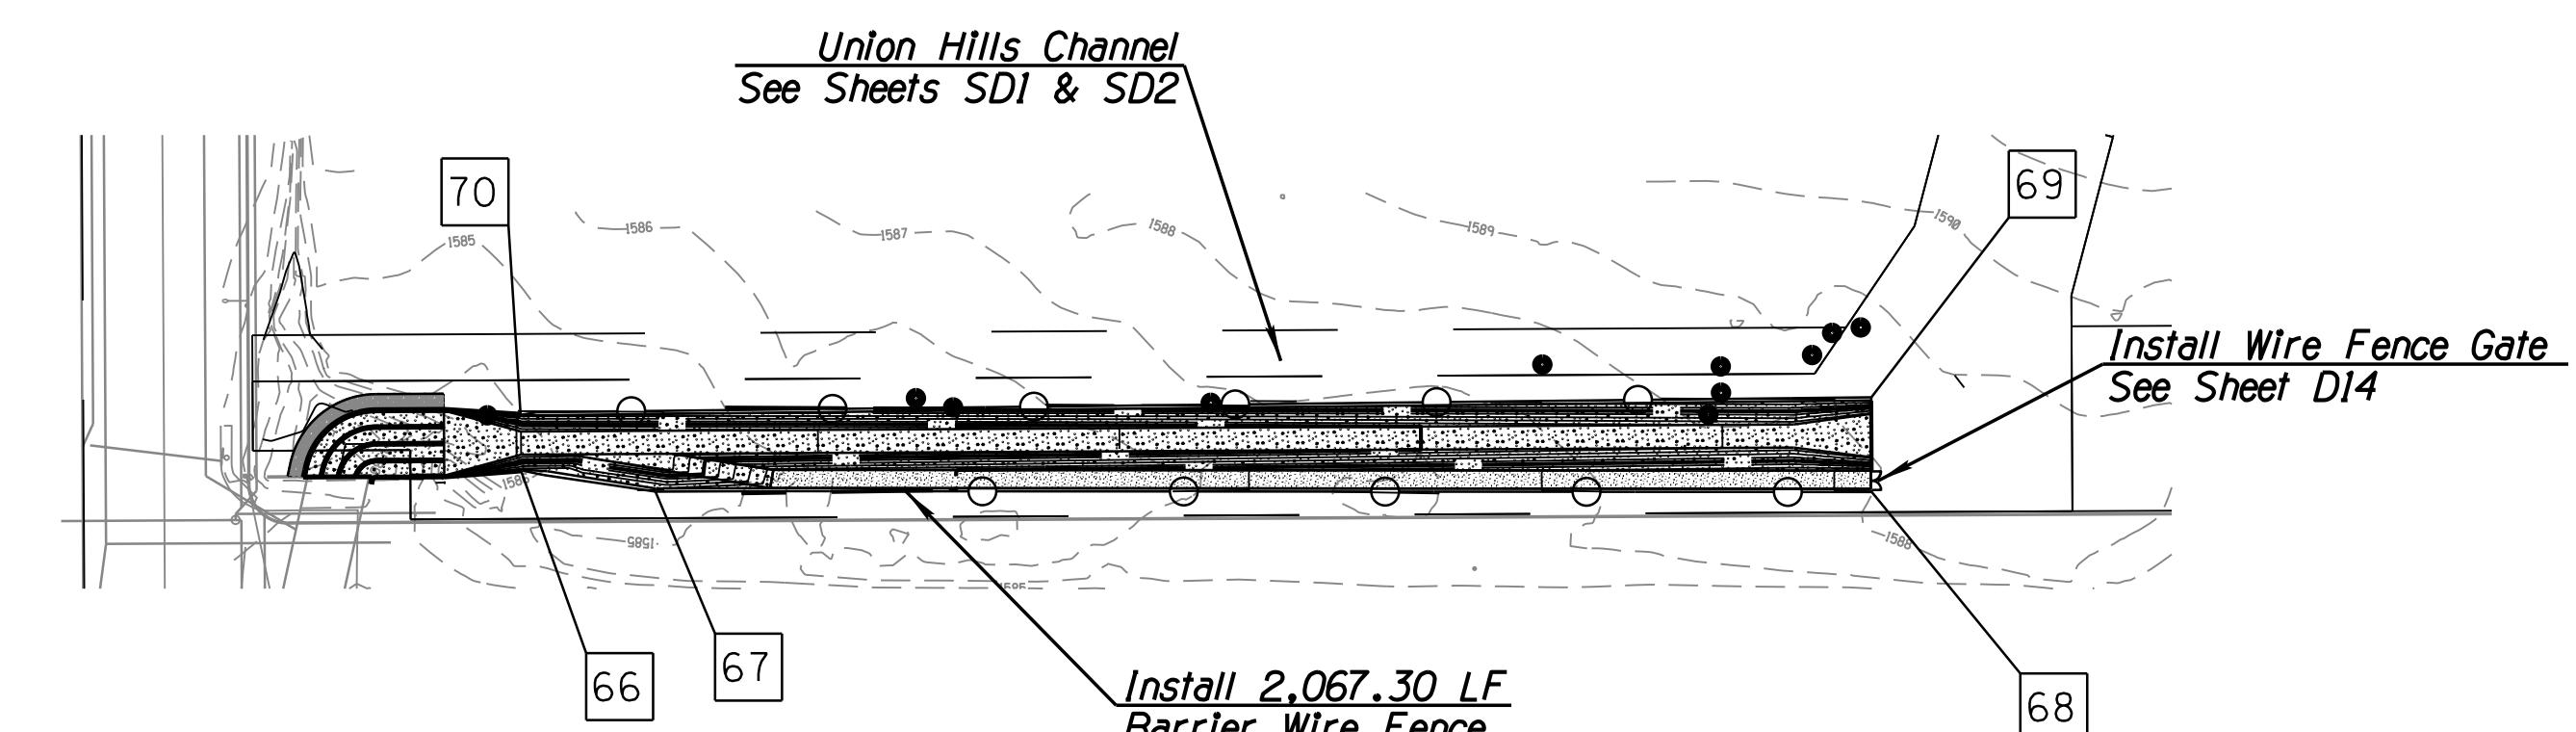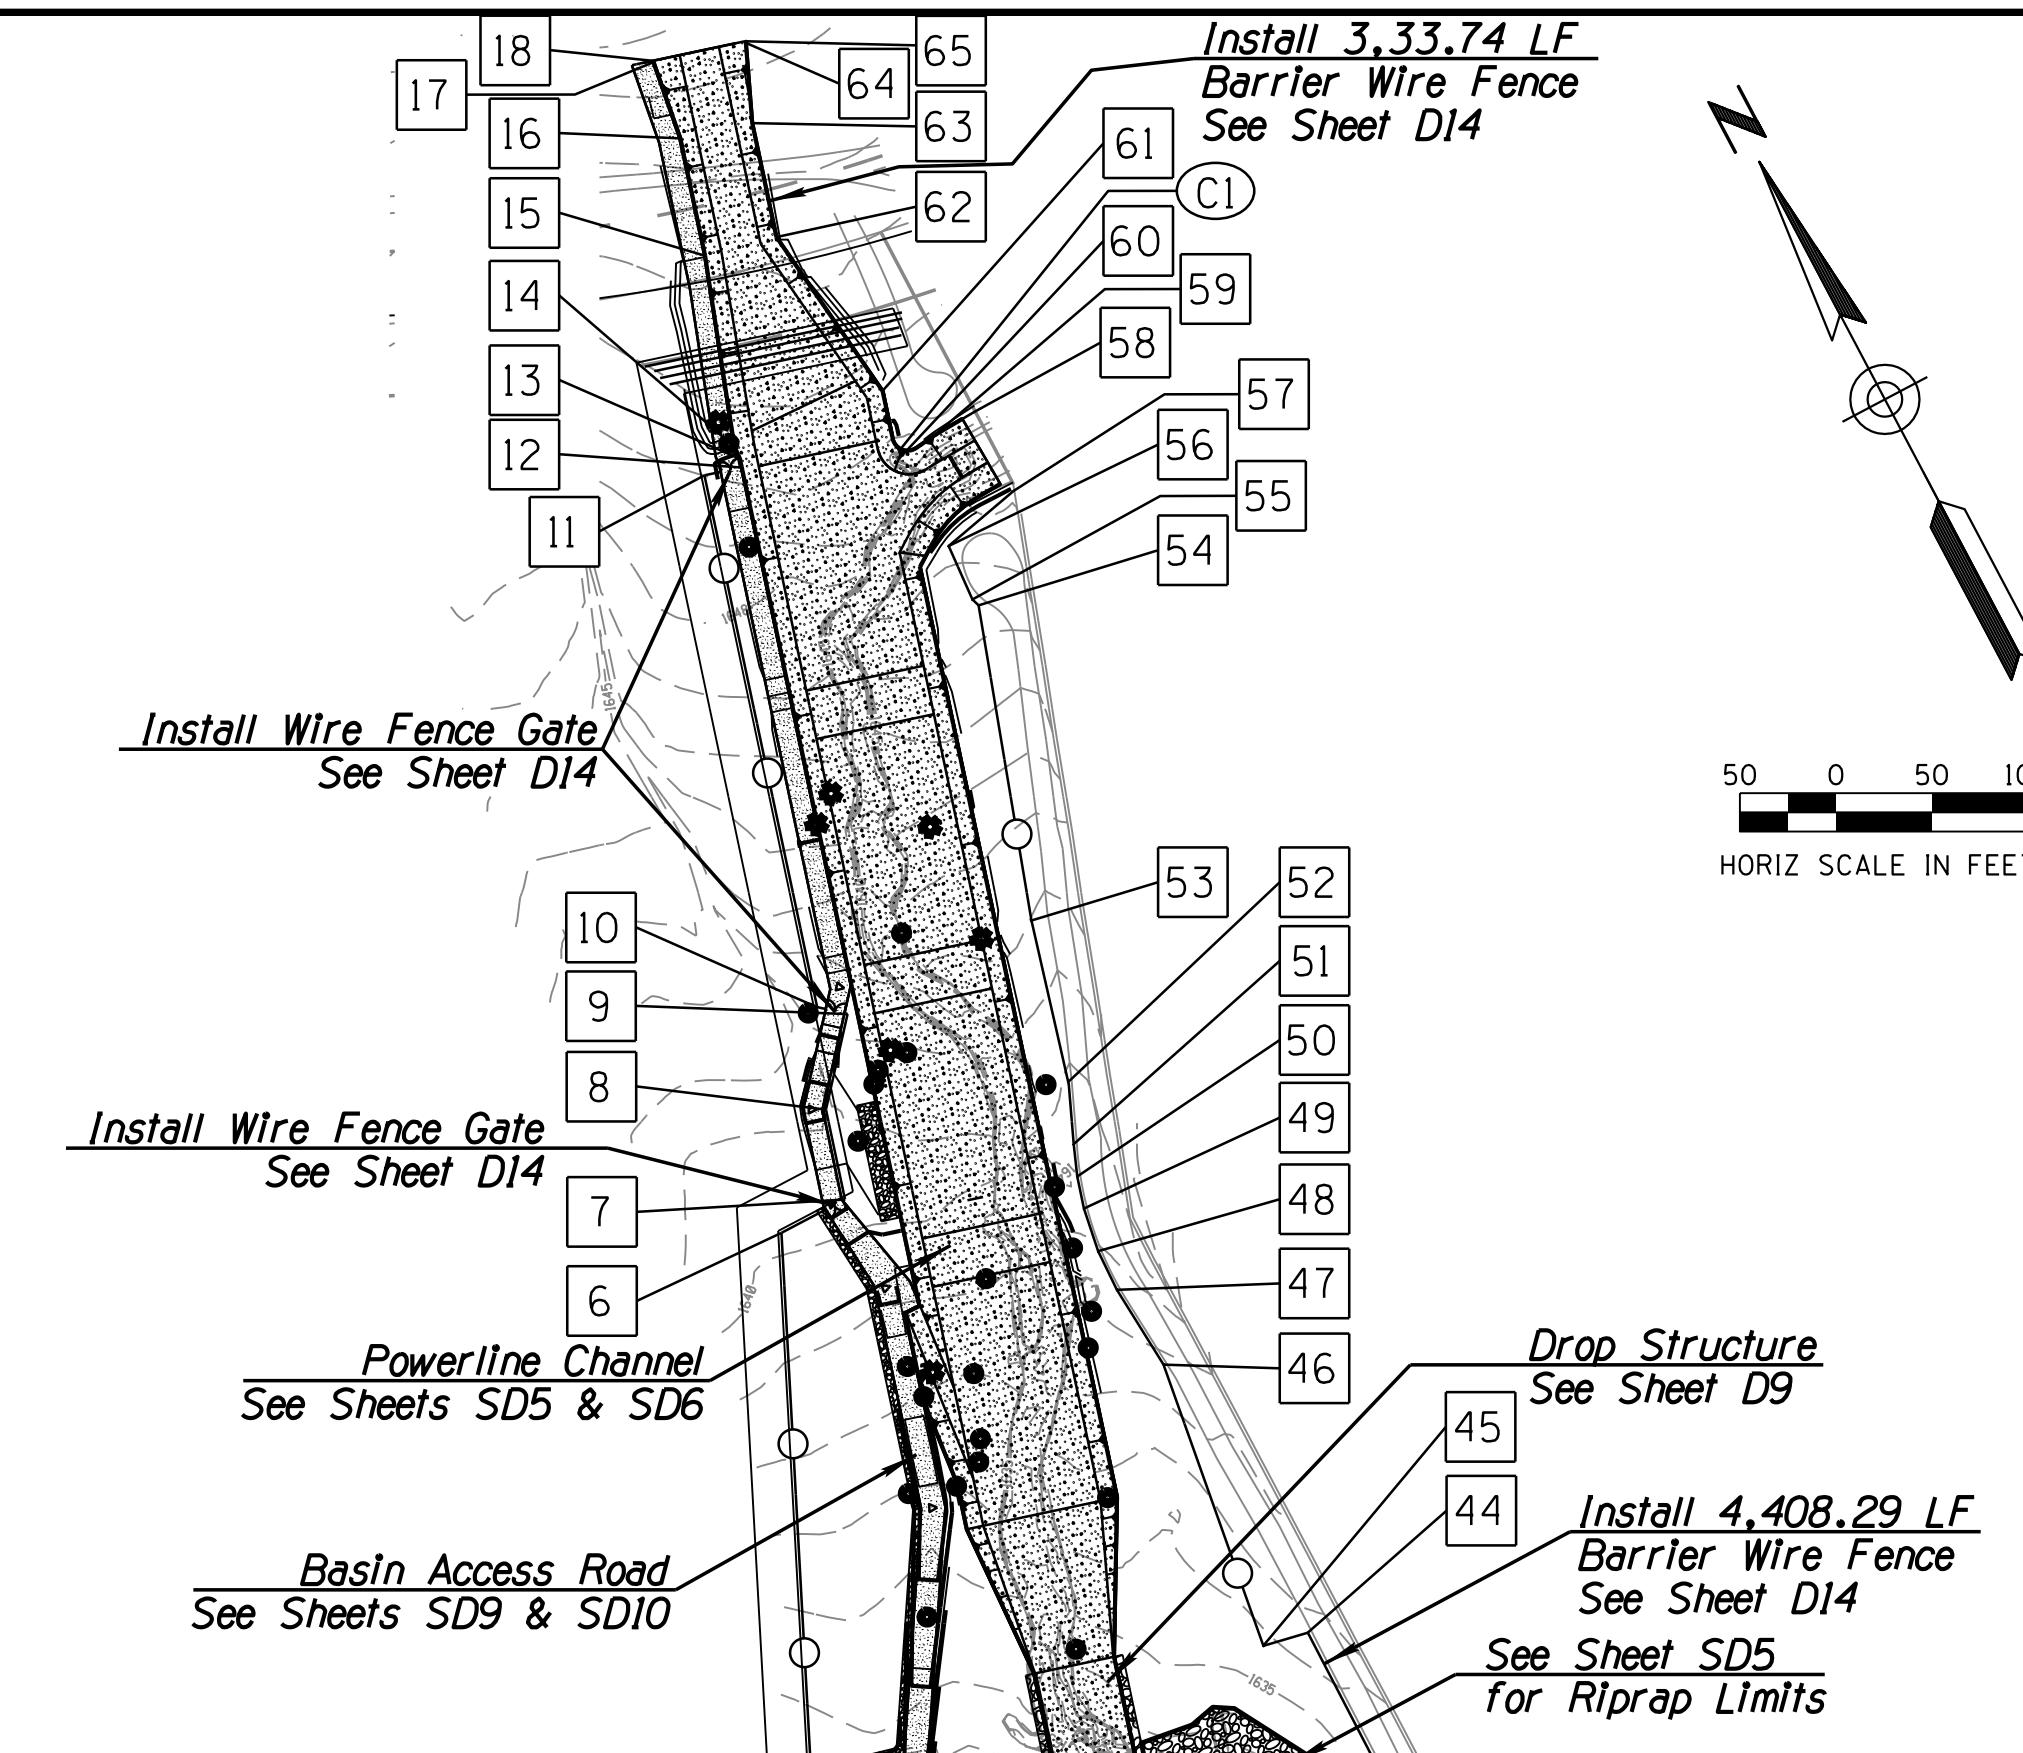

DATE: 3/13/20		REVISION:	CITY COMMENTS		BY: A.S.N.
ENGINEERED BY:	PROJ. NO.:	NO.	SHEET TITLE:		PUBLIC WORKS
REG. NO. 5986		ZEEZ SALIBA	BARRIER WIRE FENCE GEOMETRY		CAPITAL PROJECT MANAGEMENT
ARIZONA, USA		3/13/20	PROJECT TITLE: CROSSROADS EAST DRAINAGE INFRASTRUCTURE		7447 E. INDIAN SCHOOL RD., SCOTTSDALE, ARIZONA 85251
SCALE: HORIZ. 1"-100 VERT. N/A	DESIGNED AC DRAWN JJP	DATE 07/19 AS-BUILT XX/XX	BID NO. XXXX PROJECT NO. 400-FB53B-56047	SHT. D16	35 of 38

PLOT DATE: 3/13/2020

DESIGN FILE: W:\P_OJ\169678-Crossroads_East\CAD\Sheet_Files\CROSSROADS EAST.DWG

7:05:28 AM

BARRIER WIRE FENCE GEOMETRY TABLE				
Point #	Northing	Easting	Direction	Length
1	965549.00	704144.68	N 55°33'23" W	91.25'
2	965600.61	704069.42	N 23°48'29" W	111.74'
3	965702.84	704024.32	N 24°43'16" E	483.37'
4	966141.91	704226.46	N 46°13'11" E	491.14'
5	966481.73	704581.06	N 24°43'18" E	566.34'
6	966996.17	704817.92	S 89°52'31" E	44.88'
7	966996.07	704862.79	N 15°53'39" E	57.44'
8	967051.31	704878.52	N 40°37'13" E	61.25'
9	967097.80	704918.40	N 49°22'47" W	19.52'
10	967110.51	704903.58	N 15°53'38" E	339.77'
11	967437.29	704996.63	S 74°06'31" E	23.86'
12	967430.75	705019.57	N 15°53'39" E	5.65'
13	967436.19	705021.12	N 03°27'35" E	8.24'
14	967444.41	705021.62	N 19°07'17" E	120.81'
15	967558.56	705061.19	N 15°53'38" E	74.95'
16	967630.65	705081.72	N 08°29'14" E	50.42'
17	967680.52	705089.16	N 15°53'38" E	0.91'
18	967681.39	705089.41		
19	964737.68	705709.26	S 83°05'39" E	135.23'
20	964721.42	705843.50	N 45°46'06" E	118.96'
21	964804.40	705928.74	N 45°39'57" E	111.33'
22	964882.20	706008.37	N 47°32'06" E	81.16'
23	964936.99	706068.24	N 49°15'07" E	102.64'
24	965003.99	706146.00	N 10°42'40" W	36.71'
25	965040.06	706139.18	N 53°01'05" E	290.72'
26	965214.94	706371.41	N 17°14'44" E	129.27'
27	965338.40	706409.74	N 16°28'41" W	127.51'
28	965460.67	706373.57	N 535°27'51" W	144.59'
29	965546.75	706257.39	N 89°54'58" W	617.21'
30	965547.65	705640.19	N 00°05'02" E	320.16'
31	965867.81	705640.65	S 80°42'56" W	54.08'
32	965859.09	705587.28	S 85°00'22" W	58.01'
33	965854.04	705529.50	N 88°27'58" W	246.27'
34	965860.63	705283.32	N 88°20'16" W	108.62'
35	965863.78	705174.74	N 87°29'35" W	115.38'
36	965868.83	705059.47	N 85°37'32" W	79.08'
37	965874.86	704980.62	N 00°27'48" W	66.63'
38	965941.49	704980.08	N 01°47'27" E	114.36'
39	966055.79	704983.65	N 03°43'23" E	226.59'
40	966281.90	704998.37	N 01°10'32" W	16.81'
41	966298.71	704998.02	N 06°32'21" W	63.98'
42	966362.27	704990.74	N 00°03'58" E	105.94'
43	966468.21	704990.86	N 00°26'06" E	223.04'
44	9666621.42	704992.02	N 78°35'27" W	28.97'
45	966627.16	704963.62	N 08°18'19" E	186.60'
46	966811.80	704990.57	N 04°05'24" W	55.08'
47	966866.74	704986.64	N 01°58'12" E	26.83'
48	966893.55	704987.57	N 09°27'27" E	28.08'
49	966921.24	704992.18	N 16°03'57" E	20.42'
50	966940.86	704997.83	N 21°37'24" E	20.33'

BARRIER WIRE FENCE GEOMETRY TABLE				
Point #	Northing	Easting	Direction	Length
51	966959.76	705005.32	N 23°08'26" E	37.49'
52	966994.24	705020.06	N 15°01'54" E	105.12'
53	967095.76	705047.32	N 18°20'16" E	199.76'
54	967285.37	705110.17	N 18°33'46" W	5.30'
55	967290.40	705108.48	N 03°53'43" E	36.57'
56	967326.88	705110.96	N 77°33'17" E	53.14'
57	967338.33	705162.85		
58	967393.50	705164.92	S 87°28'26" W	29.27'
59	967392.21	705135.67	S 83°03'05" W	14.14'
60	967388.77	705107.43	N 15°53'39" E	30.48'
C1 SEE CURVE TABLE THIS SHEET				
61	967431.85	705119.70	N 06°44'28" W	116.93'
62	967547.97	705105.98	N 15°55'02" E	72.87'
63	967618.05	705125.96	N 23°18'03" E	50.42'
64	967664.36	705145.91	N 15°53'38" E	0.91'
65	967665.24	705146.16		
66	966503.82	706349.28	S 53°09'17" E	88.49'
67	966450.75	706420.10	S 62°07'22" E	789.85'
68	966081.44	707118.29	N 27°32'45" E	61.46'
69	966135.93	707146.72	N 62°53'05" W	877.18'
70	966535.79	706365.93		

Note: All units are in feet.



1



DATE: 3/13/20	REVISION:	CITY COMMENTS	BY: A.S.N.
		PUBLIC WORKS	
		CAPITAL PROJECT MANAGEMENT	
7447 E. INDIAN SCHOOL RD., SCOTTSDALE, ARIZONA 85251			
SHEET TITLE: BARRIER WIRE FENCE GEOMETRY			
PROJECT TITLE: CROSSROADS EAST DRAINAGE INFRASTRUCTURE			
SCALE: HORIZ. 1"-100' VERT. N/A	DESIGNED BY: AC DRAWN BY: JJP	DATE: 07/19 AS-BUILT XX/XX	BID NO. XXXX SHT. D17 PROJECT NO. 400-FBS3B-56047 36 OF 38



PLOT DATE: 3/13/2020

DESIGN FILE: W:\PJ\169678-Crossroads East\CAD\Sheet Files\Drainage\169678-D18-VANE WALL CHANNEL DETAILS.dwg

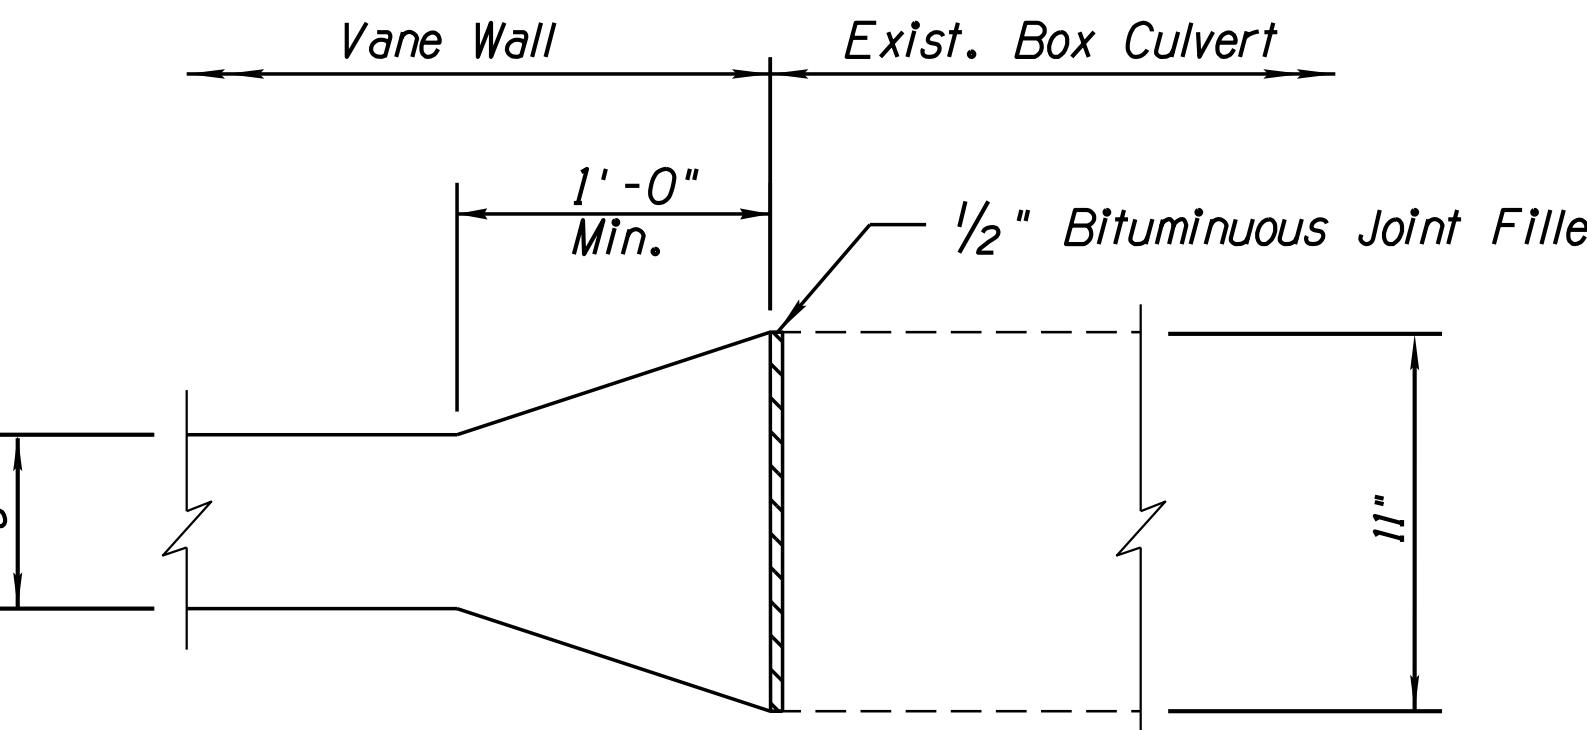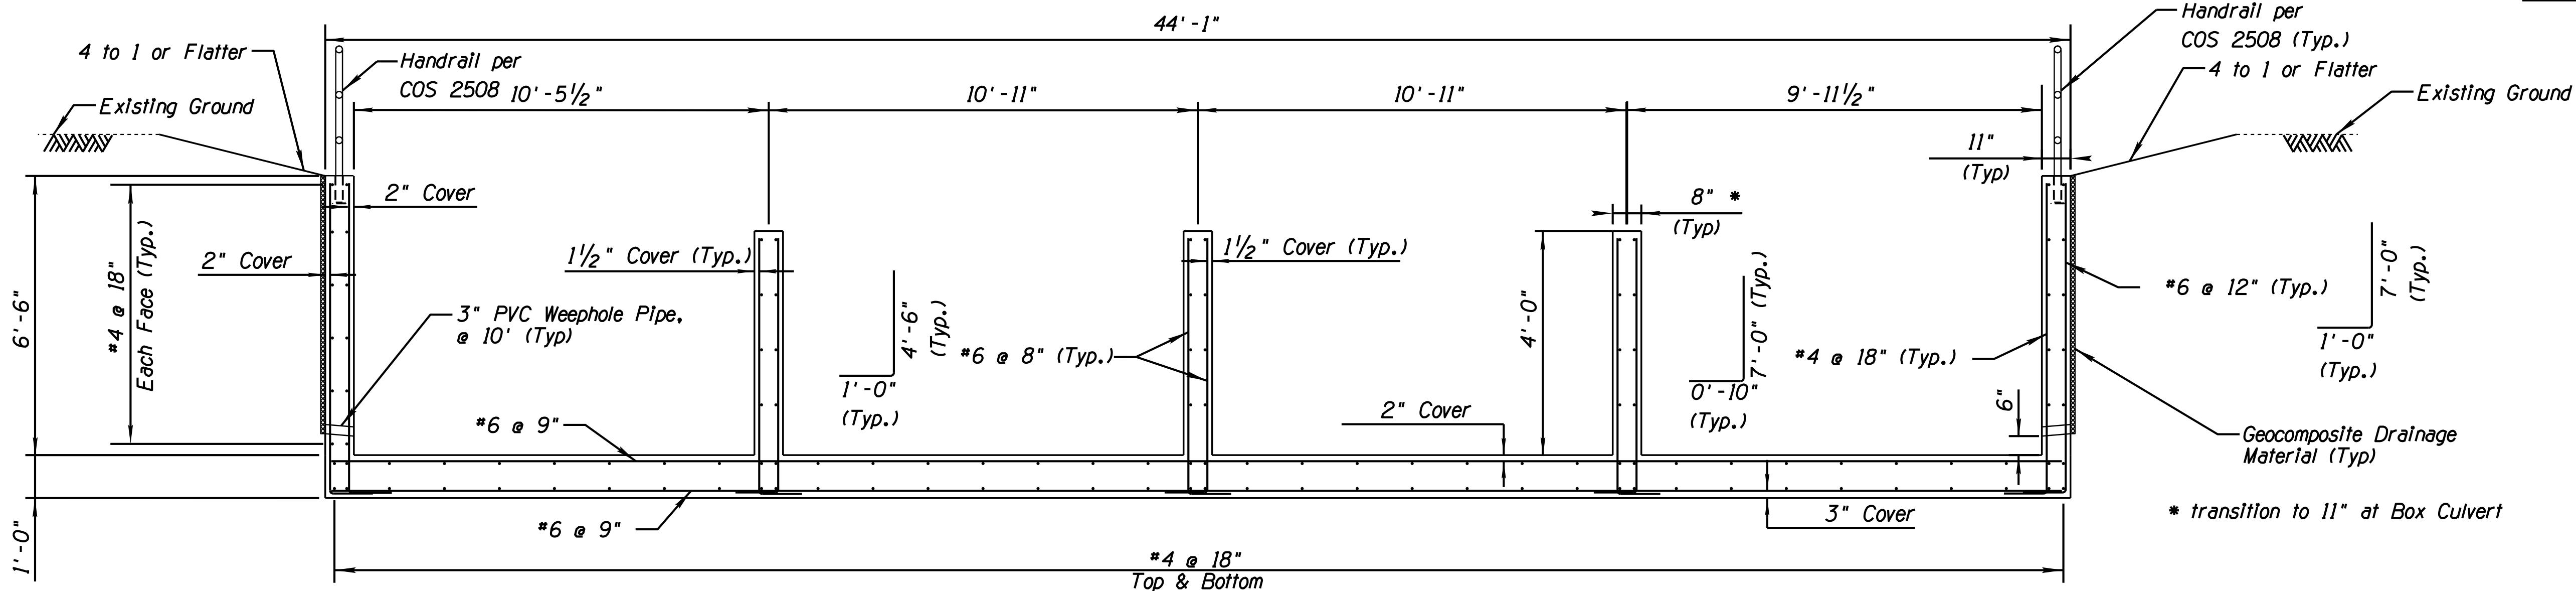


② PLAN - TRANSITION DETAIL VANE WALL

Scale: N.T.S.

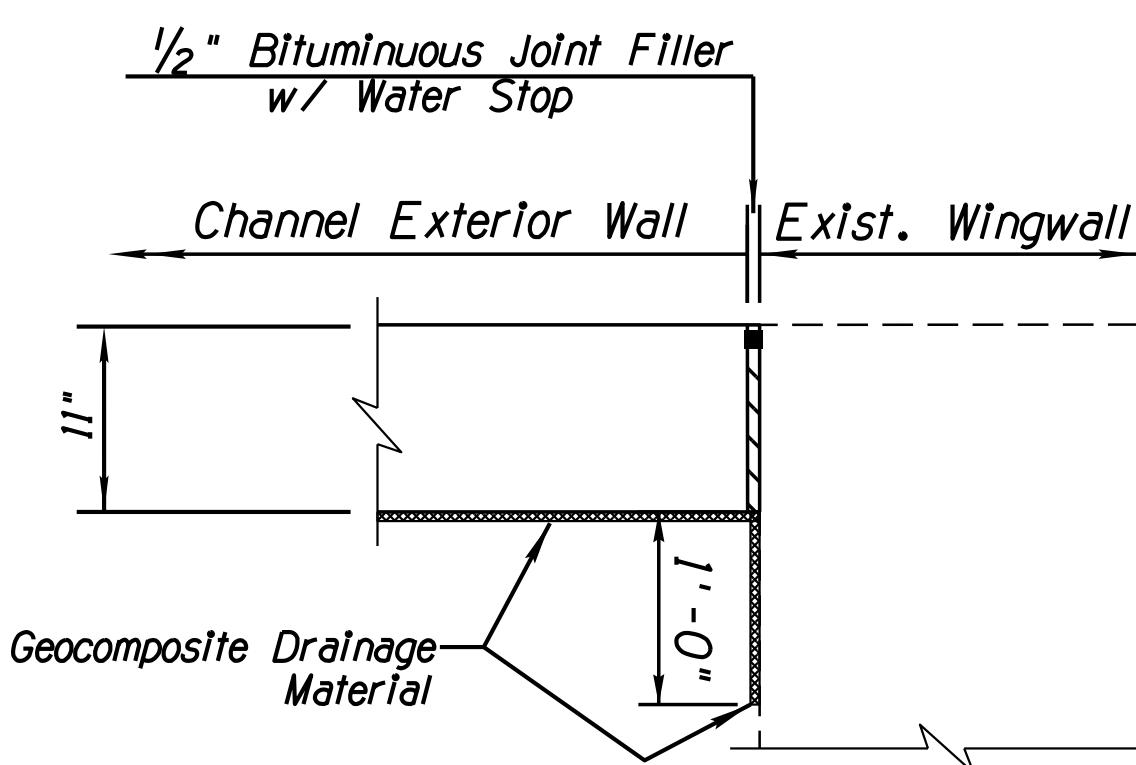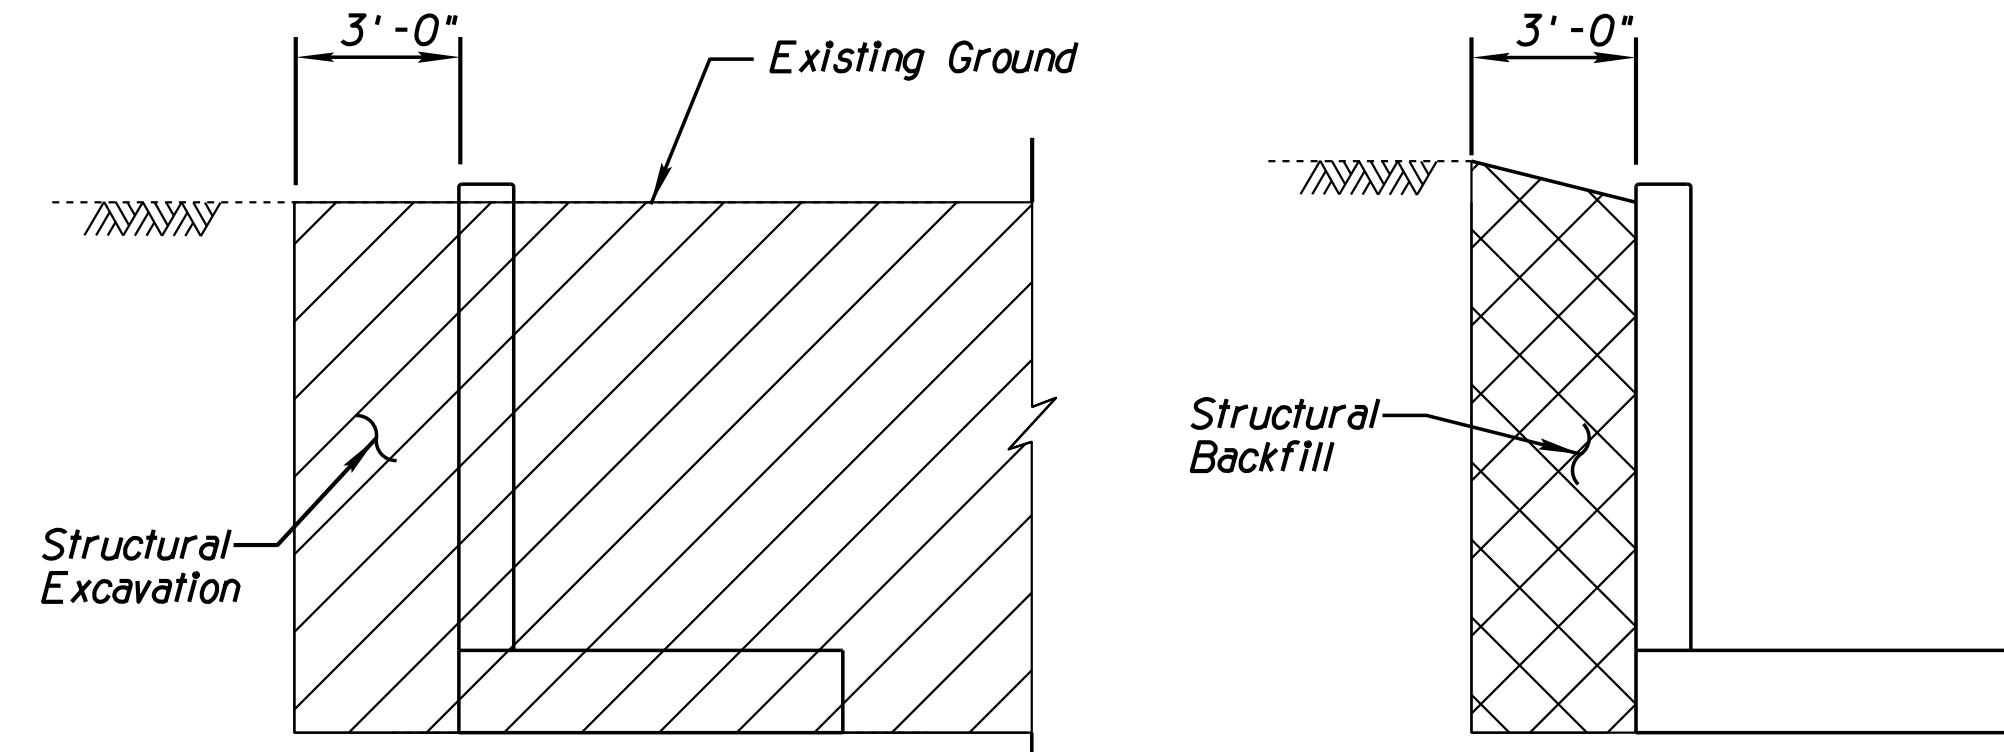


③ PLAN - EXTERIOR WALL TO WEST WINGWALL CONNECTION

Scale: N.T.S.

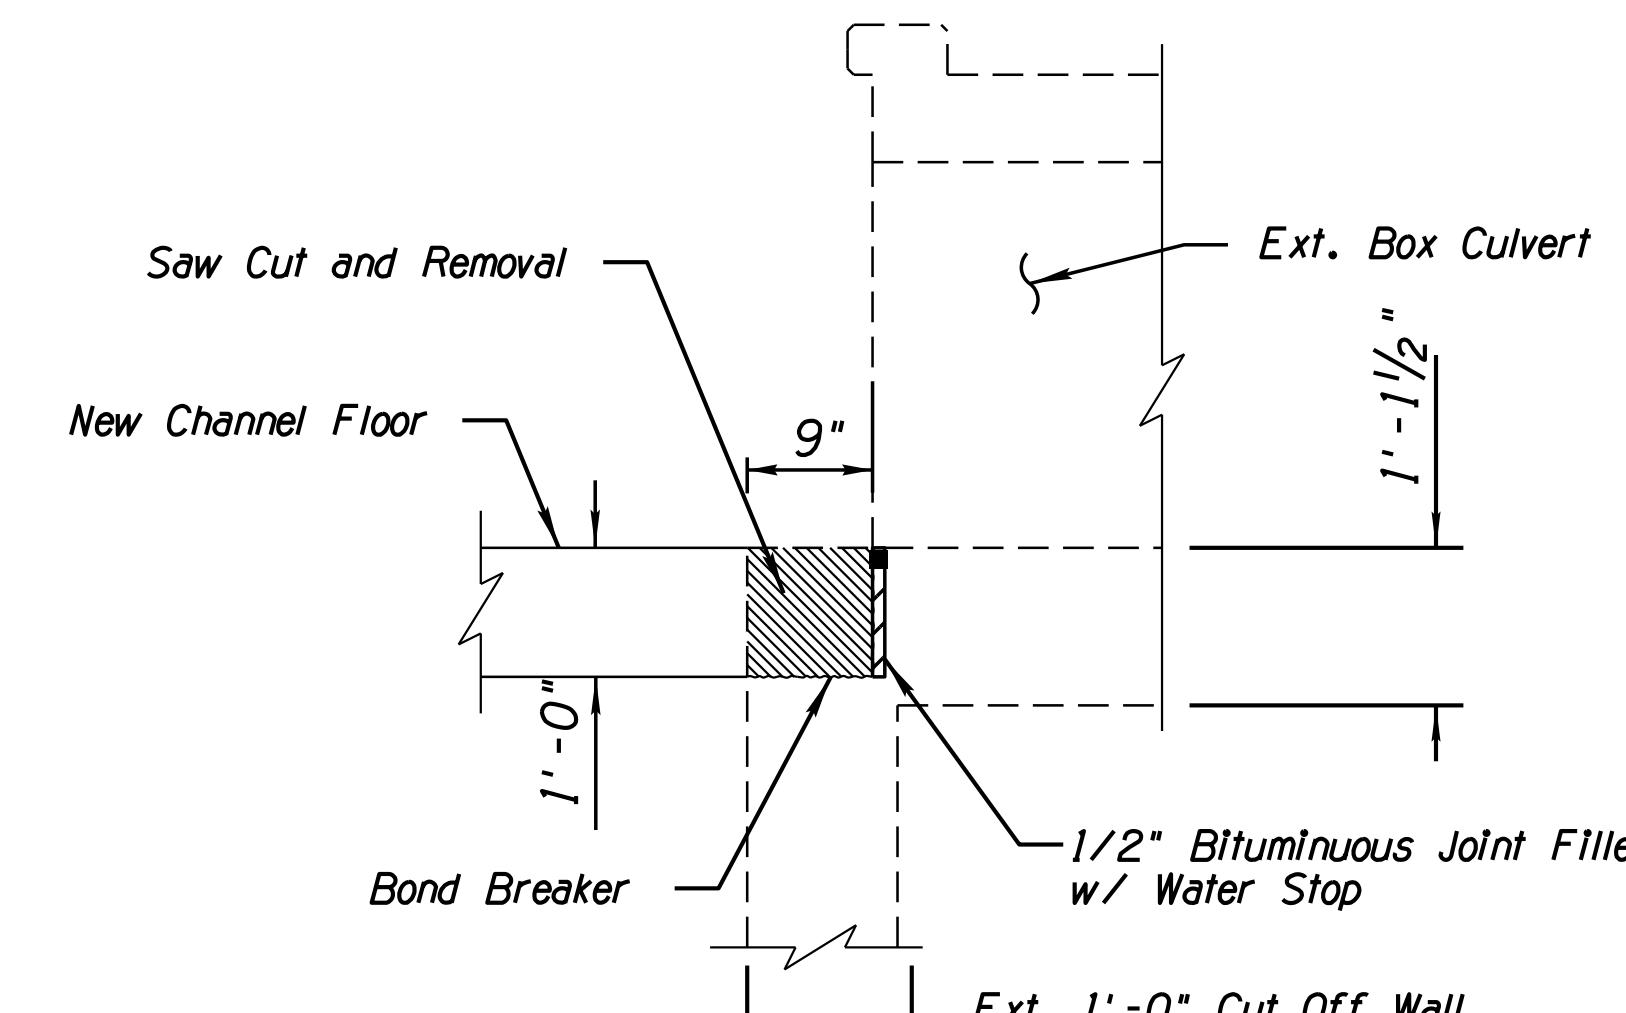


④ SECTION - CHANNEL FLOOR TO EXISTING BOX FLOOR

Scale: N.T.S.

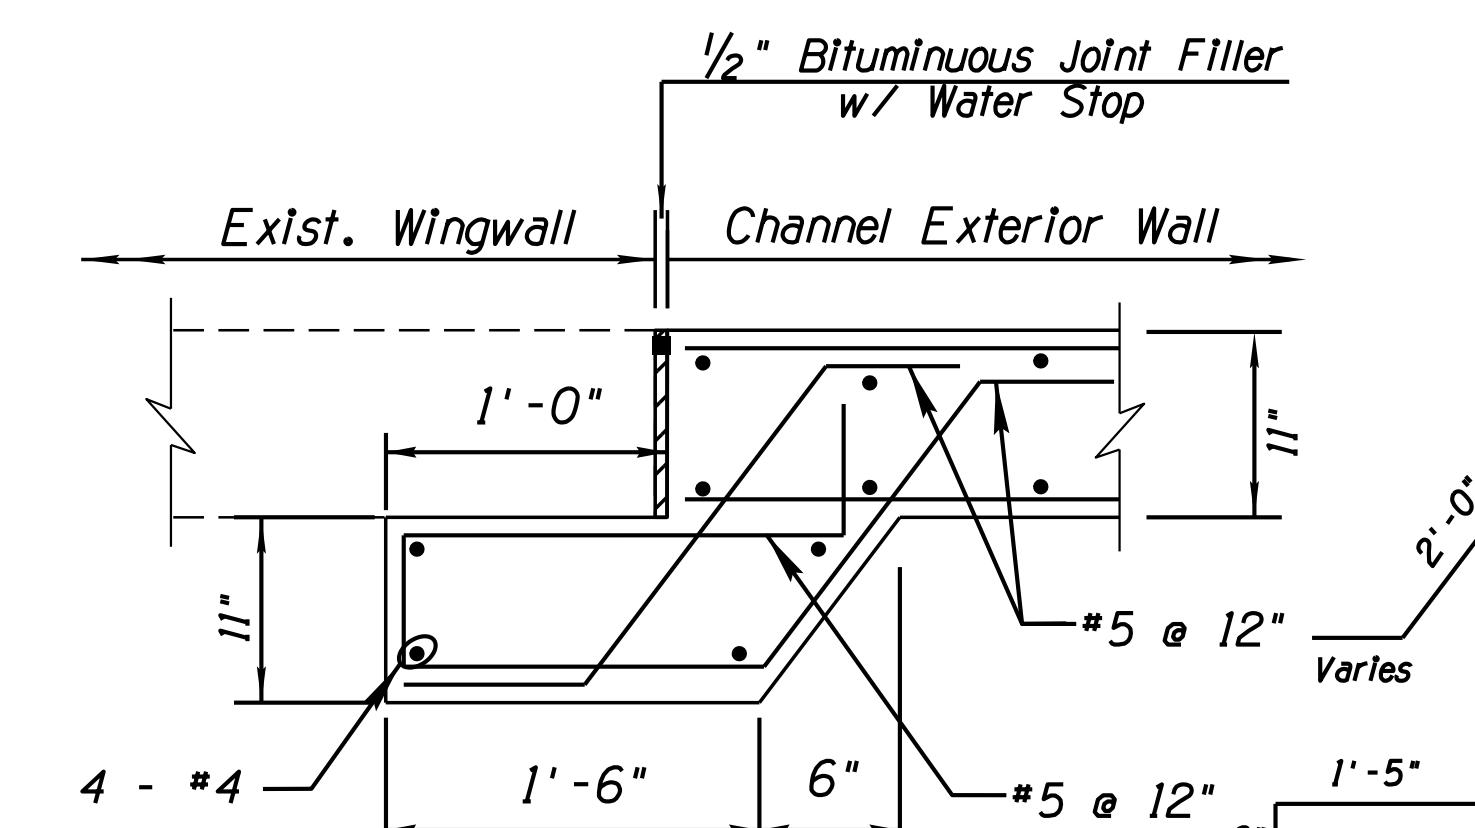

⑤ PLAN - EXTERIOR WALL TO EAST WINGWALL CONNECTION

Scale: N.T.S.

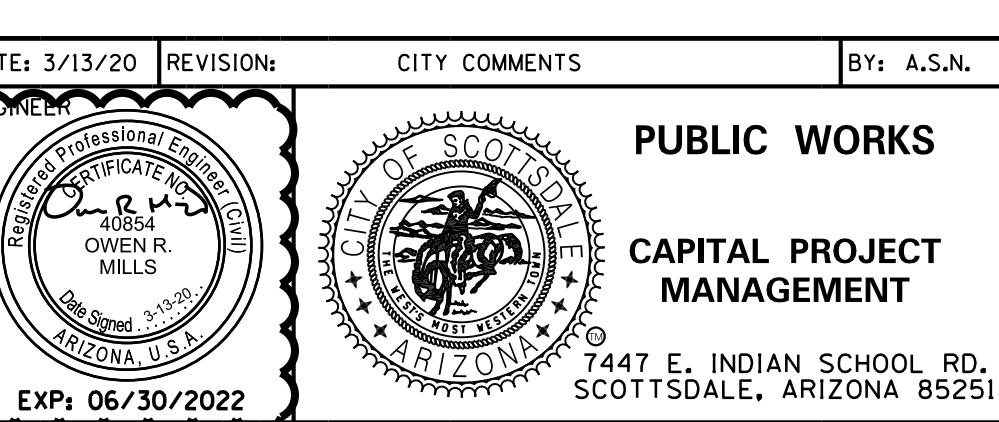


PROJECT TITLE: CROSSROADS EAST DRAINAGE INFRASTRUCTURE

SCALE HORIZ. N/A VERT. N/A	DESIGNED BY SK DRAWN CC	DATE 03/20 AS-BUILT XX/XX	BID NO. XXX	SHP. D18
----------------------------------	-------------------------------	------------------------------------	----------------	-------------

37 of 38

PLOT DATE: 3/13/2020

DESIGN FILE: W:\P-OJ\169678_Crossroads_East\CAD\Sheet Files\Drainage\169678_D19_Vane Transition Details.dwg

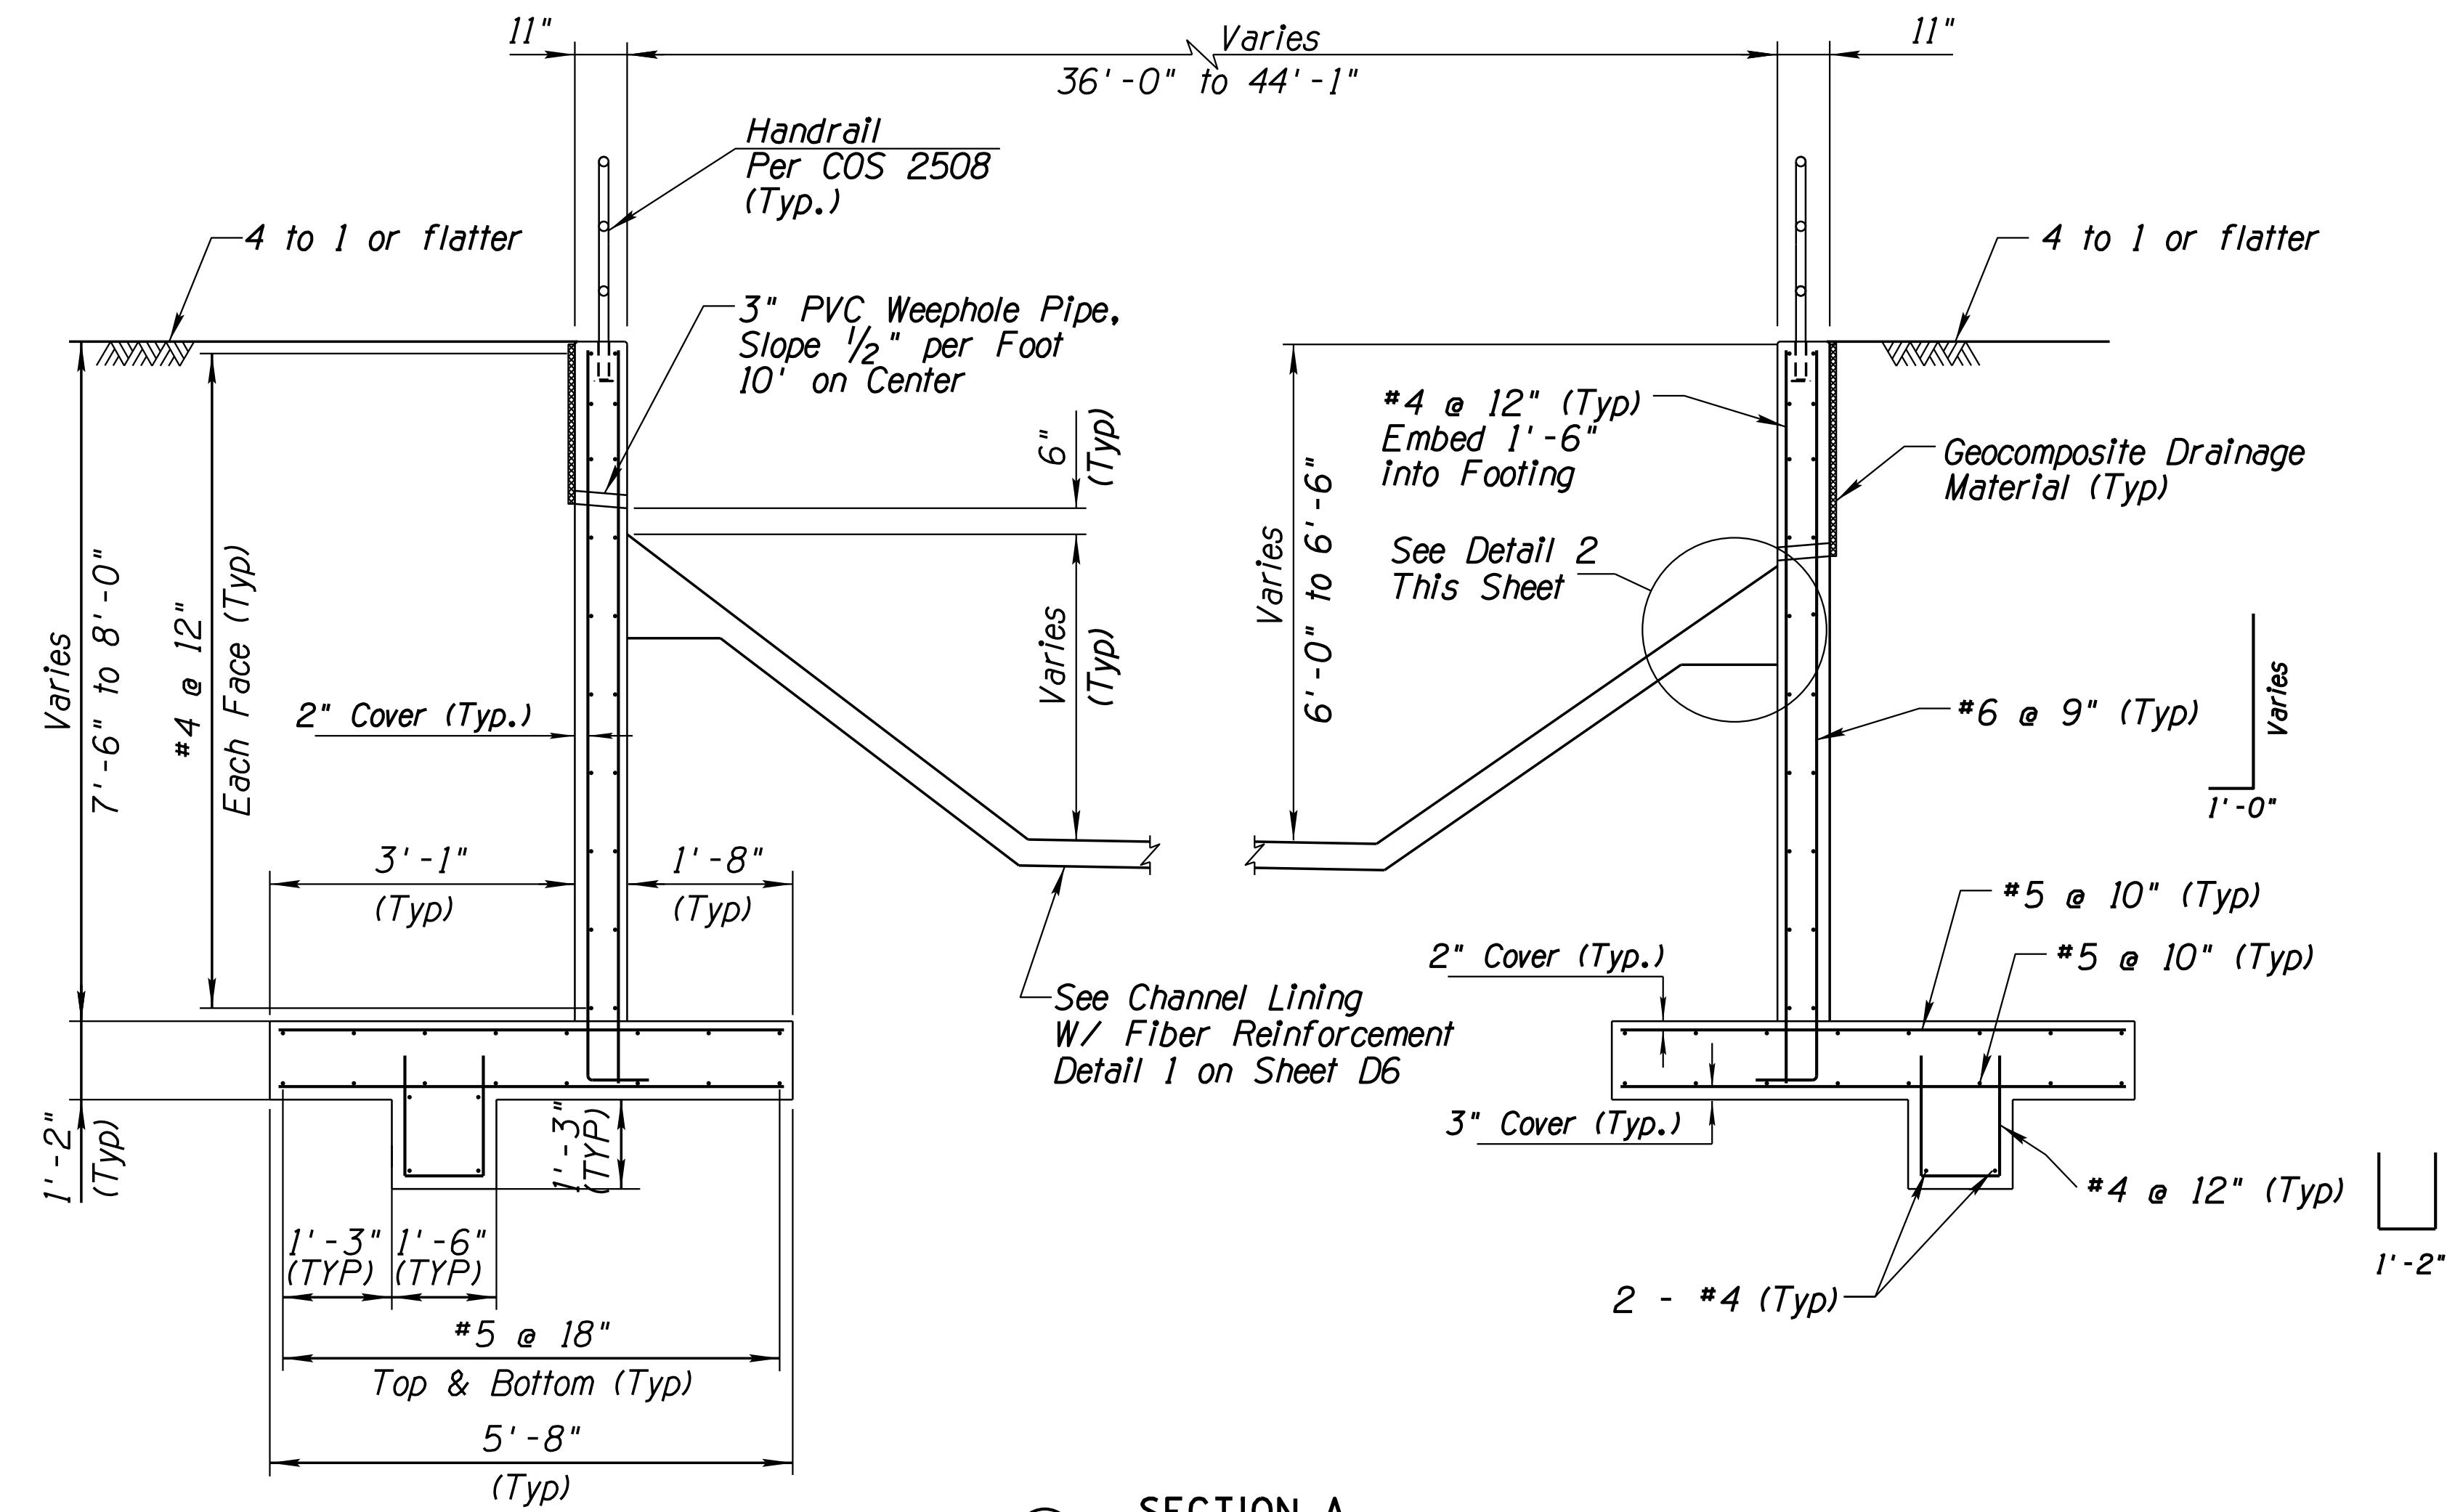


① SECTION A
Scale: N.T.S.


Sta 102+26.90 to Sta 102+26.90

Construction Notes:

1. Concrete Shall Have $f'_c = 4000 \text{ psi}$.
2. Reinforcing Steel shall conform to ASTM Specification A615. All reinforcing shall be furnished as Grade 60.
3. All bends and hooks shall meet the requirements of ACI Chapter 25. All bend dimensions for reinforcing steel shall be out-to-out bars. All placement dimensions for reinforcing steel shall be to center of bars unless noted otherwise.
4. Chamfer all exposed corners $3/4"$ unless noted otherwise.
5. Compact backfill for footing and wall base minimum 95 percent of ASTM D698 maximum dry density.
6. Overexcavate a Min of 1' Below Footing and Compact to 95% Relative Density.
7. Reinforcing Steel shall have 2' min clear cover unless otherwise noted.

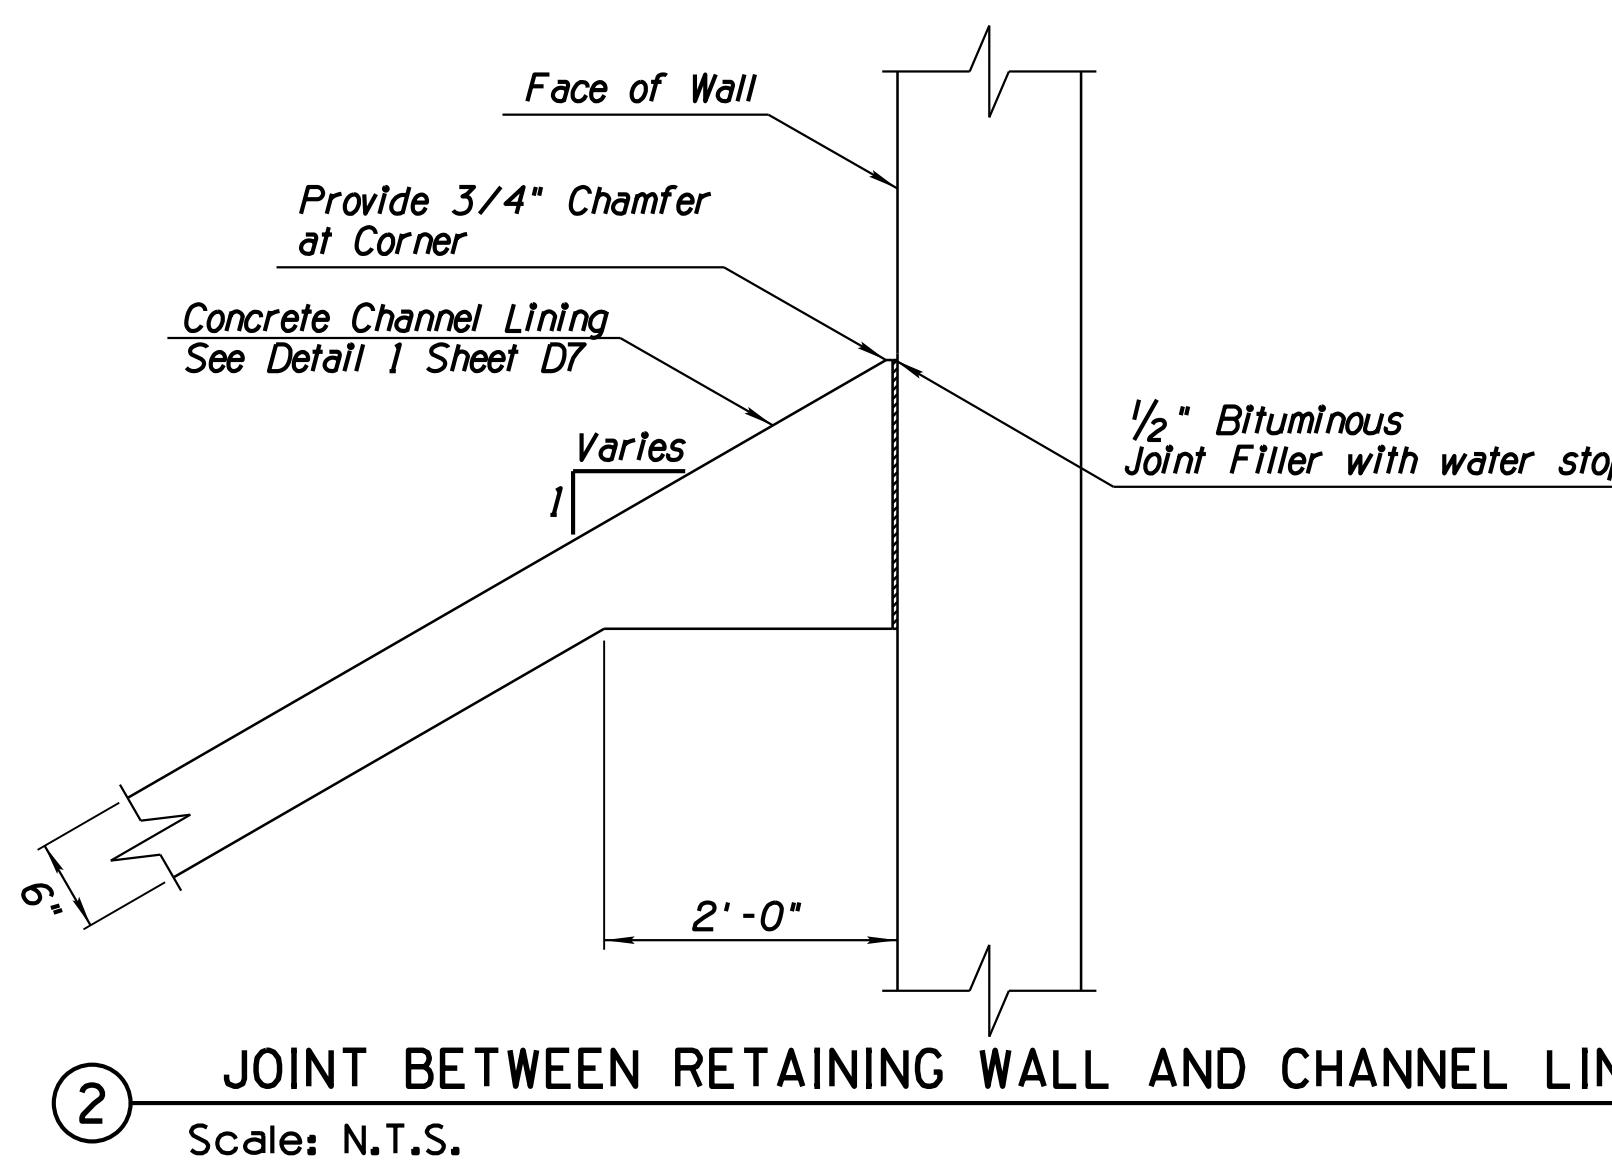

② JOINT BETWEEN RETAINING WALL AND CHANNEL LINING
Scale: N.T.S.

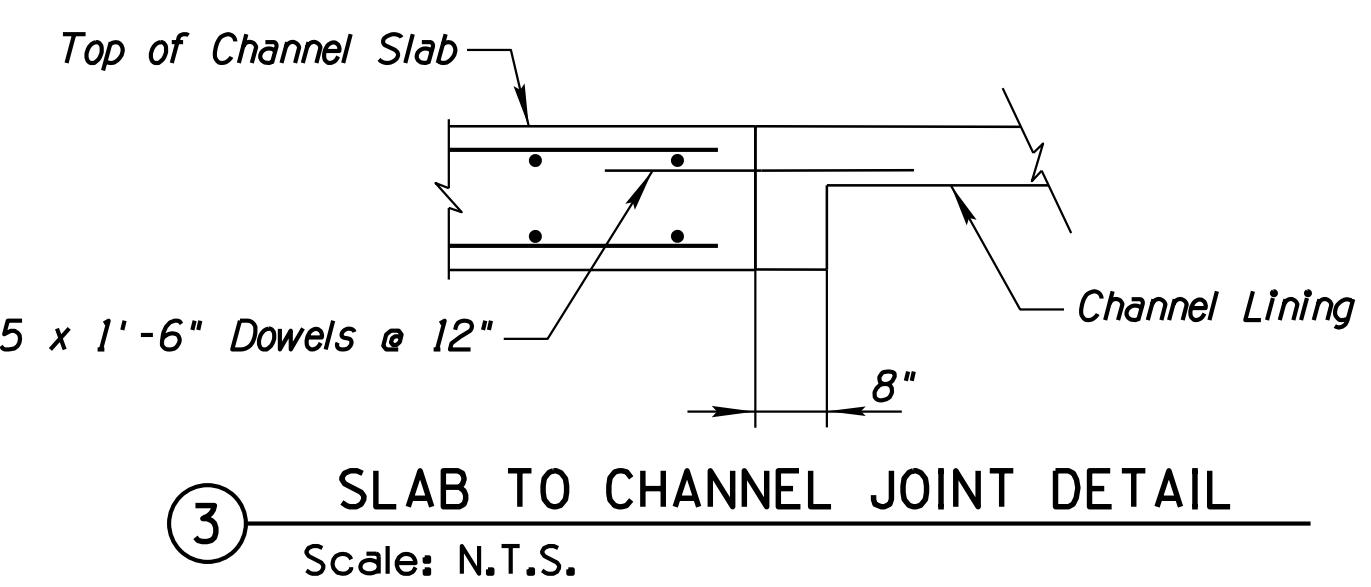

③ SLAB TO CHANNEL JOINT DETAIL
Scale: N.T.S.



DATE: 3/13/20		REVISION:	CITY COMMENTS		BY: A.S.N.
CROSSROADS EAST		PUBLIC WORKS			
DRAINAGE INFRASTRUCTURE		CAPITAL PROJECT MANAGEMENT			
SCALE HORIZ. N/A VERT. N/A	DESIGNED SK DRAWN CC	DATE 03/20 AS-BUILT XX/XX	BID NO. XXX	SH. D19	PROJECT NO. 400-FB53B-56047
EXPIRED: 06/30/2022					
SHEET NO. 1 VANES TRANSITION DETAILS					
124-SA-2018 Plan Check No: 4817-18-6					

**APPENDIX D – LOGAN SIMPSON CLEAN WATER ACT SECTION 404 TECHNICAL
MEMORANDUM**



L O G A N S I M P S O N

51 West Third Street Suite 450 Tempe, Arizona 85281
Phone: 480.967.1343 Fax: 480.966.9232 www.logansimpson.com

CLEAN WATER ACT SECTION 404

TECHNICAL MEMORANDUM

To: Joe Charles, Sales and Leasing, Arizona State Land Department
Copy: Angela Muszynski, Logan Simpson
Dylan George-Sills, Logan Simpson
From: Wayne Colebank, Logan Simpson
Date: April 6, 2020
Project Name: Hayden Road/Loop 101
Subject: Clean Water Act Section 404

INTRODUCTION

This Technical Memorandum provides a summary of findings on the presence/absence of any potential Waters of the US (Waters) on the Arizona State Land Department's (ASLD) 71-acre Parcel (Number 215-07-210B), located southeast of the intersection of North Hayden Road and State Route 101 (Loop 101) in Scottsdale, Arizona.

In 2018, a Clean Water Act (CWA) Section 404 Permit (File Number: SPL-2003-1623), including a cultural resource survey and a biological analysis, was obtained for site work and grading that occurred on the Parcel. Subsequently, the US Army Corps of Engineers (USACE), the agency that administers Section 404, issued an Approved Jurisdictional Delineation (AJD) for the Parcel. Early this year, Logan Simpson was contracted to conduct a field visit and to confirm, through correspondence with the USACE, whether Waters remain on the site subsequent to the grading permit.

As part of our due diligence for this Technical Memorandum, on March 25, 2020, prior to receiving the AJD from the USACE, Wayne Colebank, Angela Muszynski, and Dylan George-Sills of Logan Simpson completed a ground survey of the Parcel to evaluate the presence/absence of any potential Waters.

SURVEY METHODS AND ACTIVITIES

Washes previously identified in SPL-2003-1623 were mapped on Google Earth aerial images and compared to topographic maps, and the National Wetland Inventory Maps. Logan Simpson reviewed: 1) Parcel areas outside of the AJD boundaries, and 2) the previously identified washes to evaluate the physical characteristics of observed washes for consideration as a Waters and/or for the potential to remain classified as Waters. USACE guidelines for delineating Waters¹ were followed for each existing wash.

One primary wash and portions of several braids originate in the undeveloped land at the northwest corner of the Parcel (western survey area); these washes exhibit characteristics of a jurisdictional Waters. The primary wash was geographically located with a GPS-capable device and documented by ground photographs and physical characteristic descriptions.

¹ A Field Guide to the Identification of the Ordinary High Water Mark (OHWM) in the Arid West Region of the Western United States (USACE 2008).

No drainage features or potential Waters were observed in the easternmost limits of the Parcel (eastern survey area).

RESULTS

The primary wash in the western survey area discharges directly into the man-made wash along the Hayden Road frontage. Because the USACE has determined that the man-made channel is not jurisdictional Waters (see below), we are of the opinion the primary wash would typically not be considered jurisdictional due to the lack of connectivity to a downstream Waters. Similarly, the braids have no downstream connection and would not be considered jurisdictional as a result. Because of the lack of observed features, no Waters occur in the eastern survey area. To obtain the USACE's concurrence on the findings for the two survey areas, a Dry Land Approved Jurisdictional Determination Form and supporting information would need to be submitted to the USACE.

Subsequent to the field review, telephone coordination with the USACE identified the existence of the AJD. Per the USACE's AJD August 15, 2018 cover letter, there are no Waters under jurisdiction of the CWA Section 404 (as defined by 33 CFR part 329) within the review area shown on the enclosed Project Limits map. A personal conversation with Kathleen Tucker of the USACE confirmed that neither the red or yellow-highlighted washes on the AJD map are jurisdictional under the CWA. This determination is considered valid for five years from the date of August 15, 2018, unless new information or events warrant the revision of this determination before the expiration date.

It is important to note that the AJD determination is based on the current (2015) definition of Waters. Should this definition be revised as proposed in the Navigable Waters Protection Rule (NWPR) (January 23, 2020) which is yet to be authorized, ASLD should re-assess the results herein. At this time, based on the draft NWPR, it is likely that ephemeral washes, such as those on the Parcel, will be excluded from protections or permitting under the CWA.

CONCLUSION

We are of the opinion that no Waters exist within the eastern and western survey areas. To obtain the USACE's concurrence on the survey areas' assessments, a Dry Land Approved Jurisdictional Determination Form and supporting information would need to be submitted to the USACE.

Based on the findings of this Technical Memorandum and the USACE's 2018 AJD, under the current regulatory requirements and site conditions, there are no Waters within the Project Limits of the AJD review area map. If the AJD review area is developed prior to August 15, 2023, ASLD would not be required to prepare a Preliminary Jurisdictional Delineation (PJD) or a Section 404 permit prior to initiating construction.

If you have any questions, please call me at (480) 967-1343 or email me at wcolebank@logansimpson.com.

Thank you,



Wayne Colebank
Vice President, Landscape Architect
Logan Simpson

Enclosures: [USACE Approved Jurisdictional Delineation Cover Letter \(Page 1\)](#)
[USACE Approved Jurisdictional Delineation Cover Letter \(Page 2\)](#)
[USACE Dry Land Approved Jurisdictional Delineation Form](#)
[Survey Results and USACE Approved Jurisdictional Delineation Impacts to Waters of the U.S](#)
[Ground Photographs](#)



DEPARTMENT OF THE ARMY
LOS ANGELES DISTRICT, U.S. ARMY CORPS OF ENGINEERS
3636 N CENTRAL AVENUE, SUITE 900
PHOENIX, ARIZONA 85012-1939

August 15, 2018

SUBJECT: Approved Jurisdictional Determination

Mr. Wesley Mehl
Arizona State Land Department
1616 West Adams Street
Phoenix, Arizona 85007

Dear Mr. Mehl:

I am responding to your request (File No. SPL-2003-01623) dated June 8, 2018, for an approved Department of the Army jurisdictional determination (JD) for the Crossroads East project site (lat. 33.6671°N, long. -111.9146°W) located within the city of Scottsdale, Maricopa County, Arizona.

The Corps' evaluation process for determining whether or not a Department of the Army permit is needed involves two tests. If both tests are met, a permit would likely be required. The first test determines whether or not the proposed project is located within the Corps' geographic jurisdiction (i.e., it is within a water of the United States). The second test determines whether or not the proposed project is a regulated activity under Section 10 of the Rivers and Harbors Act or Section 404 of the Clean Water Act. This evaluation pertains only to geographic jurisdiction.

Based on the unauthorized activity that was resolved with an after the fact permit and settlement agreement issued on August 13, 2018, I have determined waters of the United States do not occur on the project site. The basis for our determination can be found in the enclosed Approved Jurisdictional Determination (JD) form.

This letter includes an approved jurisdictional determination for the Crossroads East project site. If you wish to submit new information regarding this jurisdictional determination, please do so within 60 days. We will consider any new information so submitted and respond within 60 days by either revising the prior determination, if appropriate, or reissuing the prior determination. If you object to this or any revised or reissued jurisdictional determination, you may request an administrative appeal under Corps regulations at 33 CFR Part 331. Enclosed you will find a Notification of Appeal Process (NAP) fact sheet and Request for Appeal (RFA) form. If you wish to appeal this decision, you must submit a completed RFA form within 60 days of the date on the NAP to the Corps South Pacific Division Office at the following address:

Tom Cavanaugh
Administrative Appeal Review Officer
U.S. Army Corps of Engineers

-2-

South Pacific Division, CESPD-PDS-O, 2042B
1455 Market Street
San Francisco, California 94103-1399

In order for an RFA to be accepted by the Corps, the Corps must determine that it is complete, that it meets the criteria for appeal under 33 CFR Part 331.5 (see below), and that it has been received by the Division Office by **October 14, 2018**.

This determination has been conducted to identify the extent of the Corps' Clean Water Act jurisdiction on the particular project site identified in your request, and is valid for five years from the date of this letter, unless new information warrants revision of the determination before the expiration date. This determination may not be valid for the wetland conservation provisions of the Food Security Act of 1985. If you or your tenant are USDA program participants, or anticipate participation in USDA programs, you should request a certified wetland determination from the local office of the Natural Resources Conservation Service prior to starting work.

Thank you for participating in the regulatory program. If you have any questions, please contact me at (602) 230-6956 or via e-mail at Kathleen.A.Tucker@usace.army.mil. Please help me to evaluate and improve the regulatory experience for others by completing the customer survey form at http://corpsmapu.usace.army.mil/cm_apex/f?p=regulatory_survey.

Sincerely,



Sallie Diebolt
Chief, Arizona Branch
Regulatory Division

Enclosure

DRY LAND APPROVED JURISDICTIONAL DETERMINATION FORM¹
U.S. Army Corps of Engineers

This form should be completed by following the instructions provided in Section IV of the JD Form Instructional Guidebook.

SECTION I: BACKGROUND INFORMATION

A. REPORT COMPLETION DATE FOR APPROVED JURISDICTIONAL DETERMINATION (JD): August 15, 2018

B. DISTRICT OFFICE, FILE NAME, AND NUMBER: SPL-2003-2623

C. PROJECT LOCATION AND BACKGROUND INFORMATION:

State: Arizona County/parish/borough: Maricopa City: Scottsdale

Center coordinates of site (lat/long in degree decimal format): Lat. 33.6671 °, Long. -111.9146 °

Universal Transverse Mercator:

Name of nearest waterbody: Indian Bend Wash

Name of watershed or Hydrologic Unit Code (HUC): 1506010602

- Check if map/diagram of review area is available upon request.
 Check if other sites (e.g., offsite mitigation sites, disposal sites, etc...) are associated with this action and are recorded on a different JD form.

D. REVIEW PERFORMED FOR SITE EVALUATION (CHECK ALL THAT APPLY):

- Office (Desk) Determination. Date: August 13, 2018
 Field Determination. Date(s): [Click here to enter a date](#).

SECTION II: SUMMARY OF FINDINGS

A. RHA SECTION 10 DETERMINATION OF JURISDICTION.

There are no "navigable waters of the U.S." within Rivers and Harbors Act (RHA) jurisdiction (as defined by 33 CFR part 329) in the review area.

B. CWA SECTION 404 DETERMINATION OF JURISDICTION.

There are no "waters of the U.S." within Clean Water Act (CWA) jurisdiction (as defined by 33 CFR part 328) in the review area.


SECTION III: DATA SOURCES

A. SUPPORTING DATA. Data reviewed for JD (check all that apply - checked items shall be included in case file and, where checked and requested, appropriately reference sources below):

- Maps, plans, plots or plat submitted by or on behalf of the applicant/consultant.
 Data sheets prepared/submitted by or on behalf of the applicant/consultant.
 Office concurs with data sheets/delineation report.
 Office does not concur with data sheets/delineation report.
 Data sheets prepared by the Corps:
 U.S. Geological Survey Hydrologic Atlas:
 USGS NHD data.
 USGS 8 and 12 digit HUC maps.
 U.S. Geological Survey map(s). Cite scale & quad name:
 USDA Natural Resources Conservation Service Soil Survey. Citation:
 National wetlands inventory map(s). Cite name:
 State/Local wetland inventory map(s):
 FEMA/FIRM maps:
 100-year Floodplain Elevation is: (National Geodetic Vertical Datum of 1929)
 Photographs: Aerial (Name & Date): July 2017
 or Other (Name & Date): July 2017
 Previous determination(s). File no. and date of response letter:
 Applicable/supporting case law:
 Applicable/supporting scientific literature:
 Other information (please specify): unauthorized activity that filled in washes

B. REQUIRED ADDITIONAL COMMENTS TO SUPPORT JD. EXPLAIN RATIONALE FOR DETERMINATION THAT THE REVIEW AREA ONLY INCLUDES DRY LAND: An unauthorized activity filled washes with asphalt millings and thus there is no OHWM and thus no Waters on site.

¹ This form is for use only in recording approved JDs involving dry land. It extracts the relevant elements of the longer approved JD form in use since 2007 for aquatic areas and adds no new fields.

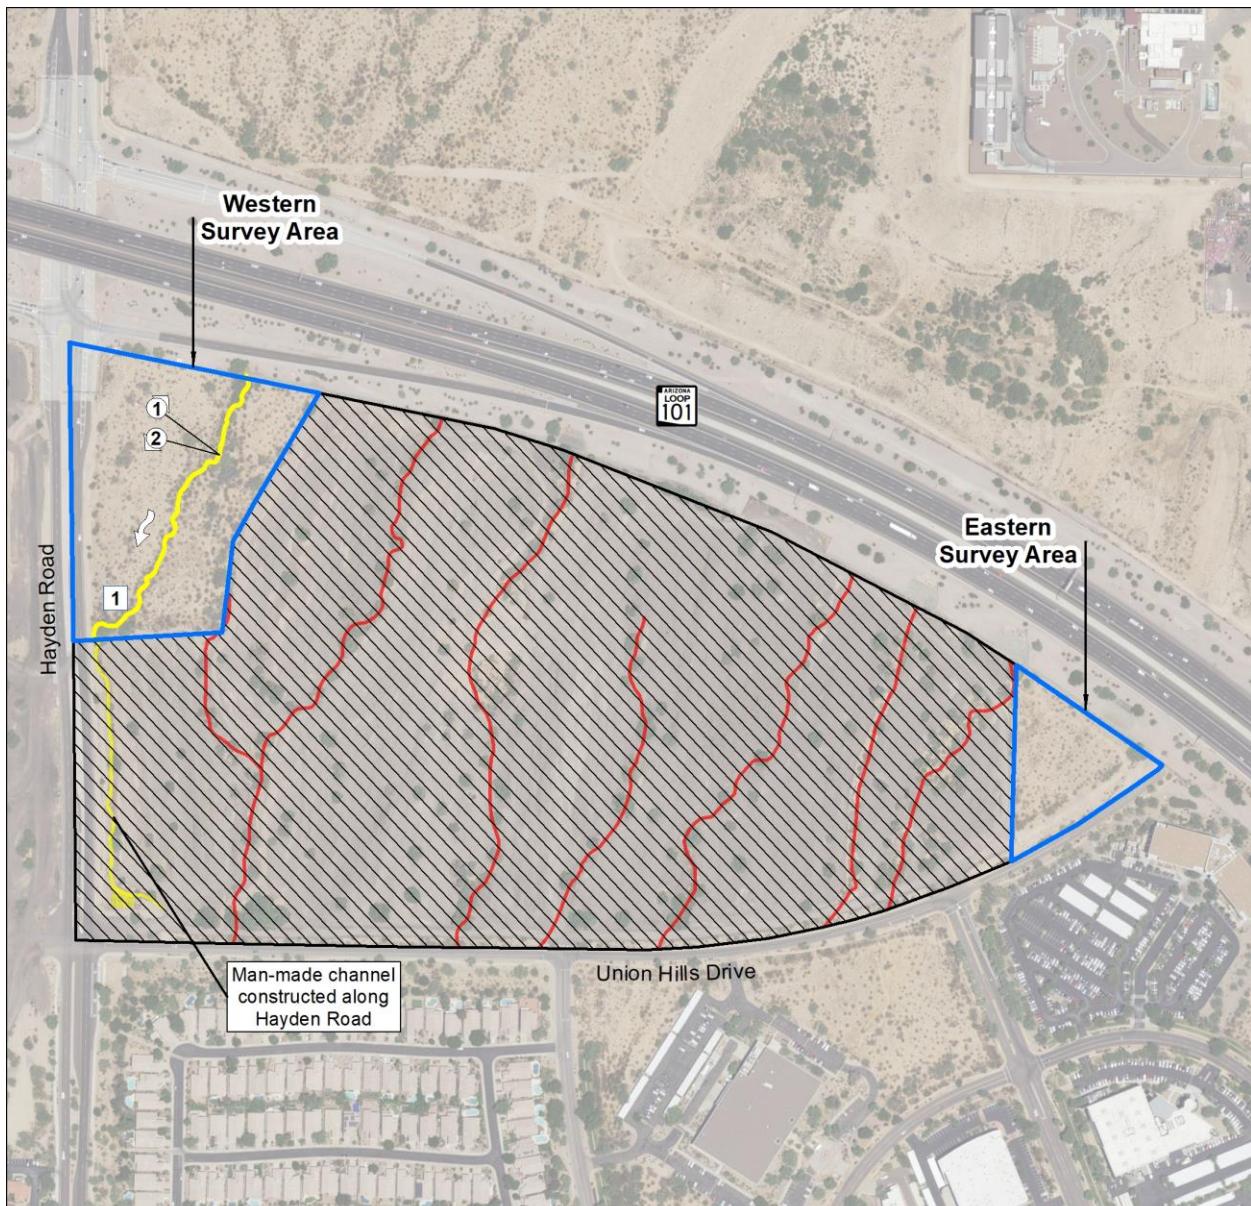

Source: Esri, USDA Farm Service Agency

Key

 Survey Area	# Feature number	Feet
\ AJD Area (SPL-2003-01623)		0 1,000
— Potentially Jurisdictional Waters		
— Permanent Impacts to Jurisdictional Waters		
	Photo location	
	Flow direction	



Survey Results and USACE Approved Jurisdictional Delineation Impacts to Waters of the U.S.

Photo No. 1 (Wash 1 – Potential Waters)




Upstream view facing northeast

Photo No. 2 (Wash 1 – Potential Waters)



Downstream view facing southwest

**APPENDIX E – MICHAEL BAKER INTERNATIONAL CROSSROADS EAST DRAINAGE
INFRASTRUCTURE PHASE 1 PROJECT NO. 169678**



Drainage Design Report

CROSSROADS EAST DRAINAGE INFRASTRUCTURE PHASE 1

Contract No. 2018-017-COS | MBI Job No. 169678





Plan #	4817-18-19
Case #	
Q-S #	
<input checked="" type="checkbox"/> Accepted	
<input type="checkbox"/> Corrections	
Reviewed By 	
Date 03/31/2020	

Prepared for:
City of Scottsdale
7447 E. Indian School Rd.
Scottsdale, AZ 85251

Prepared by:

Michael Baker
INTERNATIONAL

2929 North Central Ave.
Suite 800
Phoenix, AZ 85012

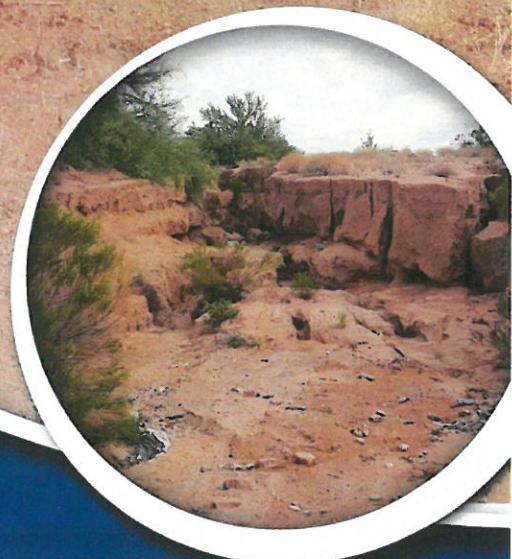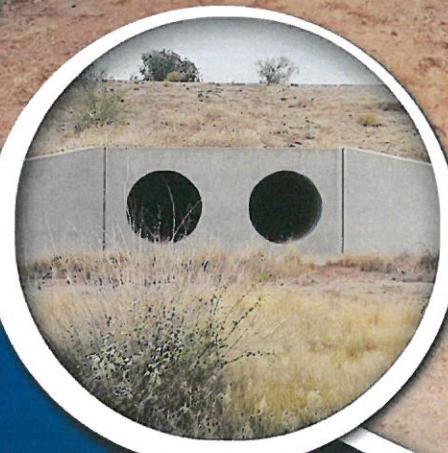



1. Introduction

1.1. Purpose

This drainage report supports the design of the Crossroads East Phase I drainage infrastructure improvement project for the City of Scottsdale (City) under contract 2018-017-COS. The project consists of underground pipe, channel, spillway, and detention basin design.

1.2. Location

The project location is in the City of Scottsdale, AZ near Hayden Rd. and State Route 101L (SR 101L). It is in Sections 25 and 36 of Township 4 North and Range 4 East of the Gila and Salt River Base and Meridian.

The project extends from the future Legacy Blvd. alignment on the north, to Basin 53R, and south of SR 101L to the northeast corner of Union Hills Dr. and Hayden Rd. Figure 1.1 shows the project extents.

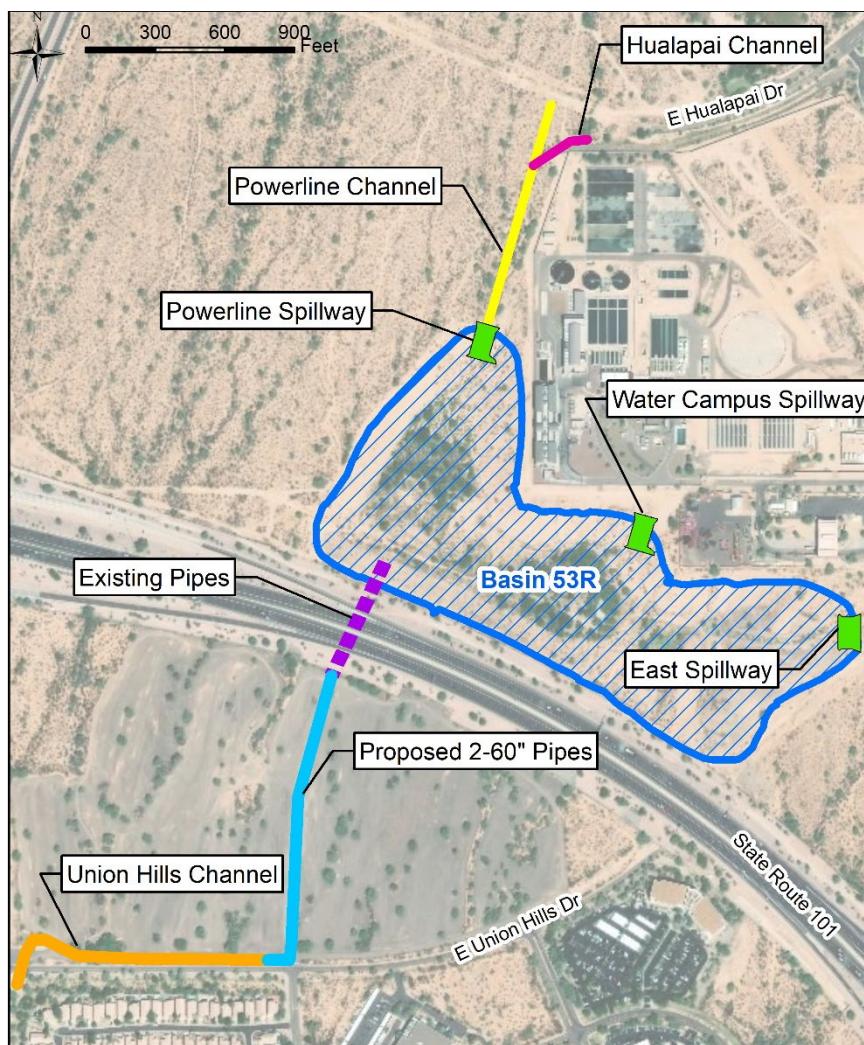


Figure 1.1: Vicinity Map



2.2. Methodology

The hydrology developed for the project is a combination of FLO-2D (Build 13.07.05) and HEC-HMS (Version 4.3). The FLO-2D offsite hydrographs were input into HEC-HMS for the detention basin design and basin routing. The onsite developed conditions hydrology was determined using HEC-HMS. Figure 7 shows the offsite inflows and the onsite sub-basin drainage areas.

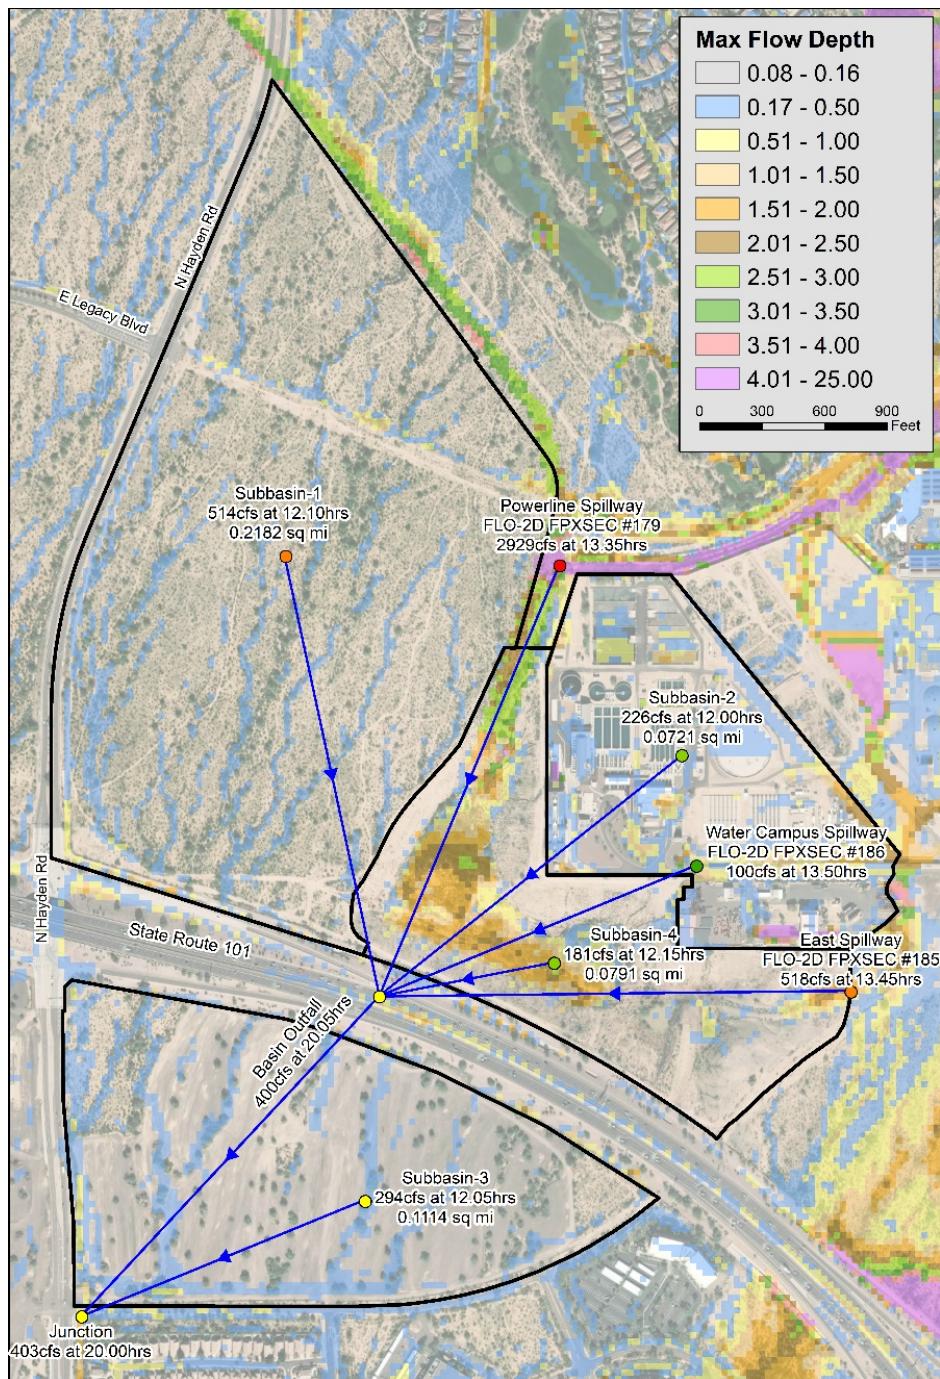


Figure 7: Hydrology Routing Schematic



5.2.3. Union Hills Channel

The Union Hills Channel receives the outfall from Basin 53R pipes and routes the flow to the existing 4 - 10' x 4' box culvert under Union Hills Dr. east of Hayden Rd. The design discharge is from Junction-1 per Table 12: 100-year Summary. Junction-1 accounts for Basin 53R flow and Sub-basin-3 at the existing Union Hills box culvert. Table 23 is a summary of the Union Hills Channel Design. The Union Hills Channel only contains the flow depths (403 cfs) from Phase I design. This section of the channel will be re-designed when Phase II design discharges additional flow into the channel.

Table 23: Union Hills Channel

100-year Design Discharge	403 cfs
Shape	Trapezoidal
Bottom Width	15 ft
Minimum Depth	6.5 ft
Side Slopes (H:V)	2:1
Minimum Slope	0.20%
Material	Concrete
n-value	0.014*
Flow Regime	Mixed

*finished grade concrete

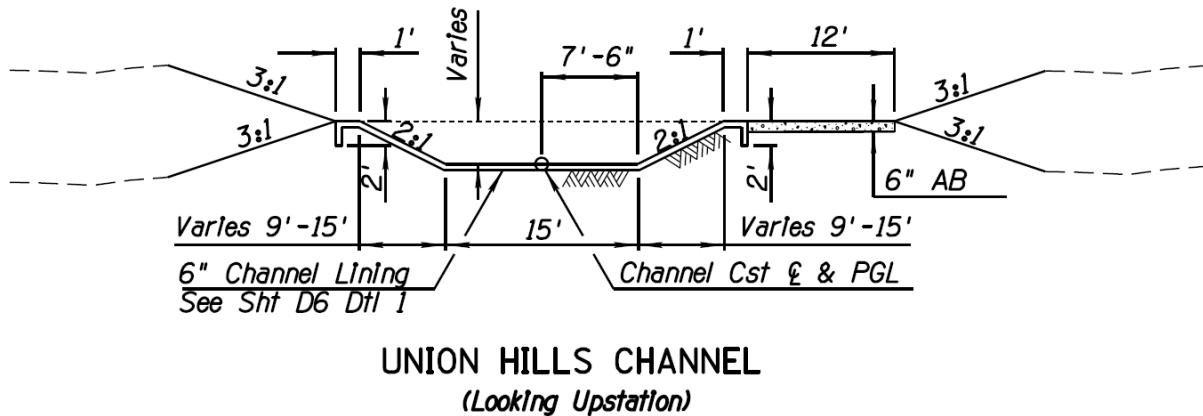


Figure 25: Union Hills Channel Cross-Section



5.2.4. Union Hills Upstream Channel Section

The Union Hills channel inflow model analyzed the proposed conditions from Basin 53R outfall pipes to downstream of the existing box culvert. The Basin 53R outfall pipe that discharges into the Union Hills channel is designed using StormCAD model as described in Section 5.1.1. In order to better understand the hydraulic impacts of the Basin 53R Pipe outfall discharge into the Union Hills Channel, a Los Angeles County Flood Control District hydraulic analysis program F0515P, WSPGW (Windows Version 14.06) was utilized to develop the hydraulic model of the drainage system. WSPGW computes and plots uniform and non-uniform steady flow water surface profiles and pressure gradients in open channels or closed conduits with irregular or regular sections. The computational procedure is based on solving Bernoulli's equation for the total energy between the sections in a reach. The open channel flow procedure utilizes the standard step method. Confluences are analyzed using pressure and momentum theory. The channel section was modeled in WSPGW, the assumptions and results such as channel depths and velocities are shown in Appendix D.

5.2.5. Union Hills Channel Bend


Before discharging into the 4'-10" x 4' box culvert under Union Hills Dr., the channel section has a bend. Channel bends, though not preferable are necessary in urban settings. Channel bends may cause changes in flow regime and oscillations. It was determined that one-dimensional models do not adequately simulate the hydraulic characteristic of flows in such a situation, so a two-dimensional XPSWMM (2019) model was developed to design the channel transition, channel bend and entrance to the culvert. XPSWMM accounts for channel transitions from trapezoidal to rectangular sections, the radius of curvature in the channel bend and super elevation. Structural Vanes were used to evenly distribute the flows between 4'-10" x 4' box culverts at the entrance. The amount of flow going through each cell will depend on hydraulic characteristics upstream. Upstream of the crossing the channel goes through a significant bend which will tend to concentrate flow toward the left (inner) side of the section (looking downstream). The 2D XPSWMM model was evaluated with different alternatives to determine if the length of the Vanes at the upstream side would have significant impact on the distribution of flows and velocities within the channel compartments. Varying the length of the Vane did not have significant impact on the distribution of flows or the depth. Figure 25 shows a typical plan view of the channel section with the Vane and Culvert entrance along with the flow depth distribution. The velocity distribution between the Vanes and depth profile for the channel with the Vane are shown in Appendix D. Please refer Appendix M for details of the structural calculation of the Vanes and Walls in the channel.

The wall height along the channel was designed such that flow depth is contained within the channel in addition to 1 ft of freeboard. The minimum height of the wall



on outside is 6.5 ft with a transition of 5.5 ft to the culvert entrance. The minimum height of the Vanes is 4 ft.

There are some additional local flows (22 cfs) coming from the north at the proposed channel bend. This flow is not included as part of the Phase I design flows (403 cfs) due to expected variance in time to peak between the channel peak flow and the local flow. The channel section at the bend is protected with riprap at the outer curve of the channel boundary.

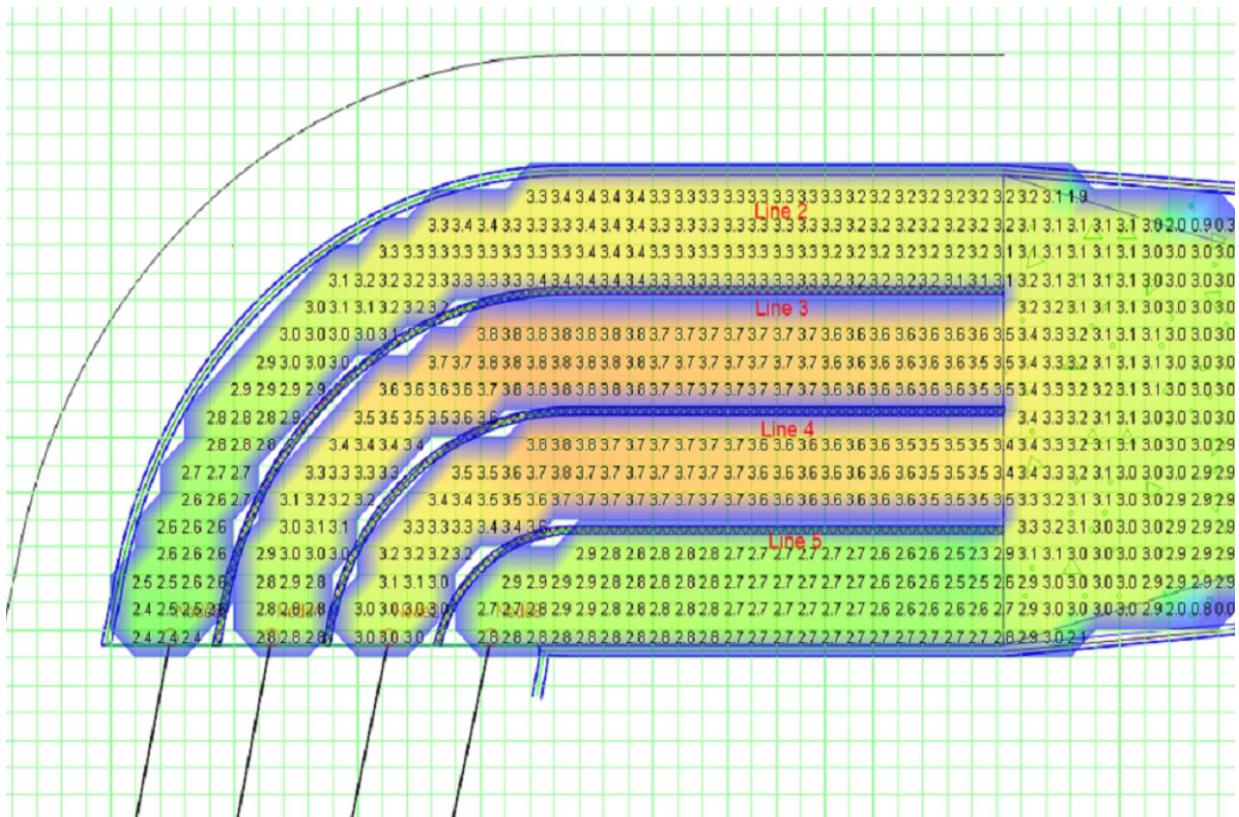

Sections	Line 2	Line 3	Line 4	Line 5
Discharge (cfs)	94	103	106	100

Figure 26: Union Hills Channel Bend Flow depth



6. Downstream Impacts

The proposed drainage design will discharge 403 cfs (Table 12 – 100-year Peak Discharge for Junction-1) downstream along the Hayden Road Channel to Reach 11 Impoundment Area. The proposed flow will increase the flow above existing conditions, but will not exceed the flow of 2,500 cfs that the Hayden Road channel was designed for (Development Engineering, Inc., 1994). Appendix K contains the drainage report prepared for the Stonebrook development. The existing Union Hills culvert was built to convey 1500 cfs under the roadway per As-built drawings received from the City of Scottsdale from the Hayden Rd. – Frank Lloyd Wright to Loop 101 project (Appendix L). The Union Hills model was extended down to Reach 11 (downstream of the Stonebrook Subdivision) using the topography from 2010 and verifying that the flow is contained in the channel.



APPENDIX

- Appendix A: Hydrology Calculations
- Appendix B: HY-8 Rating Table
- Appendix C: StomCAD Output
- Appendix D: HEC-RAS, WSPGW and XPSWMM Output
- Appendix F: Hualapai Channel FlowMaster
- Appendix G: Concrete Rubble Specification (FCDMC Hydraulics Manual)
- Appendix H: Riprap Spillways
- Appendix I: Powerline Channel Baffle Chute Spillway
- Appendix J: ADOT Permit No. 88283
- Appendix K: Stonebrook Drainage Report
- Appendix L: As-builts
- Appendix M: Structural Calculations




Appendix D:HEC-RAS, WSPGW and XPSWMM Output

- **Existing Powerline Channel** (North of Thompson Peak Pkwy)
- **Proposed Powerline Channel** (South of Legacy Blvd. to Basin 53R)
- **Proposed Union Hills Channel**

WSPGW Model - (Outfall of 2 – 60” CMP ties to Union Hills Dr. and Hayden Rd.)

XPSWMM Model – (Channel transition, Channel bend and Culvert entrance)


Proposed Union Hills Channel

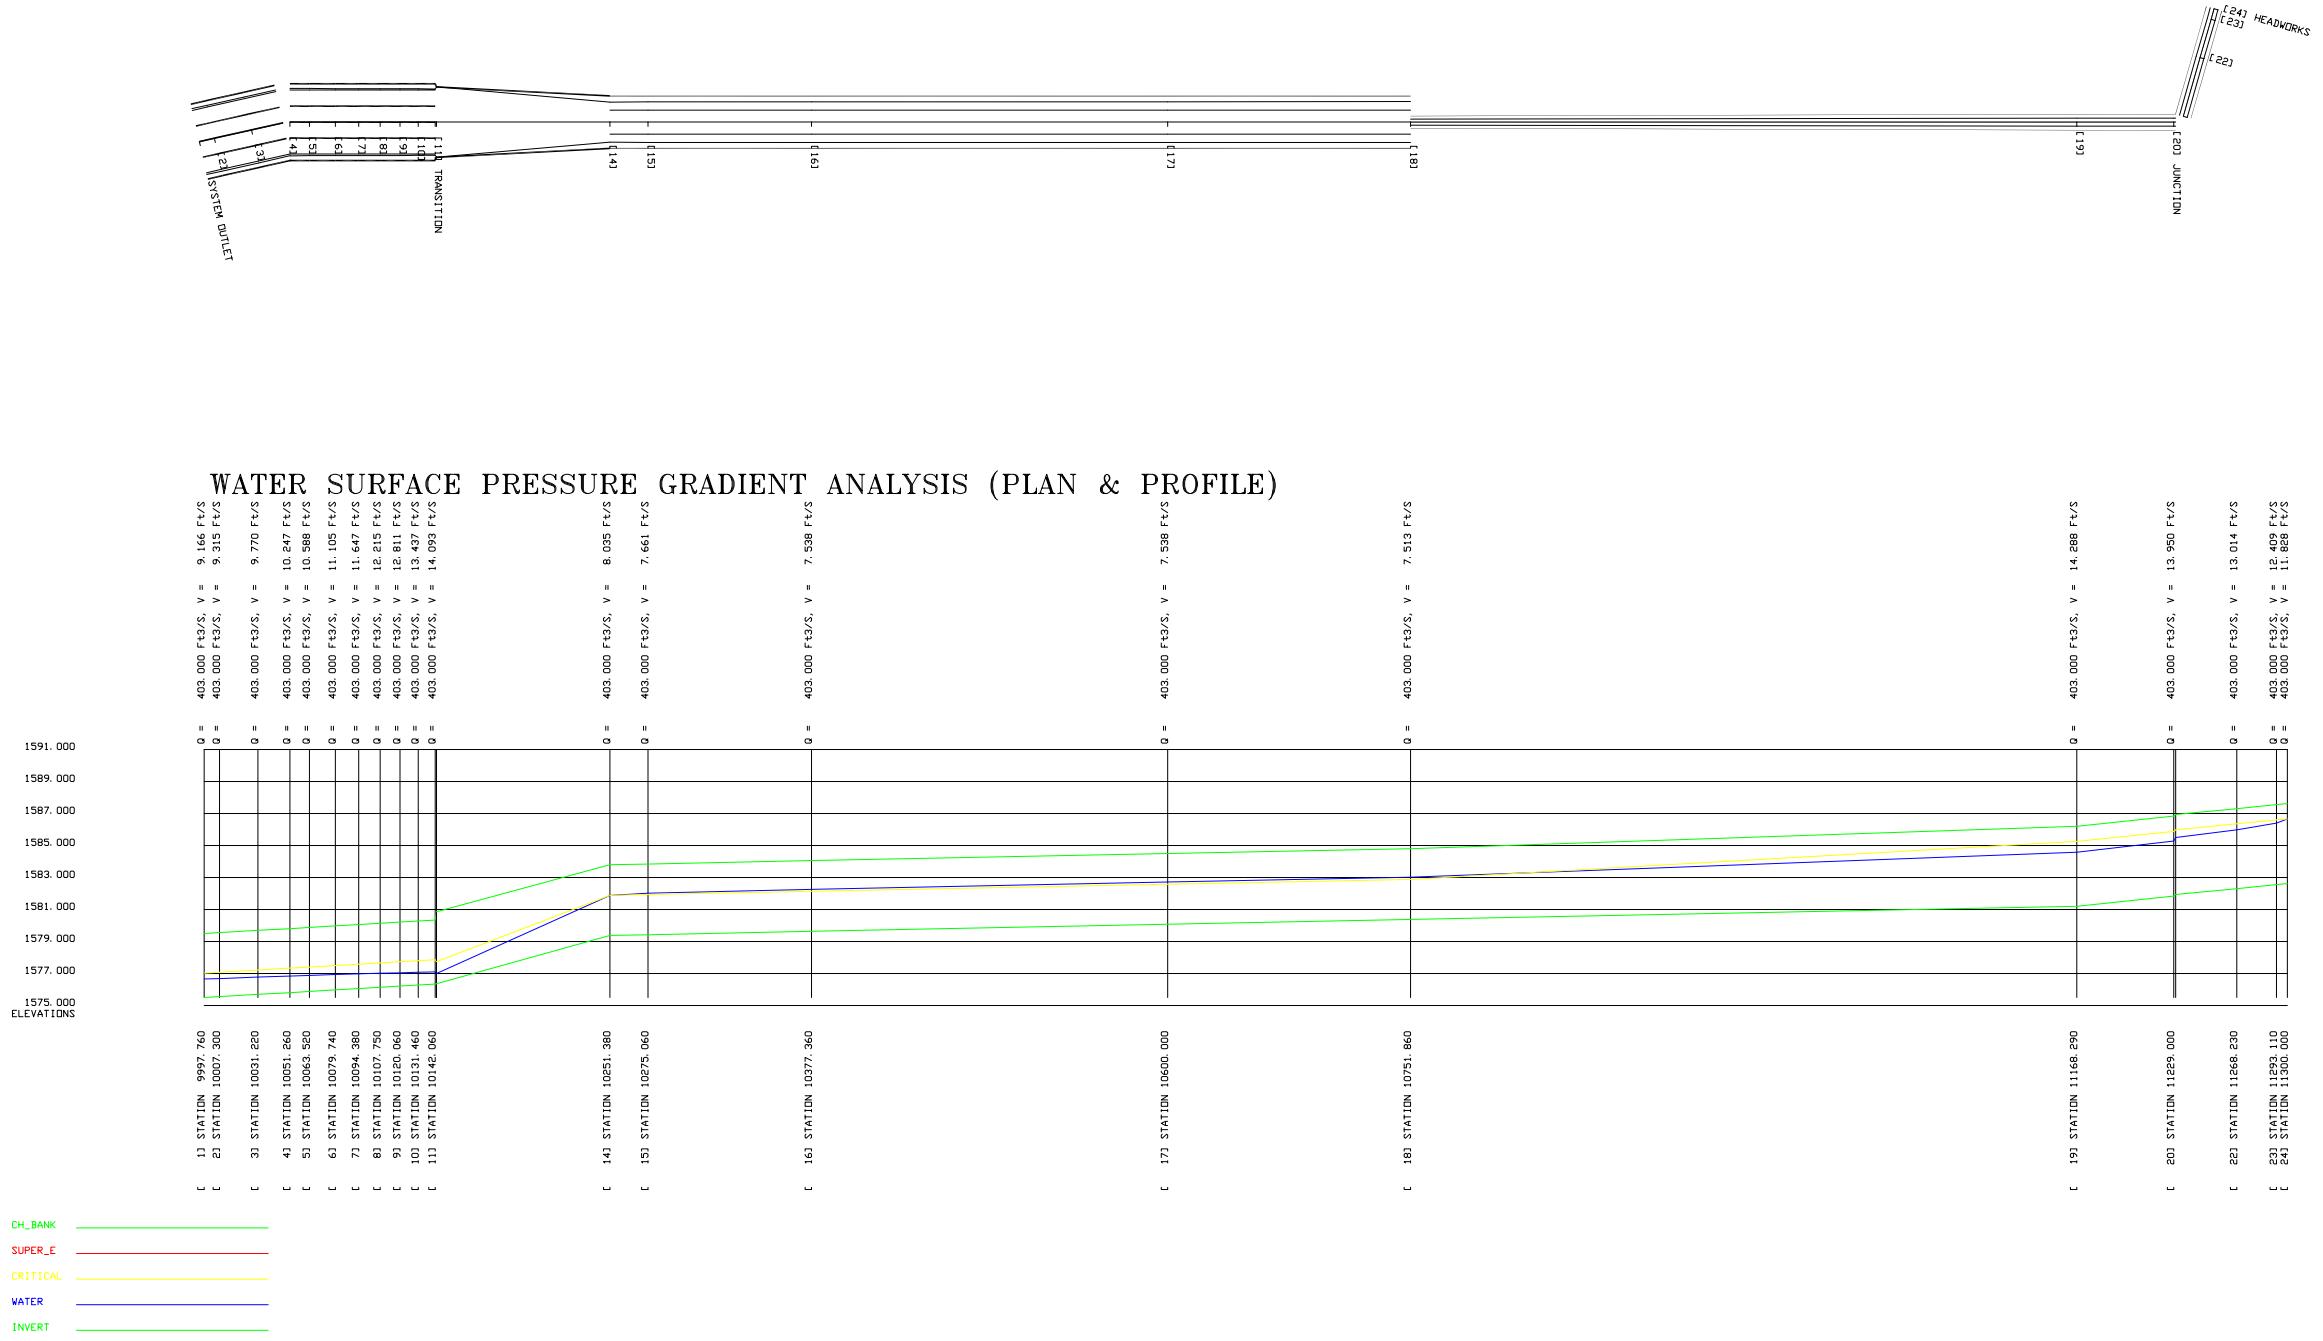

STATION [No.]	OPERATION TYPE	STATION	INV ELEV (FT)	WATER LEVEL	CHAN HT	CHANNEL TYPE	MANNING'S "N"	# PIER/PIP	FLOW RATE	VELOCITY	TOP WIDTH	CHAN WDTH PIER	PIER WIDTH	ZL	ZR	SUPEL RT B	SUPEL LT B	CRIT DPTH	RADIUS/< PT	
		(FT)	(FT)	(FT)	(FT)				(CFS)	(FT/S)	(FT)	(FT)	(FT)			(FT)	(FT)	(FT)		
[1]	SYSTEM OUTLET	9997.76	1575.500	1.152	4.00	BOX		0.014	3	403	9.166	42.305	40	1.00	1	1	0	0	1.523	0.000
[2]	REACH	10007.30	1575.555	1.135	4.00	BOX		0.014	3	403	9.315	42.269	40	1.00	1	1	0	0	1.523	0.000
[3]	REACH	10031.22	1575.694	1.083	4.00	BOX		0.014	3	403	9.770	42.166	40	1.00	1	1	0	0	1.523	0.000
[4]	REACH	10051.26	1575.810	1.034	4.00	BOX		0.014	3	403	10.247	42.068	40	1.00	1	1	0	0	1.523	12.602
[5]	REACH	10063.52	1575.882	1.001	4.00	BOX		0.014	3	403	10.588	42.003	40	1.00	1	1	0	0	1.523	0.000
[6]	REACH	10079.74	1575.976	0.956	4.00	BOX		0.014	3	403	11.105	41.912	40	1.00	1	1	0	0	1.523	0.000
[7]	REACH	10094.38	1576.062	0.912	4.00	BOX		0.014	3	403	11.647	41.825	40	1.00	1	1	0	0	1.523	0.000
[8]	REACH	10107.75	1576.140	0.871	4.00	BOX		0.014	3	403	12.215	41.742	40	1.00	1	1	0	0	1.523	0.000
[9]	REACH	10120.06	1576.212	0.831	4.00	BOX		0.014	3	403	12.811	41.663	40	1.00	1	1	0	0	1.523	0.000
[10]	REACH	10131.46	1576.278	0.794	4.00	BOX		0.014	3	403	13.437	41.587	40	1.00	1	1	0	0	1.523	0.000
[11]	REACH	10142.06	1576.340	0.757	4.00	BOX		0.014	3	403	14.093	41.515	40	1.00	1	1	0	0	1.523	0.000
[12]	TRANSITION	10142.90	1576.360	0.621	4.50	RECTANGULAR		0.014	0	403	14.741	44.000	44	0.00	0	0	0	0	1.376	0.000
[13]	REACH	10143.00	1576.370	0.622	4.50	RECTANGULAR		0.014	0	403	14.730	44.000	44	0.00	0	0	0	0	1.376	0.000
[14]	TRANSITION	10251.38	1579.380	2.506	4.42	TRAPEZOIDAL		0.014	0	403	8.035	25.024	15	0.00	2	2	0	0	2.506	0.000
[15]	REACH	10275.06	1579.427	2.604	4.42	TRAPEZOIDAL		0.014	0	403	7.661	25.413	15	0.00	2	2	0	0	2.506	0.000
[16]	REACH	10377.36	1579.633	2.637	4.42	TRAPEZOIDAL		0.014	0	403	7.538	25.548	15	0.00	2	2	0	0	2.506	0.000
[17]	REACH	10600.00	1580.080	2.637	4.42	TRAPEZOIDAL		0.014	0	403	7.538	25.548	15	0.00	2	2	0	0	2.506	0.000
[18]	REACH	10751.86	1580.382	2.644	4.42	TRAPEZOIDAL		0.014	0	403	7.513	25.576	15	0.00	2	2	0	0	2.506	0.000
[19]	REACH	11168.29	1581.210	3.375	5.00	PIPE		0.013	2	403	14.288	4.683	10	0.25	0	0	0	0	4.049	0.000
[20]	REACH	11229.00	1581.840	3.449	5.00	PIPE		0.013	2	403	13.950	4.626	10	0.25	0	0	0	0	4.049	0.000
[21]	JUNCTION	11230.01	1581.940	3.56	5.00	PIPE		0.013	2	403	13.475	4.528	10	0.25	0	0	0	0	4.049	-74.000
[22]	REACH	11268.23	1582.311	3.679	5.00	PIPE		0.013	2	403	13.014	4.410	10	0.25	0	0	0	0	4.049	0.000
[23]	REACH	11293.11	1582.553	3.854	5.00	PIPE		0.013	2	403	12.409	4.204	10	0.25	0	0	0	0	4.049	0.000
[24]	HEADWORKS	11300.00	1582.620	4.049	5.00	PIPE		0.013	2	403	11.828	3.924	10	0.25	0	0	0	0	4.049	0.000


Scale, Vertical = 4.000 Horizontal = 40.000
 Height = 4.000 Width = 40.000
 Top Width = 42.305 Number of Piers/pipes = 3
 Critical Depth = 1.523 Mannings N = .014
 Invert = 1575.500 Water Surface = 1576.652
 BOX Velocity = 9.166 Flow = 403.000

[1] STATION = 9997.760

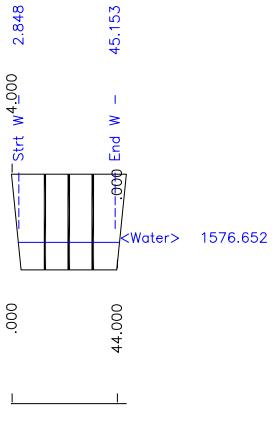


Scale, Vertical = 4.000 Horizontal = 40.000
 Height = 4.000 Width = 40.000
 Top Width = 41.825 Number of Piers/pipes = 3
 Critical Depth = 1.523 Mannings N = .014
 Invert = 1576.062 Water Surface = 1576.974
 BOX Velocity = 11.647 Flow = 403.000

[7] STATION = 10094.380

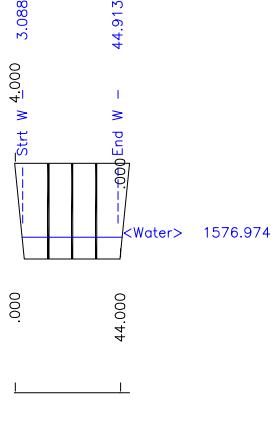


Scale, Vertical = 4.000 Horizontal = 40.000
 Height = 4.000 Width = 40.000
 Top Width = 42.269 Number of Piers/pipes = 3
 Critical Depth = 1.523 Mannings N = .014
 Invert = 1575.555 Water Surface = 1576.690
 BOX Velocity = 9.315 Flow = 403.000

[2] STATION = 10007.300

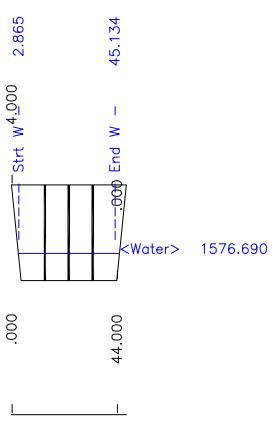


Scale, Vertical = 4.000 Horizontal = 40.000
 Height = 4.000 Width = 40.000
 Top Width = 41.742 Number of Piers/pipes = 3
 Critical Depth = 1.523 Mannings N = .014
 Invert = 1576.140 Water Surface = 1577.011
 BOX Velocity = 12.215 Flow = 403.000

[8] STATION = 10107.750

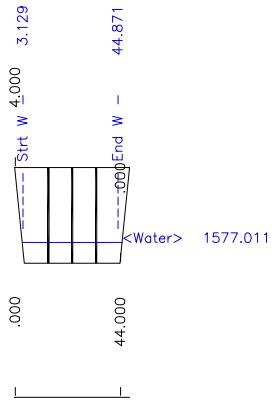


Scale, Vertical = 4.000 Horizontal = 40.000
 Height = 4.000 Width = 40.000
 Top Width = 42.166 Number of Piers/pipes = 3
 Critical Depth = 1.523 Mannings N = .014
 Invert = 1575.694 Water Surface = 1576.777
 BOX Velocity = 9.770 Flow = 403.000

[3] STATION = 10031.220

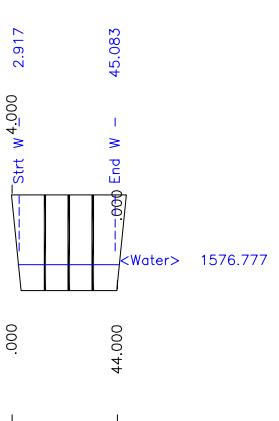


Scale, Vertical = 4.000 Horizontal = 40.000
 Height = 4.000 Width = 40.000
 Top Width = 41.663 Number of Piers/pipes = 3
 Critical Depth = 1.523 Mannings N = .014
 Invert = 1576.212 Water Surface = 1577.043
 BOX Velocity = 12.811 Flow = 403.000

[9] STATION = 10120.060




Scale, Vertical = 4.000 Horizontal = 40.000
 Height = 4.000 Width = 40.000
 Top Width = 42.068 Number of Piers/pipes = 3
 Critical Depth = 1.523 Mannings N = .014
 Invert = 1575.810 Water Surface = 1576.844
 BOX Velocity = 10.247 Flow = 403.000

[4] STATION = 10051.260

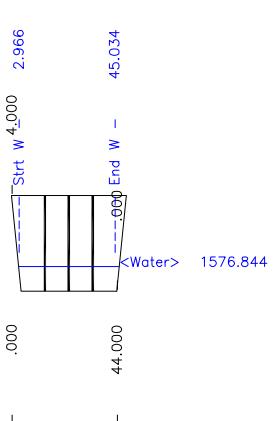


Scale, Vertical = 4.000 Horizontal = 40.000
 Height = 4.000 Width = 40.000
 Top Width = 41.587 Number of Piers/pipes = 3
 Critical Depth = 1.523 Mannings N = .014
 Invert = 1576.278 Water Surface = 1577.072
 BOX Velocity = 13.437 Flow = 403.000

[10] STATION = 10131.460




Scale, Vertical = 4.000 Horizontal = 40.000
 Height = 4.000 Width = 40.000
 Top Width = 42.003 Number of Piers/pipes = 3
 Critical Depth = 1.523 Mannings N = .014
 Invert = 1575.882 Water Surface = 1576.883
 BOX Velocity = 10.588 Flow = 403.000

[5] STATION = 10063.520

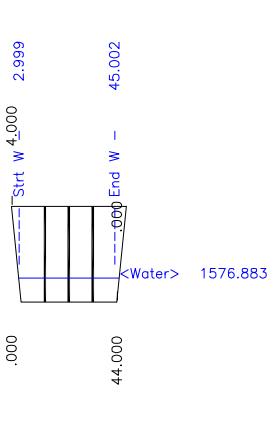


Scale, Vertical = 4.000 Horizontal = 40.000
 Height = 4.000 Width = 40.000
 TRANSITION
 Top Width = 41.515 Number of Piers/pipes = 3
 Critical Depth = 1.523 Mannings N = .014
 Invert = 1576.340 Water Surface = 1577.097
 BOX Velocity = 14.093 Flow = 403.000

[11] STATION = 10142.060




Scale, Vertical = 4.000 Horizontal = 40.000
 Height = 4.000 Width = 40.000
 Top Width = 41.912 Number of Piers/pipes = 3
 Critical Depth = 1.523 Mannings N = .014
 Invert = 1575.976 Water Surface = 1576.932
 BOX Velocity = 11.105 Flow = 403.000

[6] STATION = 10079.740

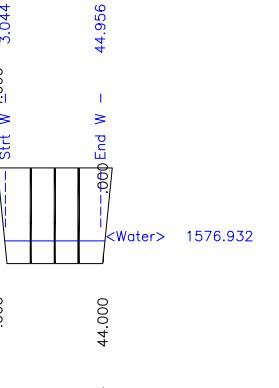


Scale, Vertical = 4.000 Horizontal = 40.000
 Height = 4.500 Width = 44.000
 Top Width = 44.000 Number of Piers/pipes = 0
 Critical Depth = 1.376 Mannings N = .014
 Lt Super EI = .000 Rt Super EI = .000
 Invert = 1576.360 Water Surface = 1576.981
 RECTANGULAR Velocity = 14.741 Flow = 403.000

[12] STATION = 10142.900




Scale, Vertical = 4.000 Horizontal = 40.000
 Height = 4.500 Width = 44.000
TRANSITION
 Top Width = 44.000 Number of Piers/pipes = 0
 Critical Depth = 1.376 Mannings N = .014
 Lt Super El = .000 Rt Super El = .000
 Invert = 1576.370 Water Surface = 1576.992
RECTANGULAR Velocity = 14.730 Flow = 403.000

[13] STATION = 10143.000

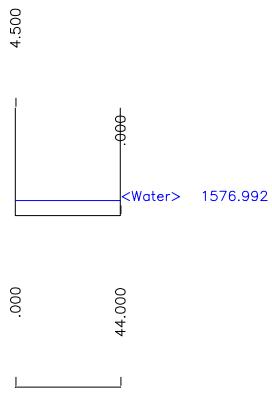


Scale, Vertical = 4.000 Horizontal = 40.000
 Height = 5.000 Width = 10.000
TRANSITION
 Top Width = 4.683 Number of Piers/pipes = 2
 Critical Depth = 4.049 Mannings N = .013
 Invert = 1581.210 Water Surface = 1584.585
PIPE Velocity = 14.288 Flow = 403.000

[19] STATION = 11168.290

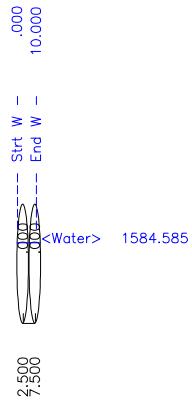


Scale, Vertical = 4.000 Horizontal = 40.000
 Height = 4.420 Width = 15.000
TRANSITION
 Top Width = 25.024 Number of Piers/pipes = 0
 Critical Depth = 2.506 Mannings N = .014
 Lt Super El = .000 Rt Super El = .000
 Invert = 1579.380 Water Surface = 1581.886
TRAPEZOIDAL Velocity = 8.035 Flow = 403.000

[14] STATION = 10251.380

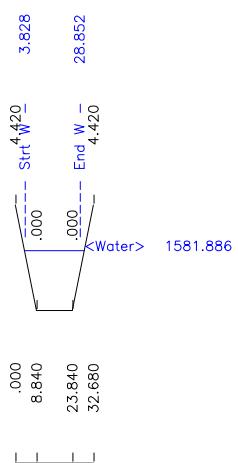


Scale, Vertical = 4.000 Horizontal = 40.000
 Height = 5.000 Width = 10.000
JUNCTION
 Top Width = 4.626 Number of Piers/pipes = 2
 Critical Depth = 4.049 Mannings N = .013
 Invert = 1581.840 Water Surface = 1585.289
PIPE Velocity = 13.950 Flow = 403.000

[20] STATION = 11229.000

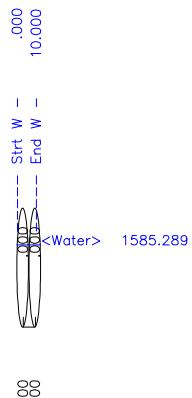


Scale, Vertical = 4.000 Horizontal = 40.000
 Height = 4.420 Width = 15.000
TRANSITION
 Top Width = 25.413 Number of Piers/pipes = 0
 Critical Depth = 2.506 Mannings N = .014
 Lt Super El = .000 Rt Super El = .000
 Invert = 1579.427 Water Surface = 1582.031
TRAPEZOIDAL Velocity = 7.661 Flow = 403.000

[15] STATION = 10275.060

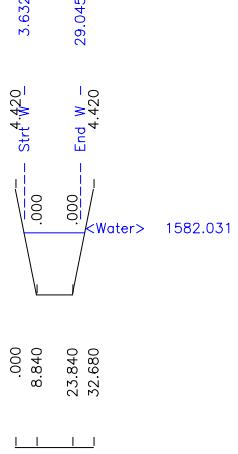


Scale, Vertical = 4.000 Horizontal = 40.000
 Height = 5.000 Width = 10.000
TRANSITION
 Top Width = 4.528 Number of Piers/pipes = 2
 Critical Depth = 4.049 Mannings N = .013
 Invert = 1581.940 Water Surface = 1585.500
PIPE Velocity = 13.475 Flow = 403.000

[21] STATION = 11230.010

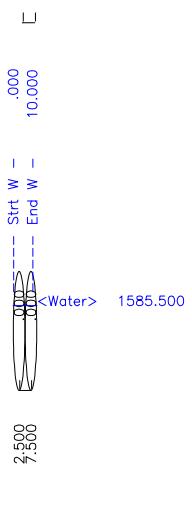


Scale, Vertical = 4.000 Horizontal = 40.000
 Height = 4.420 Width = 15.000
TRANSITION
 Top Width = 25.548 Number of Piers/pipes = 0
 Critical Depth = 2.506 Mannings N = .014
 Lt Super El = .000 Rt Super El = .000
 Invert = 1579.633 Water Surface = 1582.270
TRAPEZOIDAL Velocity = 7.538 Flow = 403.000

[16] STATION = 10377.360




Scale, Vertical = 4.000 Horizontal = 40.000
 Height = 5.000 Width = 10.000
TRANSITION
 Top Width = 4.410 Number of Piers/pipes = 2
 Critical Depth = 4.049 Mannings N = .013
 Invert = 1582.311 Water Surface = 1585.990
PIPE Velocity = 13.014 Flow = 403.000

[22] STATION = 11268.230




Scale, Vertical = 4.000 Horizontal = 40.000
 Height = 4.420 Width = 15.000
TRANSITION
 Top Width = 25.548 Number of Piers/pipes = 0
 Critical Depth = 2.506 Mannings N = .014
 Lt Super El = .000 Rt Super El = .000
 Invert = 1580.080 Water Surface = 1582.717
TRAPEZOIDAL Velocity = 7.538 Flow = 403.000

[17] STATION = 10600.000

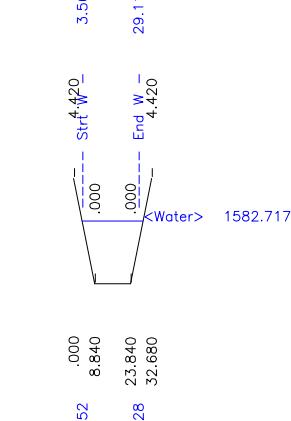


Scale, Vertical = 4.000 Horizontal = 40.000
 Height = 5.000 Width = 10.000
TRANSITION
 Top Width = 4.204 Number of Piers/pipes = 2
 Critical Depth = 4.049 Mannings N = .013
 Invert = 1582.553 Water Surface = 1586.407
PIPE Velocity = 12.409 Flow = 403.000

[23] STATION = 11293.110

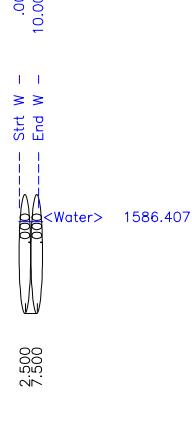


Scale, Vertical = 4.000 Horizontal = 40.000
 Height = 4.420 Width = 15.000
TRANSITION
 Top Width = 25.576 Number of Piers/pipes = 0
 Critical Depth = 2.506 Mannings N = .014
 Lt Super El = .000 Rt Super El = .000
 Invert = 1580.382 Water Surface = 1583.026
TRAPEZOIDAL Velocity = 7.513 Flow = 403.000

[18] STATION = 10751.860

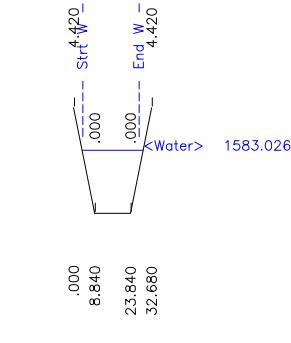

Scale, Vertical = 4.000 Horizontal = 40.000
 Height = 5.000 Width = 10.000
HEADWORKS
 Top Width = 3.924 Number of Piers/pipes = 2
 Critical Depth = 4.049 Mannings N = .013
 Invert = 1582.620 Water Surface = 1586.669
PIPE Velocity = 11.828 Flow = 403.000

[24] STATION = 11300.000

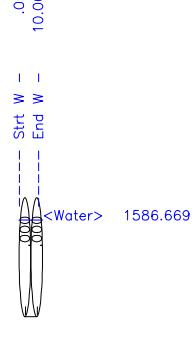

T1	UnionHills_Channel		0			
T2						
T3						
SO	9997.7601575.500	3	1577.140			
R	10051.2601575.810	3	.014	.000	12.602	0
R	10142.0601576.340	3	.014	.000		
TS	10142.9001576.360	1	.014	.000		
R	10143.0001576.370	1	.014	.000		
TS	10251.3801579.380	4	.014	.000		
R	10600.0001580.080	4	.014	.000		
R	11168.2901581.210	4	.014	.000		
R	11229.0001581.840	2	.013	.000	.000	0
JX	11230.0001581.940	2	.013			
R	11230.0101581.940	2	.013	.000	-74.000	0
R	11300.0001582.620	2	.013	.000	-74.000	1
SH	11300.0001582.620	2		1582.620		
CD	1 2 0 .000	4.500	44.000	.000	.000	.00
CD	2 4 2 .000	5.000	15.000	2.000	2.000	.00
CD	3 3 3 1.000	4.000	40.000	1.000	1.000	.00
CD	4 1 0 .000	4.420	15.000	2.000	2.000	.00
Q		403.000	.0			

FILE: UnionHills_Channel.WSW

W S P G W - EDIT LISTING - Version 14.10
 WATER SURFACE PROFILE - CHANNEL DEFINITION LISTING

Date: 3- 2-2020 Time: 6:34:17
 PAGE 1

CARD CODE	SECT NO	CHN TYPE	NO OF PIER/PIP	AVE WIDTH	PIER	HEIGHT DIAMETER	BASE	ZL	ZR	INV	Y(1)	Y(2)	Y(3)	Y(4)	Y(5)	Y(6)	Y(7)	Y(8)	Y(9)	Y(10)
CD	1	2	0	.000	4.500	44.000														
CD	2	4	2		5.000															
CD	3	3	3	1.000	4.000	40.000	1.000	1.000												
CD	4	1	0	.000	4.420	15.000	2.000	2.000												

W S P G W

PAGE NO 1

WATER SURFACE PROFILE - TITLE CARD LISTING

HEADING LINE NO 1 IS -

UnionHills_Channel

HEADING LINE NO 2 IS -

HEADING LINE NO 3 IS -

W S P G W

WATER SURFACE PROFILE - ELEMENT CARD LISTING

PAGE NO 2

ELEMENT NO	1 IS A SYSTEM OUTLET	*	*	*	U/S DATA	STATION	INVERT	SECT	W S ELEV				
		*	*	*	9997.760	1575.500		3	1577.140				
ELEMENT NO	2 IS A REACH	*	*	*	U/S DATA	STATION	INVERT	SECT	RADIUS	ANGLE	ANG PT	MAN H	
		*	*	*	10051.260	1575.810		3	.000	.000	12.602	0	
ELEMENT NO	3 IS A REACH	*	*	*	U/S DATA	STATION	INVERT	SECT	N	RADIUS	ANGLE	ANG PT	MAN H
		*	*	*	10142.060	1576.340		3	.000	.000	.000	0	
ELEMENT NO	4 IS A TRANSITION	*	*	*	U/S DATA	STATION	INVERT	SECT	N	RADIUS	ANGLE		
		*	*	*	10142.900	1576.360		1	.000	.000			
ELEMENT NO	5 IS A REACH	*	*	*	U/S DATA	STATION	INVERT	SECT	N	RADIUS	ANGLE	ANG PT	MAN H
		*	*	*	10143.000	1576.370		1	.000	.000	.000	0	
ELEMENT NO	6 IS A TRANSITION	*	*	*	U/S DATA	STATION	INVERT	SECT	N	RADIUS	ANGLE		
		*	*	*	10251.380	1579.380		4	.000	.000			
ELEMENT NO	7 IS A REACH	*	*	*	U/S DATA	STATION	INVERT	SECT	N	RADIUS	ANGLE	ANG PT	MAN H
		*	*	*	10600.000	1580.080		4	.000	.000	.000	0	
ELEMENT NO	8 IS A REACH	*	*	*	U/S DATA	STATION	INVERT	SECT	N	RADIUS	ANGLE	ANG PT	MAN H
		*	*	*	11168.290	1581.210		4	.000	.000	.000	0	

WARNING - ADJACENT SECTIONS ARE NOT IDENTICAL - SEE SECTION NUMBERS AND CHANNEL DEFINITIONS

ELEMENT NO	9 IS A REACH	*	*	*	U/S DATA	STATION	INVERT	SECT	N	RADIUS	ANGLE	ANG PT	MAN H				
		*	*	*	11229.000	1581.840		2	.000	.000	.000	0					
ELEMENT NO	10 IS A JUNCTION	*	*	*	U/S DATA	STATION	INVERT	SECT	LAT-1	LAT-2	N	Q3	Q4	INVERT-3	INVERT-4	PHI 3	PHI 4
		*	*	*	11230.000	1581.940		2	0	0	.013	.000	.000	.000	.000	.000	
ELEMENT NO	11 IS A REACH	*	*	*	U/S DATA	STATION	INVERT	SECT	N	RADIUS	ANGLE	ANG PT	MAN H				
		*	*	*	11230.010	1581.940		2	.000	.000	-74.000	0					

W S P G W

PAGE NO 3

WATER SURFACE PROFILE - ELEMENT CARD LISTING

ELEMENT NO	12 IS A REACH	*	*	*	U/S DATA	STATION	INVERT	SECT	N	RADIUS	ANGLE	ANG PT	MAN H
		*	*	*	11300.000	1582.620		2	.000	.000	-74.000	1	

ELEMENT NO 13 IS A SYSTEM HEADWORKS *
U/S DATA STATION INVERT SECT
11300.000 1582.620 2

*
W S ELEV
1582.620

UnionHills_Channel

Station	Invert Elev	Depth (FT)	Water Elev	Q (CFS)	Vel (FPS)	Vel Head	Energy Grd.El.	Super Elev	Flow Depth	Top Width	Height Dia.-FT	Base or I.D.	ZL	No Prs/Pip Wth	
L/Elem	Ch Slope														Type Ch
9997.760	1575.500	1.152	1576.652	403.00	9.17	1.30	1577.96	.00	1.52	42.30	4.000	40.000	1.00	3 1.0	
9.537	.0058							.0084	.08	1.15	1.58	1.29	.014	.00 1.00 BOX	
10007.300	1575.555	1.134	1576.690	403.00	9.32	1.35	1578.04	.00	1.52	42.27	4.000	40.000	1.00	3 1.0	
23.923	.0058							.0093	.22	1.13	1.62	1.29	.014	.00 1.00 BOX	
10031.220	1575.694	1.083	1576.777	403.00	9.77	1.48	1578.26	.00	1.52	42.17	4.000	40.000	1.00	3 1.0	
20.040	.0058							.0107	.22	1.08	1.74	1.29	.014	.00 1.00 BOX	
10051.260	1575.810	1.034	1576.844	403.00	10.25	1.63	1578.47	.00	1.52	42.07	4.000	40.000	1.00	3 1.0	
12.256	.0058							.0121	.15	1.03	1.87	1.28	.014	.00 1.00 BOX	
10063.520	1575.882	1.002	1576.883	403.00	10.59	1.74	1578.62	.00	1.52	42.00	4.000	40.000	1.00	3 1.0	
16.228	.0058							.0138	.22	1.00	1.96	1.28	.014	.00 1.00 BOX	
10079.740	1575.976	.956	1576.932	403.00	11.10	1.91	1578.85	.00	1.52	41.91	4.000	40.000	1.00	3 1.0	
14.642	.0058							.0159	.23	.96	2.10	1.28	.014	.00 1.00 BOX	
10094.380	1576.062	.913	1576.974	403.00	11.65	2.11	1579.08	.00	1.52	41.83	4.000	40.000	1.00	3 1.0	
13.369	.0058							.0185	.25	.91	2.26	1.28	.014	.00 1.00 BOX	
10107.750	1576.140	.871	1577.011	403.00	12.22	2.32	1579.33	.00	1.52	41.74	4.000	40.000	1.00	3 1.0	
12.308	.0058							.0214	.26	.87	2.42	1.28	.014	.00 1.00 BOX	
10120.060	1576.212	.831	1577.043	403.00	12.81	2.55	1579.59	.00	1.52	41.66	4.000	40.000	1.00	3 1.0	
11.397	.0058							.0249	.28	.83	2.60	1.28	.014	.00 1.00 BOX	

UnionHills_Channel

Station	Invert Elev	Depth (FT)	Water Elev	Q (CFS)	Vel (FPS)	Vel Head	Grd.El.	Elev	Depth	Width	Dia.-FT	or I.D.	ZL	Prs/Pip	No Wth
L/Elem	Ch Slope						SF Ave	HF	SE Dpth	Froude N	Norm Dp	"N"	X-Fall	ZR	Type Ch
10131.460	1576.278	.794	1577.072	403.00	13.44	2.80	1579.88	.00	1.52	41.59	4.000	40.000	1.00	3 1.0	
	10.601	.0058						.0289	.31	.79	2.79	1.28	.014	.00 1.00	
10142.060	1576.340	.757	1577.097	403.00	14.09	3.08	1580.18	.00	1.52	41.51	4.000	40.000	1.00	3 1.0	
	TRANS STR	.0238						.0344	.03	.76	2.99		.014	.00 1.00	
10142.900	1576.360	.621	1576.981	403.00	14.74	3.37	1580.36	.00	1.38	44.00	4.500	44.000	.00	0 .0	
	.100	.1005						.0377	.00	.62	3.30	.46	.014	.00 .00	
10143.000	1576.370	.622	1576.992	403.00	14.73	3.37	1580.36	.00	1.38	44.00	4.500	44.000	.00	0 .0	
	TRANS STR	.0278						.0200	2.17	.62	3.29		.014	.00 .00	
10251.380	1579.380	2.506	1581.886	403.00	8.04	1.00	1582.89	.00	2.51	25.02	4.420	15.000	2.00	0 .0	
	23.677	.0020						.0023	.05	2.51	1.00	2.64	.014	.00 2.00	
10275.060	1579.427	2.603	1582.031	403.00	7.66	.91	1582.94	.00	2.51	25.41	4.420	15.000	2.00	0 .0	
	102.306	.0020						.0021	.21	2.60	.94	2.64	.014	.00 2.00	
10377.360	1579.633	2.637	1582.270	403.00	7.54	.88	1583.15	.00	2.51	25.55	4.420	15.000	2.00	0 .0	
	222.639	.0020						.0020	.45	2.64	.92	2.64	.014	.00 2.00	
10600.000	1580.080	2.637	1582.717	403.00	7.54	.88	1583.60	.00	2.51	25.55	4.420	15.000	2.00	0 .0	
	151.856	.0020						.0020	.30	2.64	.92	2.64	.014	.00 2.00	
10751.860	1580.382	2.644	1583.026	403.00	7.51	.88	1583.90	.00	2.51	25.58	4.420	15.000	2.00	0 .0	
	416.434	.0020						.0020	.83	2.64	.91	2.64	.014	.00 2.00	
														TRAP	

UnionHills_Channel

Station	Invert Elev	Depth (FT)	Water Elev	Q (CFS)	Vel (FPS)	Vel Head	Energy Grd.El.	Super Elev	Flow Depth	Top Width	Base Dia.-FT	Flow I.D.	ZL	No Prs/Pip	Wth
L/Elem	Ch Slope						SF Ave	HF	SE Dpth	Froude N	Norm Dp	"N"	X-Fall	ZR	Type Ch
11168.290	1581.210	2.644	1583.854	403.00	7.51	.88	1584.73	.00	2.51	25.58	4.420	15.000	2.00	0	.0
60.710	.0104														PIPE
11229.000	1581.840	3.449	1585.289	403.00	13.95		3.02	1588.31	.00	4.05	4.63	5.000	.000	.00	2 .0
JUNCT STR	.1000														PIPE
11230.010	1581.940	3.560	1585.500	403.00	13.47	2.82	1588.32	.00	4.05	4.53	5.000	.000	.00	2 .0	
24.879	.0097														PIPE
11268.230	1582.311	3.678	1585.990	403.00	13.01	2.63	1588.62	.00	4.05	4.41	5.000	.000	.00	2 .0	
6.889	.0097														PIPE
11293.110	1582.553	3.854	1586.407	403.00	12.41	2.39	1588.80	.00	4.05	4.20	5.000	.000	.00	2 .0	
11300.000	1582.620	4.049	1586.669	403.00	11.83	2.17	1588.84	.00	4.05	3.92	5.000	.000	.00	2 .0	

Worksheet for Station 9997.76

Project Description

Friction Method	Manning Formula
Solve For	Normal Depth

Input Data

Channel Slope	0.009 ft/ft
Discharge	403.00 cfs

Section Definitions

Station (ft)	Elevation (ft)
0+00.00	1,580.14
0+02.14	1,580.08
0+04.16	1,579.97
0+14.14	1,579.27
0+18.16	1,578.97
0+26.14	1,578.47
0+28.14	1,578.16
0+30.14	1,577.78
0+38.14	1,576.16
0+40.14	1,575.79
0+42.14	1,575.52
0+54.14	1,575.08
0+62.12	1,575.08
0+64.14	1,575.05
0+66.14	1,575.14
0+76.12	1,576.57
0+78.12	1,576.93
0+86.14	1,578.71
0+88.14	1,579.27
0+94.14	1,579.17
0+96.14	1,578.88
0+98.14	1,578.84
1+00.14	1,578.86
1+01.85	1,578.90

Roughness Segment Definitions

Start Station	Ending Station	Roughness Coefficient
(0+00.00, 1,580.14)	(0+26.14, 1,578.47)	0.035
(0+26.14, 1,578.47)	(0+88.14, 1,579.27)	0.030
(0+88.14, 1,579.27)	(1+01.85, 1,578.90)	0.035

Options

Current Roughness Weighted Method	Pavlovskii's Method
Open Channel Weighting Method	Pavlovskii's Method

Worksheet for Station 9997.76

Options

Closed Channel Weighting Method	Pavlovskii's Method
---------------------------------	---------------------

Results

Normal Depth	2.09 ft
Elevation Range	1,575.1 to 1,580.1 ft
Flow Area	68.1 ft ²
Wetted Perimeter	46.1 ft
Hydraulic Radius	1.48 ft
Top Width	45.75 ft
Normal Depth	2.09 ft
Critical Depth	1.92 ft
Critical Slope	0.012 ft/ft
Velocity	5.92 ft/s
Velocity Head	0.55 ft
Specific Energy	2.63 ft
Froude Number	0.856
Flow Type	Subcritical

GVF Input Data

Downstream Depth	0.00 ft
Length	0.0 ft
Number Of Steps	0


GVF Output Data

Upstream Depth	0.00 ft
Profile Description	N/A
Profile Headloss	0.00 ft
Downstream Velocity	Infinity ft/s
Upstream Velocity	Infinity ft/s
Normal Depth	2.09 ft
Critical Depth	1.92 ft
Channel Slope	0.009 ft/ft
Critical Slope	0.012 ft/ft


**XPSWMM Model Results for
Proposed Union Hills Channel**

Flowrates: Flowlines defined in image below.

Alternatvie	Line 2	Line 3	Line 4	Line 5
Base	94	103	106	100

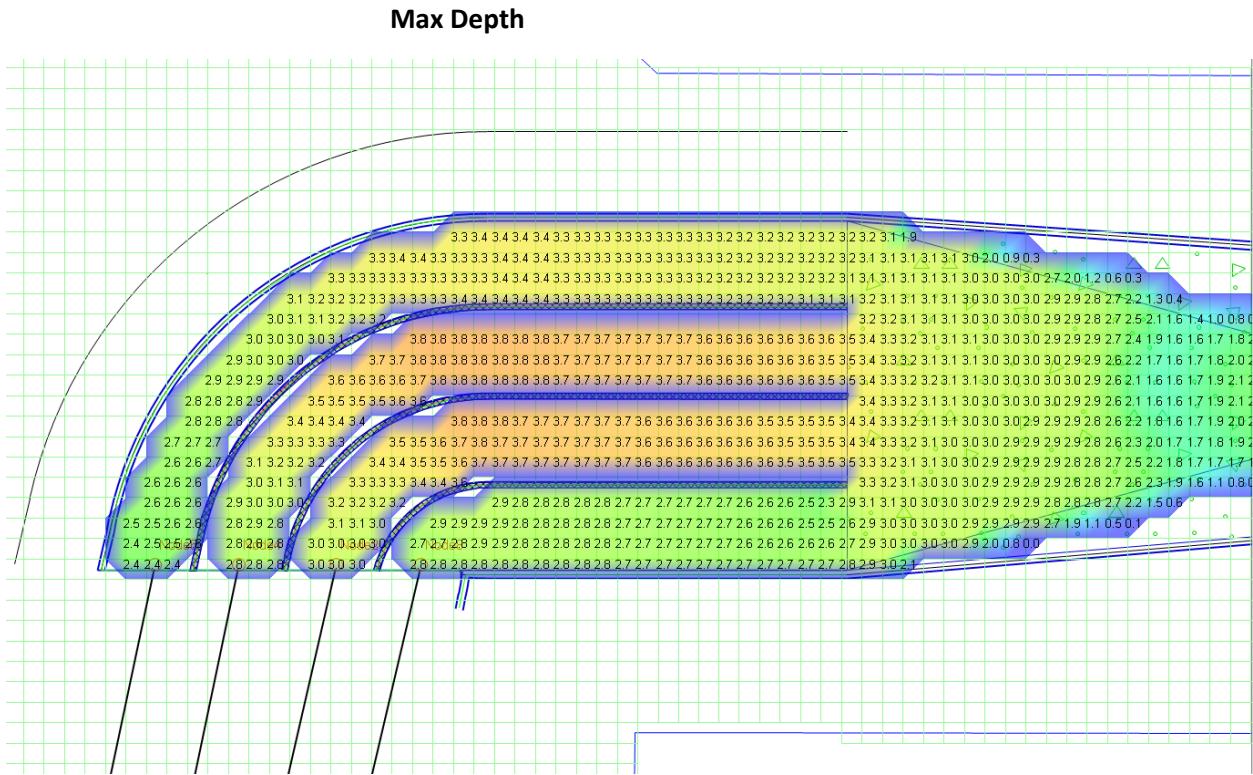

Max Velocity

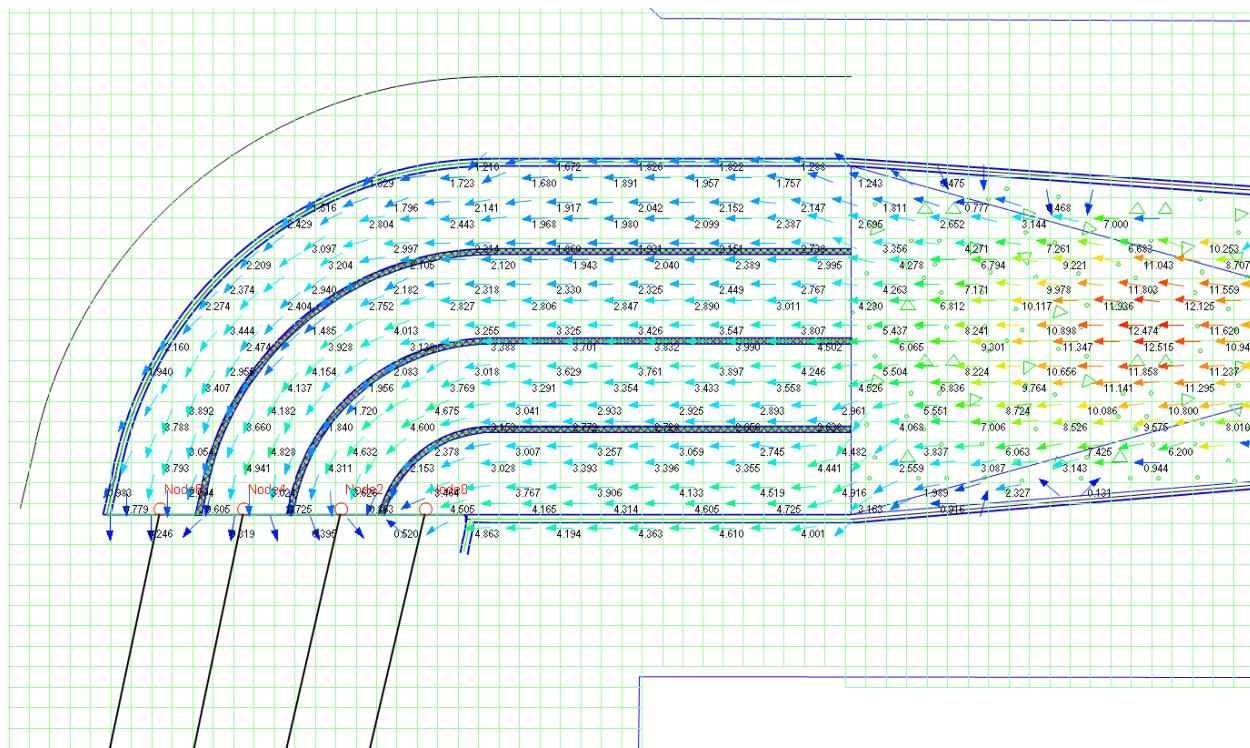



**Drainage Design Report
CROSSROADS EAST DRAINAGE INFRASTRUCTURE - PHASE 1**

Appendix L: As-builts



**Drainage Design Report
CROSSROADS EAST DRAINAGE INFRASTRUCTURE - PHASE 1**

EXHIBITS


Exhibit 1: Soil Data

Exhibit 2: Land Use

Exhibit 3: Sub-basin Flow Paths

Exhibit 4: Developed Conditions Peak Discharge Exhibit

Max Flow Depth

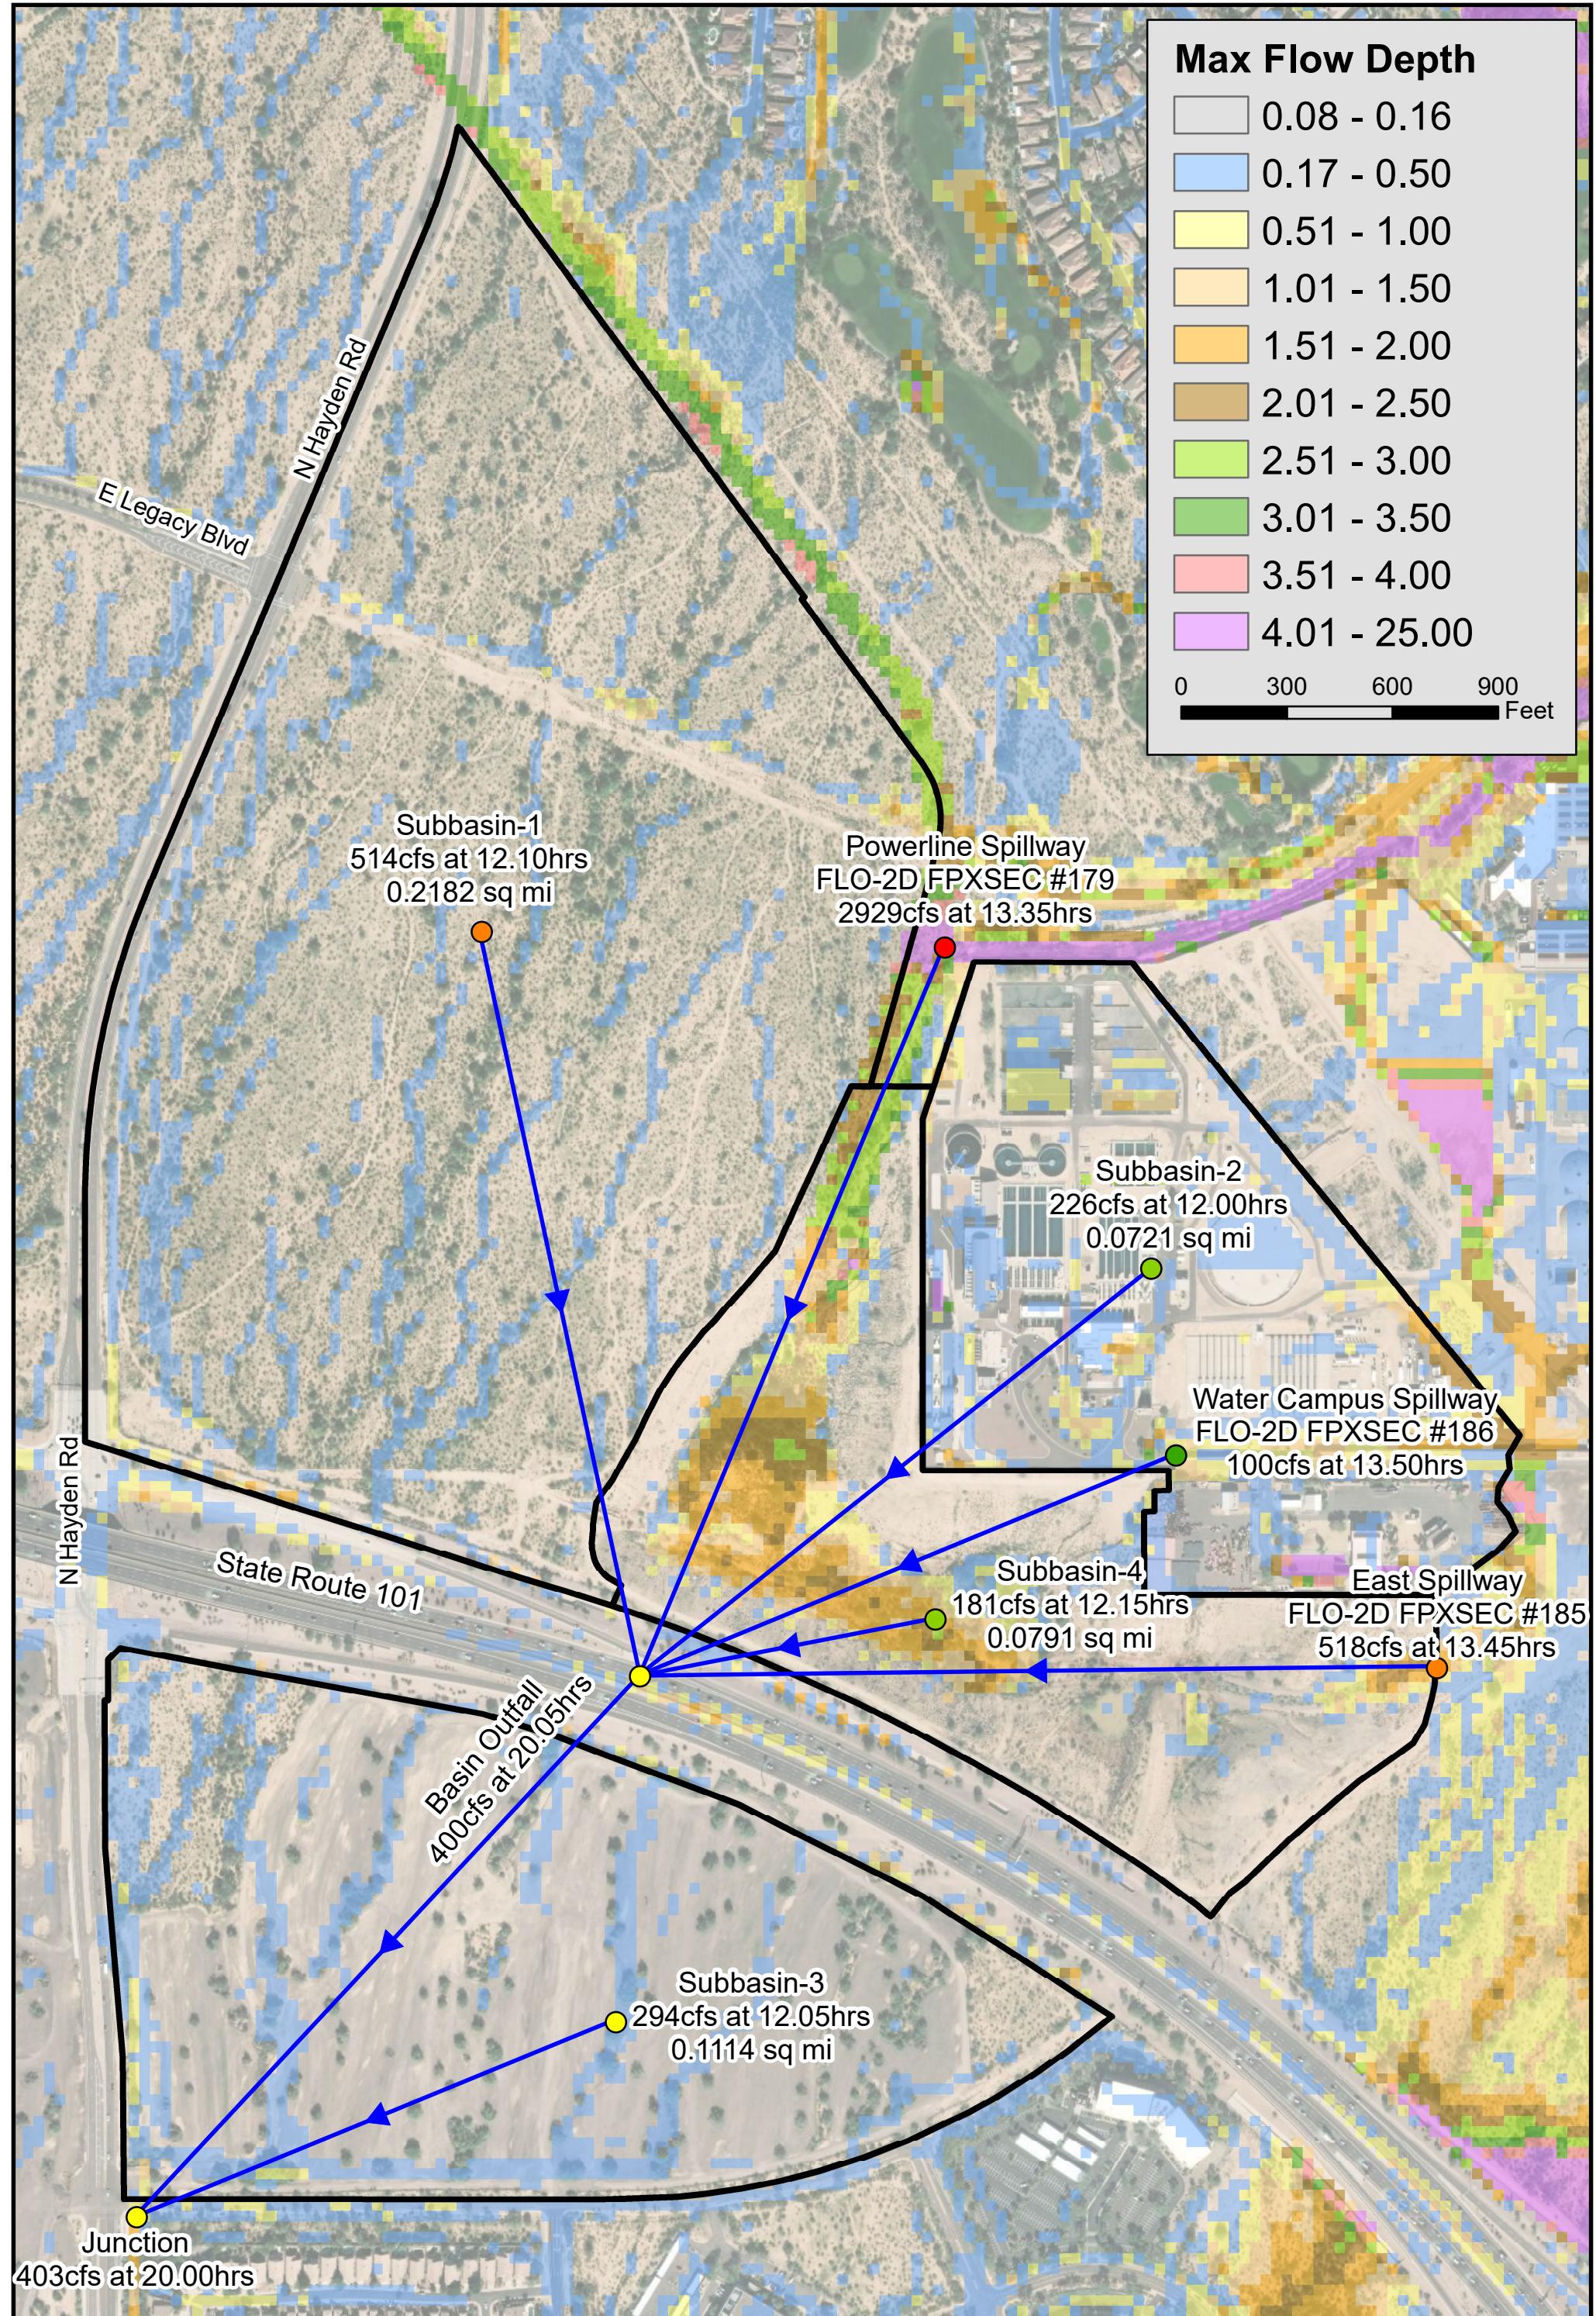

APPENDIX F – TY LIN INTERNATIONAL HEC-1 SCHEMATIC PHASE 1


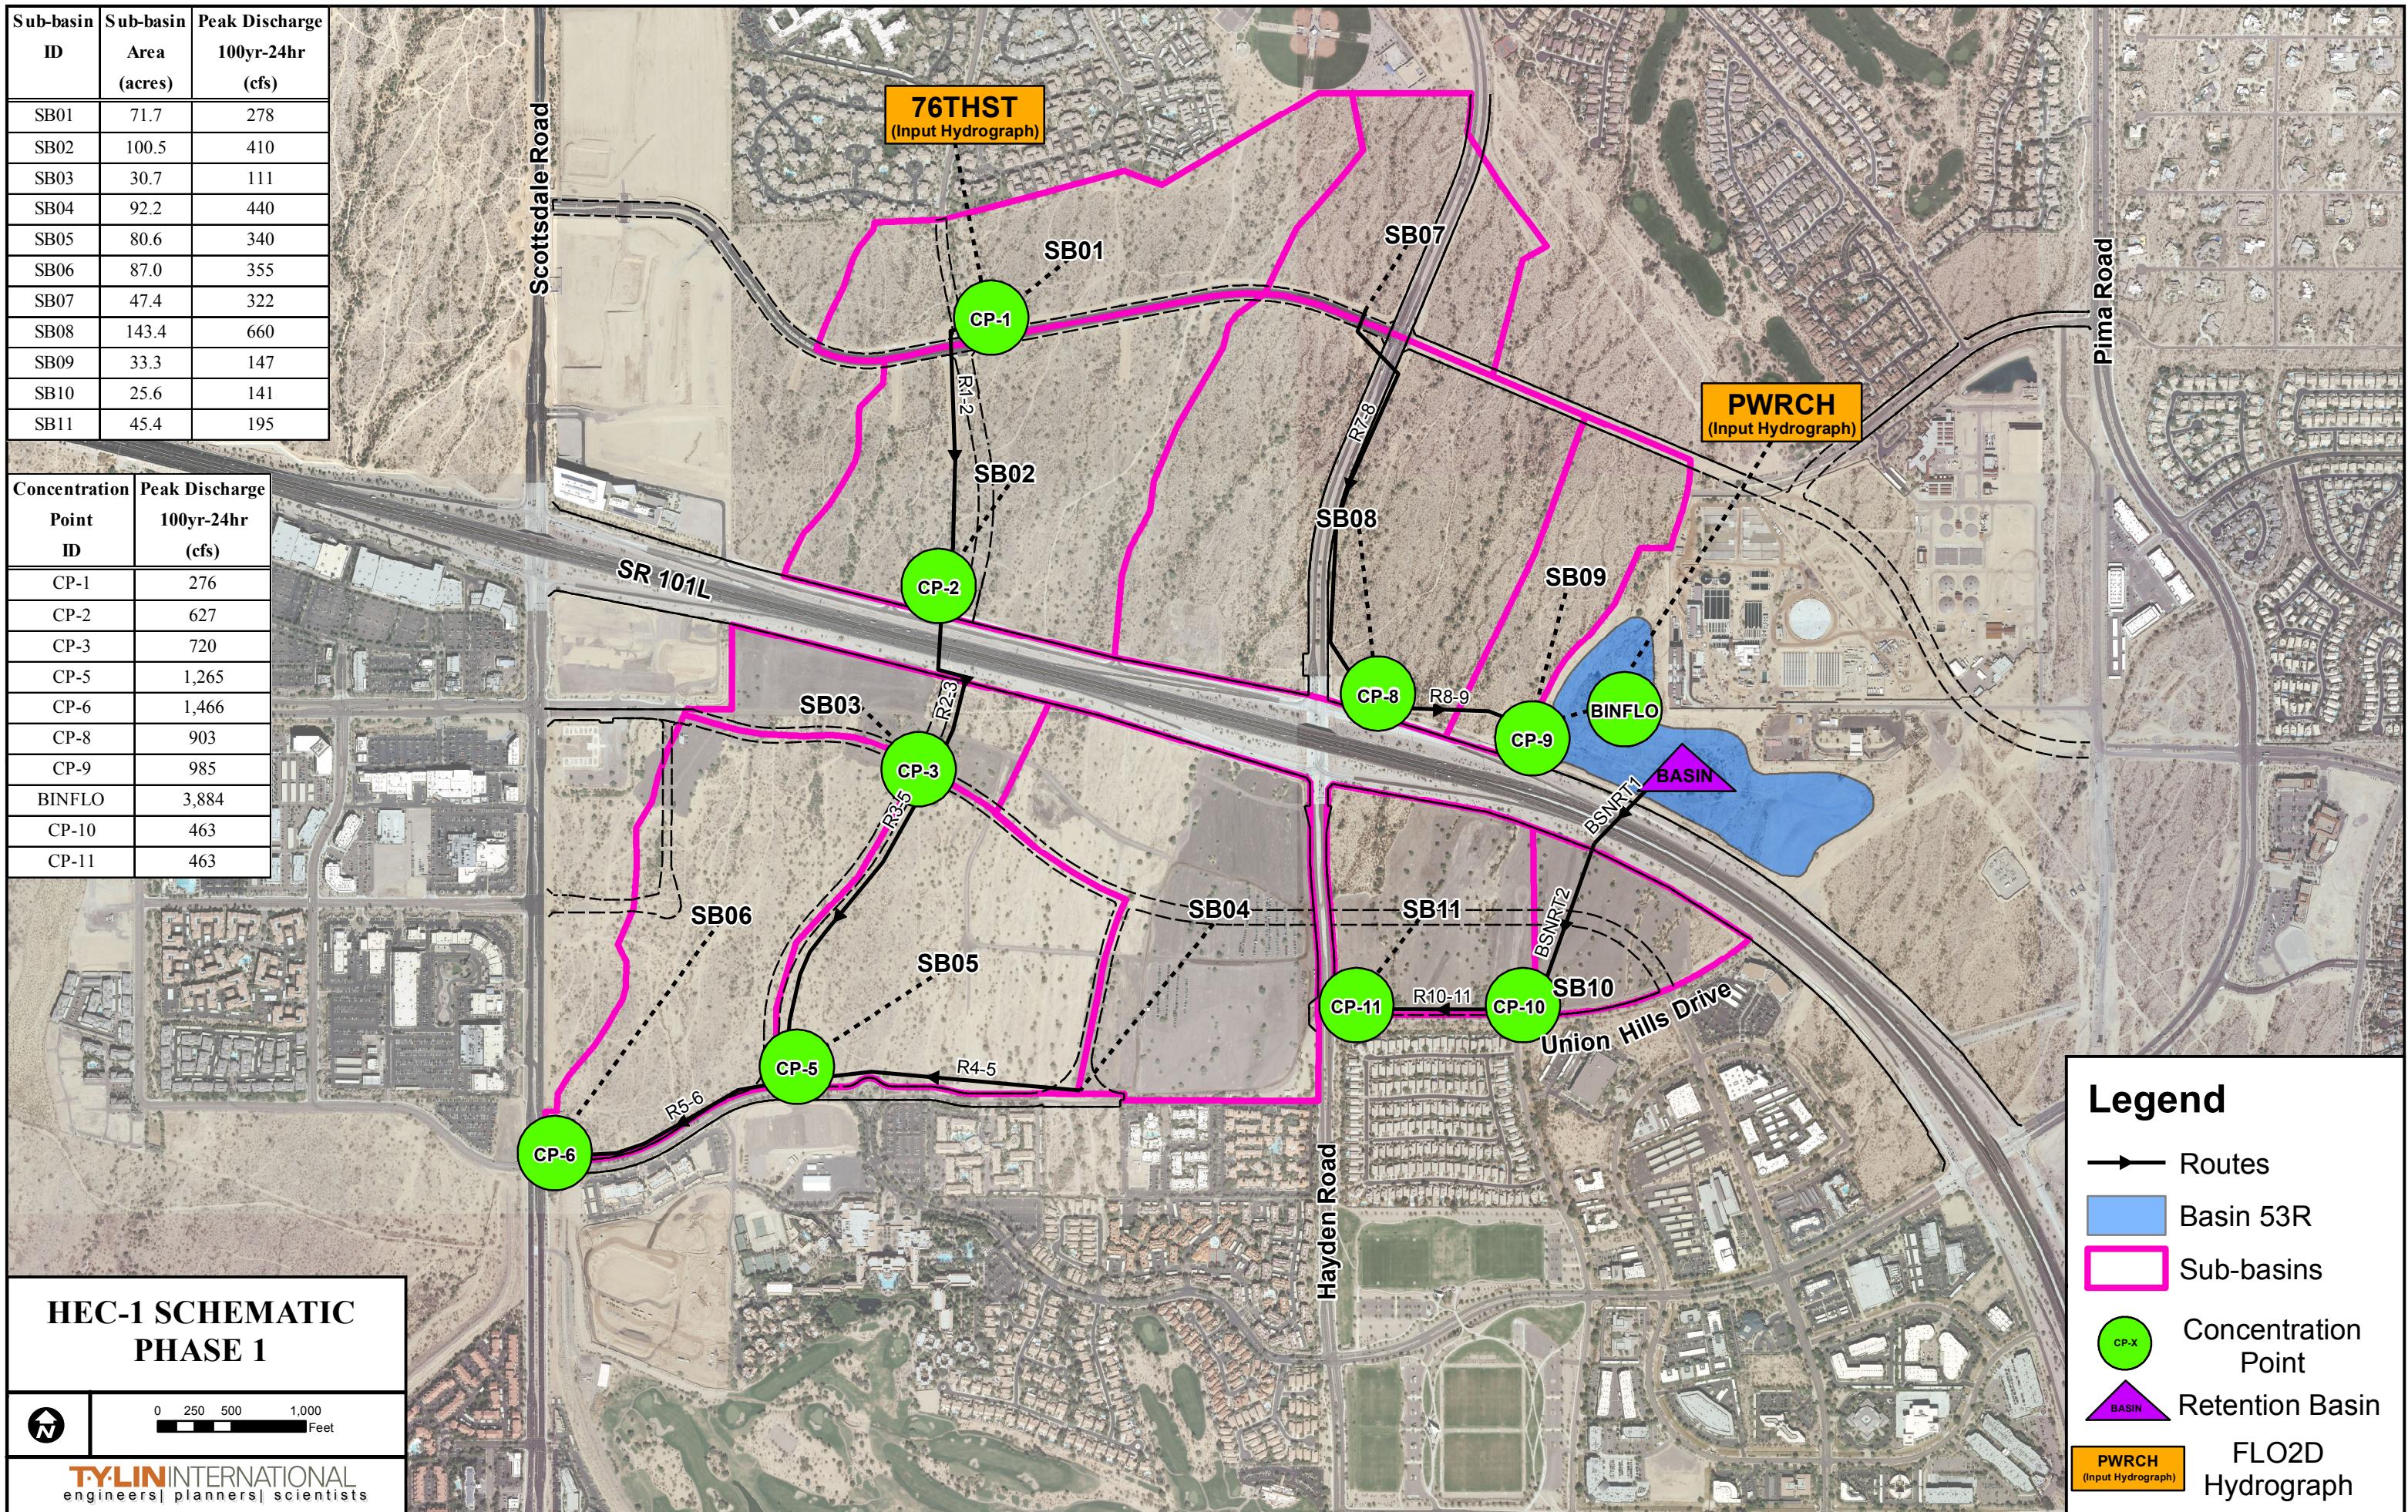


EXHIBIT 1 – VICINITY MAP

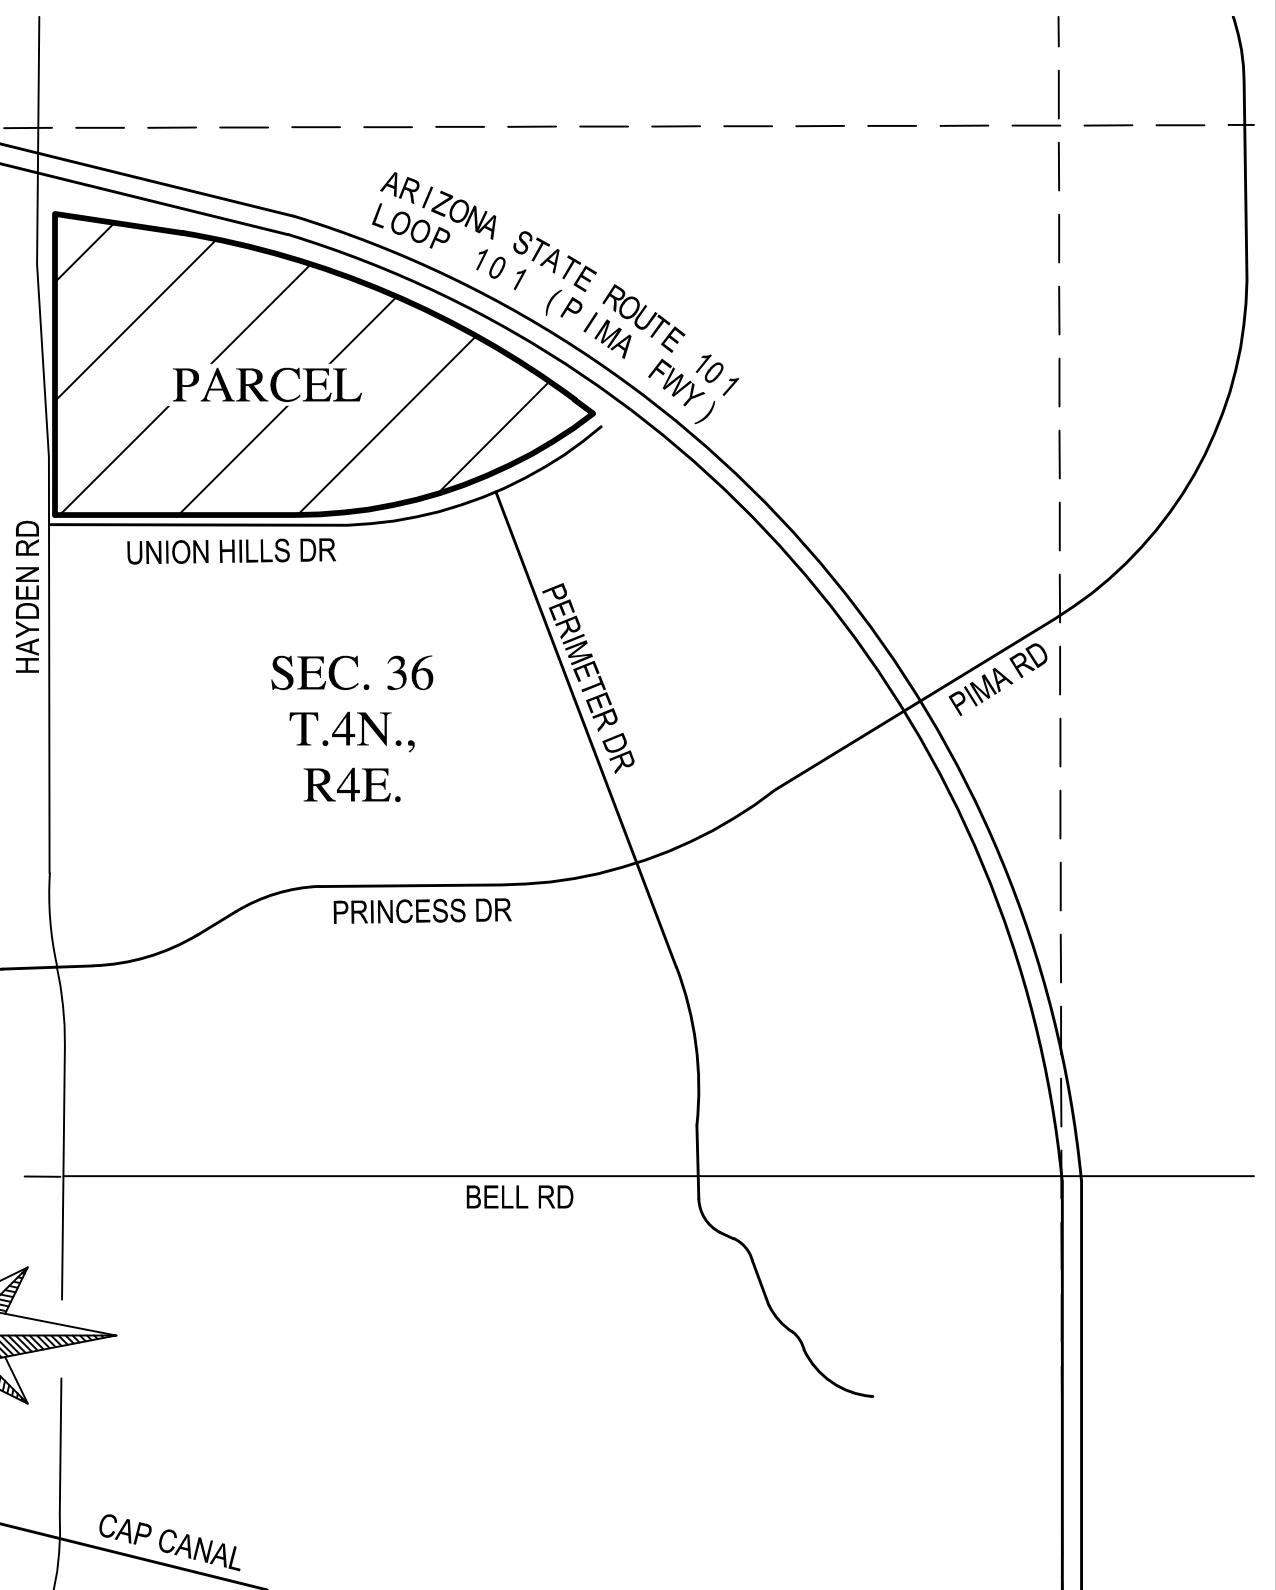


WOOD
PATEL

AXON

VICINITY MAP - STATE PLATE NO. 16-B
CORE SOUTH TRACT 14A

DATE	9/11/20	SCALE	1" = 1000'	SHEET	1 OF 1
JOB NO.	205133	DESIGN	AF	CHECK	JB
		DRAWN	AF		

EXHIBIT 2 – FEMA FIRM

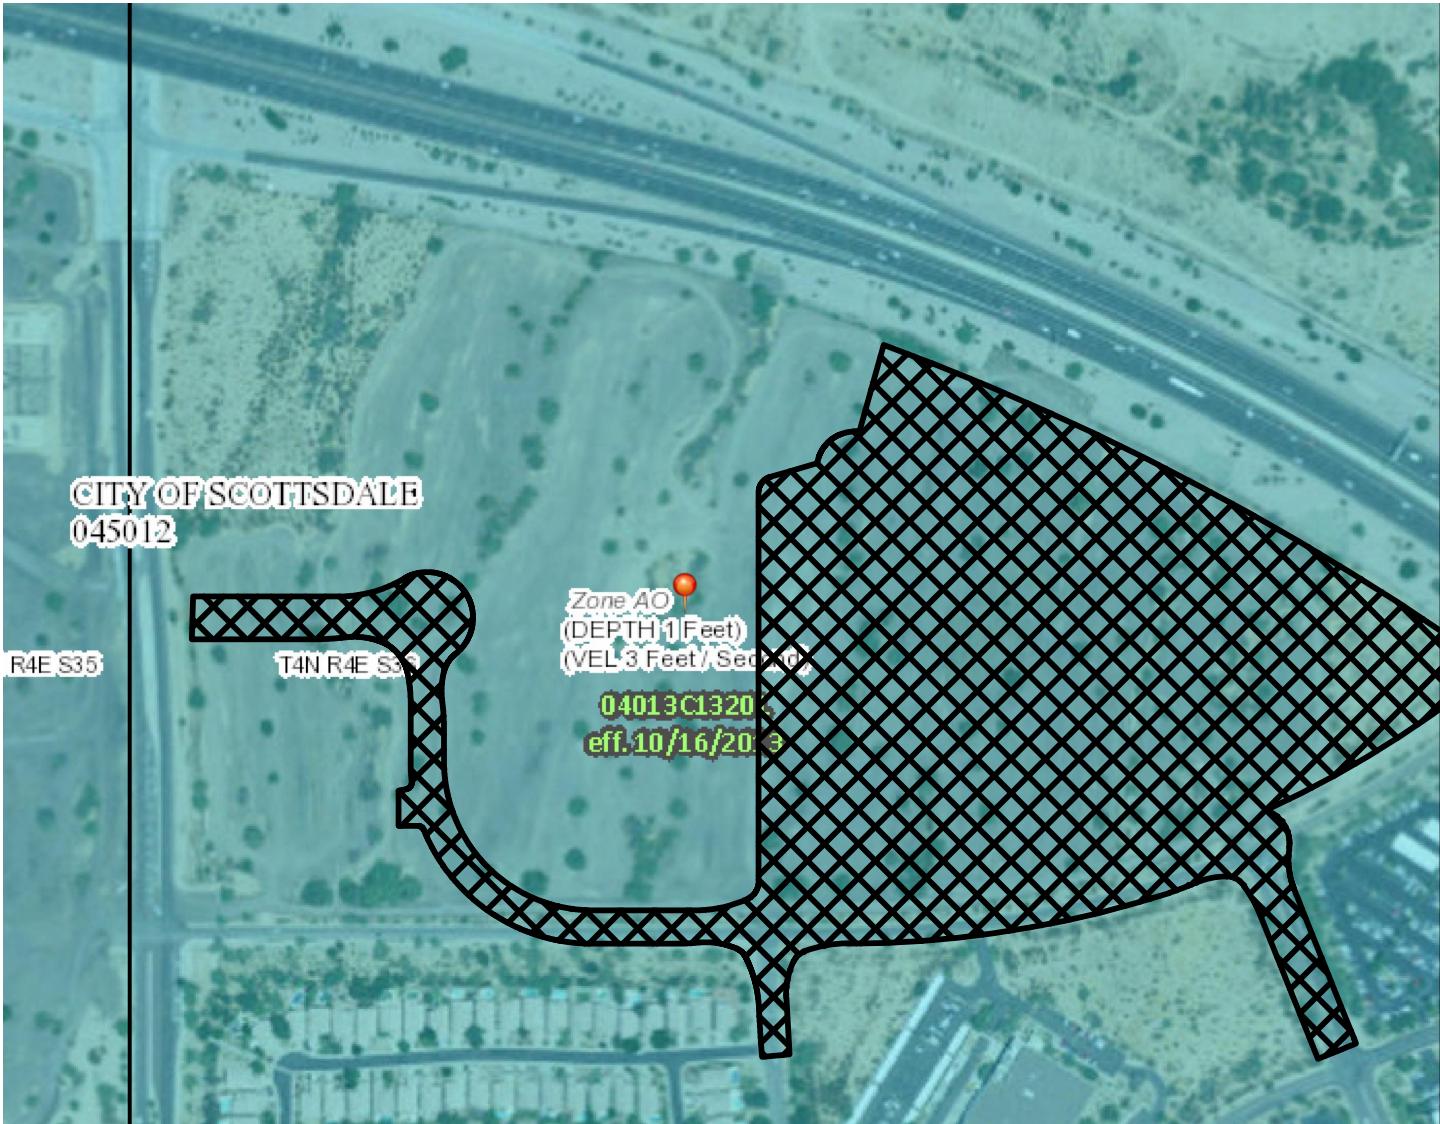

Legend

SEE FIS REPORT FOR DETAILED LEGEND AND INDEX MAP FOR FIRM PANEL LAYOUT

SPECIAL FLOOD HAZARD AREAS	
OTHER AREAS OF FLOOD HAZARD	
GENERAL STRUCTURES	
OTHER FEATURES	
MAP PANELS	

The pin displayed on the map is an approximate point selected by the user and does not represent an authoritative property location.

This map complies with FEMA's standards for the use of digital flood maps if it is not void as described below. The basemap shown complies with FEMA's basemap accuracy standards



PROJECT
AREA

AXON



FEMO FIRM MAP

NOT
FOR
CONSTRUCTION
OR RECORDING

WOOD
PATEL

DATE	9-11-20	SCALE	N/A	SHEET	01 OF 01
JOB NO.	205133	DESIGN	AF	DRAWN	AF

EXHIBIT 3 – EXISTING DRAINAGE MAP

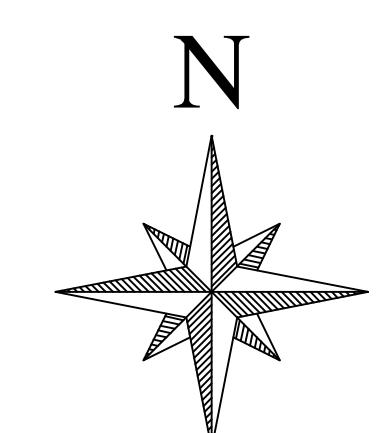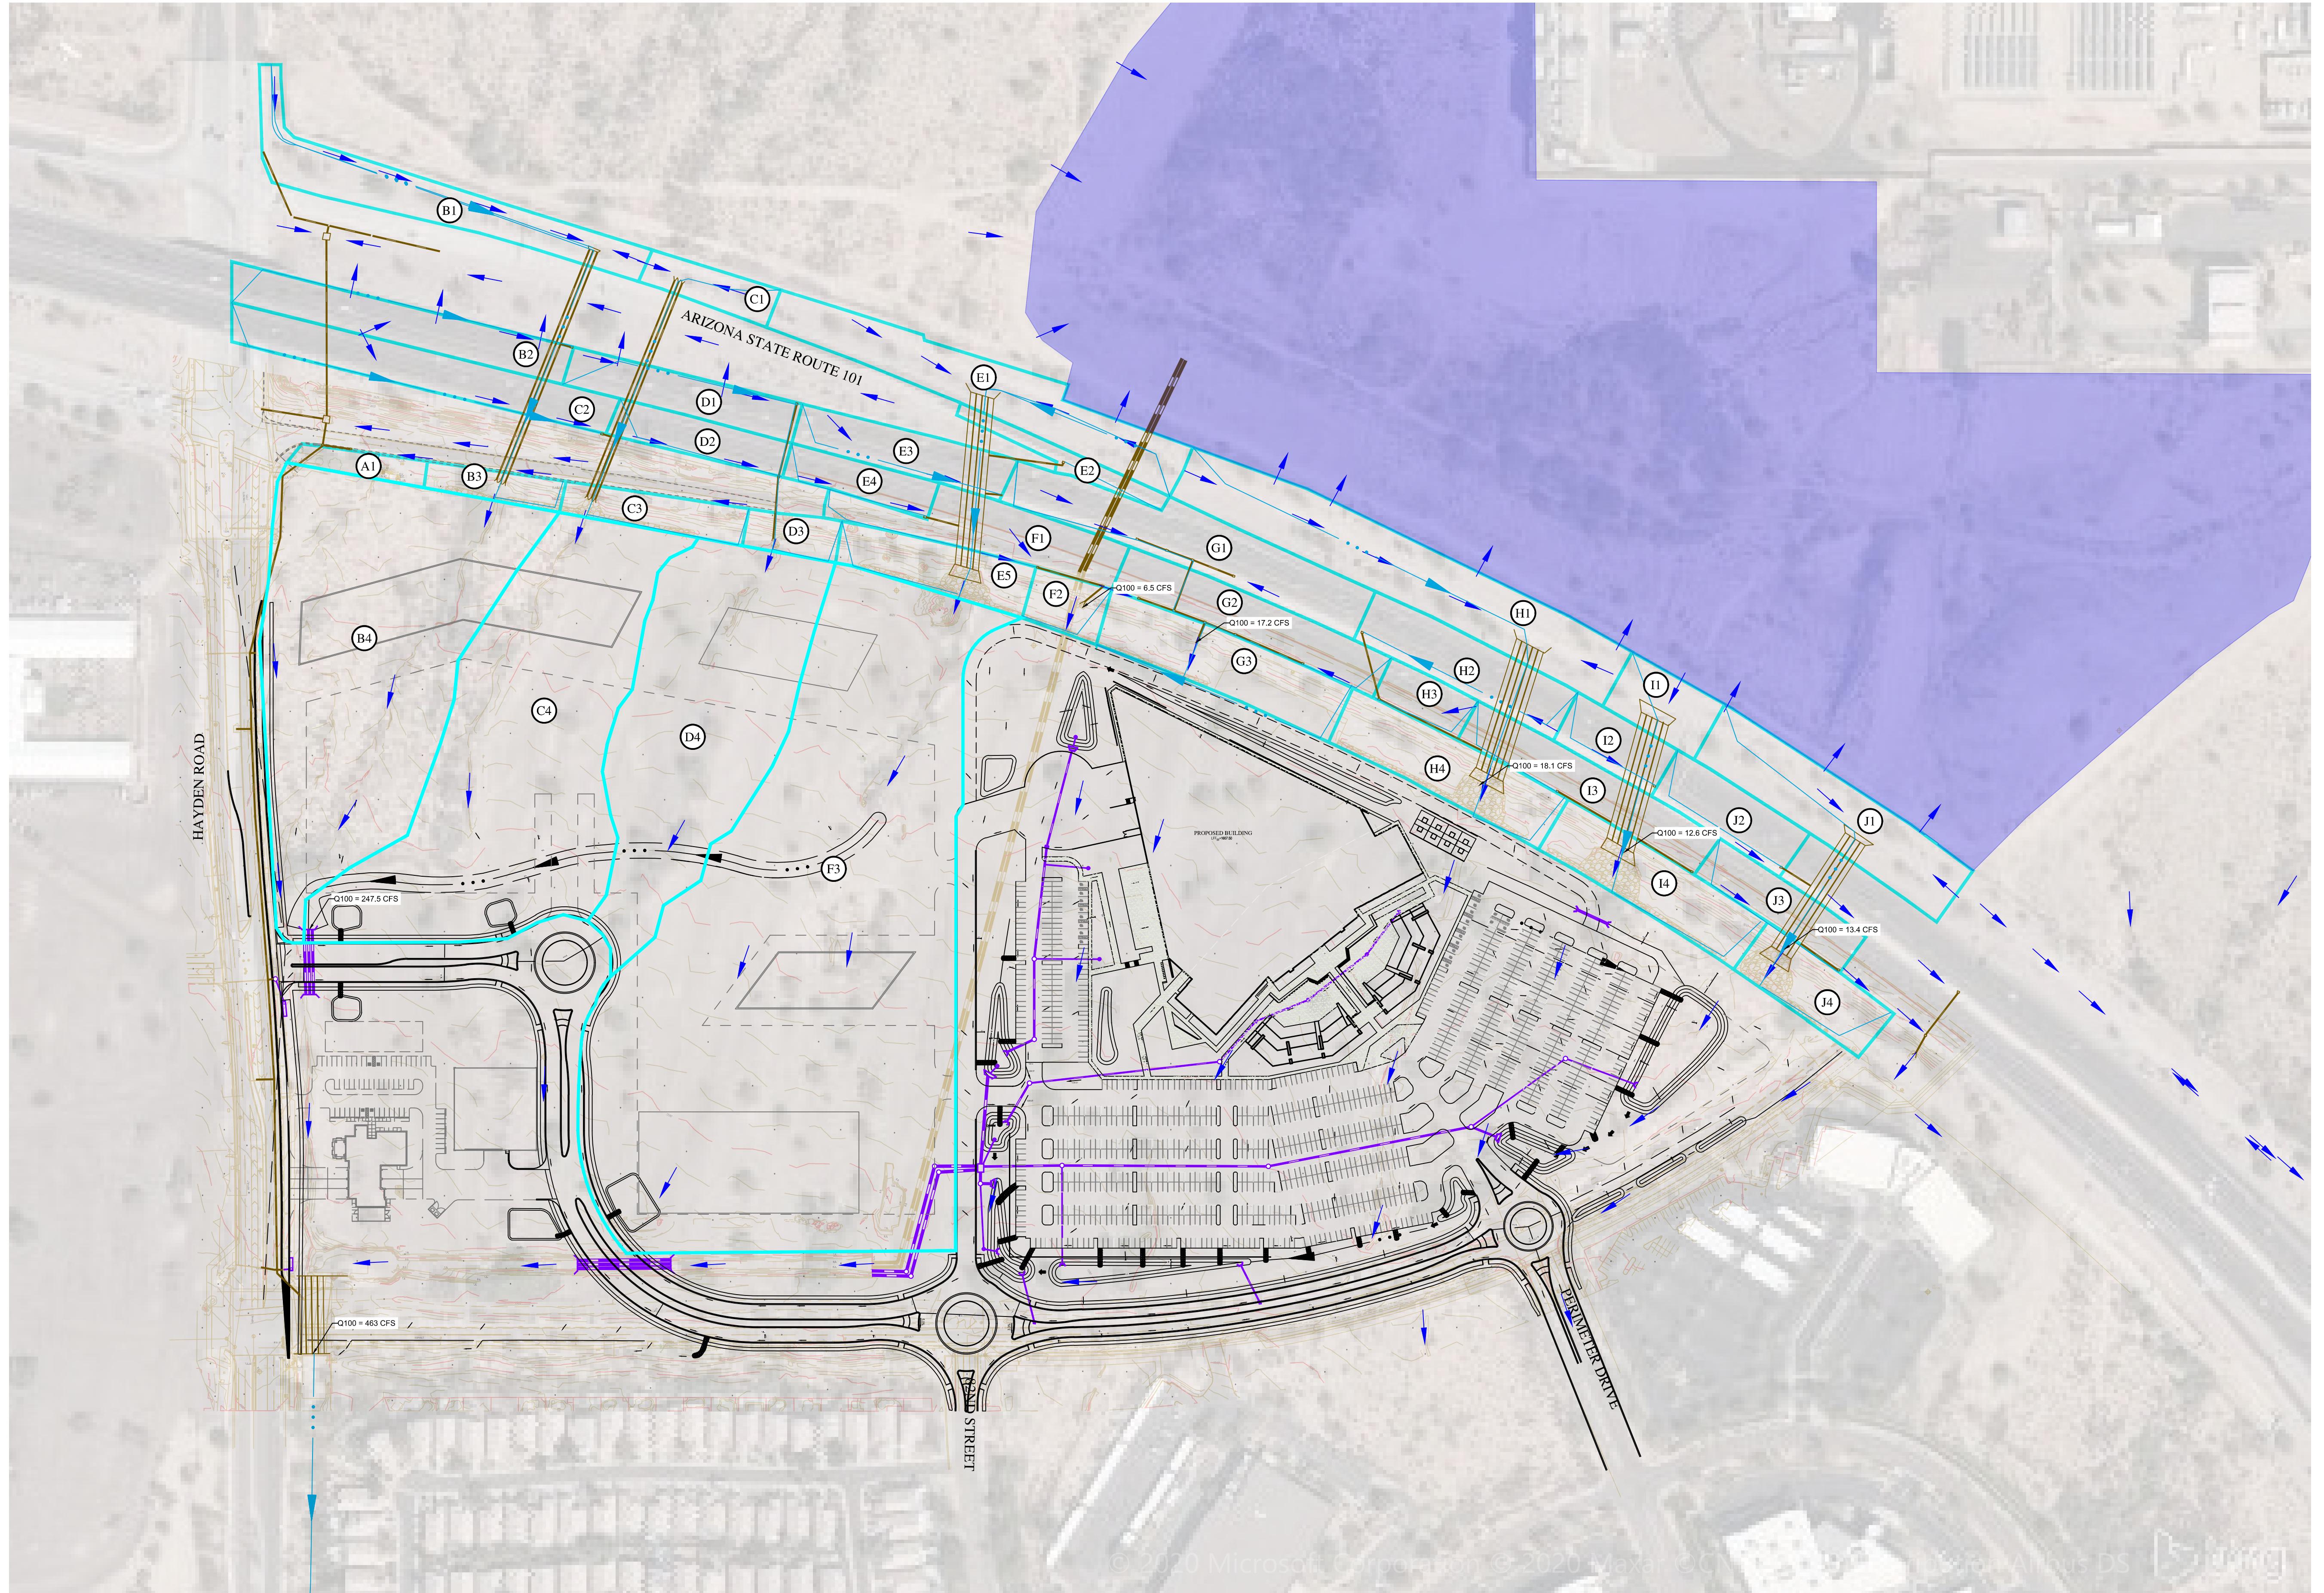

0
75
150
Horz. 1 in. = 150 ft.

NOT
FOR
CONSTRUCTION
OR RECORDING




AXON

OFFSITE DRAINAGE MAP


DATE	09-11-20	SCALE	1" = 150'	SHEET	01 OF 01
JOB NO.	205133	DESIGN	JB/AF	DRAWN	AF

Z:\2020\205133\Project Support\Reports\Drainage\Exhibits\5133-OFFDM.dwg

EXHIBIT 4 – PROPOSED DRAINAGE MAP

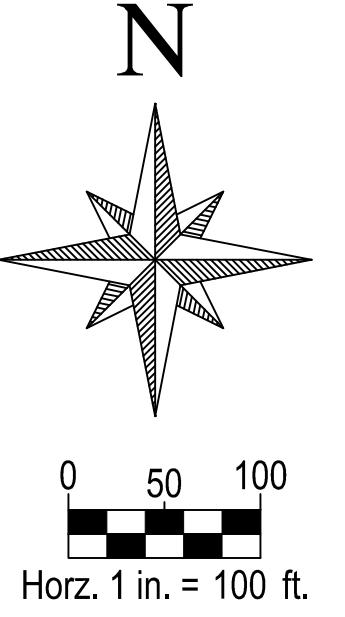

ARIZONA STATE ROUTE 101

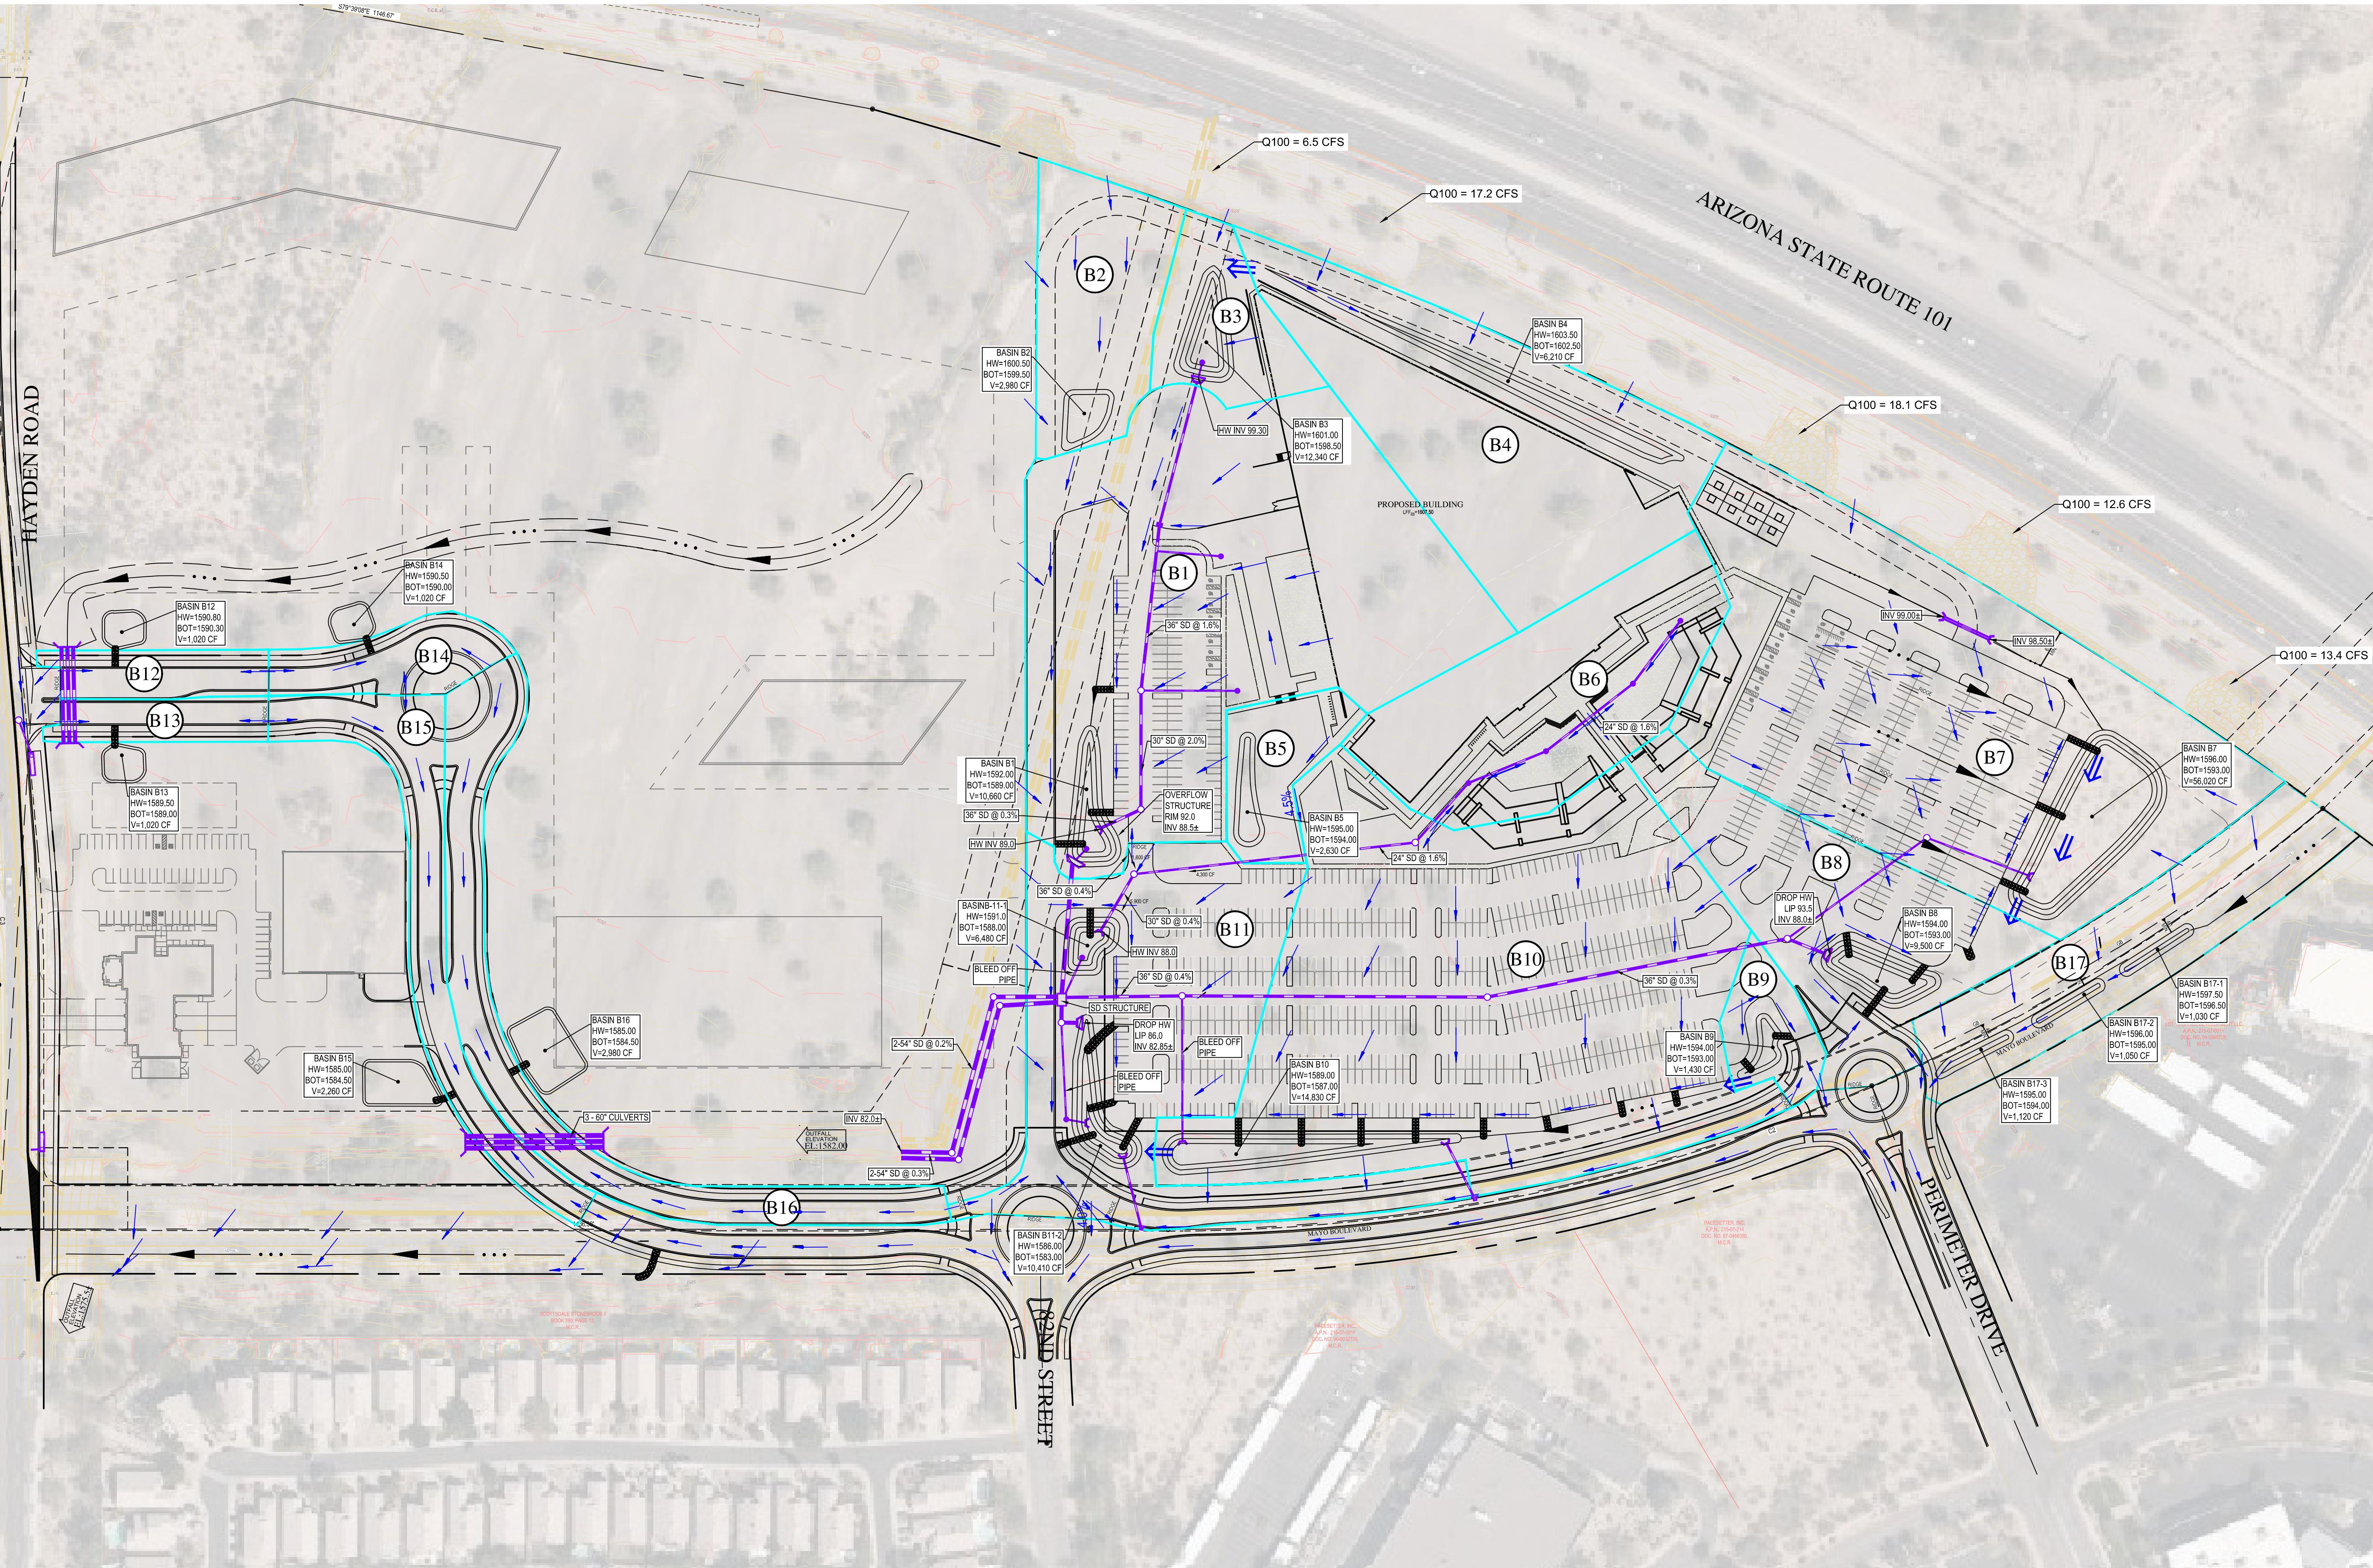

NOT
FOR
CONSTRUCTION
OR RECORDING


WOOD
PATEL

AXON

PRELIMINARY DRAINAGE MAP

DATE 09-11-2020 SCALE 1" = 100' SHEET 1 OF 1
JOB NO. 205133 DESIGN JB DRAWN MP
Z:\2020\205133\Project Support\Reports\Drainage\Exhibits\5133-EXH4-ONDW.dwg


EXHIBIT 5 – CATCH BASIN INLET MAP

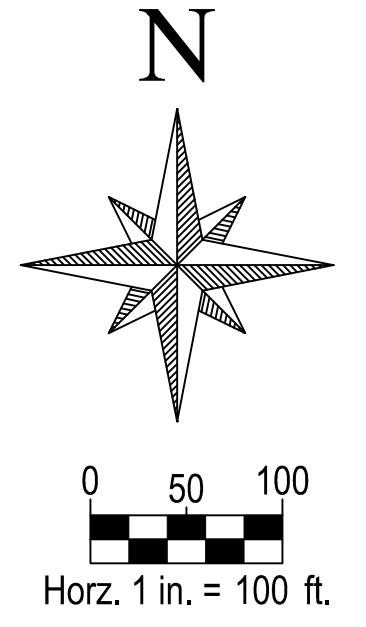

0 50 100
Horz. 1 in. = 100 ft.

LEGEND

- (A1) DRAINAGE SUBBASIN
- DRAINAGE SUBBASIN BOUNDARY
- STORM DRAIN
- EXISTING MINOR CONTOUR
- EXISTING MAJOR CONTOUR

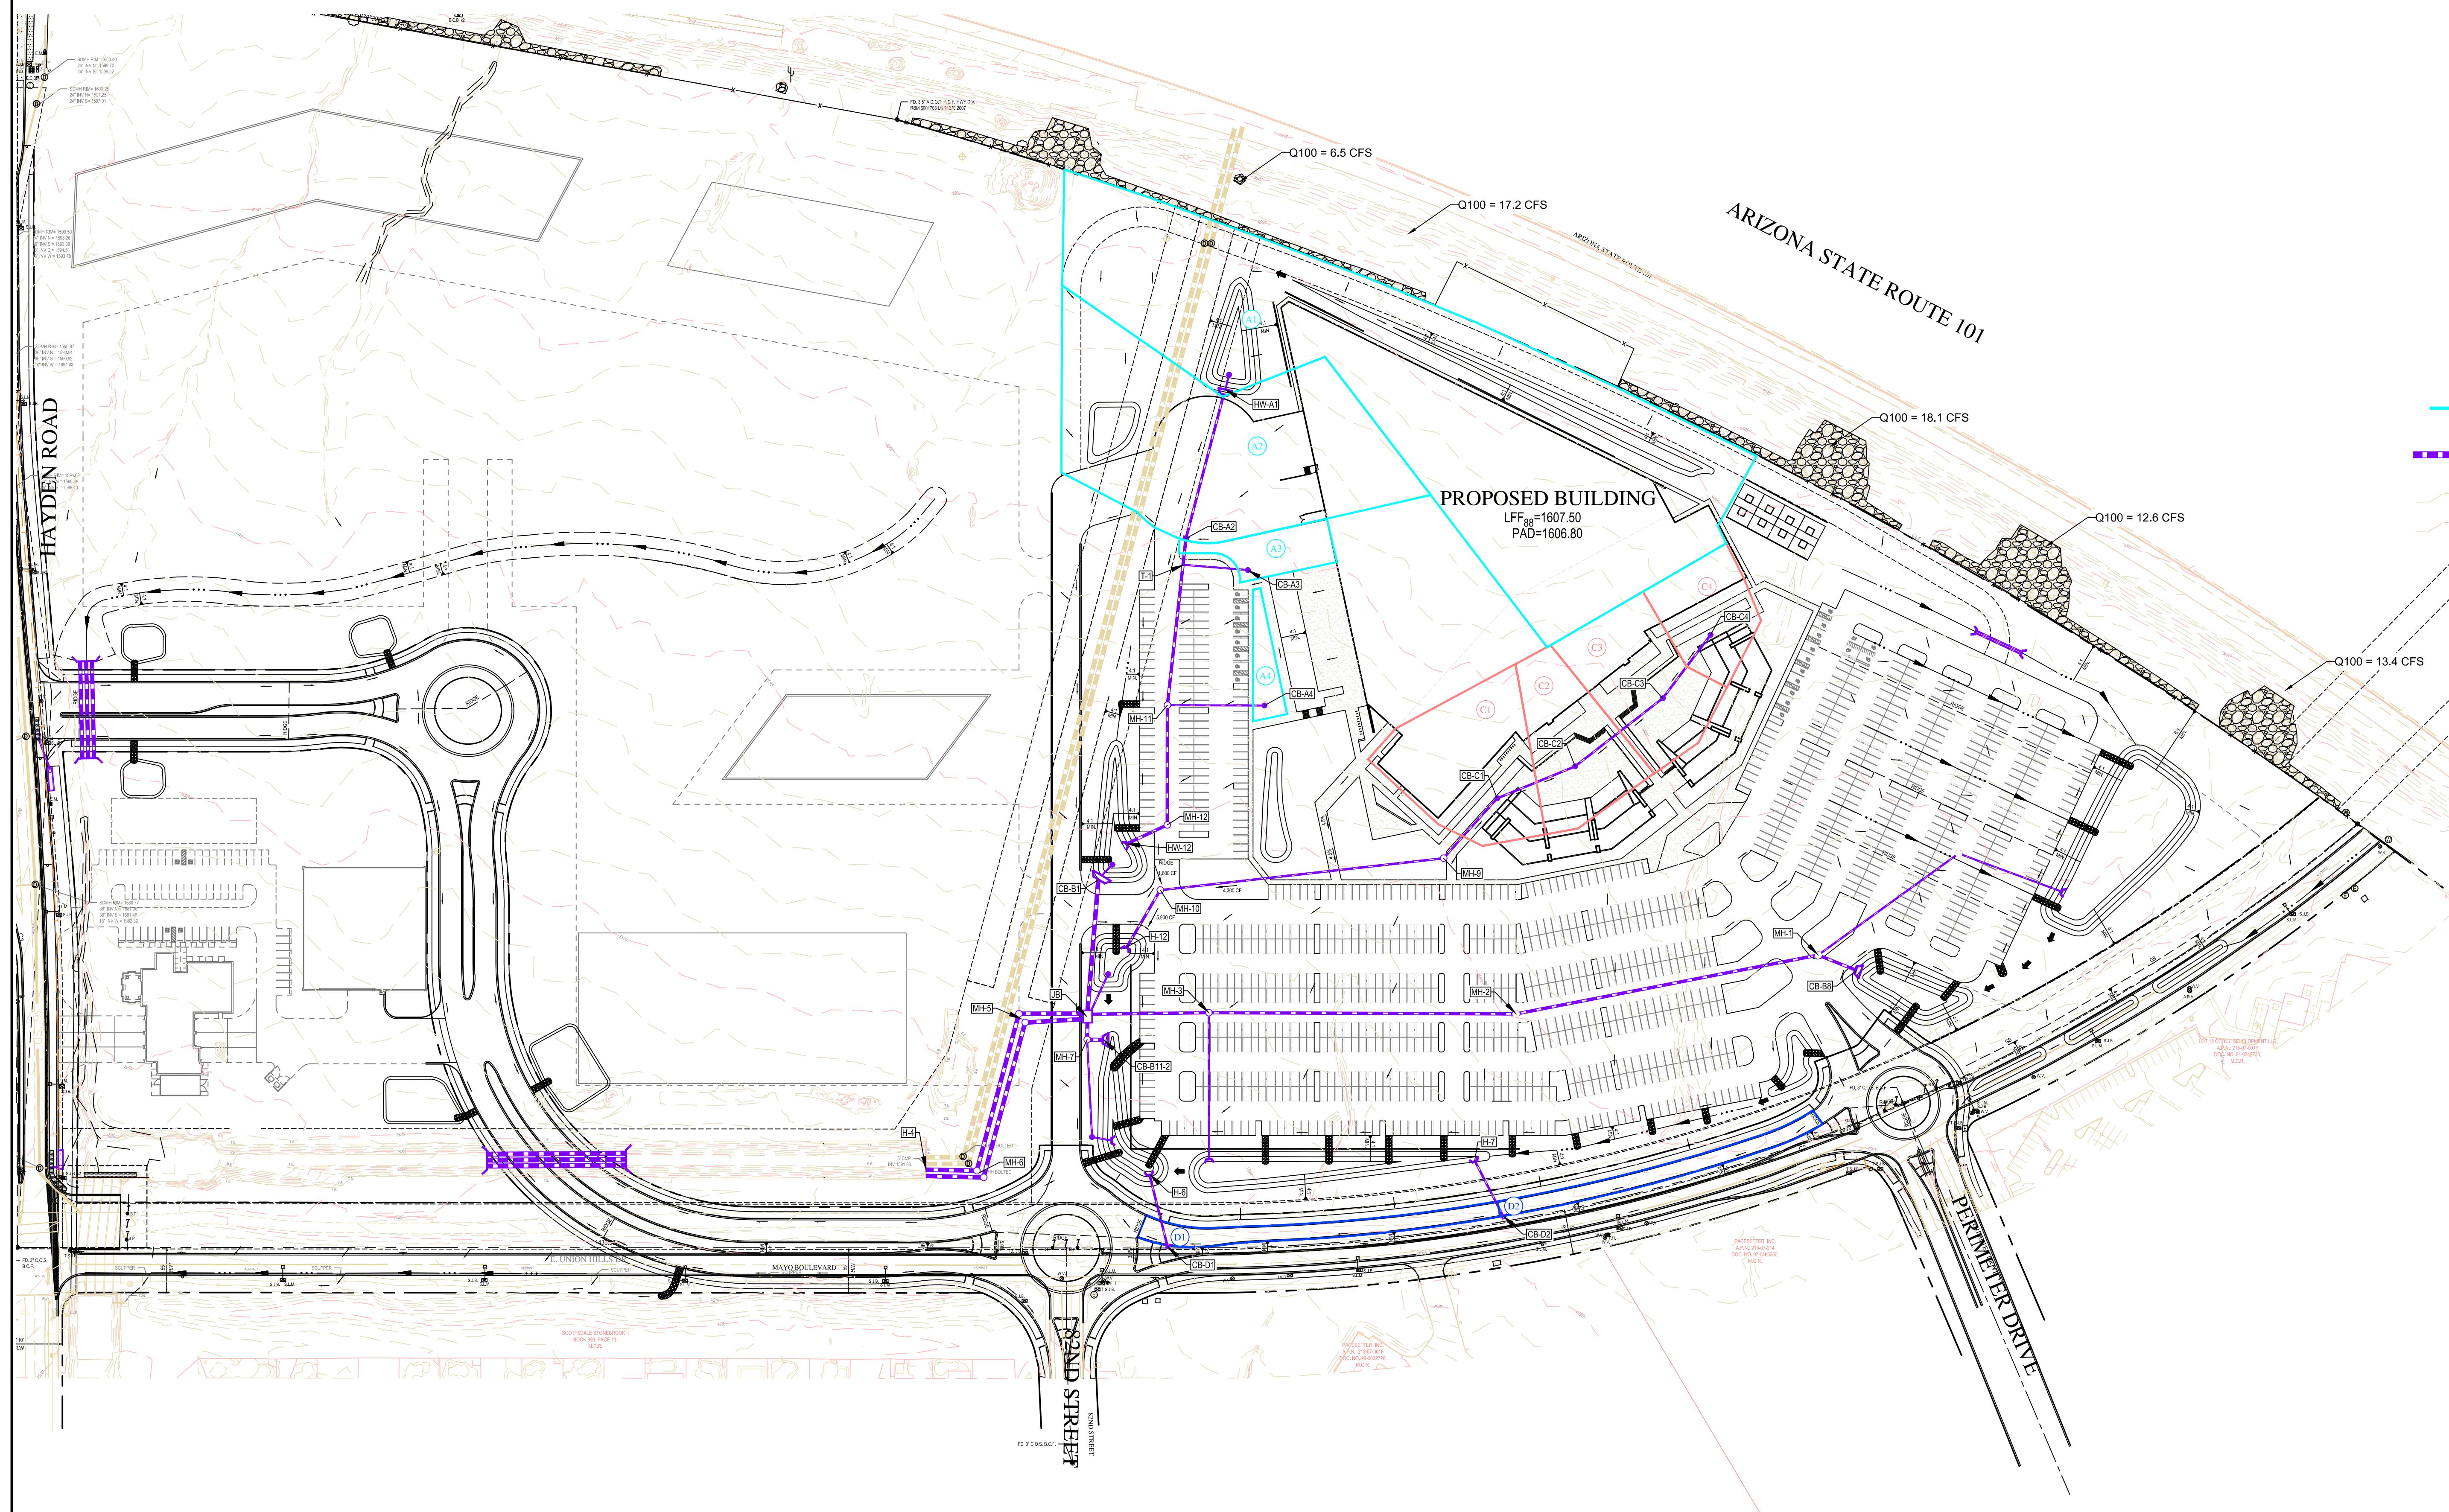

NOT
FOR
CONSTRUCTION
OR RECORDING

**WOOD
PATEL**

AXON

CATCH BASIN INLET MAP

DATE	09-11-20	SCALE	1" = 100'	SHEET	01 OF 01
------	----------	-------	-----------	-------	----------

JOB NO.	205133	DESIGN	JB/AF	DRAWN	AF
---------	--------	--------	-------	-------	----

Z:\2020\205133\Project Support\Reports\Drainage\Exhibits\5133-EXH5-CB FLOW MAP.dwg