



**WASTEWATER DISTRIBUTION SYSTEM
PRELIMINARY BASIS OF DESIGN REPORT
FOR
FAIRMONT SCOTTSDALE PRINCESS
PRIVADO WELCOME BUILDING AND PARKING MODIFICATIONS**

July 29, 2022
WP# 215319

**PRELIMINARY Basis of Design
Report**

- ☐ ACCEPTED
☒ ACCEPTED AS NOTED
☐ REVISE AND RESUBMIT



Disclaimer: If accepted; the preliminary approval is granted under the condition that a final basis of design report will also be submitted for city review and approval (typically during the DR or PP case). The final report shall incorporate further water or sewer design and analysis requirements as defined in the city design standards and policy manual and address those items noted in the preliminary review comments (both separate and included herein). The final report shall be submitted and approved prior to the plan review submission.

For questions or clarifications contact the Water Resources Planning and Engineering Department at 480-312-5685.

BY apritchard

DATE 9/14/2022



EXPIRES 06-30-25

TABLE OF CONTENTS

1.0	EXECUTIVE SUMMARY	1
2.0	INTRODUCTION.....	2
2.1	General Background	2
2.2	Project Location	2
2.3	Purpose of Report	2
3.0	EXISTING WASTEWATER INFRASTRUCTURE.....	3
3.1	Existing Utility System Conditions.....	3
4.0	PROPOSED WASTEWATER INFRASTRUCTURE	4
4.1	Proposed Utility System Conditions.....	4
4.2	Modeling and Results	4
5.0	CONCLUSIONS.....	5
6.0	REFERENCES.....	6

APPENDICES

APPENDIX A Hydraulic Modeling Results

EXHIBITS

EXHIBIT 1 Vicinity Map
EXHIBIT 2 Wastewater Exhibit



se
Y:\WP\Reports\Commercial\215319 FSP Privado Welcome Building & Parking Mods Preliminary Wastewater BOD.docx

1.0 EXECUTIVE SUMMARY

The Fairmont Scottsdale Princess Privado Welcome Building and Parking Modifications (Site) is a proposed hotel visitor center and parking lot development on an approximate 6.0- acre parcel at the Fairmont Scottsdale Princess, in the City of Scottsdale (APN#215-08-003C). The proposed development will consist of one (1) visitor center building and new parking lot expansion. The project will include parking, hardscape, landscape, and utility improvements to support the development. The Site is located approximately 1,300 feet to the east of the Scottsdale Road and Princess Boulevard, on the south side of Princess Boulevard within Section 35, Township 4 North, Range 4 East of the Gila and Salt River Base and Meridian, Maricopa County, Arizona. Refer to Exhibit 1 – *Vicinity Map* for the project location. The existing property, currently zoned C-2, is primarily developed with buildings, parking lots, pools, sidewalks, and a variety of landscaping (desert and grass).

The design criteria used to estimate potable water demands and evaluate system hydraulics are based on Wood, Patel & Associates, Inc’s (WOODPATEL’s) understanding of the requirements listed in the *City of Scottsdale Design Standards and Policies Manual, 2018*.

The following is a summary of the design criteria utilized:

Average Day Wastewater Demand, Commercial/Retail:	0.5 gpd / sf
Peak Factor, Commercial/Retail:	3.0
Minimum Mean Full Flow Velocity:	2.50 fps
Minimum Peak Full Flow Velocity:	10.0 fps
<u>Minimum Peak Flow d/D Ratio (12-inch diameter or less sewers):</u>	<u>d/D = 0.65</u>
Abbreviations: gpd = gallons per day; fps = feet per second; P = population/1,000	

2.0 INTRODUCTION

2.1 General Background

Privado Welcome Building and Parking Modifications (Site) is a proposed hotel visitor center and parking lot development on an approximate 6.0- acre parcel in the City of Scottsdale (APN#215-08-003C). The proposed development will consist of one (1) visitor center building and new parking lot expansion. The project will include parking, hardscape, landscape, and utility improvements to support the development.

2.2 Project Location

The Site is located approximately 1,300 feet to the east of the Scottsdale Road and Princess Boulevard, on the south side of Princess Boulevard within Section 35, Township 4 North, Range 4 East of the Gila and Salt River Base and Meridian, Maricopa County, Arizona. Refer to Exhibit 1 – *Vicinity Map* for the project location.

2.3 Purpose of Report

This Wastewater Collection System Basis of Design Report has been prepared in Wood, Patel & Associates, Inc.'s (WOODPATEL's) understanding of the City of Scottsdale Wastewater Collection System Design requirements, as applicable for the Site. The purpose of this Report is to address the following wastewater design consideration for the Site:

- Average-day and Peak Wastewater flows determination.
- Capacity analysis of the proposed wastewater collection system.

3.0 EXISTING WASTEWATER INFRASTRUCTURE

3.1 Existing Utility System Conditions

The existing wastewater infrastructure adjacent to the Site, includes a public 18-inch PVC sewer line on the west side of the Site that extends south from Princess Boulevard to the south end of the property. The public 18-inch sewer line then continues east along the south side of the adjacent property. Please refer to Exhibit 2 – *Wastewater Exhibit* for a depiction of the existing wastewater infrastructure surrounding the Site.

4.0 PROPOSED WASTEWATER INFRASTRUCTURE

4.1 Proposed Utility System Conditions

As a part of the project, one sewer service will be removed from an existing building and added for the proposed Welcome Building. According to our calculations, the existing wastewater infrastructure can handle the wastewater flows and demands for the proposed project since sewer flows into the existing 18-inch sewer line will not be increased.

4.2 Modeling and Results

Based on the current City of Scottsdale design criteria, the projected average-day flow for the proposed Site is calculated to be 1,281 gallons per day (gpd), or 0.9 gallons per minute (gpm). The peak flow is projected to be 3,843 gpd, or 2.7 gpm. Refer to Appendix A – *Hydraulic Modeling Results* for calculations. The proposed sewer slopes, projected flow velocities, and pipe flow capacities with the current flows are summarized on the attached spreadsheet and indicated that the wastewater system is adequate for the Site.

5.0 CONCLUSIONS

Based on our wastewater collection system analysis for the proposed Privado Welcome Building and Parking Modifications, the following conclusions are made:

1. The design criteria used to estimate wastewater flows and evaluate system hydraulics are based on the WOODPATEL's understanding of the published City of Scottsdale Design Standards and Policies Manual, 2018.
2. The projected average-day flow for the proposed Site is calculated to be 1,281 gallons per day (gpd), or 0.9 gallons per minute (gpm). The peak flow is projected to be 3,843 gpd, or 2.7 gpm.

6.0 REFERENCES

1. City of Scottsdale Design Standards and Policies Manual, 2018

APPENDIX A – HYDRAULIC MODELING RESULTS

TABLE 1
WASTEWATER DESIGN CRITERIA

Project Fairmont Scottsdale Princess Privado Welcome Center and Parking Expansion
Location Scottsdale AZ
Project Number 215319
Project Engineer Darin Moore, P.E.
References City of Scottsdale Design Standards and Policies Manual (2018)

WASTEWATER DEMANDS			
LAND USE	AVERAGE DAILY DEMAND (ADD)		POPULATION¹
	VALUE	UNITS	
Commercial/Retail	0.50	gpd/sf	0.005 Persons per sf
Office	0.40	gpd/sf	0.004 Persons per sf
Restaurant	1.20	gpd/sf	0.012 Persons per sf
High Density Condominiums	140	gpd/DU	1.4 Persons per DU
School: without Cafeteria	30	gpd/Student	0.3 Persons per Student
School: with Cafeteria	50	gpd/Student	0.5 Persons per Student
Resort Hotel	380	gpd/Room	3.8 Persons per Room
Cultural	0.1	gpd/sf	0.001 Persons per sf
Fitness Center/Spa/ Health Club	0.8	gpd/sf	0.008 Persons per sf

HYDRAULIC MODELING CRITERIA	
DESCRIPTION	VALUE²
PEAK FLOW	
Peak Flow = Peaking Factor (PF) x ADD	
Commercial/Retail	3.0
Fitness Center/Spa/Health Club	3.5
High Density Condominium	4.5
Restaurant	6.0
HYDRAULICS	
Minimum Pipe Diameter (in)	8
Manning's "n" value	0.013
Maximum d/D ratio at peak flow	0.75

PIPE SIZE (in)	MEAN VELOCITY ²		DESIGN SLOPE ²	
	Minimum (ft/sec)	Maximum (ft/sec)	Minimum (%)	Maximum (%)
8	2.5	10.0	0.380	6.980
10	2.5	10.0	0.306	5.121
12	2.5	10.0	0.256	3.919

Notes

1. Based on Arizona Administrative Code, Title 18, Chapter 9 value of 100 gallons per capita per day.
2. Per City of Scottsdale Design Standards and Policies Manual (2018)

WASTEWATER MODEL, FULL BUILD-OUT CONDITION

Project Fairmont Scottsdale Princess Privado Welcome Center and Parking Expansion
Location Scottsdale AZ
Project Number 215319
Project Engineer Darin Moore, P.E.
References City of Scottsdale Design Standards and Policies Manual (2018)
 Arizona Administrative Code, Title 18, Chapter 9

FROM NODE	Commercial/ Retail (SF)	Commercial/ Retail (GPD/SF)	SEWER NODE ADD (GPD)	SEWER NODE ADD (GPM)	PEAK FLOW ¹ (GPD)	PEAK FLOW ¹ (GPM)
Outfall						
Welcome Center	2562	0.5	1,281	0.9	3,843	2.7
Total Outfall	2,562		1,281	0.9	3,843	2.7


1 Peaking Factor per the City of Scottsdale Design Standards & Policies Manual are as follows:
 Commercial/Retail: 3

CALCULATED PIPE CAPACITIES, FULL BUILD-OUT CONDITION

Project Fairmont Scottsdale Princess Privado Welcome Center and Parking Expansion
Location Scottsdale AZ
Project Number 215319
Project Engineer Darin Moore, P.E.
References City of Scottsdale Design Standards and Policies Manual (2018)
 ADEQ Bulletin No. 11

					PEAK FLOW RESULTS					
FROM NODE	PIPE SIZE	MODELED PIPE SLOPE	PIPE CAPACITY (FULL)		PEAK FLOW	PEAK FLOW	d/D	MEAN VELOCITY (at d/D=0.75)	SURPLUS CAPACITY	PERCENT OF CAPACITY
	(in)	(ft/ft)	(gpd)	(gpm)	(gpd)	(gpm)		(ft/sec)	(gpd)	(%)
Outfall										
Welcome Center	4	0.0200	174,431	121	3,843	2.7	0.10	3.5	170,588	2.2%

EXHIBIT 1 – VICINITY MAP

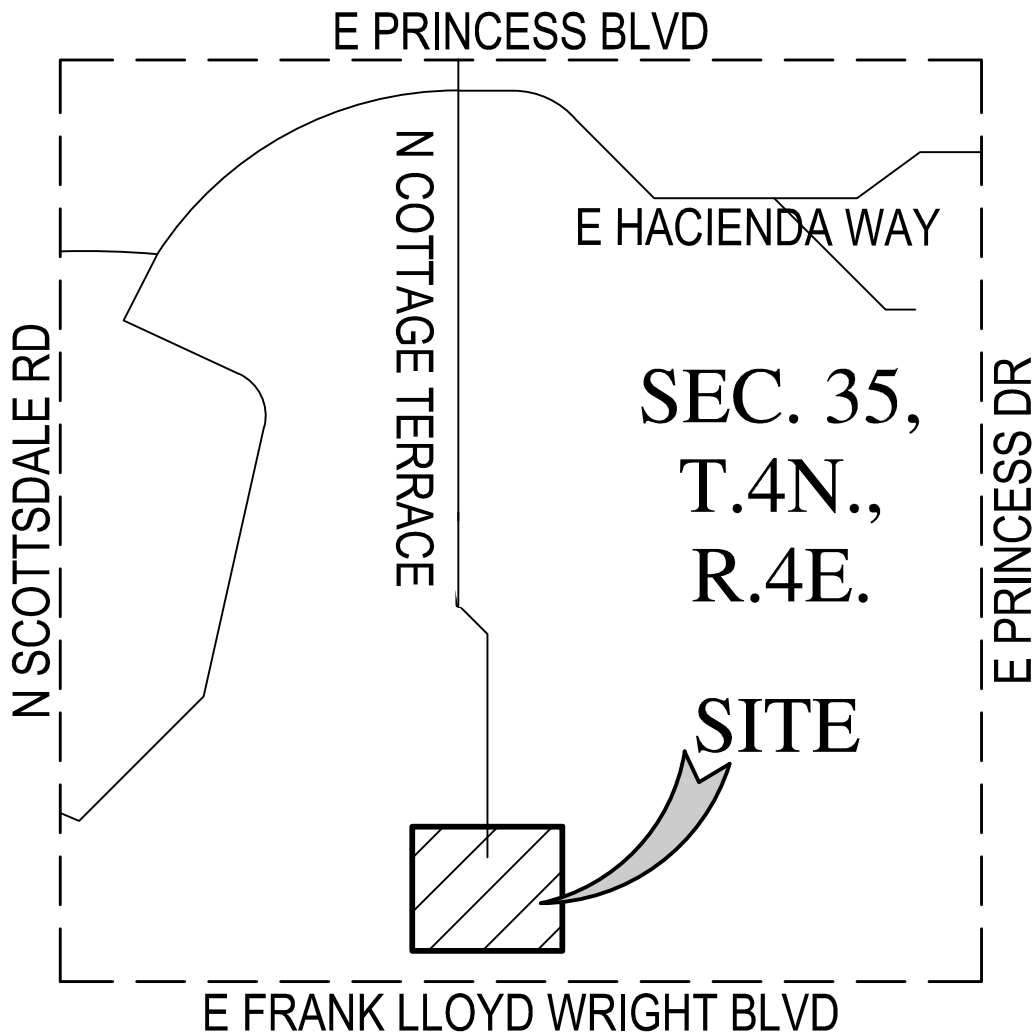

VICINITY MAP

N.T.S.

**NOT
FOR
CONSTRUCTION
OR RECORDING**

**WOOD
PATEL**

FAIRMONT SCOTTSDALE PRINCESS PRIVADO WELCOME CENTER AND PARKING MODIFICATIONS

VICINITY MAP EXHIBIT

DATE	7-29-2022	SCALE	N.T.S	SHEET	1 OF 1
JOB NO.	215319	DESIGN	RS	CHECK	
		DRAWN	LBD	RFI #	

Z:\2021\215319\Project Support\Reports\Drainage\Exhibits\5319-EXH1-VM.dwg

EXHIBIT 2 – WASTEWATER EXHIBIT

