

PRELIMINARY DRAINAGE REPORT

Magnolia on Osborn

NEC of 70th Street and Osborn Road

Prepared For:



2435 E Southlake Blvd Ste 150
Southlake, TX 76092



Prepared by:



Sustainability Engineering Group
8280 E. Gelding Drive, Suite 101
Scottsdale, AZ 85260
480.588.7226 www.azSEG.com

Project Number: 220205
Submittal Date: November 10, 2022

Case No.: TBD

Plan Check No.: TBD

Table of Contents

1. INTRODUCTION	1
2. LOCATION AND PROJECT DESCRIPTION	1
2.1 LOCATION:	1
2.2 EXISTING AND PROPOSED DEVELOPMENTS SURROUNDING THE SITE:	1
2.3 EXISTING SITE DESCRIPTION:	2
2.4 PROPOSED SITE DEVELOPMENT:	2
2.5 FLOOD HAZARD ZONE:	2
3. EXISTING DRAINAGE CONDITIONS	2
3.1 OFF-SITE DRAINAGE PATTERNS	2
3.2 ON-SITE DRAINAGE	2
4. PROPOSED STORM WATER MANAGEMENT	3
4.1 DESIGN INTENT:	3
4.2 DESIGN STORM REQUIREMENTS:	4
4.3 LAND CHARACTERISTICS:	4
4.4 STORMWATER RETENTION:	4
4.5 STORMWATER DISCHARGE	6
4.6 ADEQ WATER QUALITY REQUIREMENTS	7
5. FLOOD SAFETY FOR DWELLINGS	7
5.1 FINISHED FLOOR ELEVATIONS	7
6. CONCLUSIONS	7
6.1 OVERALL PROJECT:	7
6.2 PROJECT PHASING:	8
7. WARNING AND DISCLAIMER OF LIABILITY	8
8. REFERENCES	8



LIST OF TABLES:

TABLE 1	-	Existing Site Discharges
TABLE 2	-	Proposed Discharges
TABLE 3	-	Provided Storage Basins
TABLE 4	-	Proposed Retention Basin Summary
TABLE 5	-	Ultimate Flows to Public Storm Drain System

LIST OF FIGURES:

FIGURE 1	-	Vicinity Map
FIGURE 2	-	Aerial
FIGURE 3	-	FIRM
FIGURE 4	-	FLO-2D Map (North)
FIGURE 5	-	FLO-2D Map (South)

APPENDICES:

APPENDIX I	-	Rainfall Data
APPENDIX II	-	Calculations
APPENDIX III	-	Preliminary Grading and Drainage Plan

1. INTRODUCTION

This Preliminary Drainage Report represents the storm water analysis for a multi-family residential development proposed in Scottsdale, Arizona. The purpose of this report is to provide the hydrologic and hydraulic analysis, required by the City of Scottsdale, to support the proposed site plan for said development. This report includes discussions and calculations defining the storm water management concepts for the collection and conveyance necessary to comply with the drainage requirements of the City of Scottsdale and Maricopa County. Preparation of this report has been done in accordance with the requirements of the City of Scottsdale Design Standards & Policies Manual (DS&PM) 2018 ¹, and the Drainage Design Manuals for Maricopa County, Arizona, Volume I² and Volume II³.

2. LOCATION AND PROJECT DESCRIPTION

2.1 LOCATION:

The subject property consists of land located in a portion of the Northeast Quarter of Section 27, Township 2 North, Range 4 East of the Gila and Salt River Base and Meridian, Maricopa County Arizona:

- Parcel ID: 130-13-064 and 130-13-062, Zoning is C-3.
- Address: 7018 E Osborn Rd Scottsdale, AZ 85251
7024 E Osborn Rd, Scottsdale, AZ 85251

Refer to **FIGURE 1 - Vicinity Map** for the project's location with respect to major cross streets

2.2 EXISTING AND PROPOSED DEVELOPMENTS SURROUNDING THE SITE:

- South: Across Osborn Road
 - Parcel 130-16-087; First Baptist Church; Zoning is R-5
- North: Across 6th Street
 - Parcel 130-13-075 to 130-13-088; Loloma Cove Condos; Zoning is R-5.
 - Parcel 130-13-063; Extended Stay America (hotel); Zoning is C-3.
- West:
 - Parcel 130-13-431; 70th Street Lofts Condominiums; Zoning is D/DMU-2.
 - Parcel 130-13-068; Residential home; Zoning is C-3.
- East:
 - Parcel 130-13-060A; Two Men and a Truck (moving company); Zoning is C-3.
 - Parcel 130-13-060B; Arizona Party Bike – Scottsdale (Tour Operator); Zoning is C-3.

2.3 EXISTING SITE DESCRIPTION:

The project area includes two parcels totaling approximately 1.45 acres of land and is designated with zoning C-3. The west parcel is a parking lot. The east parcel is an office building with surface parking and an enclosed storage yard.

Per Topographic Survey received from the client, the site topography slopes from the northwest to the southeast with approximately three feet of fall.

Refer to **FIGURE 2** attached for an aerial of the site.

2.4 PROPOSED SITE DEVELOPMENT:

Site development includes the demolition of existing structures and designated parking lots for the construction of a new high density multifamily project. The development will include two access points proposed at Osborn Road and 6th Street.

Refer to **APPENDIX III** – Preliminary Grading and Drainage Plan for site layout.

2.5 FLOOD HAZARD ZONE:

FIRM Map Number 04013C2235M dated September 18, 2020 indicates the site is designated as Zone "X". As such, it is defined as areas determined to be outside the 0.2% annual chance floodplain and therefore is not in a special flood hazard area. Refer to **FIGURE 3** for the FIRM.

3. EXISTING DRAINAGE CONDITIONS

3.1 OFF-SITE DRAINAGE PATTERNS

The topographic survey and FLO-2D maps provides the following information for offsite drainage:

- *North:* Half of the runoff from 6th Street flows towards the site, where it is conveyed through curb and gutter into an existing catch basin located approximately 200 ft east of the site. No offsite flows from the north affect the site. Refer to **APPENDIX II** for 6th Street gutter calculations.
- *East:* Runoff from the properties east of the site travels south into Osborn Road, where it is conveyed via curb and gutter into an existing catch basin approximately 100 ft east of the site.
- *West:* Runoff from the properties west of the site travels south into Osborn Road, where it is conveyed via curb and gutter into an existing catch basin south of the site.
- *South:* Half of the runoff from Osborn Road flows towards the site, where it is conveyed through curb and gutter into an existing catch basin south of the site.

Refer to **FIGURE 4** - FLO-2D Map (North) and **FIGURE 5** - FLO-2D Map (South)

3.2 ON-SITE DRAINAGE

Based on the topographic information, the historical outfalls are as follows:

- Flows from drainage areas EX-A1 through EX-A3 are collected in retention areas (EX-Basin 1 and EX-Basin 2) north of the screen walls in the west parcel.

- Flows from drainage areas EX-B1 and EX-B2 are collected by EX-CB-2 located in the southeastern corner of the west parcel in EX-Basin 3.
- Flows from drainage area EX-C1 and EX-C2 flow overland southerly to Osborn Road, where flows then travel easterly via curb and gutter into an existing catch basin south of the site (EX-CB-3) or continue easterly to additional existing catch basins.
- Flows from drainage area EX-D1 are self-retaining due to ponding on the area (EX-Basin 4).

Refer to **APPENDIX II** for **Existing Conditions Drainage Area Map**.

Table 1 below is a summary of existing conditions runoff calculations:

TABLE 1:

EXISTING SITE DISCHARGES									
	TOTAL AREA	Cwt	Intensity 10 yr 5-min	Q 10	Intensity 100 yr 5-min	Q 100	Control Point	Total flows Q10	Total flows Q100
	(ac)	(-)	(in/hr)	(cfs)	(in/hr)	(cfs)	CP#	(cfs)	(cfs)
	1.43		4.70	-	7.44	-	-	4.80	7.60
EX-A1	0.03	0.45	4.70	0.07	7.44	0.11	EX-Pipe-1	0.07	0.11
EX-A2	0.25	0.93	4.70	1.11	7.44	1.76	EX-CB-1	1.13	1.80
EX-A3	0.01	0.45	4.70	0.02	7.44	0.04			
EX-B1	0.34	0.92	4.70	1.47	7.44	2.33	EX-CB-2	1.53	2.42
EX-B2	0.03	0.45	4.70	0.05	7.44	0.09			
EX-C1	0.05	0.75	4.70	0.19	7.44	0.30	EX-CB-3	2.07	3.27
EX-C2	0.47	0.86	4.70	1.88	7.44	2.98			
EX-D1	0.25	0.48	4.70	0.56	7.44	0.89	N/A	N/A	N/A

Overall project area includes **1.43 Acres** at **C_{wt} = 0.80** (Existing conditions)

Refer to the **Existing Conditions Cwt** and **Existing Conditions Drainage Area Map** in **APPENDIX II**.

4. PROPOSED STORM WATER MANAGEMENT

4.1 DESIGN INTENT:

Given that the site has been previously developed, on-site retention shall be calculated per City of Scottsdale DSPM 4-1.201. In order to preserve existing drainage patterns, most of the on-site drainage will discharge to the historical outlets, a portion of the site run-off will also be stored in basins to fulfill stormwater retention and first flush requirements. The roof will be drained into a proposed underground storage tank. The proposed underground storage tank and open retention basins will store the pre-vs-post associated volume of the site. Excess volume will be discharged to Osborn Street south and 6th Street north. A drywell will be proposed for the underground storage tank. **APPENDIX II** for **Proposed Conditions Drainage Area Map**.

4.2 DESIGN STORM REQUIREMENTS:

In accordance with City of Scottsdale requirements for lots that are already developed, stormwater storage for the 100-year 2-hour storm event is required based on maintaining existing retention volume plus the difference between the pre vs. post development runoff from the 100-year 2-hour storm event if increased or first flush, whichever is greater.

4.3 LAND CHARACTERISTICS:

The proposed project site consists of a multi-family residential building with a retail space and landscape areas along the perimeter of the structure. Based on the DS&PM, runoff coefficients for the 100-year storm event used are as follows:

- C=0.95 for building or concrete
- C=0.95 for paved surface
- C=0.45 for undisturbed natural desert or desert landscape

HYDROLOGIC ANALYSIS: The hydrologic analysis is determined using the procedures in the City of Scottsdale Design Standards & Policies Manual and the Drainage Design Manual for Maricopa County, Arizona, Volume I.

Table 2 below is a summary of proposed conditions runoff calculations:

TABLE 2:

PROPOSED SITE DISCHARGES									
	TOTAL AREA	Cwt	Intensity 10 yr 5-min	Q 10	Intensity 100 yr 5-min	Q 100	Control Point	Total flows Q10	Total flows Q100
	(ac)	(-)	(in/hr)	(cfs)	(in/hr)	(cfs)	CP#	(cfs)	(cfs)
	1.43		4.70	-	7.44	-	-	5.27	8.34
DA-A1	1.12	0.95	4.70	5.01	7.44	7.93	N/A	5.01	7.93
DA-A2	0.11	0.50	4.70	0.26	7.44	0.41	R-1	0.26	0.41
DA-B1	0.06	0.45	4.70	0.12	7.44	0.19	N/A	0.12	0.19
DA-C1	0.05	0.45	4.70	0.10	7.44	0.16	N/A	0.10	0.16
DA-D1	0.10	0.51	4.70	0.23	7.44	0.37	Basin B	0.23	0.37

Overall project area includes **1.43 Acres at C_{wt} = 0.85** (Proposed conditions)

Refer to the **Proposed Conditions Cwt and Proposed Conditions Drainage Area Map in APPENDIX II.**

4.4 STORMWATER RETENTION:

100-YR, 2-HR STORM: Per City of Scottsdale DSPM 4-1.201, development storage requirements for the 100-yr, 2-hr storm event are calculated as follows:

$$V_r = \Delta C \left(\frac{R}{12} \right) A$$

where:

V_r = Required storage (cf)

R = Precipitation amount =2.16 in per NOAA Atlas 14 Precipitation Frequency Estimates

A = Total area of site (sf)

$\Delta C = C_{post} - C_{pre}$

$$V_r = (0.85 - 0.80) \left(\frac{2.16}{12} \right) (62,392) = 562 \text{ cf}$$

Since the difference of the weighted coefficients is positive, stormwater flows in the project area will increase, generating additional flow contributions to existing drainage patterns. Therefore, stormwater retention is required for the development following the pre vs. post analysis.

FIRST FLUSH: First Flush storage required is calculated in accordance with City of Scottsdale DSPM 4-1.201. Only the areas where runoff could be affected by vehicular contact are considered in the first flush calculation. The roof drainage is considered to be free of heavy traffic pollutants, therefore, on-site driveway areas and sidewalks will be considered for the calculation. As shown in the Proposed Conditions Cwt Exhibit, first flush area is calculated as the total project area (62,392 sf) minus roof area (48,858 sf) and landscape areas (12,597 sf), equating to 937 sf. Since the first flush area is less than one acre, no first flush calculation is required.

Retention shall be provided for the Pre vs Post, therefore on-site retention will be designed to store the Pre vs. Post volume. (562 cf). The provided storage volume will also account for the existing basins provided volumes, which have a combined volume of 4,293 cf. Refer to **APPENDIX II** for existing basins volume calculations. The total required volume is 4,293 cf + 562 cf = **4,855** cf. Provided storage on proposed conditions is calculated below:

Provided storage of *Basin 1*:

Basin 1 will consist of a 10' diameter corrugated metal pipe and will have a length of 45 LF.

$$V_p = \pi * \text{Pipe radius}^2 * \text{Pipe length}$$

$$V_p = (\pi * 5^2) * (45) = 3,534 \text{ cf}$$

Provided storage *Basin 2*:

Basin 2					
ELEV.	AREA	DEPTH	AVG VOLUME	SUM VOLUME	COMMENT
(FT)	(SF)	(FT)	(CF)	(CF)	
1248.0	153			0.00	Bottom
		1.00	593.74		
1249.0	1,034			593.74	

Provided storage *Basin 3:*

Basin 3					
ELEV.	AREA	DEPTH	AVG VOLUME	SUM VOLUME	COMMENT
(FT)	(SF)	(FT)	(CF)	(CF)	
1250.0	0			0.00	Bottom
		1.00	192.18		
1251.0	384			192.18	

Provided storage *Basin 4:*

Basin 4					
ELEV.	AREA	DEPTH	AVG VOLUME	SUM VOLUME	COMMENT
(FT)	(SF)	(FT)	(CF)	(CF)	
1251.0	342			0.00	Bottom
		1.00	992.64		
1252.0	1,643			992.64	

The table below shows a summary of proposed and required volume for the site:

TABLE 4:

Proposed Retention Basin Summary					
Basin		TYPE	Vp	Vptotal	Vr
(ID)		(--)	(CF)	(CF)	(CF)
Basin 1	Basin 1	UG	3,534	5,313	4,855
Basin 2	Basin 2	OPEN	594		
Basin 3	Basin 3	OPEN	192		
Basin 4	Basin 4	OPEN	993		
Total:				5,313	4,855

The proposed basin has enough capacity to store the required additional volume generated from the Pre vs. Post analysis.

4.5 STORMWATER DISCHARGE

For Basins with no direct bleed-off available, Drywells are proposed in the on-site storage facilities to dispose of the stormwater within thirty-six (36) hours. The calculation is as follows:

- Minimum percolating rate of a drywell (for planning purposes) = 0.1 cfs
- Volume to be drained in 36 hours = 0.1 cfs * 36 hours * 3600 sec/hour = 12,960 cf = 0.298 acre-feet.
- The number of drywells will be reduced if geotechnical testing for percolation rates determine adequate infiltration is available in the native soils at lower depths. If the

percolation rate of the drywells is less than 0.1 cfs the number of drywells may have to be increased.

Basin 1:

Total provided storage = **3,534 CF**

3,534 CF / 12,960 CF per drywell = 0.28 = 1 drywell required.

No drywell is required for one-foot basins.

Pre vs post discharges

Proposed conditions will ultimately increase site flow contributions to the existing public storm drain system. The overall run-off coefficient of the site will be increased by 0.05

Table 3 below summarizes the project discharges per outfall for the 10-year and 100-year storm events, providing the differences between existing and proposed peak flows for each case.

TABLE 5:

Outfall	Q10 (cfs)			Q100 (cfs)		
	Existing	Proposed	Δ	Existing	Proposed	Δ
6th Street	0.00	0.00	0.00	0.00	0.00	0.00
EX-CB-4 (Osborn Rd)	3.60	0.00	-3.60	5.69	0.00	-5.69

During the 100-year storm event, discharges to the overall public storm drain system will be decreased by 5.69 cfs.

Refer to **Existing Conditions Drainage Area Map** and **Proposed Conditions Drainage Area Map** in **APPENDIX II**.

4.6 ADEQ WATER QUALITY REQUIREMENTS

The total disturbed area of this site is approximately 1.45 acres. The Arizona Department of Environmental Quality requires that any site disturbance over an acre is required to submit an NOI. A NOI will be submitted to ADEQ for this site after the first submittal of the construction documents as this site disturbance is over 1 acre.

5. FLOOD SAFETY FOR DWELLINGS

5.1 FINISHED FLOOR ELEVATIONS

This project lies in an "X" Flood Zone. Therefore, the proposed building finished floor elevation will be set a minimum of 14 inches above the lot ultimate outfall, located at the southeast corner of the site at an elevation of 1248.74'.

6. CONCLUSIONS

6.1 OVERALL PROJECT:

1. The finish floor elevations will be designed a minimum of 14 inches above the low top of curb of the lot.

2. The historical outfalls will be affected at proposed conditions and overall discharge to the public storm drain system will be decreased.
3. On-site storage facilities will be provided to account for the Pre vs. Post volume and existing on-site basins required volume.

6.2 PROJECT PHASING:

This project will be constructed in a single phase.

7. WARNING AND DISCLAIMER OF LIABILITY

RE: following page.

8. REFERENCES

1. *Design Standards & Policies Manual, City of Scottsdale – January 2018*
2. *Drainage Design Manual for Maricopa County, Arizona, Volume I, Hydrology, Flood Control District of Maricopa County, Fourth Edition, December 14, 2018*
3. *Drainage Design Manual for Maricopa County, Arizona, Volume II, Hydraulics, Flood Control District of Maricopa County, December 14, 2018*

GRADING & DRAINAGE LANGUAGE

WARNING AND DISCLAIMER OF LIABILITY

The City’s Stormwater and Floodplain Management Ordinance is intended to minimize the occurrence of losses, hazards and conditions adversely affecting the public health, safety and general welfare which might result from flooding. The Stormwater and Floodplain Management Ordinance identifies floodplains, floodways, flood fringes and special flood hazard areas. However, a property outside these areas could be inundated by floods. Also, much of the city is a dynamic flood area; floodways, floodplains, flood fringes and special flood hazard areas may shift from one location to another, over time, due to natural processes.

WARNING AND DISCLAIMER OF LIABILITY

The flood protection provided by the Stormwater and Floodplain Management Ordinance is considered reasonable for regulatory purposes and is based on scientific and engineering considerations. Floods larger than the base flood can and will occur on rare occasions. Floodwater heights may be increased by constructed or natural causes. The Stormwater and Floodplain Management Ordinance does not create liability on the part of the city, any officer or employee thereof, or the federal, state or county government for any flood damages that result from reliance on the Ordinance or any administrative decision lawfully made thereunder.

Compliance with the Stormwater and Floodplain Management Ordinance does not ensure complete protection from flooding. Flood-related problems such as natural erosion, streambed meander, or constructed obstructions and diversions may occur and have an adverse effect in the event of a flood. You are advised to consult your own engineer or other expert regarding these considerations.

I have read and understand the above.

Plan Check #	Owner	Date

FIGURES

FIGURE 1 - Vicinity Map

FIGURE 1 - Aerial

FIGURE 3 - Firm

FIGURE 3 - FLO-2D Map (North)

FIGURE 4 - FLO-2D Map (North)



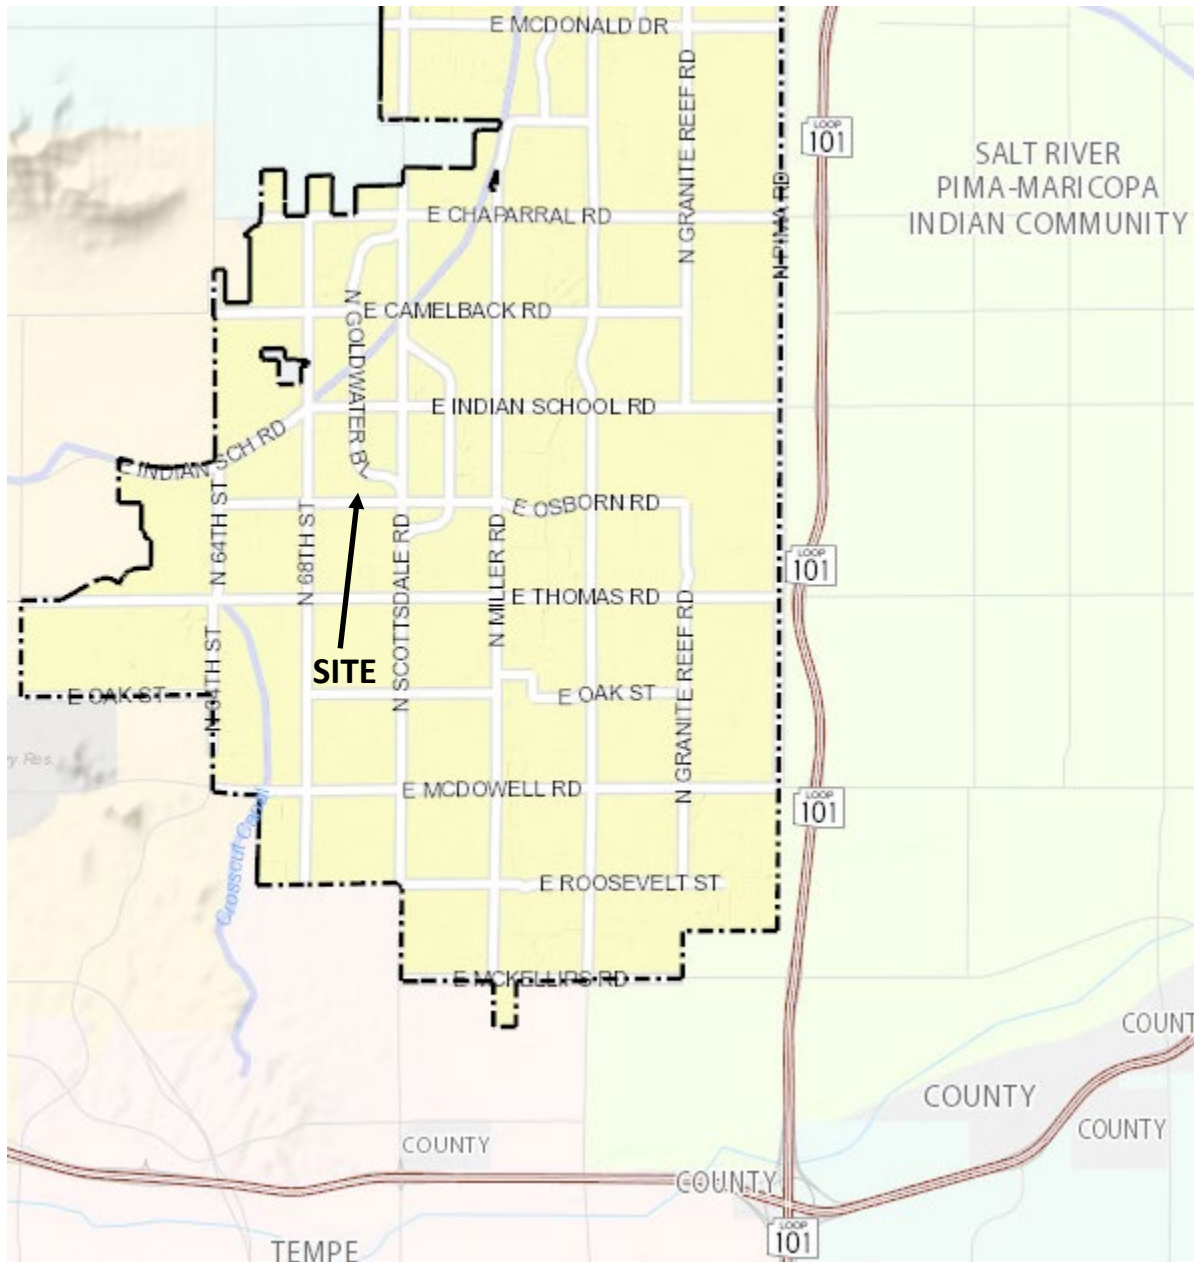


FIGURE 1. VICINITY MAP

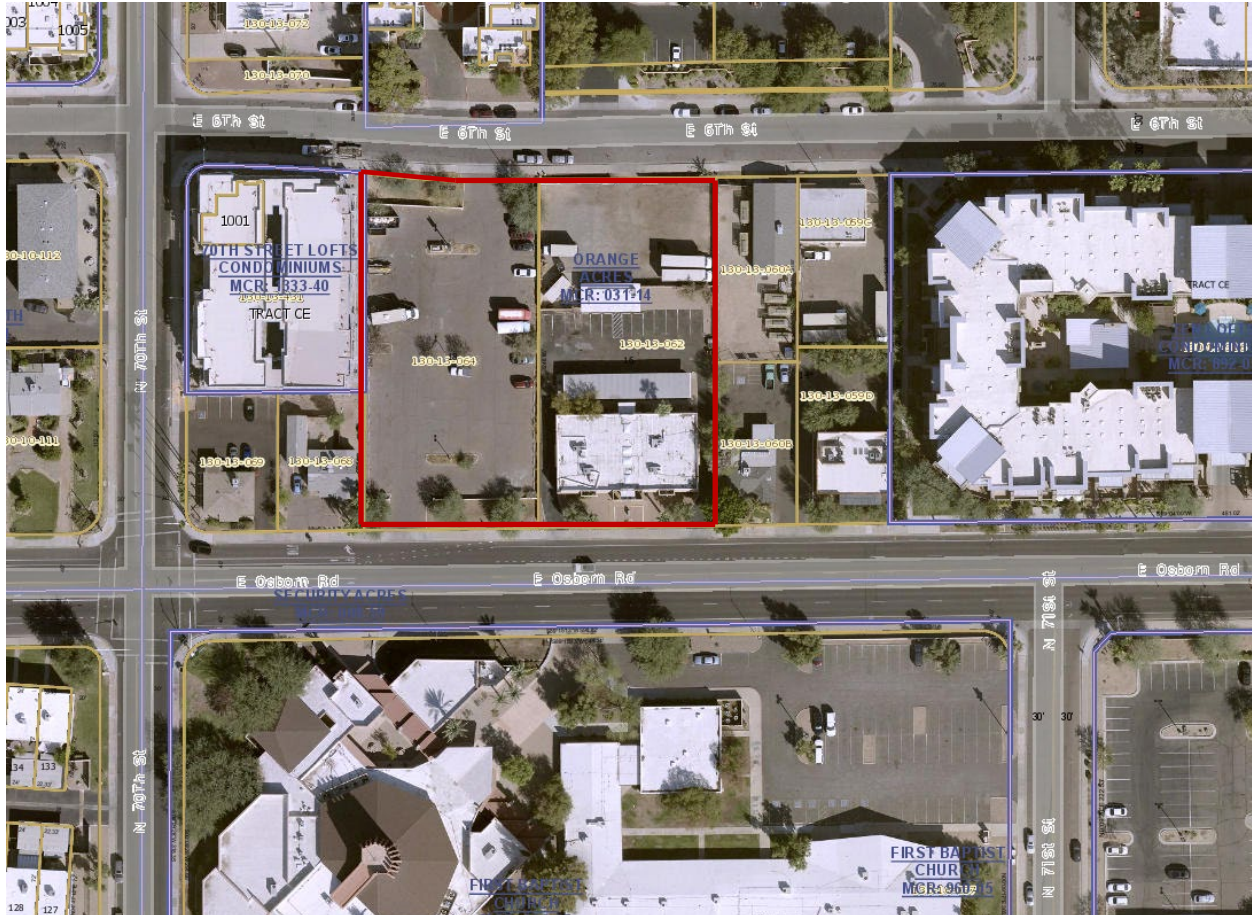

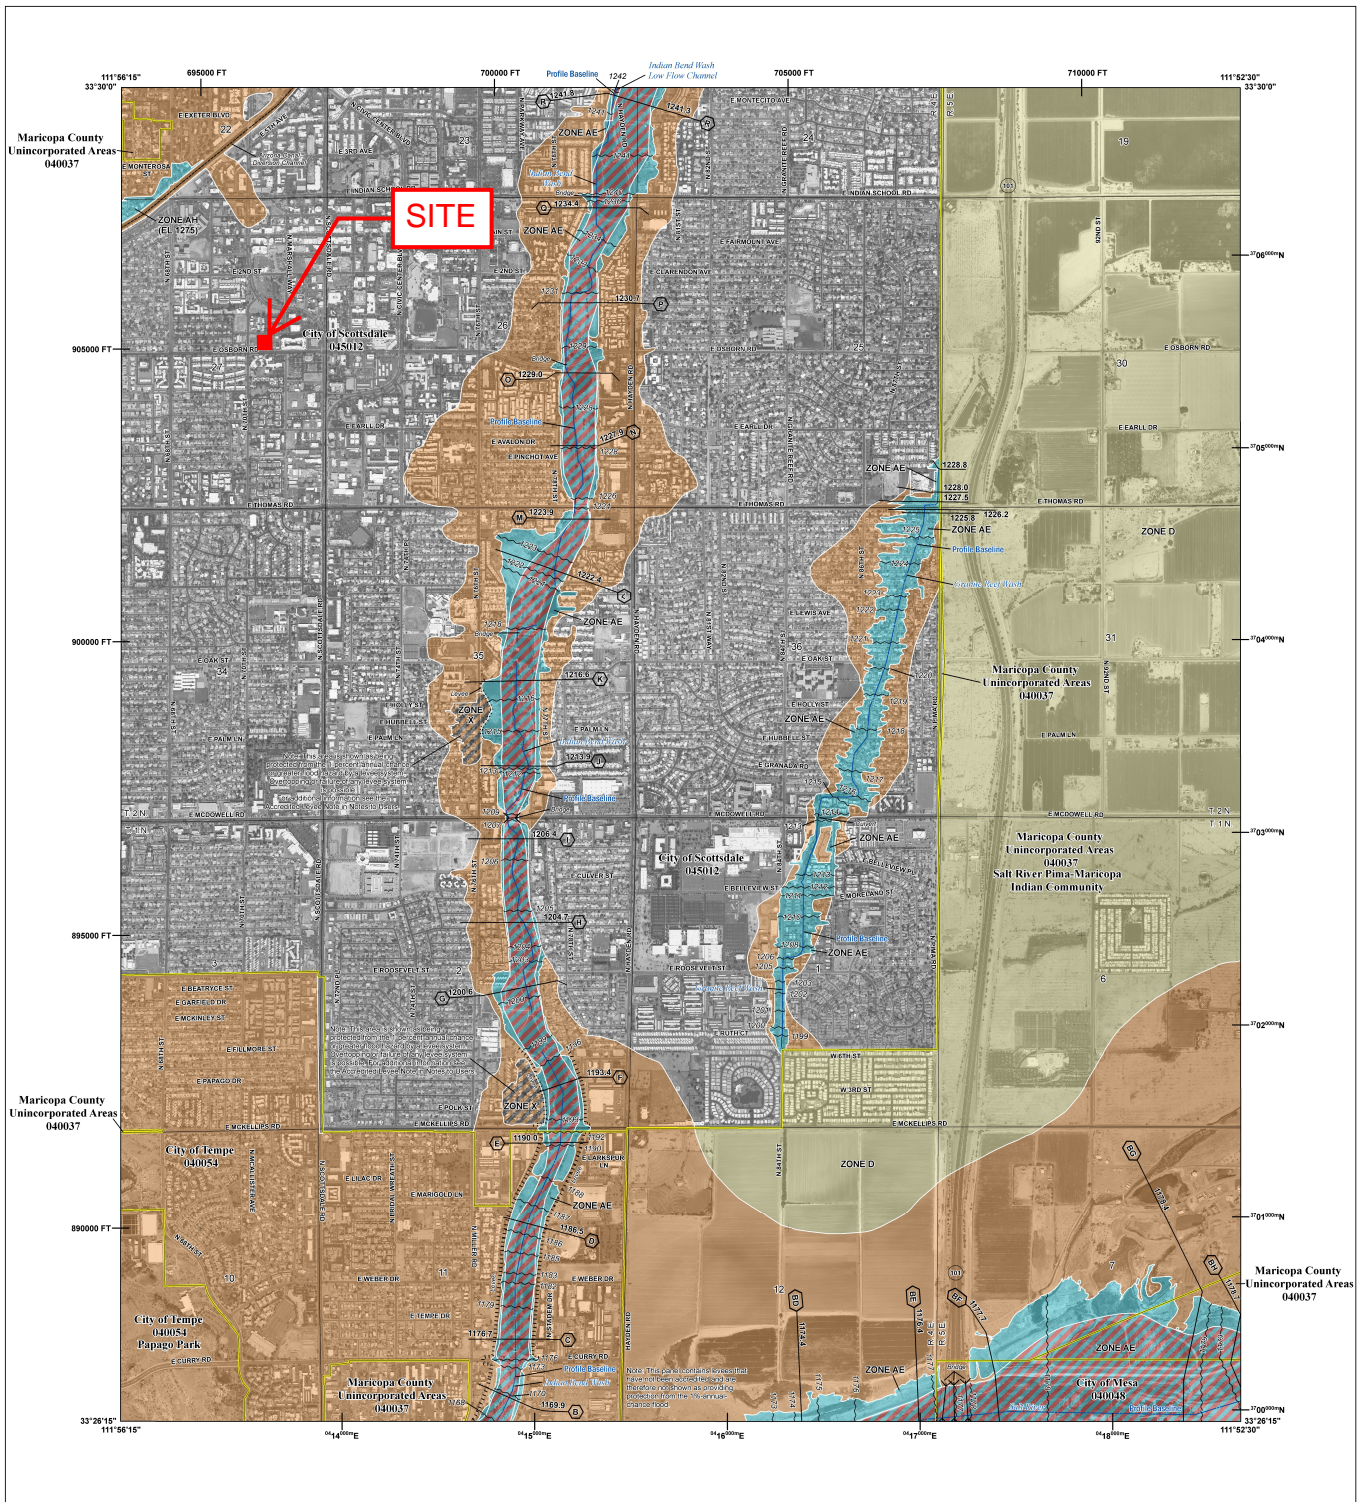

FLOOD HAZARD INFORMATION

SEE FIS REPORT FOR DETAILED LEGEND AND INDEX MAP FOR FIRM PANEL LAYOUT
THE INFORMATION DEPICTED ON THIS MAP AND SUPPORTING DOCUMENTATION ARE ALSO AVAILABLE IN DIGITAL FORMAT AT
[HTTPS://MSC.FEMA.GOV](https://msc.fema.gov)

- SPECIAL FLOOD HAZARD AREAS**
 - Without Base Flood Elevation (BFE) Zone A, V, AE, AO, AP, VE, AR
 - With BFE or Depth Zone AE, AO, AP, VE, AR
 - Regulatory Floodway
 - 0.2% Annual Chance Flood Hazard, Areas of 1% annual chance flood with average depth less than one foot or with drainage areas of less than one square mile Zone X
 - Future Conditions 1% Annual Chance Flood Hazard Zone X
 - Area with Reduced Flood Risk due to Levee See Notes, Zone X
 - Area with Flood Risk due to Levee Zone D
- OTHER AREAS OF FLOOD HAZARD**
 - NO SCREEN Area of Minimal Flood Hazard Zone X
 - Area of Undetermined Flood Hazard Zone D
- GENERAL STRUCTURES**
 - Channel, Culvert, or Storm Sewer
 - Levee, Dike, or Floodwall
 - Cross Sections with 1% Annual Chance Water Surface Elevation
 - Coastal Transect
 - Coastal Transect Baseline
 - Profile Baseline
 - Hydrographic Feature
 - Base Flood Elevation Line (BFE)
 - Limit of Study
 - Jurisdiction Boundary
- OTHER FEATURES**

NOTES TO USERS

For information and questions about this Flood Insurance Rate Map (FIRM), available products associated with this FIRM including historic editions, the current map date for each FIRM panel, how to order products or the National Flood Insurance Program (NFIP) in general, please call the FEMA Map Information Center at 1-877-FEMA-9999 (1-877-368-2927) or visit the FEMA Flood Map Service Center website at <https://msc.fema.gov>. Available products may include previously issued Letters of Map Change, a Flood Insurance Study Report, and/or digital versions of this map. Many of these products can be ordered or obtained directly from the website.

Communities occupying land on adjacent FIRM panels must obtain a current copy of the adjacent panel as well as the current FIRM index. These may be ordered directly from the Flood Map Service Center at the number listed above.


For community and countywide map dates refer to the Flood Insurance Study Report for this jurisdiction.

To determine if flood insurance is available in this community, contact your insurance agent or call the National Flood Insurance Program at 1-800-368-6629.


Base map information shown on this FIRM was derived from U.S. Census Bureau TIGER files, dated 2014, and digital data provided by the Flood Control District of Maricopa County. Digital orthophotography was provided by the Flood Control District of Maricopa County. The imagery was from a Fall 2013 aerial and was produced with a 0.6 foot ground sample distance.

ADDITIONAL NOTES TO USERS: Check with your local community to obtain more information, such as the estimated level of protection provided (which may exceed the 1 percent-annual-chance level) and Emergency Action Plan, or the levee protection) shown as protecting protection for areas on this panel. To mitigate flood risk in residual risk areas, property owners and residents are encouraged to consider flood insurance and floodproofing or other protective measures. For more information on flood insurance, interested parties should visit the FEMA Website at <http://www.fema.gov/national-flood-insurance-program>.

SCALE



PANEL LOCATOR

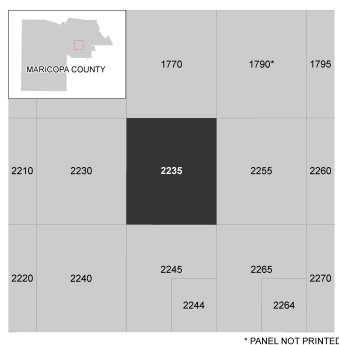

NATIONAL FLOOD INSURANCE PROGRAM
FLOOD INSURANCE RATE MAP
MARICOPA COUNTY, ARIZONA
 and Incorporated Areas
 PANEL 2235 OF 4425

Panel Contains:

COMMUNITY	NUMBER	PANEL	SUFFIX
MARICOPA COUNTY	040037	2235	M
MESA, CITY OF	040048	2235	M
SCOTTSDALE, CITY OF	043012	2235	M
TEMPE, CITY OF	040054	2235	M

VERSION NUMBER
 2.3.3.2


MAP NUMBER
 04013C2235M
 MAP DATE
 September 18, 2020


**FIGURE 3.
 FIRM**



February 14, 2022


FIGURE 4. FLO-2D MAP (NORTH)

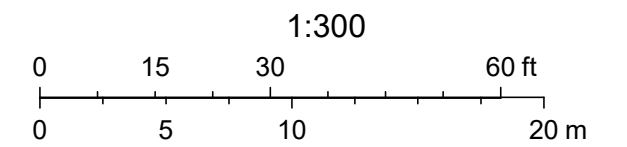

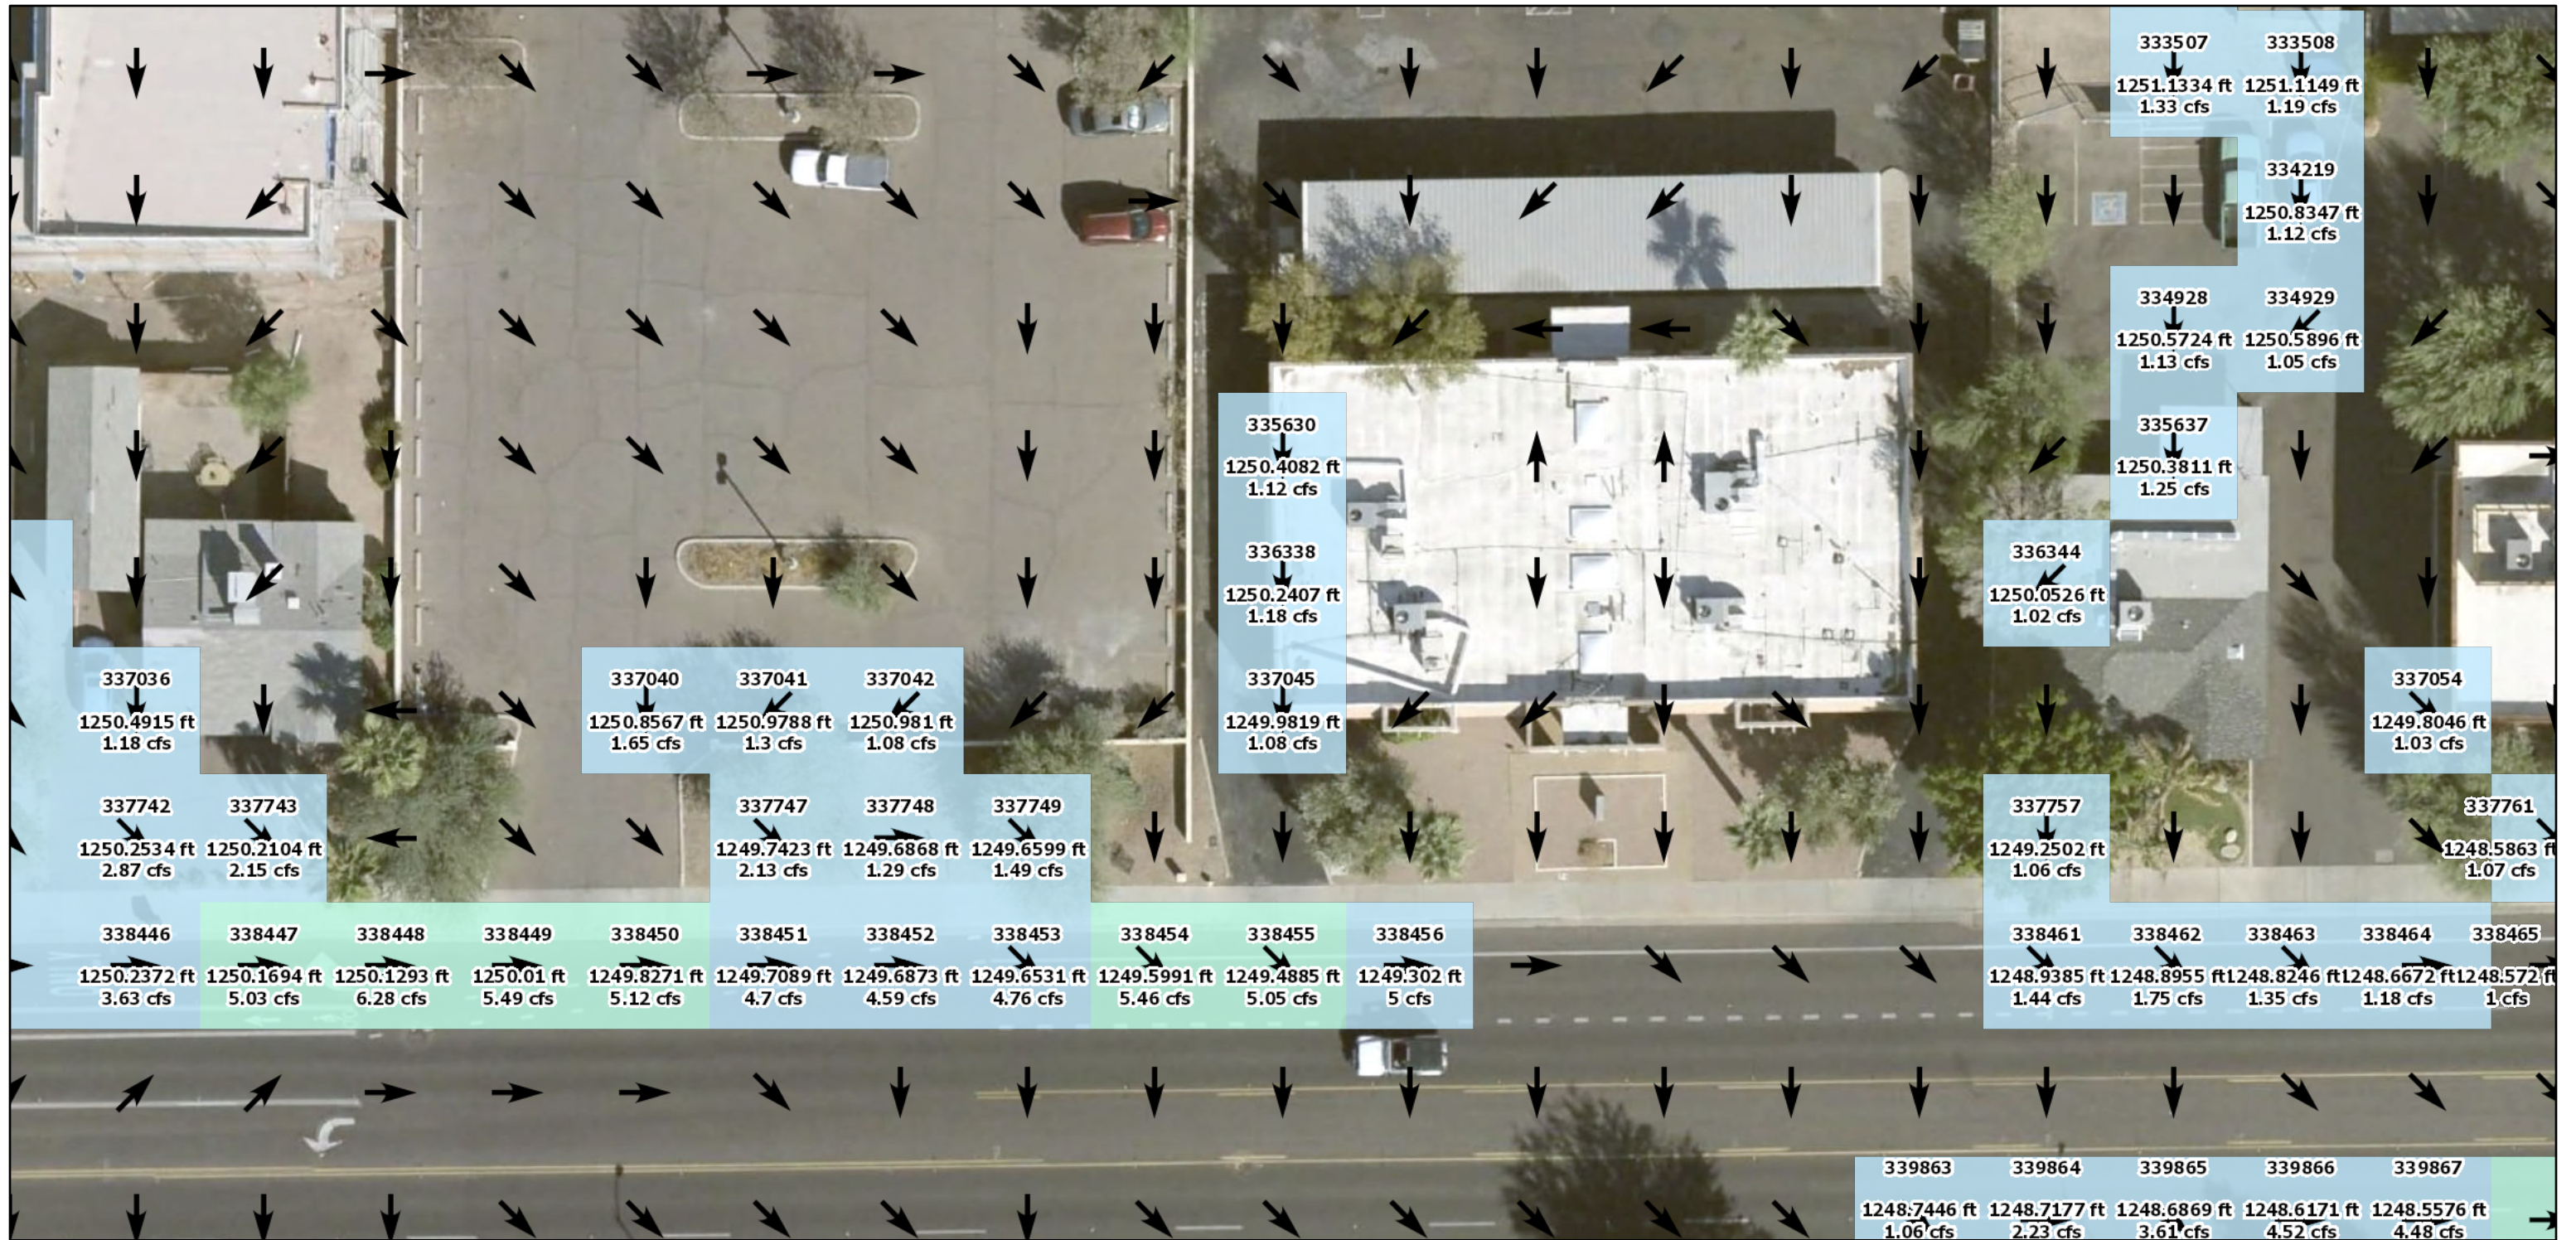

February 14, 2022

FIGURE 4. FLO-2D MAP (SOUTH)

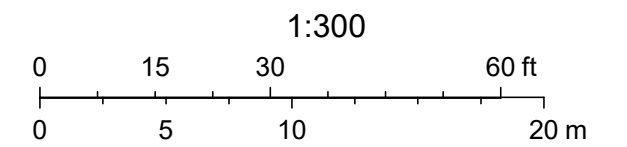

APPENDIX I

RAINFALL DATA



NOAA Atlas 14, Volume 1, Version 5
Location name: Scottsdale, Arizona, USA*
Latitude: 33.4877°, Longitude: -111.9298°
Elevation: 1250.77 ft**
 * source: ESRI Maps
 ** source: USGS



POINT PRECIPITATION FREQUENCY ESTIMATES

Sanja Perica, Sarah Dietz, Sarah Heim, Lillian Hiner, Kazungu Maitaria, Deborah Martin, Sandra Pavlovic, Ishani Roy, Carl Trypaluk, Dale Unruh, Fenglin Yan, Michael Yekta, Tan Zhao, Geoffrey Bonnin, Daniel Brewer, Li-Chuan Chen, Tye Parzybok, John Yarchoan

NOAA, National Weather Service, Silver Spring, Maryland

[PF_tabular](#) | [PF_graphical](#) | [Maps_&_aerials](#)

PF tabular





PDS-based point precipitation frequency estimates with 90% confidence intervals (in inches)¹										
Duration	Average recurrence interval (years)									
	1	2	5	10	25	50	100	200	500	1000
5-min	0.183 (0.154-0.223)	0.240 (0.202-0.291)	0.326 (0.273-0.395)	0.392 (0.326-0.472)	0.481 (0.394-0.577)	0.550 (0.444-0.657)	0.620 (0.492-0.739)	0.692 (0.540-0.824)	0.788 (0.598-0.940)	0.862 (0.641-1.03)
10-min	0.279 (0.234-0.339)	0.364 (0.307-0.443)	0.495 (0.415-0.600)	0.596 (0.496-0.719)	0.732 (0.599-0.878)	0.837 (0.676-1.00)	0.944 (0.748-1.12)	1.05 (0.821-1.25)	1.20 (0.911-1.43)	1.31 (0.976-1.57)
15-min	0.345 (0.290-0.420)	0.452 (0.381-0.549)	0.614 (0.514-0.744)	0.739 (0.614-0.891)	0.907 (0.743-1.09)	1.04 (0.838-1.24)	1.17 (0.928-1.39)	1.31 (1.02-1.55)	1.49 (1.13-1.77)	1.63 (1.21-1.94)
30-min	0.465 (0.390-0.565)	0.608 (0.513-0.740)	0.827 (0.692-1.00)	0.995 (0.827-1.20)	1.22 (1.00-1.47)	1.40 (1.13-1.67)	1.58 (1.25-1.88)	1.76 (1.37-2.09)	2.00 (1.52-2.39)	2.19 (1.63-2.61)
60-min	0.575 (0.483-0.700)	0.753 (0.635-0.915)	1.02 (0.857-1.24)	1.23 (1.02-1.49)	1.51 (1.24-1.82)	1.73 (1.40-2.07)	1.95 (1.55-2.32)	2.18 (1.70-2.59)	2.48 (1.88-2.95)	2.71 (2.02-3.24)
2-hr	0.666 (0.569-0.795)	0.863 (0.736-1.03)	1.16 (0.983-1.37)	1.38 (1.16-1.64)	1.69 (1.40-1.99)	1.92 (1.57-2.26)	2.16 (1.75-2.54)	2.41 (1.91-2.82)	2.74 (2.12-3.21)	2.99 (2.27-3.54)
3-hr	0.724 (0.614-0.870)	0.929 (0.793-1.12)	1.22 (1.04-1.47)	1.45 (1.22-1.74)	1.78 (1.47-2.11)	2.04 (1.66-2.41)	2.31 (1.85-2.73)	2.59 (2.04-3.06)	2.98 (2.28-3.52)	3.29 (2.46-3.91)
6-hr	0.873 (0.756-1.03)	1.11 (0.962-1.30)	1.42 (1.23-1.66)	1.67 (1.43-1.95)	2.01 (1.70-2.33)	2.28 (1.90-2.63)	2.56 (2.10-2.95)	2.84 (2.28-3.28)	3.23 (2.53-3.74)	3.53 (2.71-4.11)
12-hr	0.977 (0.855-1.13)	1.23 (1.08-1.44)	1.57 (1.36-1.81)	1.82 (1.58-2.11)	2.17 (1.86-2.50)	2.44 (2.07-2.81)	2.72 (2.27-3.13)	3.00 (2.47-3.45)	3.37 (2.71-3.91)	3.67 (2.89-4.28)
24-hr	1.17 (1.05-1.32)	1.49 (1.33-1.68)	1.93 (1.72-2.18)	2.28 (2.02-2.56)	2.76 (2.43-3.11)	3.14 (2.75-3.53)	3.54 (3.08-3.97)	3.95 (3.41-4.44)	4.53 (3.86-5.08)	4.98 (4.20-5.60)
2-day	1.26 (1.13-1.43)	1.62 (1.44-1.82)	2.12 (1.89-2.39)	2.53 (2.24-2.84)	3.09 (2.73-3.47)	3.54 (3.11-3.98)	4.02 (3.50-4.52)	4.51 (3.90-5.08)	5.21 (4.45-5.87)	5.76 (4.88-6.51)
3-day	1.34 (1.19-1.51)	1.71 (1.52-1.93)	2.25 (2.00-2.53)	2.69 (2.38-3.02)	3.30 (2.91-3.70)	3.79 (3.32-4.25)	4.32 (3.75-4.84)	4.87 (4.20-5.47)	5.64 (4.80-6.34)	6.26 (5.28-7.06)
4-day	1.41 (1.25-1.59)	1.80 (1.60-2.04)	2.38 (2.11-2.68)	2.85 (2.52-3.20)	3.51 (3.08-3.94)	4.04 (3.53-4.53)	4.61 (4.00-5.17)	5.22 (4.49-5.86)	6.07 (5.16-6.82)	6.77 (5.69-7.61)
7-day	1.57 (1.39-1.77)	2.00 (1.78-2.26)	2.64 (2.34-2.98)	3.16 (2.80-3.56)	3.90 (3.43-4.38)	4.49 (3.92-5.04)	5.12 (4.44-5.75)	5.79 (4.98-6.51)	6.73 (5.72-7.57)	7.49 (6.30-8.45)
10-day	1.70 (1.51-1.92)	2.18 (1.94-2.45)	2.87 (2.55-3.23)	3.44 (3.04-3.86)	4.22 (3.71-4.73)	4.85 (4.24-5.43)	5.52 (4.79-6.18)	6.22 (5.36-6.98)	7.21 (6.14-8.08)	8.00 (6.74-8.99)
20-day	2.09 (1.87-2.34)	2.69 (2.40-3.01)	3.55 (3.17-3.97)	4.20 (3.74-4.69)	5.08 (4.50-5.67)	5.76 (5.08-6.42)	6.44 (5.65-7.19)	7.14 (6.23-7.98)	8.08 (6.99-9.05)	8.81 (7.56-9.88)
30-day	2.44 (2.17-2.74)	3.14 (2.80-3.52)	4.14 (3.68-4.63)	4.90 (4.35-5.47)	5.92 (5.23-6.60)	6.70 (5.89-7.47)	7.51 (6.57-8.36)	8.32 (7.25-9.27)	9.42 (8.14-10.5)	10.3 (8.81-11.5)
45-day	2.83 (2.53-3.16)	3.64 (3.26-4.07)	4.80 (4.29-5.36)	5.66 (5.04-6.32)	6.78 (6.02-7.57)	7.63 (6.76-8.52)	8.49 (7.49-9.49)	9.35 (8.21-10.5)	10.5 (9.13-11.8)	11.3 (9.82-12.7)
60-day	3.13 (2.81-3.49)	4.04 (3.63-4.51)	5.32 (4.76-5.92)	6.24 (5.58-6.95)	7.45 (6.64-8.29)	8.34 (7.41-9.29)	9.24 (8.17-10.3)	10.1 (8.91-11.3)	11.3 (9.87-12.6)	12.1 (10.6-13.6)

¹ Precipitation frequency (PF) estimates in this table are based on frequency analysis of partial duration series (PDS). Numbers in parenthesis are PF estimates at lower and upper bounds of the 90% confidence interval. The probability that precipitation frequency estimates (for a given duration and average recurrence interval) will be greater than the upper bound (or less than the lower bound) is 5%. Estimates at upper bounds are not checked against probable maximum precipitation (PMP) estimates and may be higher than currently valid PMP values. Please refer to NOAA Atlas 14 document for more information.

[Back to Top](#)

PF graphical

PDS-based depth-duration-frequency (DDF) curves Latitude: 33.4877°, Longitude: -111.9298°

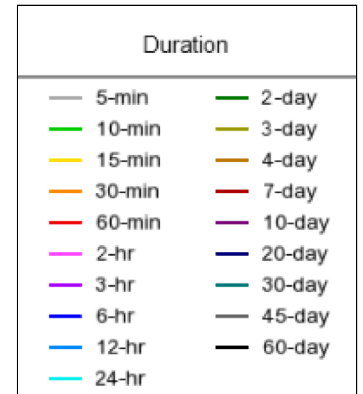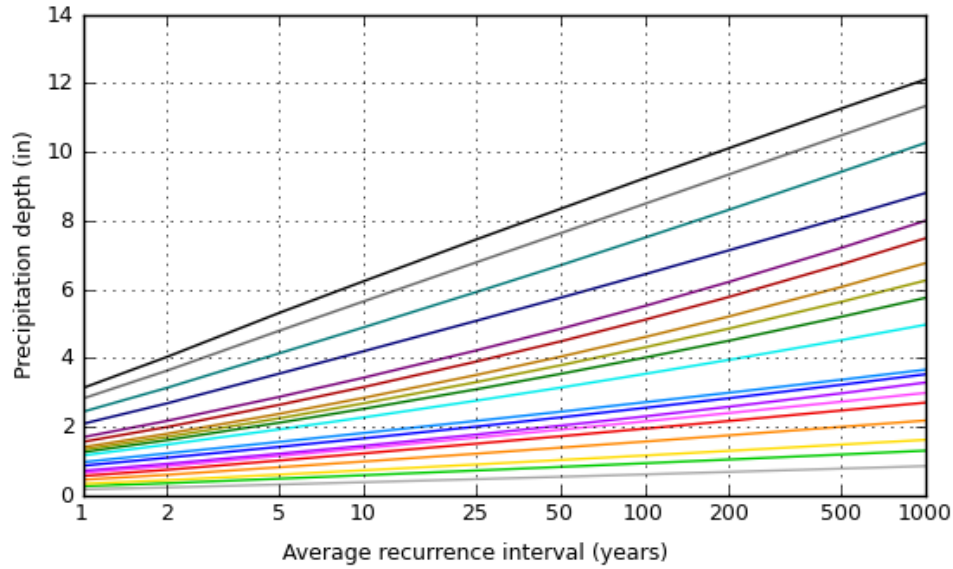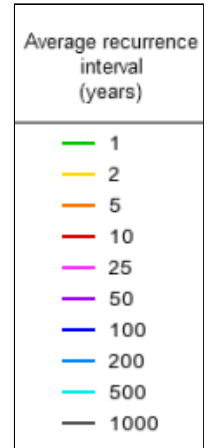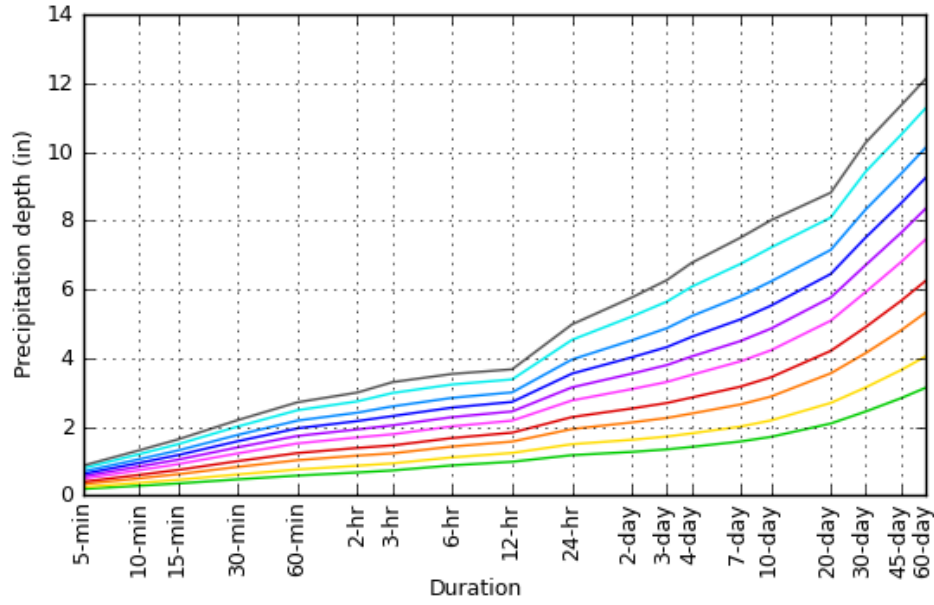

[Back to Top](#)

Maps & aerials

Small scale terrain



NOAA Atlas 14, Volume 1, Version 5
Location name: Scottsdale, Arizona, USA*
Latitude: 33.4877°, Longitude: -111.9298°
Elevation: 1250.77 ft**



* source: ESRI Maps
 ** source: USGS

POINT PRECIPITATION FREQUENCY ESTIMATES

Sanja Perica, Sarah Dietz, Sarah Heim, Lillian Hiner, Kazungu Maitaria, Deborah Martin, Sandra Pavlovic, Ishani Roy, Carl Trypaluk, Dale Unruh, Fenglin Yan, Michael Yekta, Tan Zhao, Geoffrey Bonnin, Daniel Brewer, Li-Chuan Chen, Tye Parzybok, John Yarchoan

NOAA, National Weather Service, Silver Spring, Maryland

[PF_tabular](#) | [PF_graphical](#) | [Maps_&_aerials](#)

PF tabular

PDS-based point precipitation frequency estimates with 90% confidence intervals (in inches/hour)¹										
Duration	Average recurrence interval (years)									
	1	2	5	10	25	50	100	200	500	1000
5-min	2.20 (1.85-2.68)	2.88 (2.42-3.49)	3.91 (3.28-4.74)	4.70 (3.91-5.66)	5.77 (4.73-6.92)	6.60 (5.33-7.88)	7.44 (5.90-8.87)	8.30 (6.48-9.89)	9.46 (7.18-11.3)	10.3 (7.69-12.3)
10-min	1.67 (1.40-2.03)	2.18 (1.84-2.66)	2.97 (2.49-3.60)	3.58 (2.98-4.31)	4.39 (3.59-5.27)	5.02 (4.06-6.00)	5.66 (4.49-6.74)	6.32 (4.93-7.52)	7.19 (5.47-8.58)	7.87 (5.86-9.40)
15-min	1.38 (1.16-1.68)	1.81 (1.52-2.20)	2.46 (2.06-2.98)	2.96 (2.46-3.56)	3.63 (2.97-4.36)	4.15 (3.35-4.96)	4.68 (3.71-5.58)	5.22 (4.07-6.22)	5.95 (4.52-7.09)	6.50 (4.84-7.76)
30-min	0.930 (0.780-1.13)	1.22 (1.03-1.48)	1.65 (1.38-2.00)	1.99 (1.65-2.40)	2.44 (2.00-2.93)	2.79 (2.26-3.34)	3.15 (2.50-3.75)	3.52 (2.74-4.18)	4.00 (3.04-4.77)	4.38 (3.26-5.23)
60-min	0.575 (0.483-0.700)	0.753 (0.635-0.915)	1.02 (0.857-1.24)	1.23 (1.02-1.49)	1.51 (1.24-1.82)	1.73 (1.40-2.07)	1.95 (1.55-2.32)	2.18 (1.70-2.59)	2.48 (1.88-2.95)	2.71 (2.02-3.24)
2-hr	0.333 (0.284-0.398)	0.432 (0.368-0.516)	0.578 (0.492-0.687)	0.690 (0.580-0.818)	0.842 (0.700-0.992)	0.960 (0.787-1.13)	1.08 (0.872-1.27)	1.20 (0.954-1.41)	1.37 (1.06-1.61)	1.50 (1.13-1.77)
3-hr	0.241 (0.204-0.290)	0.309 (0.264-0.374)	0.407 (0.345-0.489)	0.484 (0.407-0.578)	0.592 (0.491-0.703)	0.678 (0.554-0.803)	0.768 (0.616-0.909)	0.862 (0.680-1.02)	0.992 (0.759-1.17)	1.10 (0.818-1.30)
6-hr	0.146 (0.126-0.172)	0.185 (0.161-0.217)	0.237 (0.205-0.278)	0.279 (0.239-0.325)	0.335 (0.284-0.389)	0.380 (0.317-0.439)	0.427 (0.350-0.493)	0.474 (0.381-0.548)	0.539 (0.423-0.625)	0.590 (0.452-0.686)
12-hr	0.081 (0.071-0.094)	0.102 (0.090-0.119)	0.130 (0.113-0.150)	0.151 (0.131-0.175)	0.180 (0.154-0.208)	0.203 (0.172-0.233)	0.226 (0.188-0.260)	0.249 (0.205-0.287)	0.280 (0.225-0.324)	0.304 (0.240-0.355)
24-hr	0.049 (0.044-0.055)	0.062 (0.055-0.070)	0.080 (0.072-0.091)	0.095 (0.084-0.107)	0.115 (0.101-0.129)	0.131 (0.115-0.147)	0.148 (0.128-0.166)	0.165 (0.142-0.185)	0.189 (0.161-0.212)	0.207 (0.175-0.233)
2-day	0.026 (0.023-0.030)	0.034 (0.030-0.038)	0.044 (0.039-0.050)	0.053 (0.047-0.059)	0.064 (0.057-0.072)	0.074 (0.065-0.083)	0.084 (0.073-0.094)	0.094 (0.081-0.106)	0.108 (0.093-0.122)	0.120 (0.102-0.136)
3-day	0.019 (0.017-0.021)	0.024 (0.021-0.027)	0.031 (0.028-0.035)	0.037 (0.033-0.042)	0.046 (0.040-0.051)	0.053 (0.046-0.059)	0.060 (0.052-0.067)	0.068 (0.058-0.076)	0.078 (0.067-0.088)	0.087 (0.073-0.098)
4-day	0.015 (0.013-0.017)	0.019 (0.017-0.021)	0.025 (0.022-0.028)	0.030 (0.026-0.033)	0.037 (0.032-0.041)	0.042 (0.037-0.047)	0.048 (0.042-0.054)	0.054 (0.047-0.061)	0.063 (0.054-0.071)	0.071 (0.059-0.079)
7-day	0.009 (0.008-0.011)	0.012 (0.011-0.013)	0.016 (0.014-0.018)	0.019 (0.017-0.021)	0.023 (0.020-0.026)	0.027 (0.023-0.030)	0.030 (0.026-0.034)	0.034 (0.030-0.039)	0.040 (0.034-0.045)	0.045 (0.037-0.050)
10-day	0.007 (0.006-0.008)	0.009 (0.008-0.010)	0.012 (0.011-0.013)	0.014 (0.013-0.016)	0.018 (0.015-0.020)	0.020 (0.018-0.023)	0.023 (0.020-0.026)	0.026 (0.022-0.029)	0.030 (0.026-0.034)	0.033 (0.028-0.037)
20-day	0.004 (0.004-0.005)	0.006 (0.005-0.006)	0.007 (0.007-0.008)	0.009 (0.008-0.010)	0.011 (0.009-0.012)	0.012 (0.011-0.013)	0.013 (0.012-0.015)	0.015 (0.013-0.017)	0.017 (0.015-0.019)	0.018 (0.016-0.021)
30-day	0.003 (0.003-0.004)	0.004 (0.004-0.005)	0.006 (0.005-0.006)	0.007 (0.006-0.008)	0.008 (0.007-0.009)	0.009 (0.008-0.010)	0.010 (0.009-0.012)	0.012 (0.010-0.013)	0.013 (0.011-0.015)	0.014 (0.012-0.016)
45-day	0.003 (0.002-0.003)	0.003 (0.003-0.004)	0.004 (0.004-0.005)	0.005 (0.005-0.006)	0.006 (0.006-0.007)	0.007 (0.006-0.008)	0.008 (0.007-0.009)	0.009 (0.008-0.010)	0.010 (0.008-0.011)	0.011 (0.009-0.012)
60-day	0.002 (0.002-0.002)	0.003 (0.003-0.003)	0.004 (0.003-0.004)	0.004 (0.004-0.005)	0.005 (0.005-0.006)	0.006 (0.005-0.006)	0.006 (0.006-0.007)	0.007 (0.006-0.008)	0.008 (0.007-0.009)	0.008 (0.007-0.009)





¹ Precipitation frequency (PF) estimates in this table are based on frequency analysis of partial duration series (PDS). Numbers in parenthesis are PF estimates at lower and upper bounds of the 90% confidence interval. The probability that precipitation frequency estimates (for a given duration and average recurrence interval) will be greater than the upper bound (or less than the lower bound) is 5%. Estimates at upper bounds are not checked against probable maximum precipitation (PMP) estimates and may be higher than currently valid PMP values. Please refer to NOAA Atlas 14 document for more information.

[Back to Top](#)

PF graphical

PDS-based intensity-duration-frequency (IDF) curves


Latitude: 33.4877°, Longitude: -111.9298°

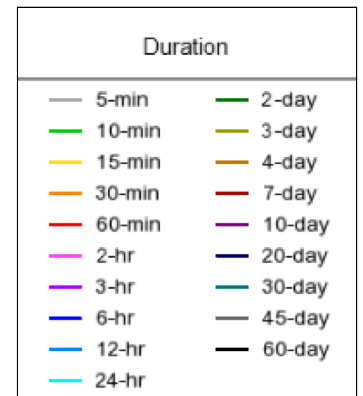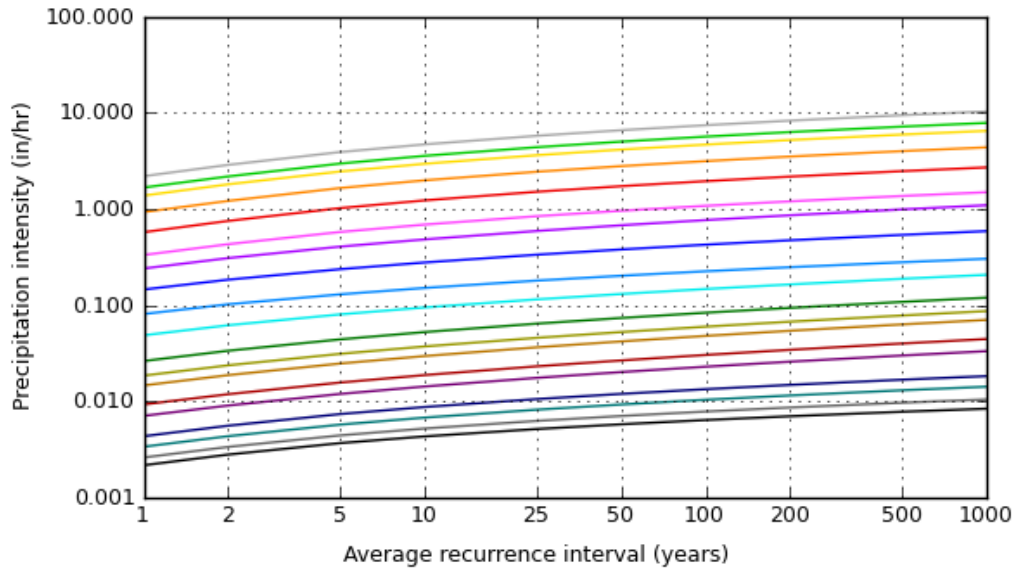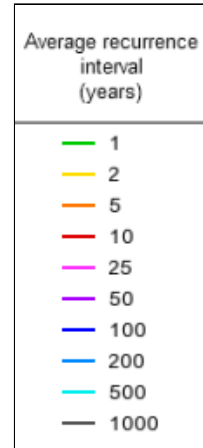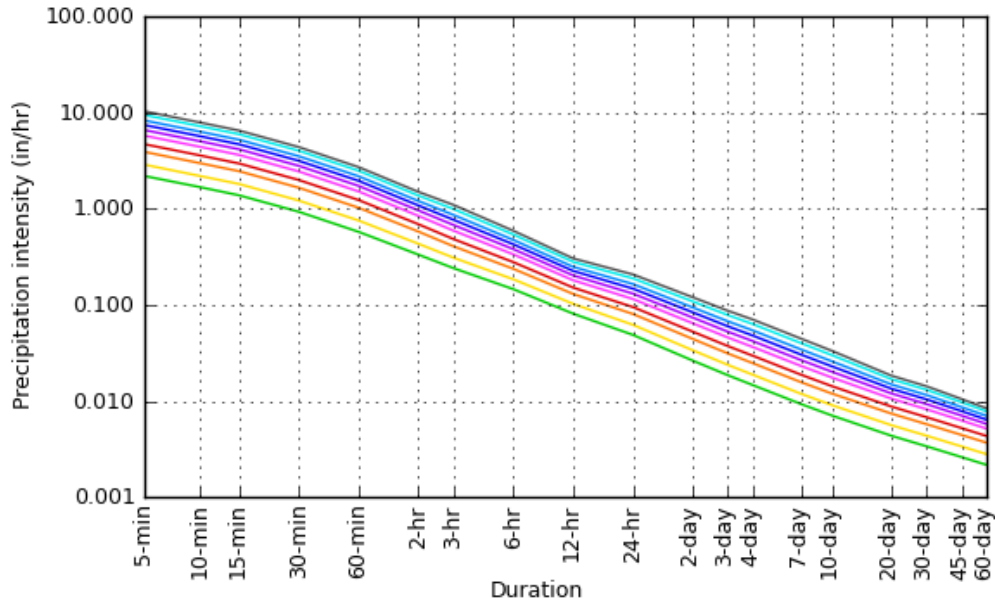

[Back to Top](#)

Maps & aerials

Small scale terrain

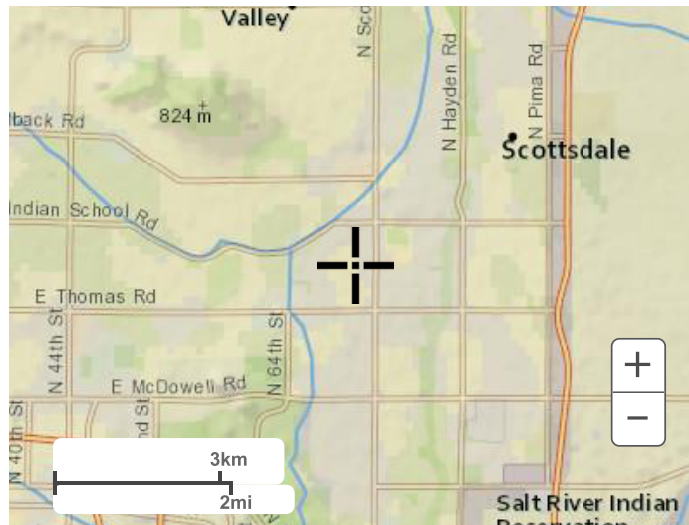

Large scale terrain



Large scale map



Large scale aerial



“LEED®ing and Developing Smart Projects”

APPENDIX II


CALCULATIONS

*8280 E. Gelding Dr., Suite 101
Scottsdale, AZ 85260*

MAGNOLIA AT OSBORN

EXISTING CONDITIONS C_{WT}

NEC OF 70TH STREET & OSBORN ROAD
 A PORTION OF THE NORTHEAST QUARTER OF SECTION 27, TOWNSHIP 2 NORTH, RANGE 4 EAST OF THE GILA AND SALT RIVER MERIDIAN, MARICOPA COUNTY, ARIZONA.

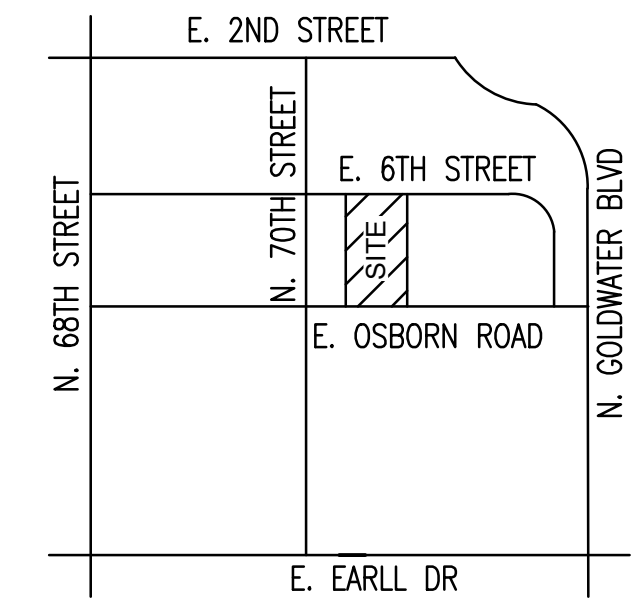


PRELIMINARY
 NOT FOR
 CONSTRUCTION

SUSTAINABILITY
 ENGINEERING
 GROUP



SEG



8280 E. GELDING DRIVE SUITE 101, SCOTTSDALE, ARIZONA 85260
 WWW.AZSEG.COM TEL. 480.988.7226 FAX. 480.259.3534

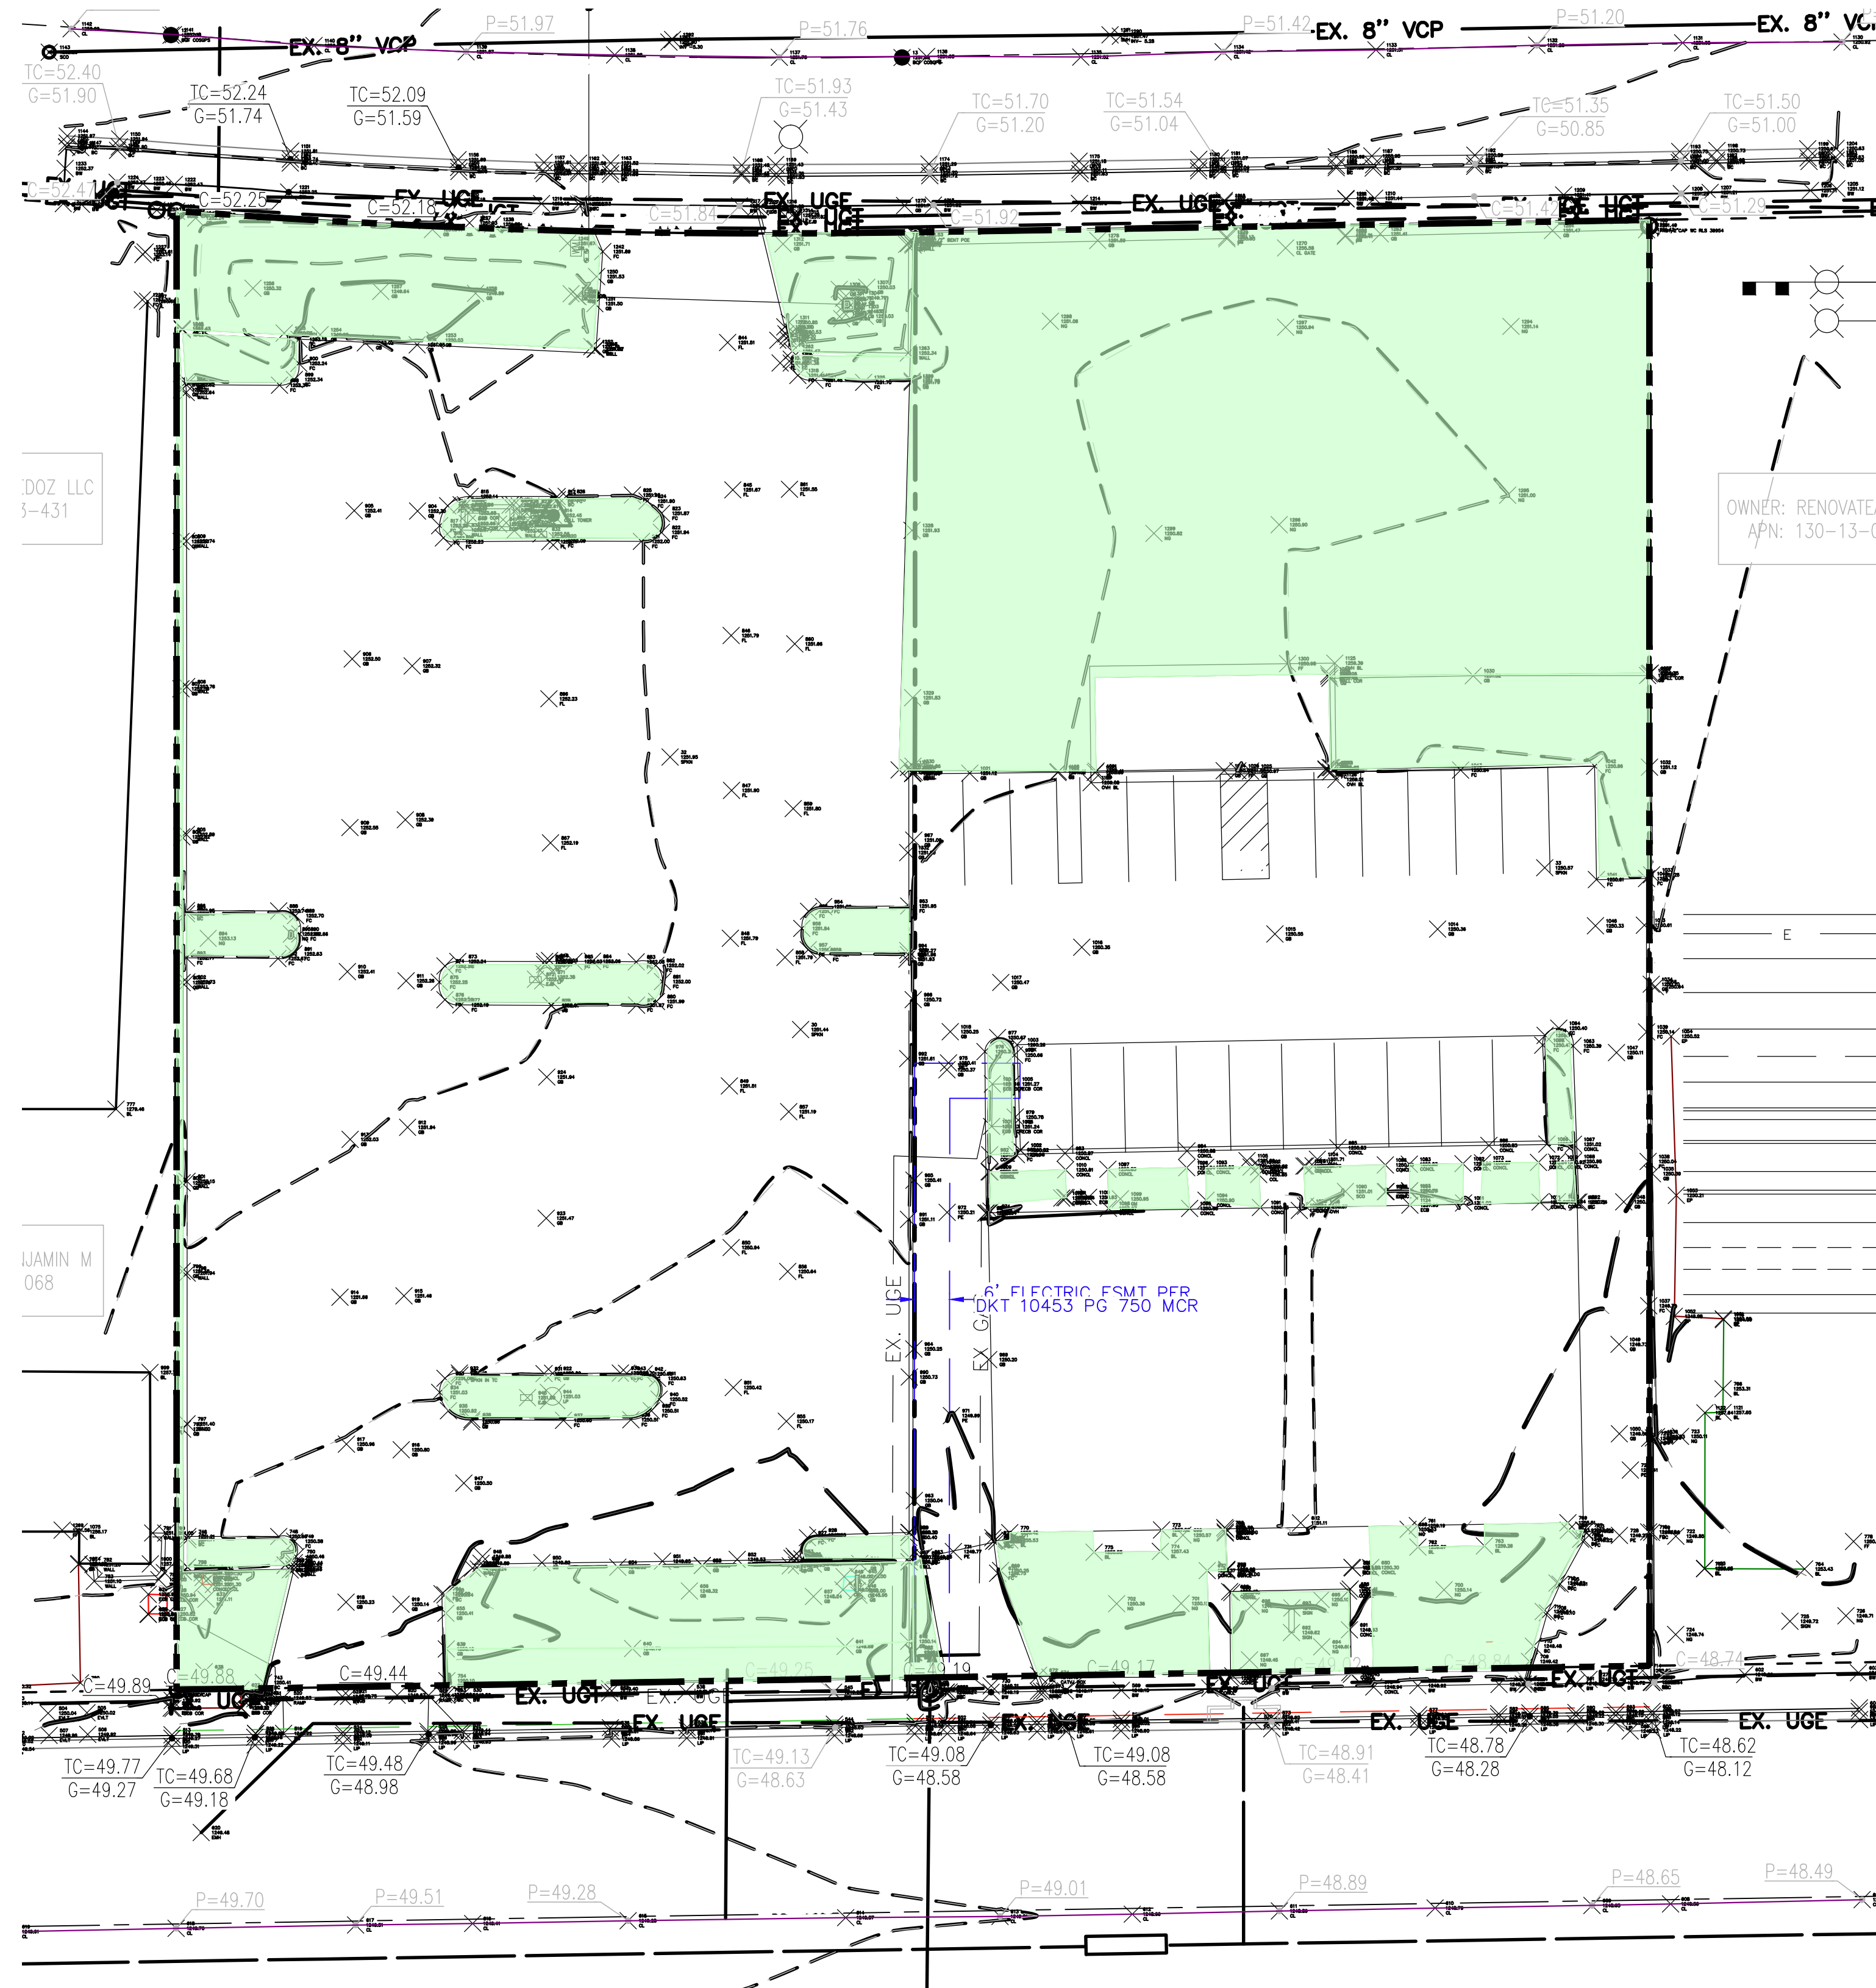

---	DISTURBED AREA		
□	ON-SITE		
□	PAVED SURFACE =	43,272 SF (0.99 AC)	@ CWT=0.95
■	NATURAL DESERT =	19,120 SF (0.44 AC)	@ CWT=0.45
	TOTAL =	62,392 SF (1.43 AC)	@ CWT=0.80

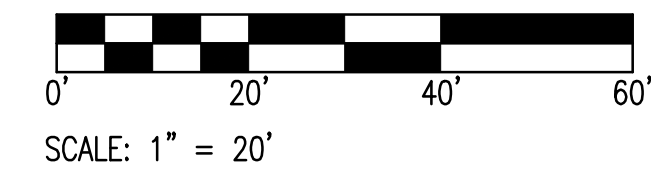

DOZ LLC
 5-431

IJAMIN M
 068

OWNER: RENOVATEA
 APN: 130-13-01

6" FIBRIFIC FSMT PER
 DKT 10453 PG 750 MCR

PROJECT: MAGNOLIA ON OSBORN
 LOCATION: NEC OF 70TH STREET AND OSBORN ROAD

DRAWN: JC 11/10/2022
 DESIGNED: JC 11/10/2022
 QC: SC 03/02/2022
 FINAL QC: SC
 PROJ. MGR: AF 11/10/2022

DATE: 11/10/2022

ISSUED FOR: REZONING

REVISION NO.: DATE:

JOB NO.: 220205

SHEET TITLE:

EXISTING
 CONDITIONS C_{WT}


PAGE NO.: 1 OF 1
 SHEET NO.: X-C_{WT}

THIS DRAWING IS AN INSTRUMENT OF SERVICE AND THE PROPERTY OF SUSTAINABILITY ENGINEERING GROUP, AND SHALL REMAIN THEIR PROPERTY. THE USE OF THIS DRAWING SHALL BE RESTRICTED TO THE ORIGINAL SITE FOR WHICH IT IS PREPARED AND PUBLICATION THEREOF IS EXPRESSLY LIMITED TO SUCH USE.

MAGNOLIA AT OSBORN

PROPOSED CONDITIONS Cwt

NEC OF 70TH STREET & OSBORN ROAD
 A PORTION OF THE NORTHEAST QUARTER OF SECTION 27, TOWNSHIP 2 NORTH, RANGE 4 EAST OF THE GILA AND SALT RIVER MERIDIAN, MARICOPA COUNTY, ARIZONA.

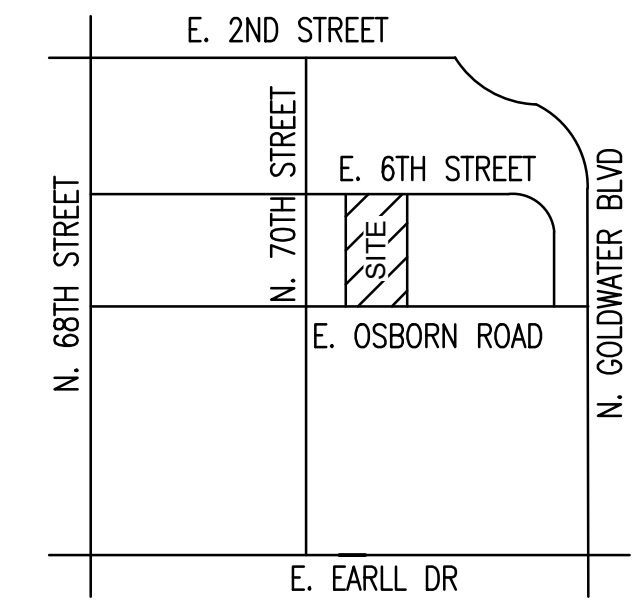

PRELIMINARY
 NOT FOR
 CONSTRUCTION



SUSTAINABILITY
 ENGINEERING
 GROUP

SEG





8280 E. GELDING DRIVE SUITE 101, SCOTTSDALE, ARIZONA 85260
 WWW.AZSEG.COM TEL. 480.586.7226 FAX. 480.259.3534

Magnolia
 PROPERTY COMPANY

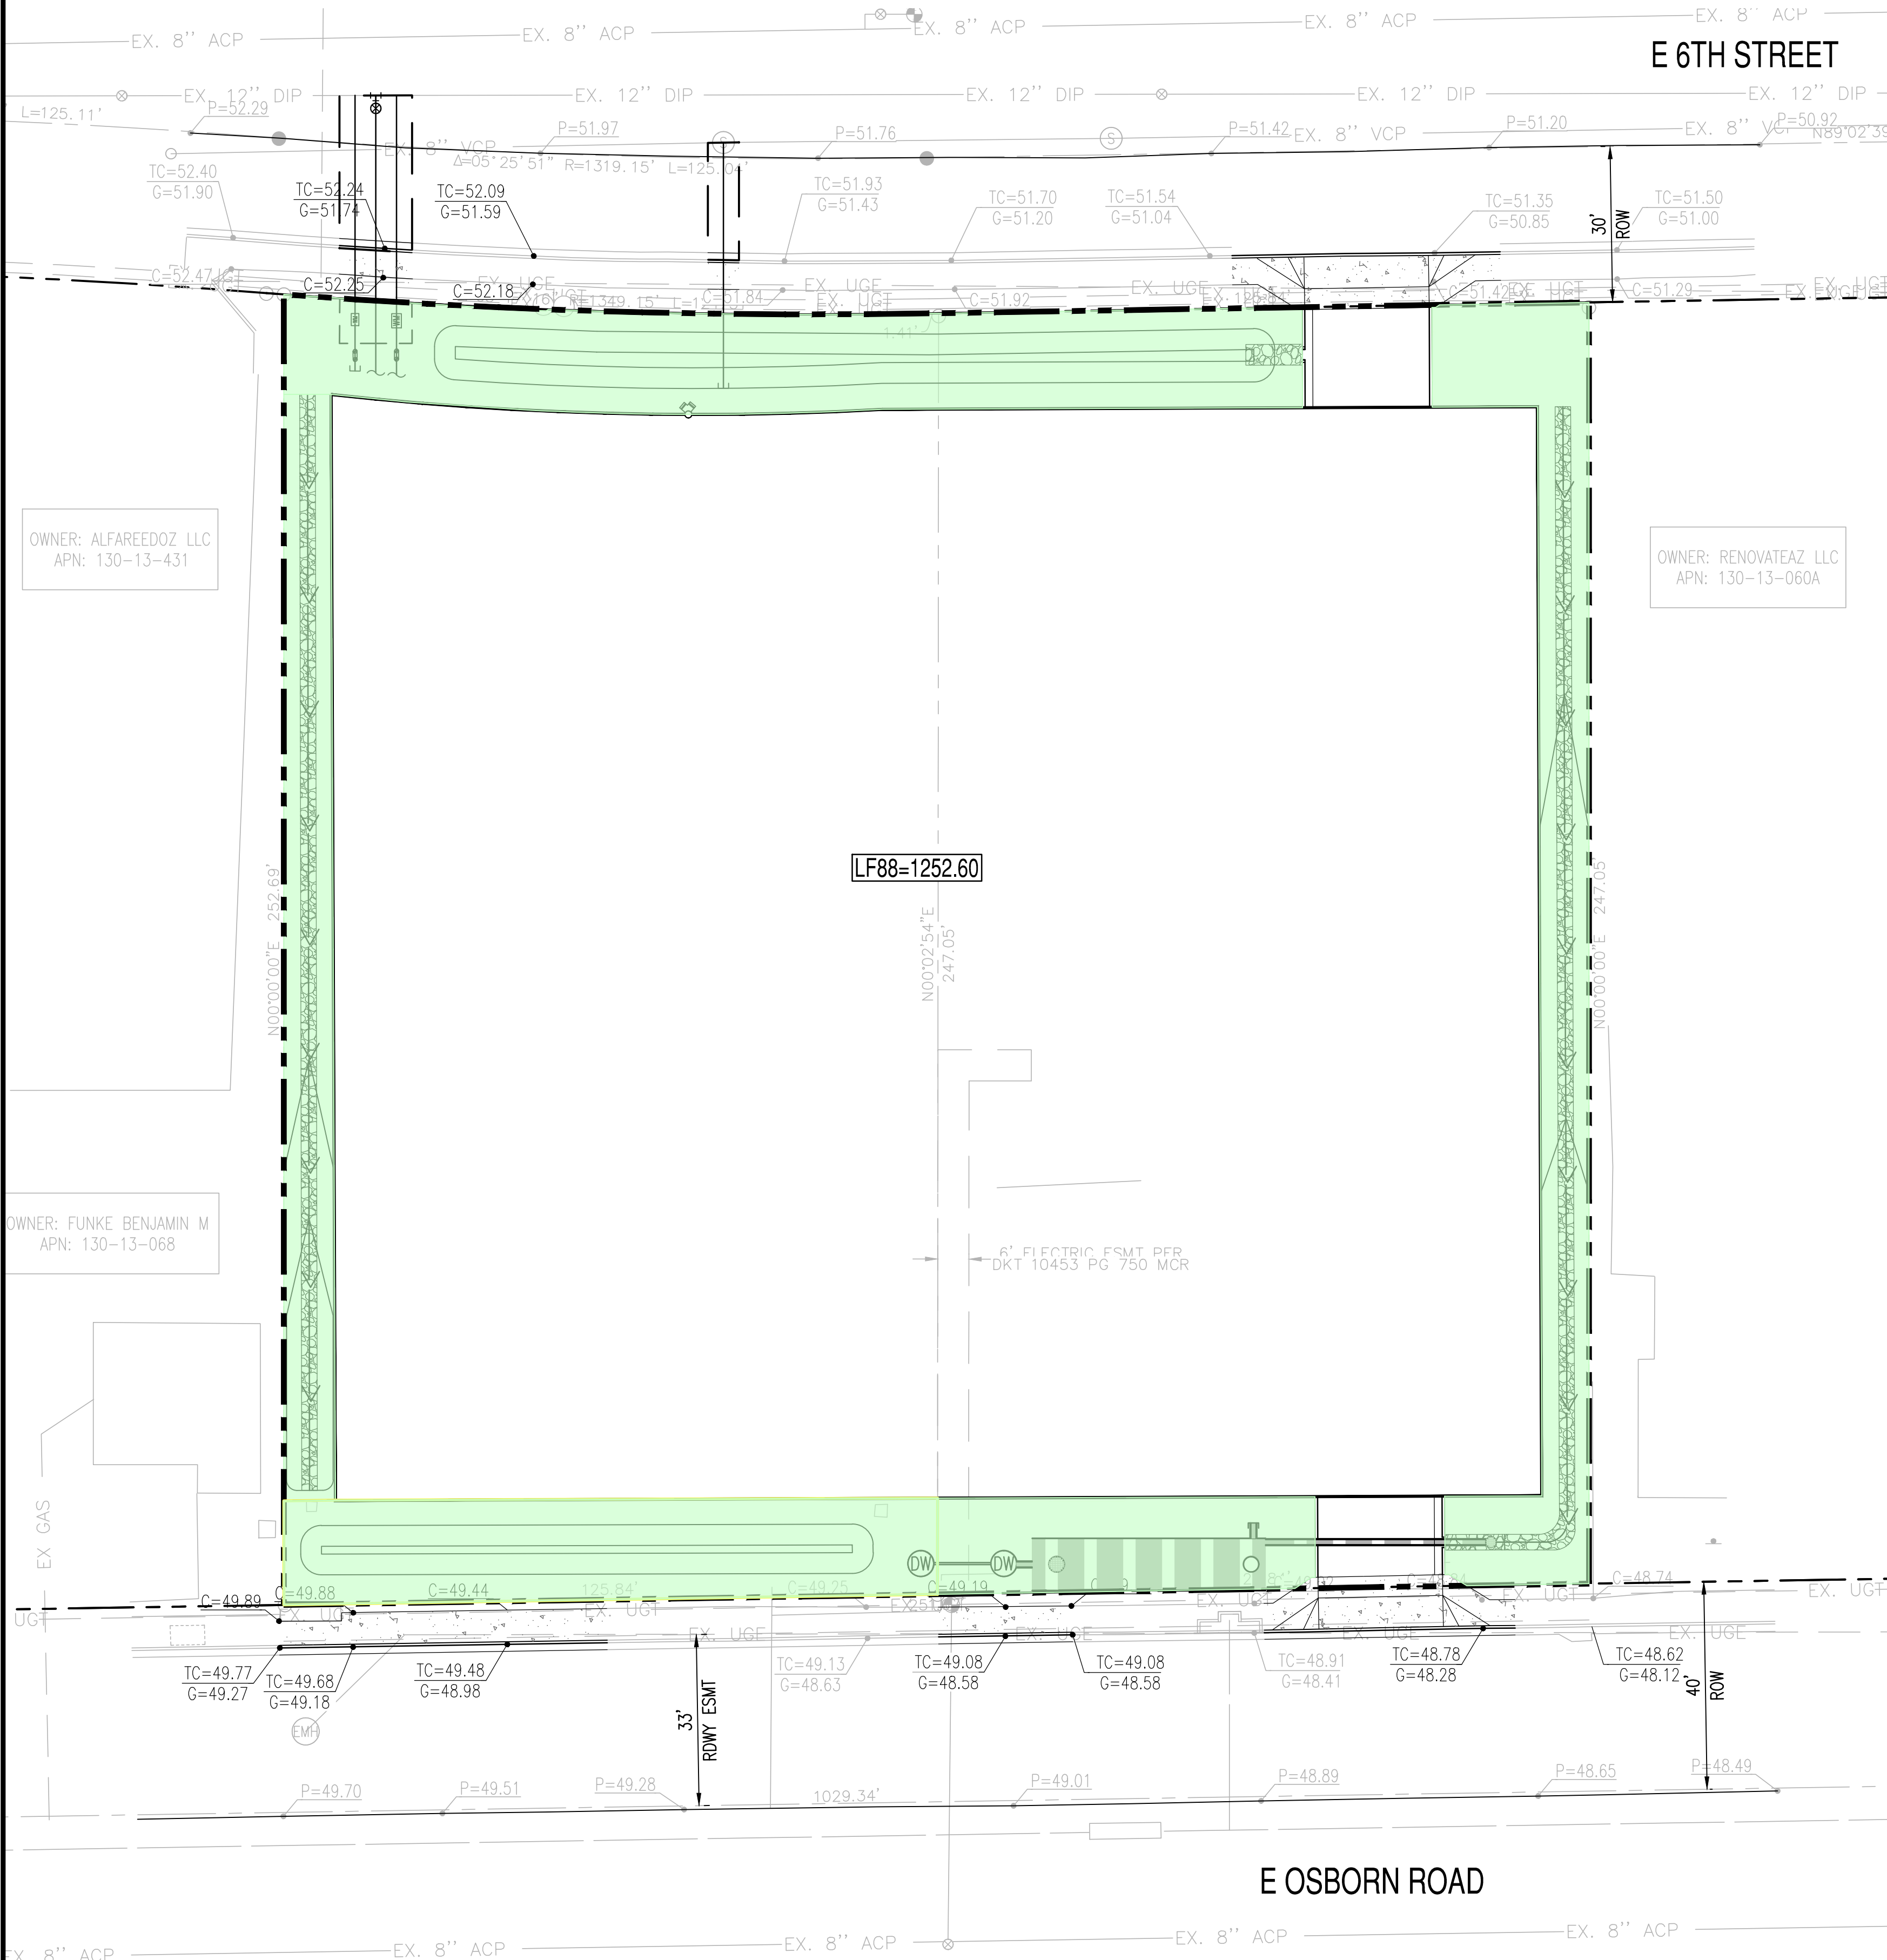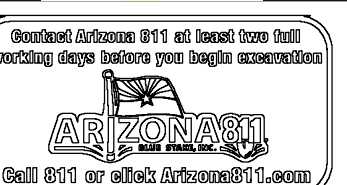

---	DISTURBED AREA		
---	ON-SITE		
▭	PAVED SURFACE =	49,796 SF (1.14 AC) @ CWT=0.95	
▭	NATURAL DESERT =	12,596 SF (0.29 AC) @ CWT=0.45	
	TOTAL =	62,392 SF (1.43 AC) @ CWT=0.85	

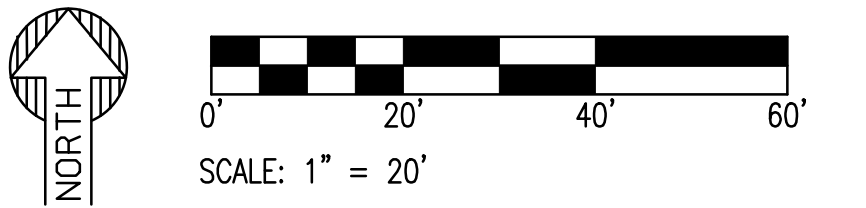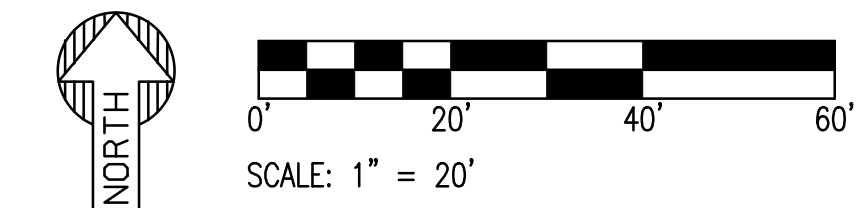

OWNER: ALFAREEDOZ LLC
 APN: 130-13-431

OWNER: RENOVATEAZ LLC
 APN: 130-13-060A

OWNER: FUNKE BENJAMIN M
 APN: 130-13-068

LF88=1252.60

6" ELECTRIC FSMT PFR
 DKT 10453 PG 750 MCR

PROJECT: MAGNOLIA ON OSBORN
 LOCATION: NEC OF 70TH STREET AND OSBORN ROAD

DRAWN: JC 11/10/2022
 DESIGNED: JC 11/10/2022
 QC: SC 03/02/2022
 FINAL QC:
 PROJ. MGR: AF 11/10/2022

DATE: 11/10/2022
 ISSUED FOR: REZONING

REVISION NO.:	DATE:

JOB NO.: 220205

SHEET TITLE:
**PROPOSED
 CONDITIONS
 Cwt**


PAGE NO.: 1 OF 1
 SHEET NO.: P-Cwt

THIS DRAWING IS AN INSTRUMENT OF SERVICE AND THE PROPERTY OF SUSTAINABILITY ENGINEERING GROUP, AND SHALL REMAIN THEIR PROPERTY. THE USE OF THIS DRAWING SHALL BE RESTRICTED TO THE ORIGINAL SITE FOR WHICH IT IS PREPARED AND PUBLICATION THEREOF IS EXPRESSLY LIMITED TO SUCH USE.

MAGNOLIA AT OSBORN

EXISTING CONDITIONS DRAINAGE AREA MAP

NEC OF 70TH STREET & OSBORN ROAD
 A PORTION OF THE NORTHEAST QUARTER OF SECTION 27, TOWNSHIP 2 NORTH, RANGE 4 EAST OF THE GILA AND SALT RIVER MERIDIAN, MARICOPA COUNTY, ARIZONA.

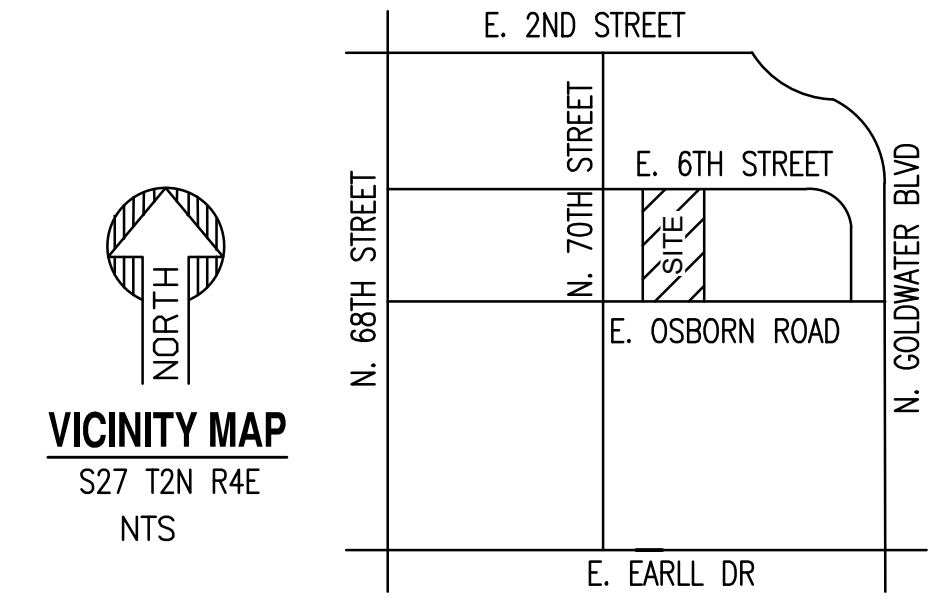

PRELIMINARY
NOT FOR
CONSTRUCTION

SUSTAINABILITY
ENGINEERING
GROUP

SEG



PROJECT: MAGNOLIA ON OSBORN
 LOCATION: NEC OF 70TH STREET AND OSBORN ROAD



DATE: 11/10/2022
 ISSUED FOR: REZONING

REVISION NO.: DATE:

JOB NO.: 220205

SHEET TITLE: EXISTING CONDITIONS DRAINAGE AREA MAP

PAGE NO.: 1 OF 1
 SHEET NO.: X-DAM

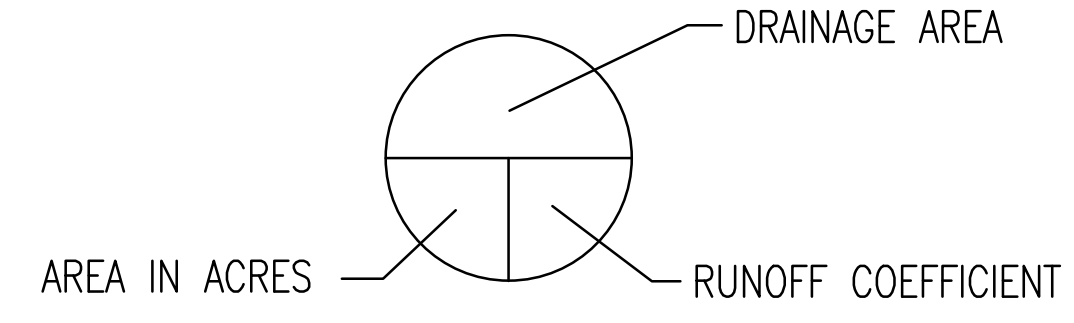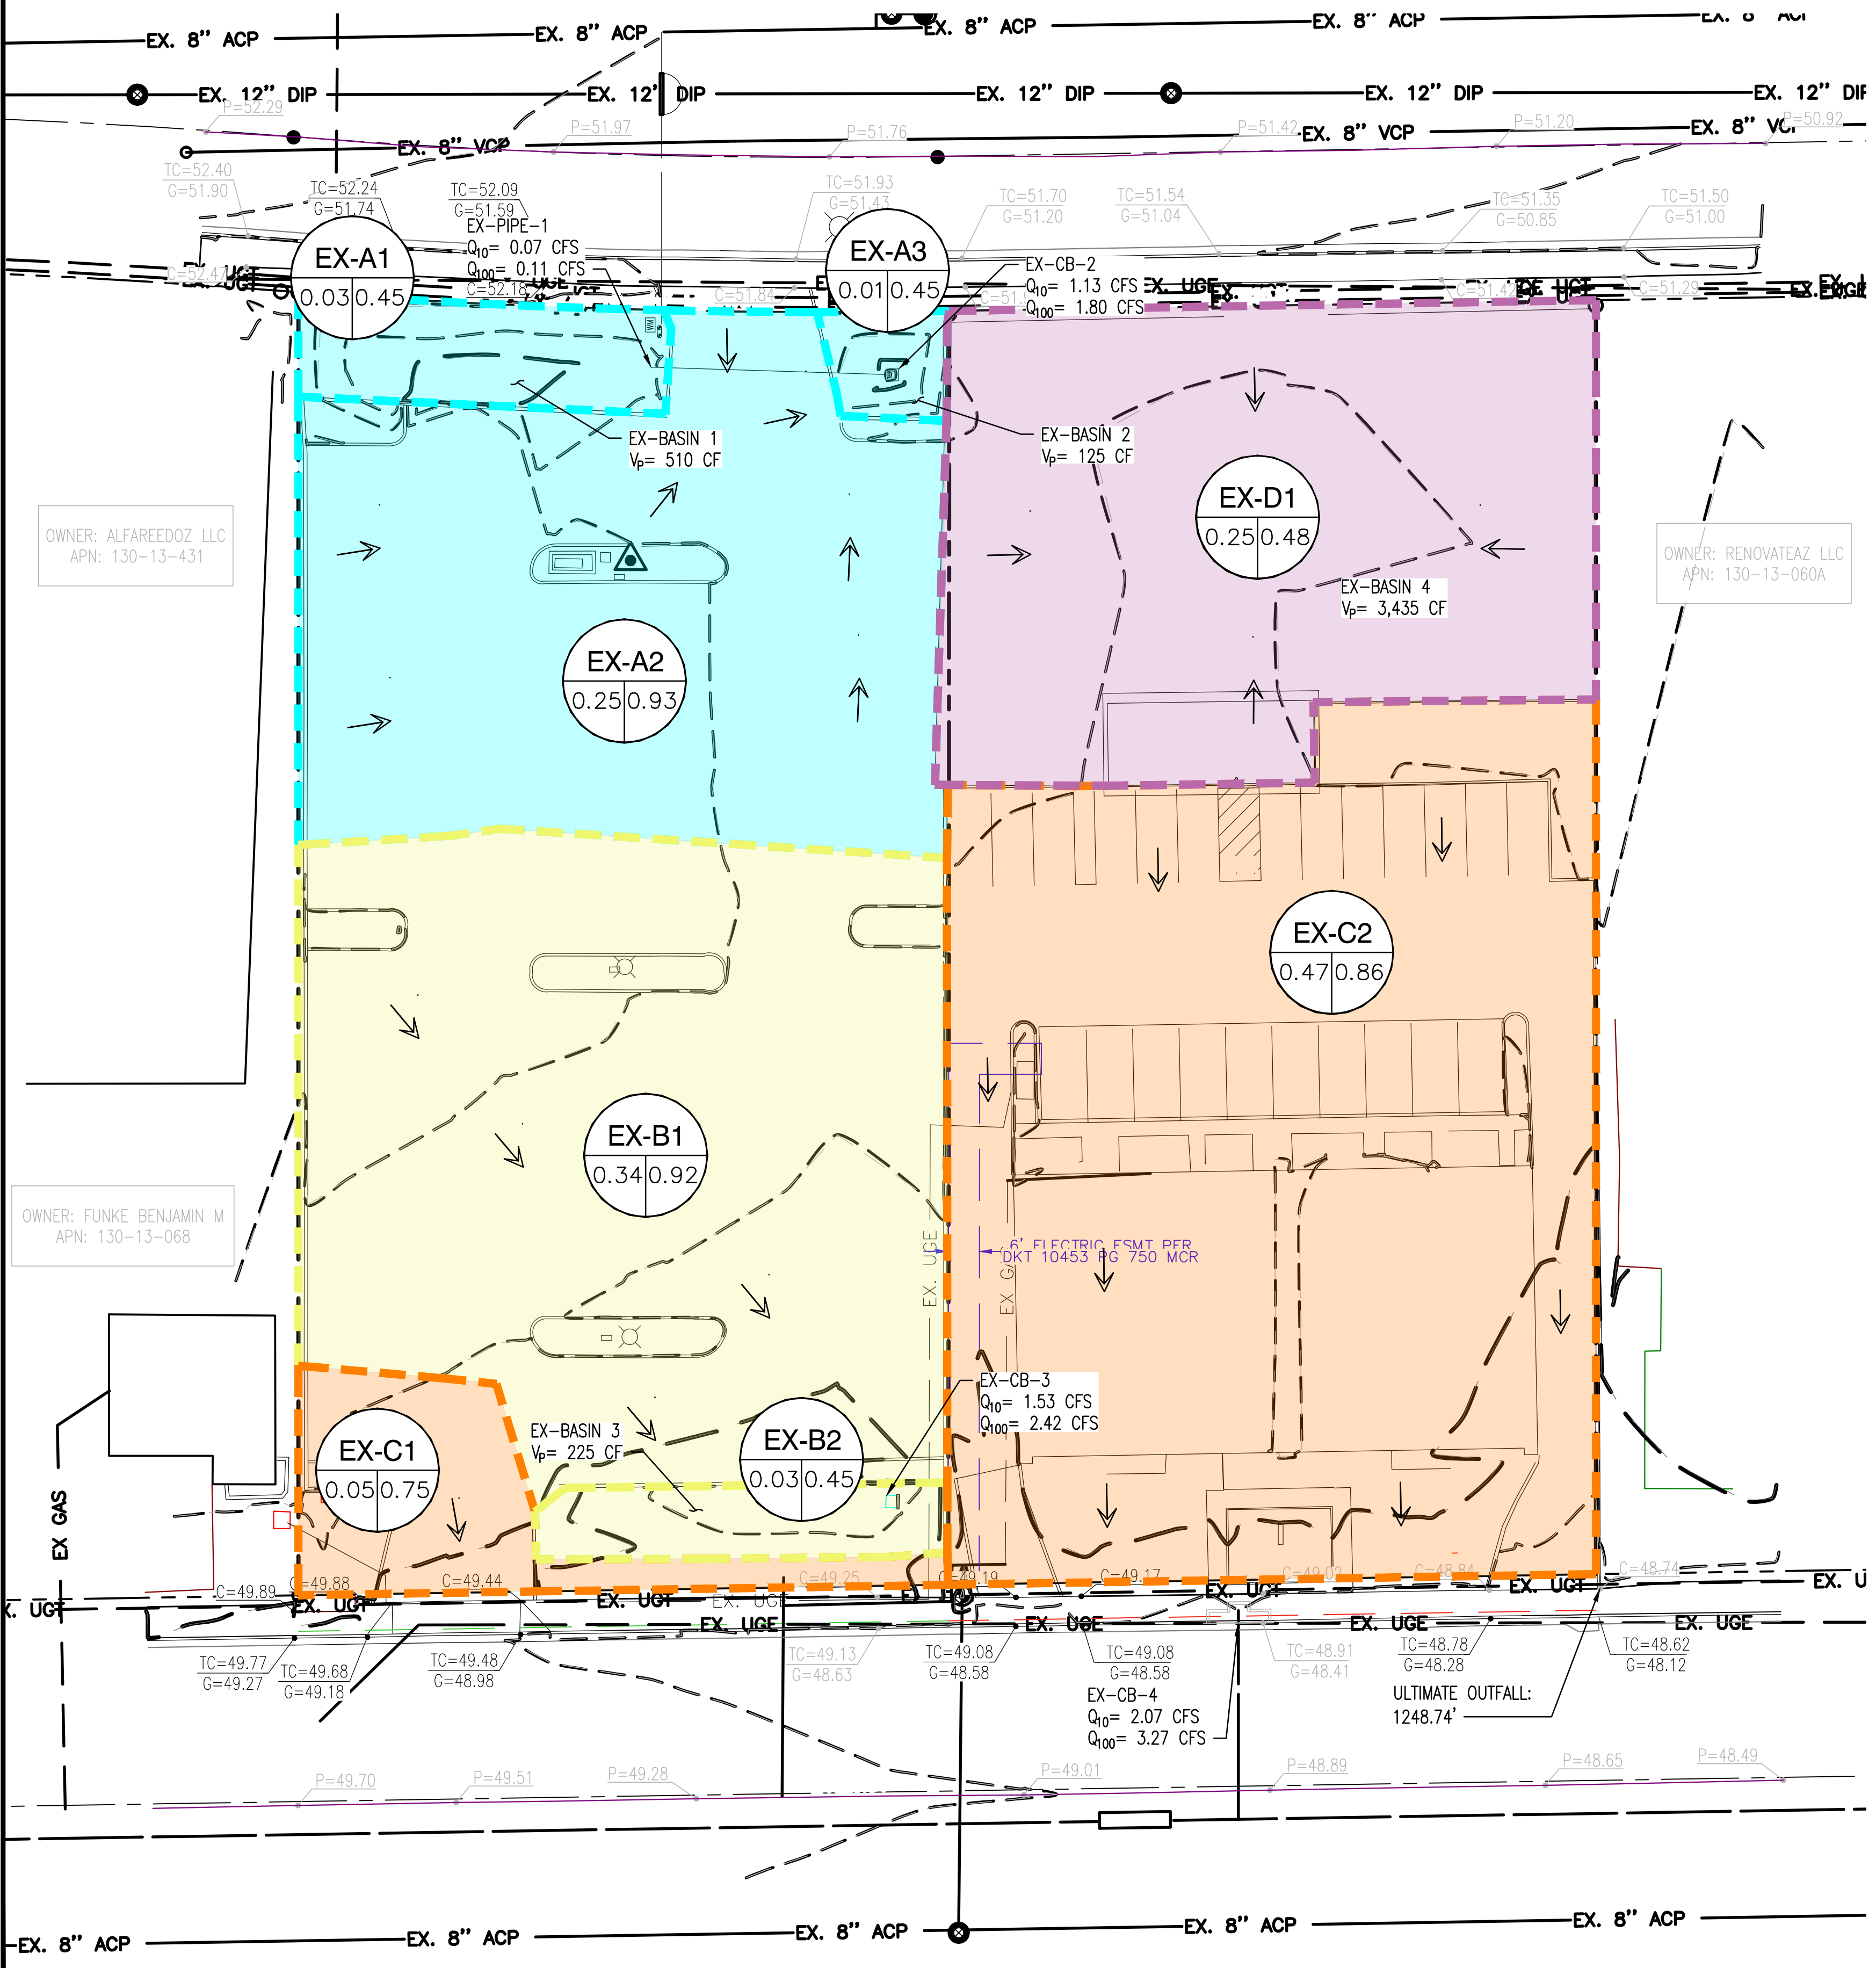


DRAINAGE AREA KEY

EXISTING LEGEND

- DRAINAGE AREAS DISCHARGING TO PUBLIC SYSTEM ON EX-CB-2.
- DRAINAGE AREAS DISCHARGING TO PUBLIC SYSTEM ON OSBORN ROAD.
- DRAINAGE AREAS DISCHARGING TO OSBORN ROAD.
- SELF-RETAINING DRAINAGE AREA.
- FLOW ARROW

EXISTING SITE DISCHARGES								
	TOTAL AREA	Cwt	Intensity 10 yr 5-min	Intensity 100 yr 5-min	Intensity 100 yr 10-min	Control Point	Total flows Q10	Total flows Q100
	(ac)	(-)	(in/hr)	(in/hr)	(cfs)	CP#	(cfs)	(cfs)
	1.43		4.70	7.44	-	-	4.80	7.60
EX-A1	0.03	0.45	4.70	0.07	7.44	EX-Pipe-1	0.07	0.11
EX-A2	0.25	0.93	4.70	1.11	7.44	EX-CB-1	1.13	1.80
EX-A3	0.01	0.45	4.70	0.02	7.44	EX-CB-1	1.13	1.80
EX-B1	0.34	0.92	4.70	1.47	7.44	EX-CB-2	1.53	2.42
EX-B2	0.03	0.45	4.70	0.05	7.44	EX-CB-2	1.53	2.42
EX-C1	0.05	0.75	4.70	0.19	7.44	EX-CB-3	2.07	3.27
EX-C2	0.47	0.86	4.70	1.88	7.44	EX-CB-3	2.07	3.27
EX-D1	0.25	0.48	4.70	0.56	7.44	N/A	N/A	N/A

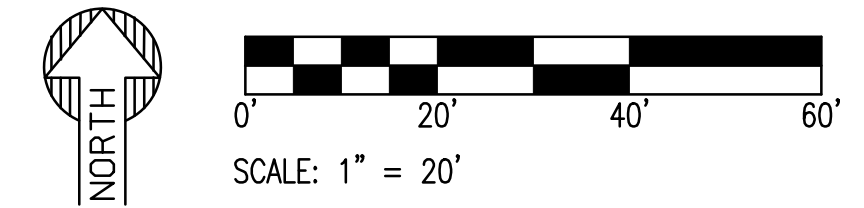


THIS DRAWING IS AN INSTRUMENT OF SERVICE AND THE PROPERTY OF SUSTAINABILITY ENGINEERING GROUP, AND SHALL REMAIN THEIR PROPERTY. THE USE OF THIS DRAWING SHALL BE RESTRICTED TO THE ORIGINAL SITE FOR WHICH IT IS PREPARED AND PUBLICATION THEREOF IS EXPRESSLY LIMITED TO SUCH USE.

MAGNOLIA AT OSBORN

EXISTING CONDITIONS DRAINAGE AREA MAP

NEC OF 70TH STREET & OSBORN ROAD
 A PORTION OF THE NORTHEAST QUARTER OF SECTION 27, TOWNSHIP 2 NORTH, RANGE 4 EAST OF THE GILA AND SALT RIVER MERIDIAN, MARICOPA COUNTY, ARIZONA.

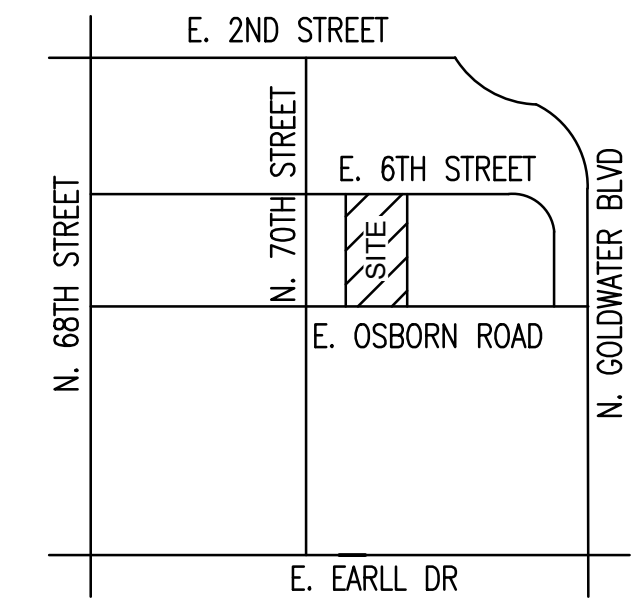


PRELIMINARY
NOT FOR
CONSTRUCTION

SUSTAINABILITY
ENGINEERING
GROUP

SEG



Magnolia
PROPERTY COMPANY

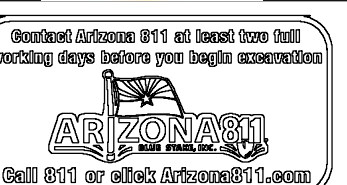

PROJECT: MAGNOLIA ON OSBORN
 LOCATION: NEC OF 70TH STREET AND OSBORN ROAD

DRAWN: JC 11/10/2022
 DESIGNED: JC 11/10/2022
 QC: SC 03/02/2022
 FINAL QC: SC 03/02/2022
 PROJ. MGR: AF 11/10/2022
 DATE: 11/10/2022



ISSUED FOR: REZONING

REVISION NO.: DATE:

JOB NO.: 220205

SHEET TITLE: PROPOSED CONDITIONS DRAINAGE AREA MAP

PAGE NO.: 1 OF 1 SHEET NO.: P-DAM

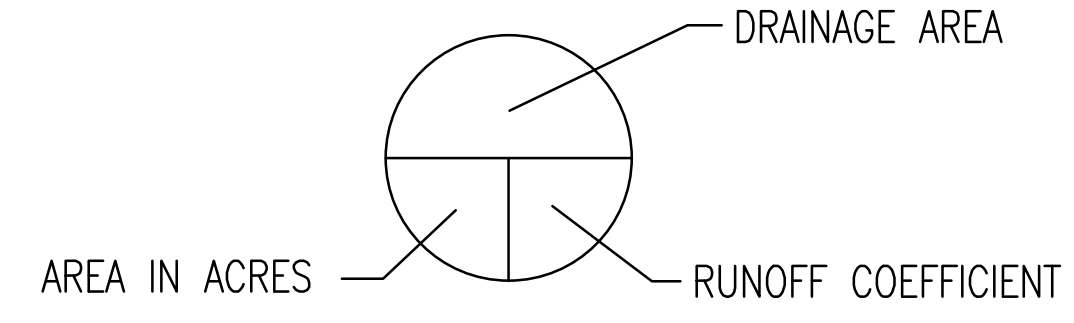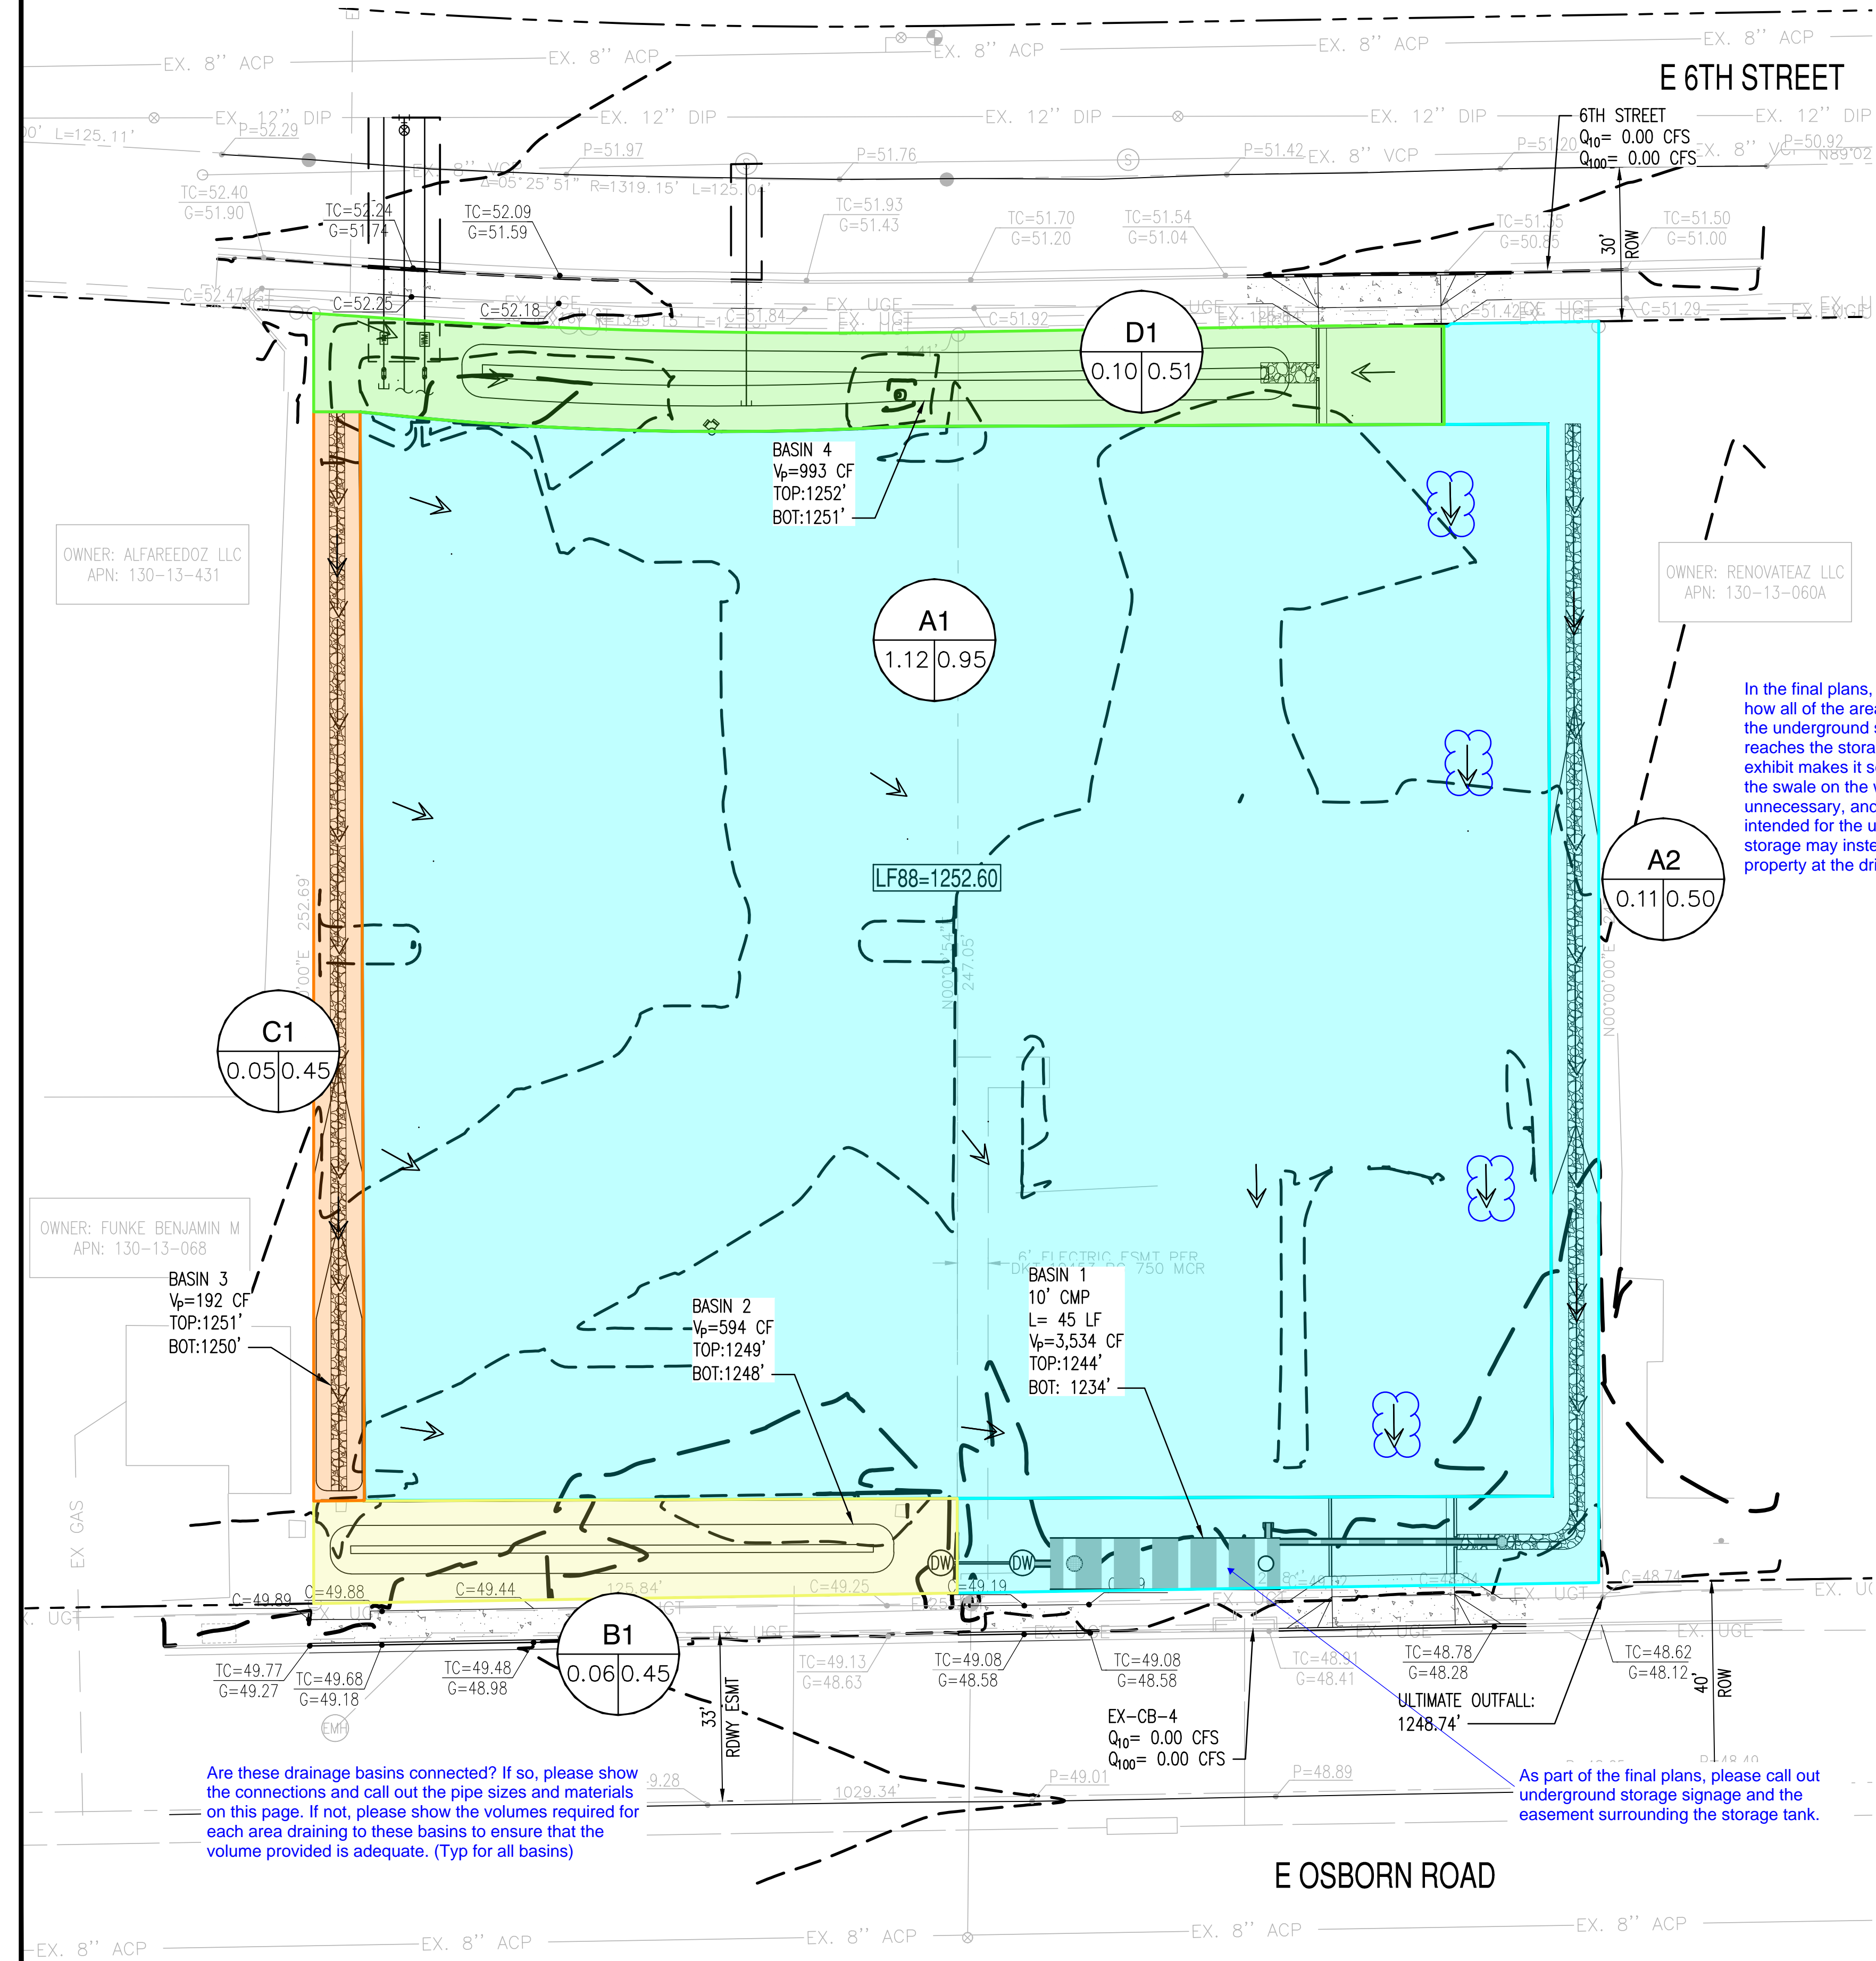

DRAINAGE AREA KEY

PROPOSED LEGEND


- DRAINAGE AREAS DISCHARGING TO BASIN 1
- DRAINAGE AREAS DISCHARGING TO BASIN 2
- DRAINAGE AREAS DISCHARGING TO BASIN 3 AND 4
- DRAINAGE AREAS DISCHARGING TO 6TH STREET *Remove if unused.*
- DRAINAGE AREAS DISCHARGING TO BASIN 5
- FLOW ARROW

Basin (ID)	TYPE (-)	Vp (CF)	Vptotal (CF)	Vr (CF)
Basin 1	UG	3,534	5,313	4,855
Basin 2	OPEN	594		
Basin 3	OPEN	192		
Basin 4	OPEN	993		
Total:			5,313	4,855

TOTAL AREA (ac)	Cwt (-)	Intensity 10 yr 5-min (in/hr)	Intensity Q 10 (cfs)	Intensity 100 yr 5-min (in/hr)	Intensity Q 100 (cfs)	Control Point CP#	Total flows Q10 (cfs)	Total flows Q100 (cfs)	
#REF!	-	4.70	-	7.44	-	-	5.27	8.34	
DA-A1	1.12	0.95	4.70	5.01	7.44	7.93	N/A	5.01	7.93
DA-A2	0.11	0.50	4.70	0.26	7.44	0.41	R-1	0.26	0.41
DA-B1	0.06	0.45	4.70	0.12	7.44	0.19	N/A	0.12	0.19
DA-C1	0.05	0.45	4.70	0.10	7.44	0.16	N/A	0.10	0.16
DA-D1	0.10	0.51	4.70	0.23	7.44	0.37	Basin B	0.23	0.37

Are these drainage basins connected? If so, please show the connections and call out the pipe sizes and materials on this page. If not, please show the volumes required for each area draining to these basins to ensure that the volume provided is adequate. (Typ for all basins)

As part of the final plans, please call out underground storage signage and the easement surrounding the storage tank.

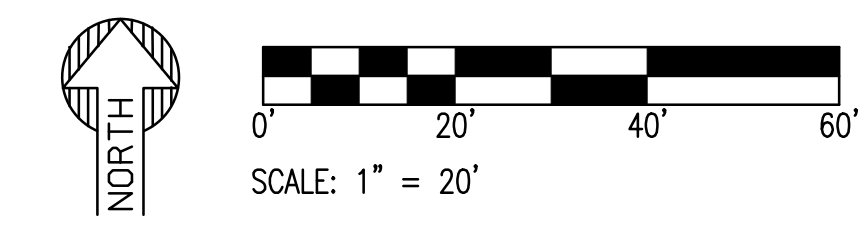

THIS DRAWING IS AN INSTRUMENT OF SERVICE AND THE PROPERTY OF SUSTAINABILITY ENGINEERING GROUP, AND SHALL REMAIN THEIR PROPERTY. THE USE OF THIS DRAWING SHALL BE RESTRICTED TO THE ORIGINAL SITE FOR WHICH IT IS PREPARED AND PUBLICATION THEREOF IS EXPRESSLY LIMITED TO SUCH USE.

EXISTING OVERALL SITE C_w

	Pavement	DESERT LANDSCAPE	TOTAL AREA	Cwt
C-VALUE	0.95	0.45		
AREA (ac)	0.99	0.44	1.43	0.80
EX-A1	0.00	0.03	0.03	0.45
EX-A2	0.24	0.01	0.25	0.93
EX-A3	0.00	0.01	0.01	0.45
EX-B1	0.32	0.02	0.34	0.92
EX-B2	0.00	0.03	0.03	0.45
EX-C1	0.03	0.02	0.05	0.75
EX-C2	0.39	0.08	0.47	0.86
EX-D1	0.01	0.24	0.25	0.48

PROPOSED OVERALL SITE C_w

	Building/ Pavement	DESERT LANDSCAPE	TOTAL AREA	Cwt
C-VALUE	0.95	0.45		
AREA (ac)	1.14	0.29	1.43	0.85
DA-A1	1.12	0.00	1.12	0.95
DA-A2	0.01	0.10	0.11	0.50
DA-B1	0.00	0.06	0.06	0.45
DA-C1	0.00	0.05	0.05	0.45
DA-D1	0.01	0.09	0.10	0.51

EX BASIN 1					
ELEV.	AREA	DEPTH	AVG VOLUME	SUM VOLUME	COMMENT
(FT)	(SF)	(FT)	(CF)	(CF)	
1250.0	234			0.00	Bottom
		1.00	510.15		
1251.0	786			510.15	Volume Provided

EX BASIN 2					
ELEV.	AREA	DEPTH	AVG VOLUME	SUM VOLUME	COMMENT
(FT)	(SF)	(FT)	(CF)	(CF)	
1250.0	28			0.00	Bottom
		1.00	124.67		
1251.0	221			124.67	Volume Provided

EX BASIN 3					
ELEV.	AREA	DEPTH	AVG VOLUME	SUM VOLUME	COMMENT
(FT)	(SF)	(FT)	(CF)	(CF)	
1248.0	40			0.00	Bottom
		1.00	224.98		
1249.0	410			224.98	

EX BASIN 4					
ELEV.	AREA	DEPTH	AVG VOLUME	SUM VOLUME	COMMENT
(FT)	(SF)	(FT)	(CF)	(CF)	
1251.0	2,851			0.00	Bottom
		0.50	3,434.94		
1251.5	10,889			3,434.94	

6th Street Gutter

Project Description	
Solve For	Spread
Input Data	
Channel Slope	0.00380 ft/ft
Discharge	18.85 cfs
Gutter Width	1.5 ft
Gutter Cross Slope	0.05800 ft/ft
Road Cross Slope	0.01700 ft/ft
Roughness Coefficient	0.013
Results	
Spread	26.5 ft
Flow Area	6.0 ft ²
Depth	6.1 in
Gutter Depression	0.7 in
Velocity	3.14 ft/s

APPENDIX III

PRELIMINARY GRADING & DRIANAGE PLAN

MAGNOLIA AT OSBORN


PRELIMINARY GRADING & DRAINAGE PLAN

NEC OF 70TH STREET & OSBORN ROAD
 A PORTION OF THE NORTHEAST QUARTER OF SECTION 27, TOWNSHIP 2 NORTH, RANGE 4 EAST OF THE GILA AND SALT RIVER MERIDIAN, MARICOPA COUNTY, ARIZONA.

CIVIL ENGINEER
 SUSTAINABILITY ENGINEERING GROUP
 8280 E. GELDING DR., SUITE 101
 SCOTTSDALE, ARIZONA 85260
 PHONE: 480-588-7226
 ATTN: ALI FAKIH
 EMAIL: ALI@AZSEG.COM

CLIENT:
 MAGNOLIA PROPERTY COMPANY
 2435 E. SOUTHLAKE BLVD., SUITE 150
 SOUTHLAKE, TEXAS 76092

SURVEYOR
 A.W. LAND SURVEYING, LLC
 P.O. BOX 2170
 CHANDLER, ARIZONA 85244
 PHONE: 480-244-7630
 ATTN: DANIEL ARMIJO

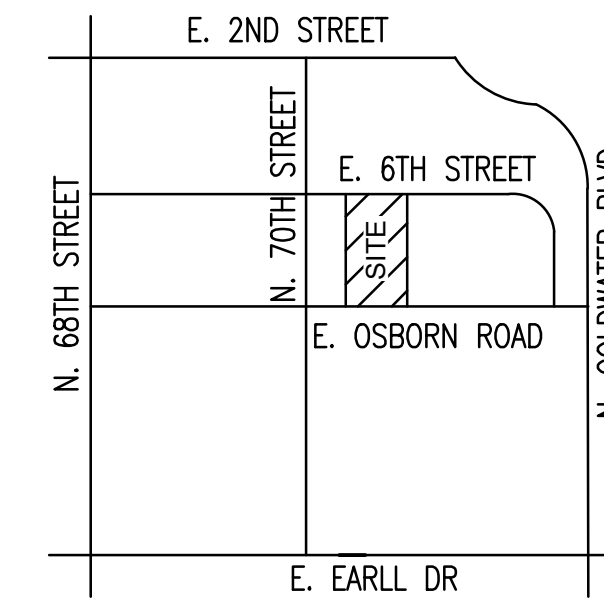

PRELIMINARY
 NOT FOR
 CONSTRUCTION

SUSTAINABILITY
 ENGINEERING
 GROUP


SEG



Magnolia
 PROPERTY COMPANY



PROJECT	MAGNOLIA ON OSBORN
LOCATION	NEC OF 70 TH STREET AND OSBORN ROAD
DRAWN	JC 11/10/2022
DESIGNED	JC 11/10/2022
QC	SC 03/02/2022
FINAL QC	
PROJ. MGR.	AF 11/10/2022
DATE:	11/10/2022
ISSUED FOR:	REZONING
REVISION NO.:	DATE:
JOB NO.:	220205
SHEET TITLE:	PRELIMINARY GRADING & DRAINAGE PLAN
PAGE NO.:	1 OF 3
SHEET NO.:	C3.10

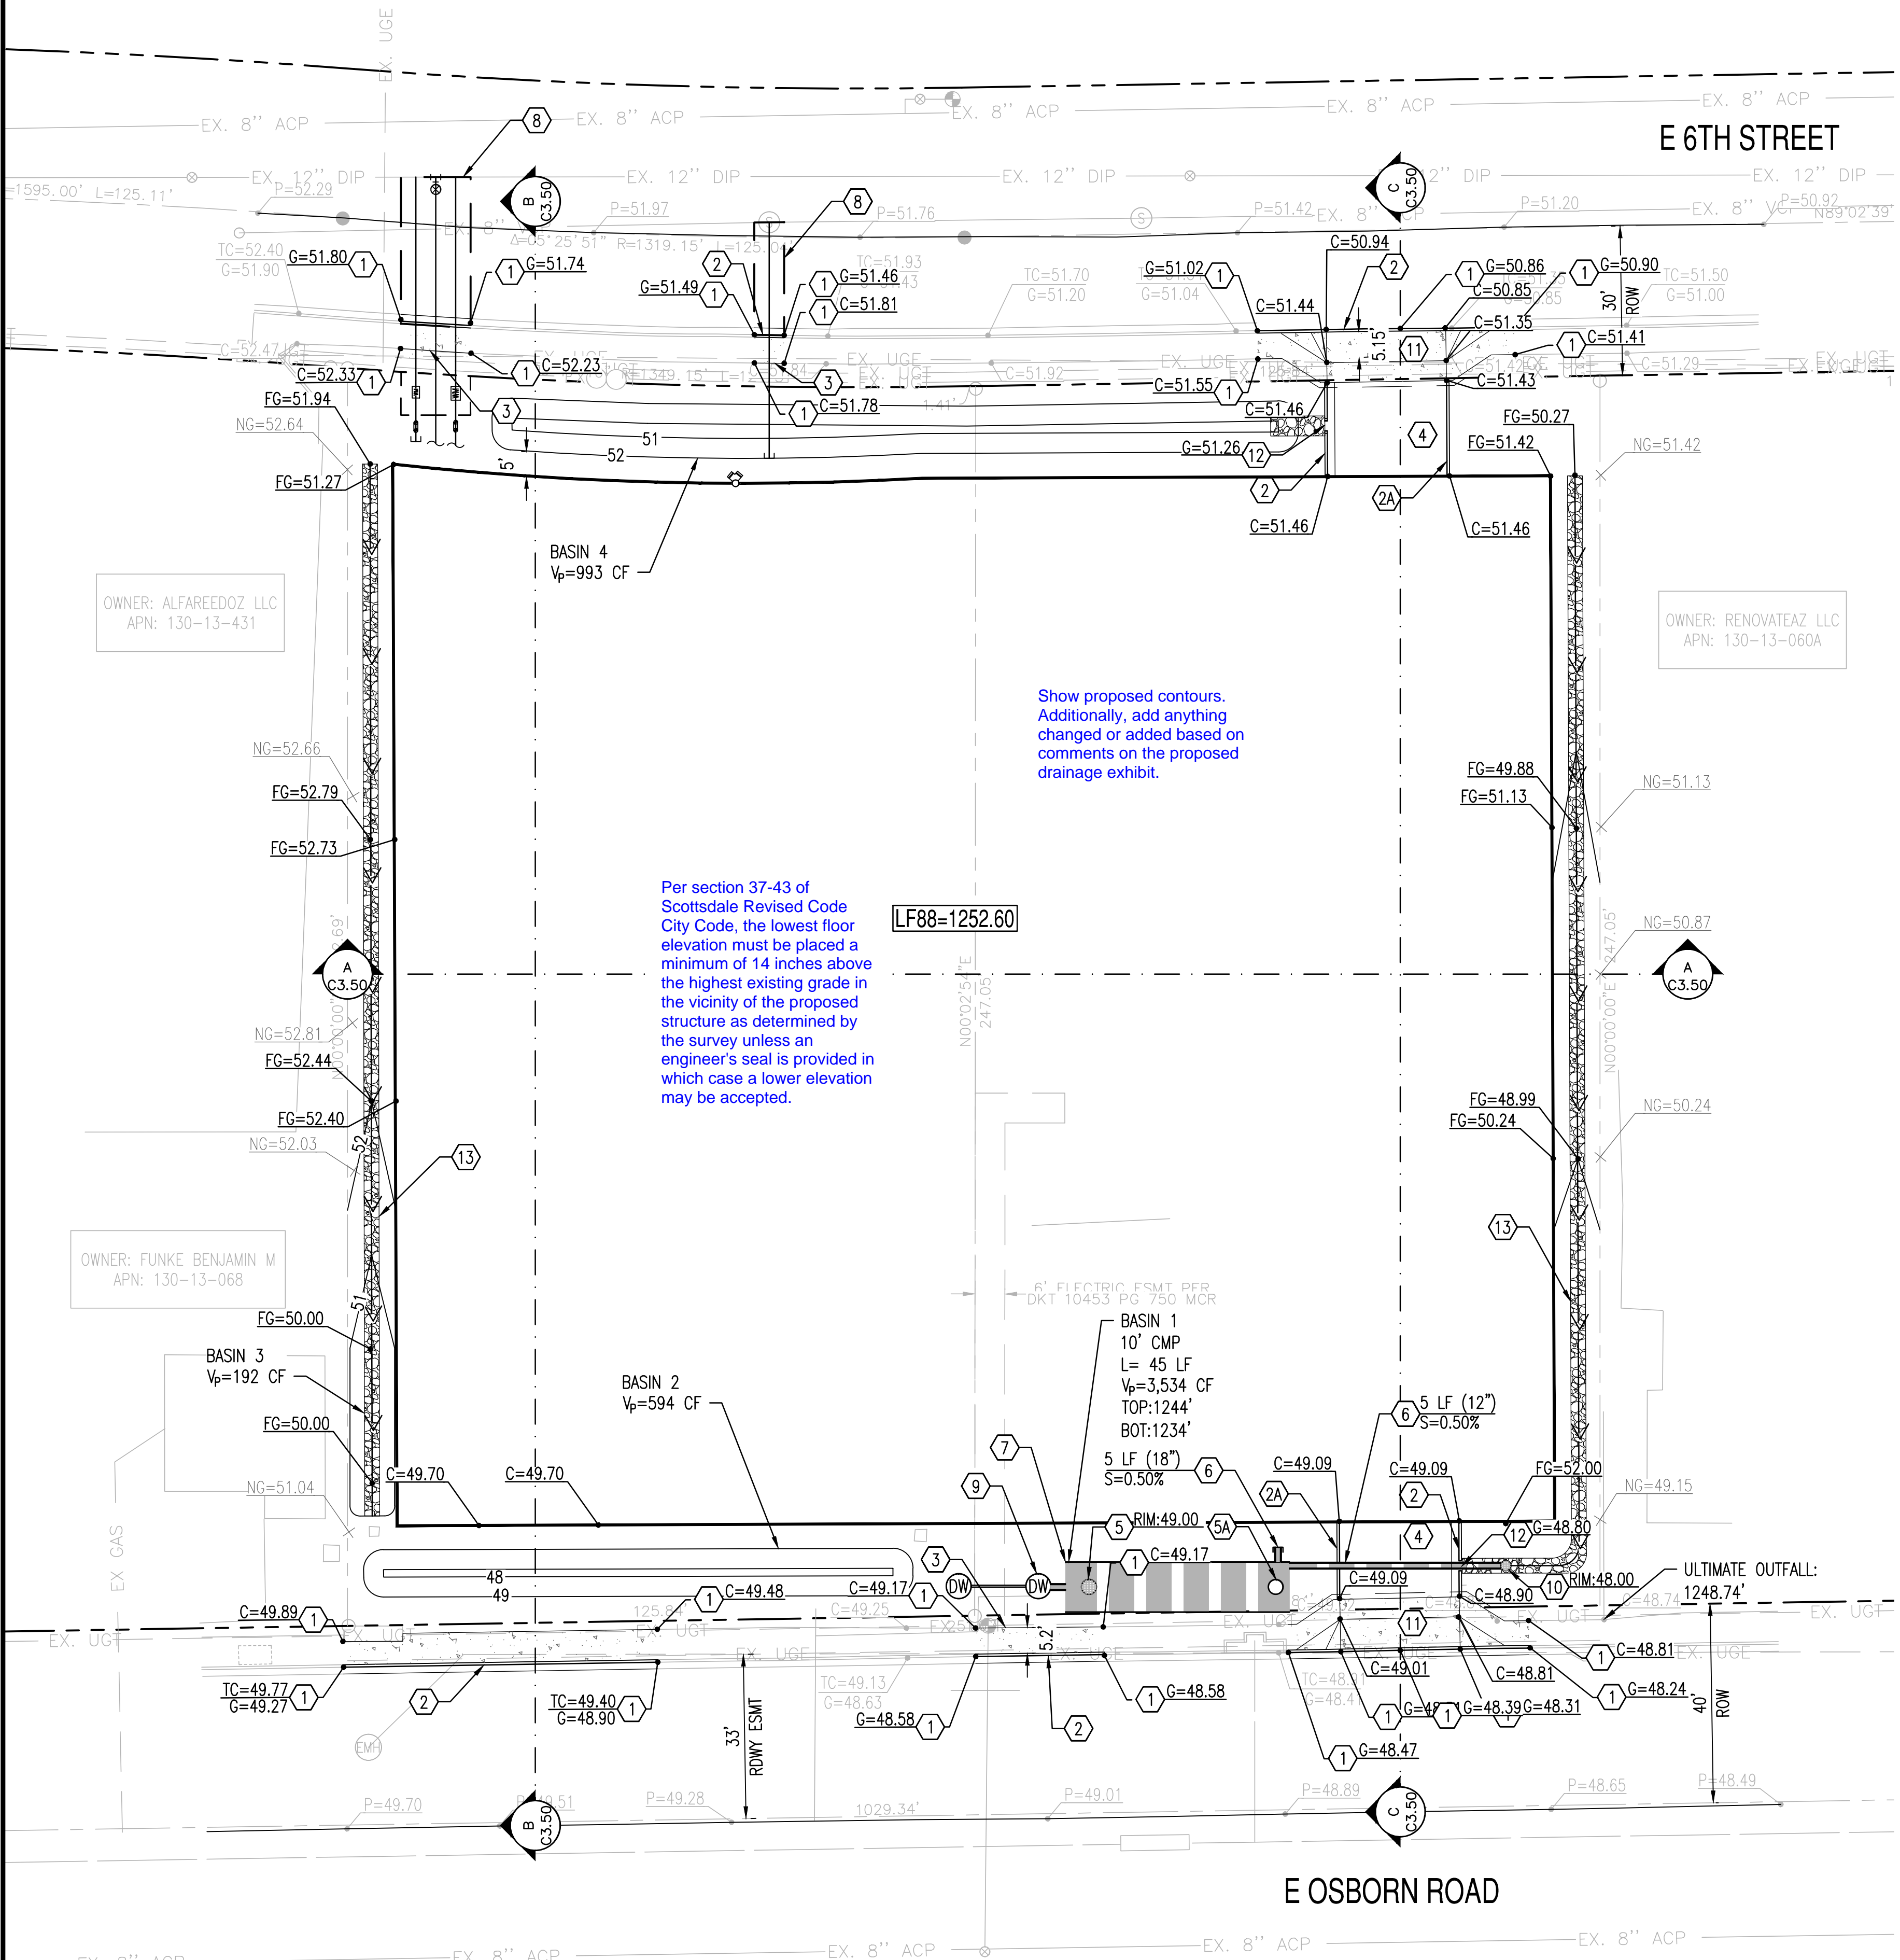

PRELIMINARY GRADING NOTES

- 1 MATCH EXISTING GRADE.
- 2 6" VERTICAL CURB AND GUTTER.
- 2A 6" VERTICAL CURB.
- 3 CONSTRUCT CONCRETE SIDEWALK. WIDTH PER PLAN.
- 4 LIGHT DUTY PAVEMENT.
- 5 INSTALL 30" CMP RISER WITH STANDARD H-20 TRAFFIC GRATED LID.
- 5A INSTALL 30" CMP RISER WITH STANDARD H-20 TRAFFIC SOLID LID.
- 6 INSTALL HDPE DOUBLE WALL PIPE. LENGTH, SIZE AND SLOPE PER PLAN.
- 7 INSTALL UNDERGROUND STORMWATER STORAGE SYSTEM.
- 8 SAWCUT EXISTING PAVEMENT TO PROVIDE STRAIGHT VERTICAL EDGES, FREE FROM IRREGULARITIES. MIN 2' FROM GUTTER.
- 9 INSTALL MAXWELL PLUS DRYWELL.
- 10 INSTALL 24" NYLOPLAST DRAIN BASIN WITH STANDARD GRATED LID.
- 11 DRIVEWAY ENTRANCE PER C.O.S. STD. DET. 2251-1.
- 12 INSTALL RIP-RAP CURB OPENING.
- 13 TYPICAL GROUTED RIP-RAP DITCH.

EXISTING LEGEND:


- XXXX --- EX. MAJOR CONTOURS
- XXXX --- EX. MINOR CONTOURS
- TC:XX.XX
GE:XX.XX EX. SPOT ELEVATION
- EX. S --- EASEMENT LINE AS NOTED
- EX. S --- SEWER LINE
- ⊙ SEWER MANHOLE
- EX. W --- WATER LINE
- ⊙ WATER VALVE
- ⊕ FIRE HYDRANT
- STORM DRAIN LINE
- STORM CATCH BASIN
- ⊙ STORM MANHOLE
- GAS --- GAS LINE
- FENCE --- FENCE
- ⊙ SIGN
- ⊙ STREET LIGHT
- ⊙ TREE
- ROAD CENTERLINE --- ROAD CENTERLINE

PROPOSED LEGEND:



- G=XX.XX GUTTER ELEVATION, TC = G+0.5'
- P=XX.XX PAVEMENT ELEVATION
- C=XX.XX CONCRETE ELEVATION
- PROPERTY LINE
- CURB AND GUTTER
- RIDGELINE
- FLOW ARROW
- STORM PIPE
- LIGHT DUTY PAVEMENT
- RIP-RAP

C.O.S. GENERAL NOTES FOR PUBLIC WORKS CONSTRUCTION


1. ALL CONSTRUCTION IN THE PUBLIC RIGHTS-OF-WAY OR IN EASEMENTS GRANTED FOR PUBLIC USE MUST CONFORM TO THE LATEST MAG UNIFORM STANDARD SPECIFICATIONS AND UNIFORM STANDARD DETAILS FOR PUBLIC WORKS CONSTRUCTION AS AMENDED BY THE LATEST VERSION OF THE CITY OF SCOTTSDALE SUPPLEMENTAL STANDARD SPECIFICATIONS AND SUPPLEMENTAL STANDARD DETAILS. IF THERE IS A CONFLICT, THE CITY'S SUPPLEMENTAL STANDARD DETAILS WILL GOVERN.
2. THE CITY ONLY APPROVES THE SCOPE, NOT THE DETAIL, OF ENGINEERING DESIGNS; THEREFORE, IF CONSTRUCTION QUANTITIES ARE SHOWN ON THESE PLANS, THEY ARE NOT VERIFIED BY THE CITY.
3. THE APPROVAL OF PLANS IS VALID FOR SIX (6) MONTHS. IF A RIGHT-OF-WAY PERMIT FOR THE CONSTRUCTION HAS NOT BEEN ISSUED WITHIN SIX MONTHS, THE PLANS MUST BE RESUBMITTED TO THE CITY FOR REAPPROVAL.
4. A PUBLIC WORKS INSPECTOR WILL INSPECT ALL WORKS WITHIN THE CITY RIGHTS-OF-WAY AND IN EASEMENTS. NOTIFY INSPECTION SERVICES 24 HOURS PRIOR TO BEGINNING CONSTRUCTION BY CALLING 480-312-5750.
5. WHENEVER EXCAVATION IS NECESSARY, CALL THE BLUE STAKE CENTER, 811, TWO WORKING DAYS BEFORE EXCAVATION BEGINS. THE CENTER WILL SEE THAT THE LOCATION OF THE UNDERGROUND UTILITY LINES IS IDENTIFIED FOR THE PROJECT.
6. RIGHT-OF-WAY PERMITS ARE REQUIRED FOR ALL WORK IN PUBLIC RIGHTS-OF-WAY AND EASEMENTS GRANTED FOR PUBLIC PURPOSES. A RIGHT-OF-WAY PERMIT WILL BE ISSUED BY THE CITY ONLY AFTER THE REGISTRANT HAS PAID A BASE FEE PLUS A FEE FOR INSPECTION SERVICES. COPIES OF ALL PERMITS MUST BE RETAINED ON-SITE AND BE AVAILABLE FOR INSPECTION AT ALL TIMES. FAILURE TO PRODUCE THE REQUIRED PERMITS WILL RESULT IN IMMEDIATE SUSPENSION OF ALL WORK UNTIL THE PROPER PERMIT DOCUMENTATION IS OBTAINED.
7. ALL EXCAVATION AND GRADING THAT IS NOT IN THE PUBLIC RIGHTS-OF-WAY OR NOT IN EASEMENTS GRANTED FOR PUBLIC USE MUST CONFORM TO APPENDIX J, GRADING, OF THE LATEST EDITION OF THE INTERNATIONAL BUILDING CODE. A PERMIT FOR THIS GRADING MUST BE SECURED FROM THE CITY FOR A FEE ESTABLISHED BY THE CITY.

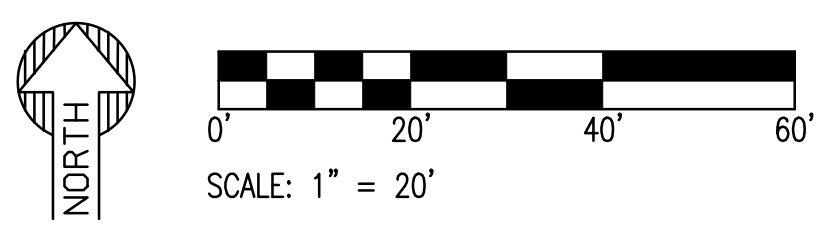


THIS DRAWING IS AN INSTRUMENT OF SERVICE AND THE PROPERTY OF SUSTAINABILITY ENGINEERING GROUP, AND SHALL REMAIN THEIR PROPERTY. THE USE OF THIS DRAWING SHALL BE RESTRICTED TO THE ORIGINAL SITE FOR WHICH IT IS PREPARED AND PUBLICATION THEREOF IS EXPRESSLY LIMITED TO SUCH USE.

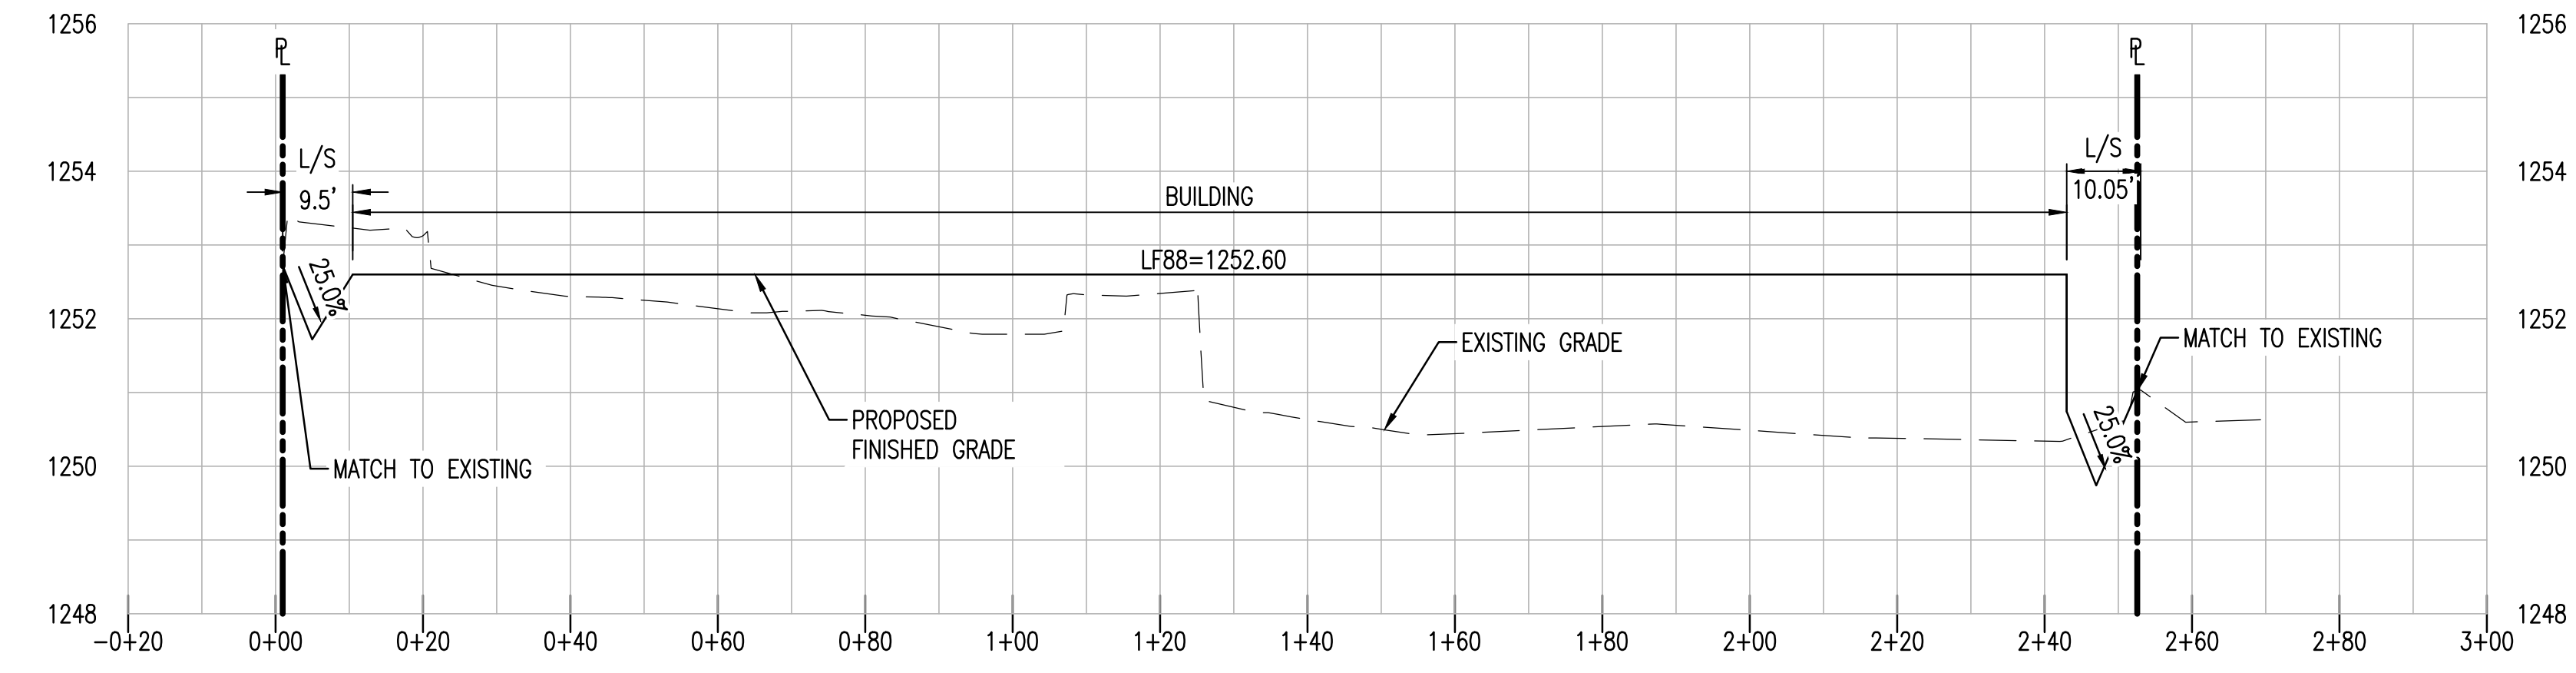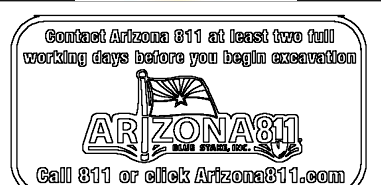

SECTION A-A C3.10
HORIZONTAL SCALE: 1" = 20'
VERTICAL SCALE: 1" = 2'

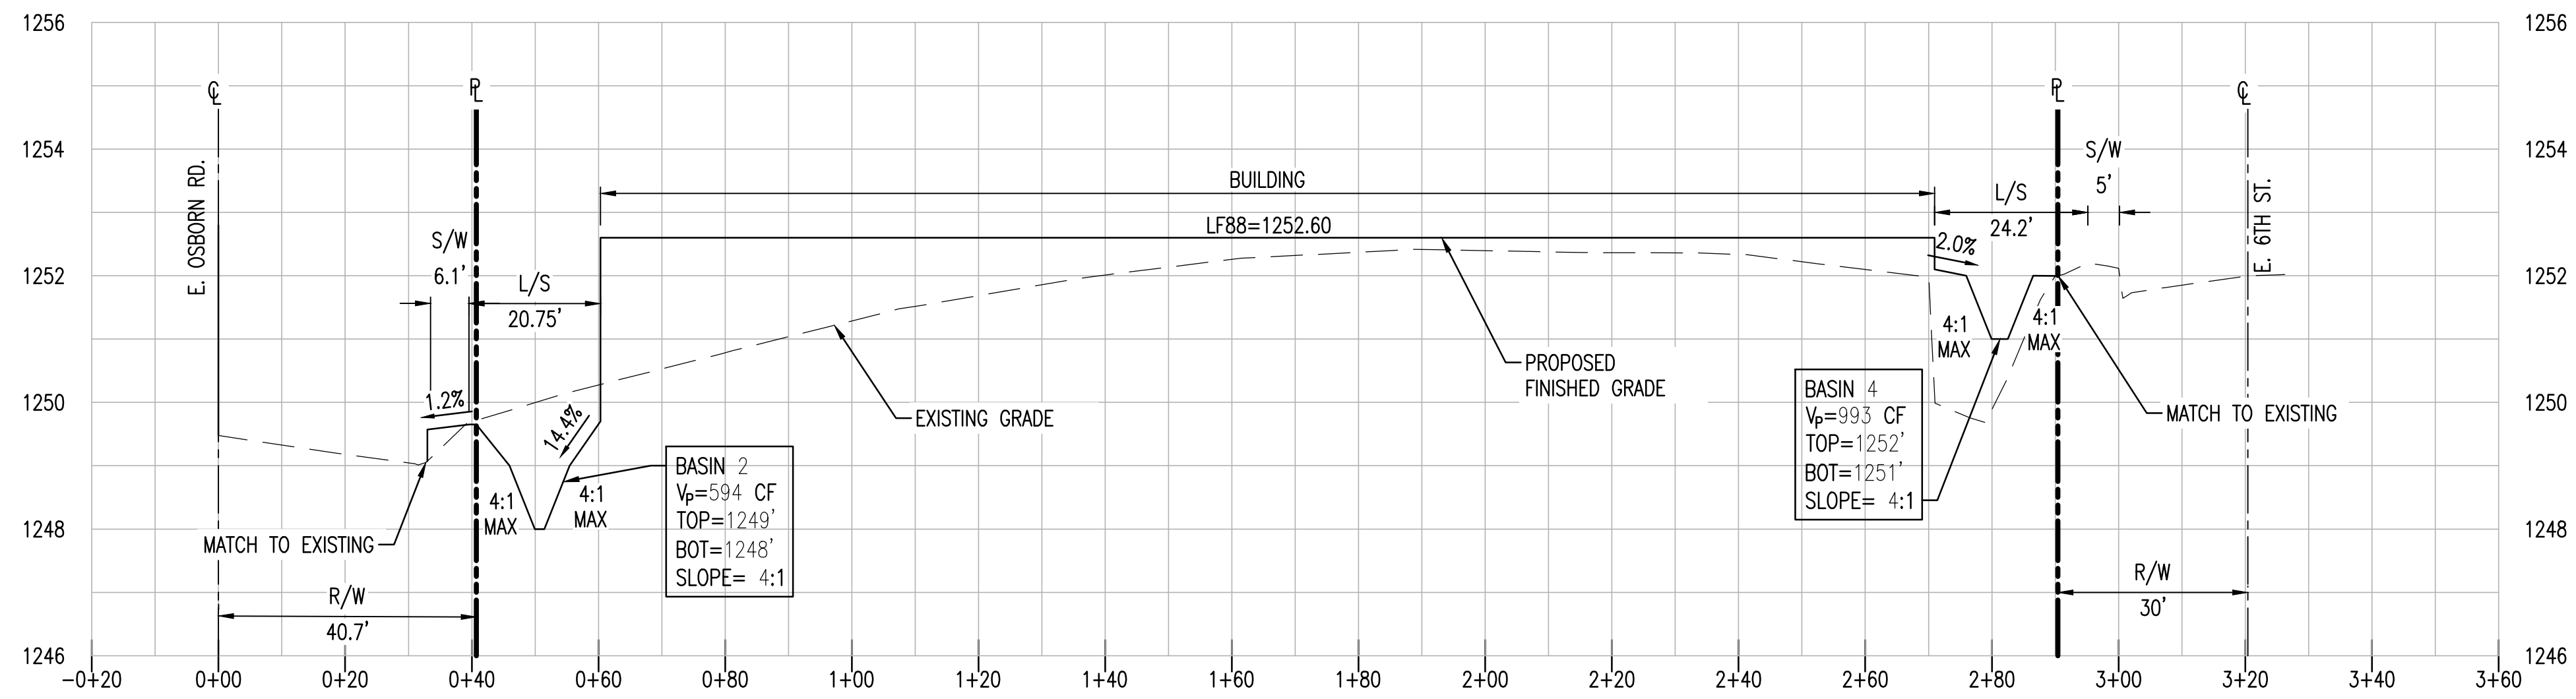

SECTION B-B C3.10
HORIZONTAL SCALE: 1" = 20'
VERTICAL SCALE: 1" = 2'

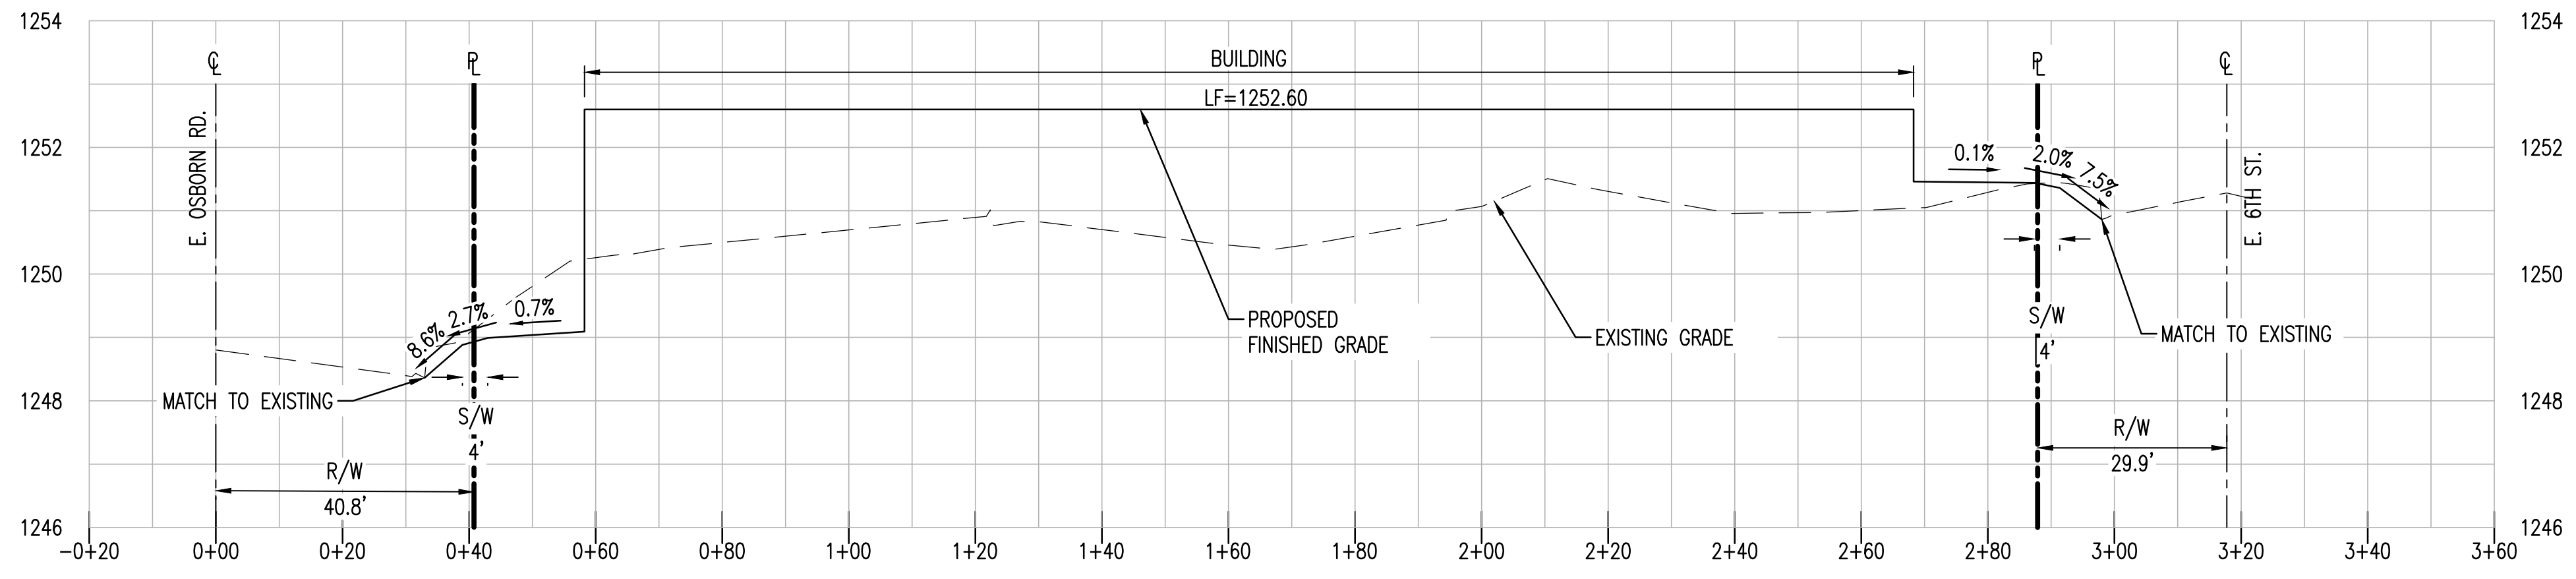

SECTION C-C C3.10
HORIZONTAL SCALE: 1" = 20'
VERTICAL SCALE: 1" = 2'

PROJECT	MAGNOLIA ON OSBORN
LOCATION	NEC OF 70 TH STREET AND OSBORN ROAD
DRAWN	JC 11/10/2022
DESIGNED	JC 11/10/2022
QC	SC 03/02/2022
FINAL QC	
PROJ. MGR.	AF 11/10/2022
DATE:	11/10/2022
ISSUED FOR:	REZONING
REVISION NO.:	DATE:
△	
△	
△	
JOB NO.:	220205
SHEET TITLE:	PRELIMINARY GRADING CROSS SECTIONS
PAGE NO.:	2 OF 3
SHEET NO.:	C3.50

THIS DRAWING IS AN INSTRUMENT OF SERVICE AND THE PROPERTY OF SUSTAINABILITY ENGINEERING GROUP, AND SHALL REMAIN THEIR PROPERTY. THE USE OF THIS DRAWING SHALL BE RESTRICTED TO THE ORIGINAL SITE FOR WHICH IT IS PREPARED AND PUBLICATION THEREOF IS EXPRESSLY LIMITED TO SUCH USE.