

# PRELIMINARY WASTEWATER REPORT

for

**3200 SCOTTSDALE**

3202 N. Scottsdale Road,  
Scottsdale, Arizona

Prepared For:

**3202 Scottsdale, LLC**

7669 E. Pinnacle Peak Rd., Ste. 250  
Scottsdale, AZ 85255

Prepared by:



**Sustainability Engineering Group**

8280 E. Gelding Drive, Suite 101  
Scottsdale, AZ 85260

480.588.7226 [www.azSEG.com](http://www.azSEG.com)

Project Number: 210708

Submittal Date: April 6, 2022

1<sup>st</sup> Revision Date: August 3, 2022

2<sup>nd</sup> Revision Date: September 14, 2022

3<sup>rd</sup> Revision Date: October 11, 2022

Case#: 6-ZN-2022

Plan Check#: TBD

## Contents

1. INTRODUCTION .....	1
1.1 SUMMARY OF PROPOSED DEVELOPEMENT .....	1
1.2 LEGAL DESCRIPTION .....	1
2. DESIGN DOCUMENTATION .....	1
2.1 DESIGN COMPLIANCE .....	1
2.2 PROCEDURES, POLICIES AND METHODOLOGIES .....	1
2.3 SOFTWARE ACKNOWLEDGEMENT:.....	1
3. EXISTING CONDITIONS .....	1
3.1 EXISTING AND PROPOSED ZONING AND LAND USES .....	1
3.2 EXISTING TOPOGRAPHY, VEGETATION AND LANDFORM FEATURES: .....	1
3.3 EXISTING SEWER INFRASTRUCTURE: .....	2
3.4 FLOW MONITORING OF EXISTING SEWER SYSTEM: .....	2
4. PROPOSED CONDITIONS .....	3
4.1 SITE PLAN .....	3
4.2 PROPOSED SEWER SERVICE CONNECTIONS .....	3
4.3 MAINTENANCE RESPONSIBILITIES .....	3
5. SEWER SYSTEM COMPUTATIONS .....	3
5.1 SEWER DEMANDS .....	3
5.2 MINIMUM SERVICE REQUIREMENTS.....	4
6. SUMMARY / CONCLUSIONS .....	5
6.1 Summary:.....	5
6.2 PROJECT SCHEDULE: .....	5
7. REFERENCES .....	5
8. EXHIBITS: .....	5
9. APPENDICIES:.....	5



## 1. INTRODUCTION

### 1.1 SUMMARY OF PROPOSED DEVELOPEMENT

3200 N. Scottsdale Road is a proposed 150-unit high-density multifamily project located between N. 71 Street and N. Scottsdale Road in Scottsdale, Arizona. The project will include a health club/gym on the ground floor. Wastewater service will be provided off the existing 8" sewer system in N. Scottsdale Road. The purpose of this memo is to provide a preliminary wastewater analysis for rezoning.

### 1.2 LEGAL DESCRIPTION

The following parcel of subdivided land is located in the East ½ of the SE ¼ of Section 27, Township 2 North, Range 4 East of the Gila and Salt River Base and Meridian in Scottsdale, Arizona. Refer to **EXHIBIT 1** for a vicinity map.

- APN 130-16-007A, Scottsdale Trailer Corral.

All part of Lot 4, Security Acres Amended, as recorded in Book 8, Page 59 of Maricopa County Records. The total land area is 91,855 sq. ft. (2.11 acres), more or less.

## 2. DESIGN DOCUMENTATION

### 2.1 DESIGN COMPLIANCE

The proposed sewer system is designed to meet design criteria of the City of Scottsdale Water Resources Department, the Arizona Department of Environmental Quality ( " A D E Q " ) , and Maricopa County Services Department.

### 2.2 PROCEDURES, POLICIES AND METHODOLOGIES

This project proposes a new service connection to the existing 8" sewer system in N. Scottsdale Road. Hydraulic design of the service pipe will include the peak flow, including pool backwash.

### 2.3 SOFTWARE ACKNOWLEDGEMENT:

Onsite sewer service line will be hydraulically evaluated using Bentley FlowMaster® V8i (SELECTseries 1).

## 3. EXISTING CONDITIONS

### 3.1 EXISTING AND PROPOSED ZONING AND LAND USES

The parcel is presently zoned C-3, Highway Commercial. The project is proposing rezoning to D/DMU-2, Downtown Multiple Use, Type 2.

### 3.2 EXISTING TOPOGRAPHY, VEGETATION AND LANDFORM FEATURES:

The parcel is fully developed as a for rent residential trailer and RV community. The topography slopes from the northwest to the southeast with approximately two feet fall. Refer to **EXHIBIT 2** for an aerial of the overall project existing conditions.

### 3.3 EXISTING SEWER INFRASTRUCTURE:

See **EXHIBIT 3** - City of Scottsdale (QS 15-44)

- Two 8" sewer lines ~~Street frontage. The western VCP line~~ has ~~its~~ been severed, plugged just north of the Earll Drive manhole. Any service connections to this pipe are unknown. The eastern PVC/VCP line provides service to properties along 71<sup>st</sup> Street including a service connection to the site (that is to be abandoned and plugged per City requirements).
- An 8" VCP line exists approximately 31' west of the site but does not presently provide any service connections to this site.
- An existing 21" sanitary sewer trunk line is located east of the site and flows east to Miller Road.

### 3.4 FLOWS IN EXISTING 8" SEWER SYSTEM:

To determine existing pools & spas backwash peak flow, volumes were calculated assuming a 5 ft depth for pools and 3 ft depth for spas. Turnover rate of 6 hrs (360 minutes) was used for pools and 20 minutes for spas. Calculations are as follow:

#### **Agave Apartments**

##### Pool

Area = 1,222 ft<sup>2</sup>

Volume = 1,222 ft<sup>2</sup> \* 5 ft = 6,110 ft<sup>3</sup> = 45,703 gal

Peak flow = 45,703 gal / 360 min = 127 gpm

##### Spa

Area = 120 ft<sup>2</sup>

Volume = 120 ft<sup>2</sup> \* 3 ft = 360 ft<sup>3</sup> = 2,693 gal

Peak flow = 2,693 gal / 20 min = 135 gpm

Total Peak Flow = 135 gpm + 127 gpm = 262 gpm

#### **ALTA Osborn Apartments**

##### Pool

Area = 1,974 ft<sup>2</sup>

Volume = 1,974 ft<sup>2</sup> \* 5 ft = 9,870 ft<sup>3</sup> = 73,828 gal

Peak flow = 73,828 gal / 360 min = 205 gpm

##### Spa

Area = 144 ft<sup>2</sup>

Volume = 144 ft<sup>2</sup> \* 3 ft = 432 ft<sup>3</sup> = 3,231 gal

Peak flow = 3,231 gal / 20 min = 162 gpm

Total Peak Flow = 205 gpm + 162 gpm = 367 gpm



As discussed in the Final Sewer Capacity Report for Alta Drinkwater (A.K.A. Osborn), dated July 2017 prepared by SEG (Refer to **APPENDIX III**), and pools and spas calculations above, flow in the existing Scottsdale Road sewer line is as follows:

<b>Table 1: EXISTING FLOW IN SCOTTSDALE ROAD 8" SEWER (Ties in at Earll Drive 21" Sewer)</b>							
	Units or s.f. com.	ADF (gpcu) or per s.f.	Avg. Day Flow (GPD)	Avg. Day Flow (GPM)	Peaking Factor	Peak Hour (GPD)	Peak Hour (GPM)
Aqave Apartments	247	140	34,580	24	4	138,320	96
Good Egg restaurant	7,000 s.f.	1.2	8,400	6	6	50,400	35
ALTA Osborn Apartments	134	143	19,162	13	4	76,648	53
Aqave Pool & Spa Backwash	-	-	-	-	-	-	262
ALTA Osborn Pool & Spa Backwash	-	-	-	-	-	-	367
Existing Flow to Thomas 8" sewer and then 21" Earll Drive Sewer			<b>62,142</b>	<b>43</b>		265,368	813

Note: Combined pool & spa backwash for Agave Apartment and Alta Osborn apartments is 629 gpm and will be analyzed at 50% capacity use (315 gpm).

## 4. PROPOSED CONDITIONS

### 4.1 SITE PLAN

**EXHIBIT 4** depicts the preliminary site plan. All onsite structures and service line will be removed. The property is being re-developed with a structure containing 150 apartment units. The ground floor will include 4,000 sf of health club/gym use (fitness center/spa/health club).

### 4.2 PROPOSED SEWER SERVICE CONNECTIONS

Sewer service will consist of a 6' pipe from the south end of the building connected to a proposed manhole (MH-1) at the existing 8" s e w e r Scottsdale Road per MAG 426 Type B drop connection. No service connection is proposed to the 71st St. line. The service line location will be coordinated to avoid conflict with other existing utilities. The preliminary utility plan is shown in **APPENDIX I**.

### 4.3 MAINTENANCE RESPONSIBILITIES

The sewer service line will be owned and maintained by the property owner.

## 5. SEWER SYSTEM COMPUTATIONS

### 5.1 PROPOSED NEW SEWER DEMAND

On-site pool backwash peak flow was calculated following the same parameters in Section 3.4 above:

$$\text{Area} = 2,250 \text{ ft}^2$$

$$V = 2,250 \text{ ft}^2 * 5 \text{ ft} = 11,250 \text{ ft}^3 = 84,156 \text{ gal}$$

$$\text{Peak flow} = 84,156 \text{ gal} / 360 \text{ min} = 234 \text{ gpm}$$

Table 2 below presents proposed on-site demands:

**Table 2: SEWER DEMAND CALCULATIONS**

	Area (sq.ft.)	Dwelling Units	ADD (gpd/unit)	Peaking Factor	Avg. Day Demand (gpm)	Peak Flow (gpm)	Peak Flow (gpd)
Residential	-	150	140	4.5	14.6	65.6	94,500
Fitness Center/Spa/Health Club	4,000	-	0.8	3.5	2.2	7.8	11,200
Total without Pool backwash					16.8	73.4	105,700
Pool				N/A	-	234.0	336,960
Total with Pool Backwash					16.8	307.4	442,660

**5.2 MINIMUM SERVICE REQUIREMENTS**

A 6" sewer at 2.00% slope is sufficient to convey the peak flow without the pool backwash at a depth of 1.9" and velocity of 3.18 fps. The peak flow with the pool backwash will have a depth of 4.3" and velocity of 4.54 fps.

This pipe will connect to the proposed manhole (MH-1) at the existing 8" sewer pipe. Type B drop connection. Refer to **APPENDIX II** for the service pipe hydraulic calculations.

**5.3 EXISTING SCOTTSDALE ROAD SEWER CAPACITY**

Capacity for the existing 8" sewer line along the d/D requirements per the DSPM. Hydraulics for this line is shown in **Table 3**. Expected peak flows for the 3200 N. Scottsdale Road project were added to the existing pipe flows. Refer to **APPENDIX IIA** for the offsite pipe hydraulic calculations.

A d/D of ratio of 0.65 is the maximum allowable limit without pool backwash and a d/D ratio of 0.80 is allowed including pool backwash. For the scenario without pool backwash, the maximum calculated flow at the allowable d/D is higher than the proposed peak flow. For the scenario with pool backwash, the maximum calculated flow at allowable d/D is lower than the proposed peak flow. As such, the existing pipe will be analyzed at subsequent submittals to ensure it has enough capacity for the new wastewater flows from the project.

The existing 8" pipe slope will be section eyed to the map. For preliminary design, the quarter-section data was used indicating a 1% slope on the pipe. Upstream manhole invert = 1232.88, downstream manhole invert = 1228.73, pipe length = 4.06'

**Table 3: SCOTTSDALE ROAD SEWER CAPACITY**

	Total Peak Flow (gpd)	Total Peak Flow (gpm)	Allowed d/D	Max Flow Capacity at allowed d/D (gpm)	Calculated Velocity (fps)
Existing Flow (Table 1a)	265,368	184			
Proposed Flow (Table 2)	105,700	73			
Total without Pool Backwash	371,068	258	0.65	410	3.8
Pool Backwash Existing* (2 spas & 2 pools)	453,600	315			
Pool Backwash Proposed* (1 pool)	168,480	117			
Total with Pool Backwash	993,148	690	0.80	530	4.0

\* Table assumes three simultaneous pool backwash scenarios at 50% capacity use

## 6. SUMMARY / CONCLUSIONS

### 6.1 Summary:

The proposed sewer flows and service connection are designed to meet criteria of the City's Design Standards and Policies Manual, the Arizona Department of Environmental Quality ("ADEQ"), and Maricopa County Environmental Services Department ("MCESD").

The hydraulic output shown in **APPENDIX II** indicates that the 6" sewer connection is sufficient to provide service to this project. The hydraulic output in **APPENDIX IIA** indicates that the existing 8" sewer has sufficient capacity to serve the project without considering pool backwash. The existing 8" sewer in Scottsdale Road will be revised in subsequent submittals to provide enough capacity for the new wastewater flows including the pool backwash from the project.

### 6.2 PROJECT SCHEDULE:

As a residential apartment development, the infrastructure and buildings are proposed to be constructed in a single phase.

## 7. REFERENCES

1. COS Sewer Q-S MAP 15-44
2. City of Scottsdale Design Standards & Policies Manual, 2018 (Chapter 7 – Sewer)

## 8. EXHIBITS:


- EXHIBIT 1 - Vicinity Map- Local Aerial
- EXHIBIT 2 - Aerial
- EXHIBIT 3 - COS Sewer Q-S Map 15-44
- EXHIBIT 4 - Preliminary Site Plan

## 9. APPENDICES:

- APPENDIX I - Preliminary Utility Plan/Service Layout
- APPENDIX II - Preliminary Onsite Sewer Service Line Hydraulic Calculations
- APPENDIX IIA- Preliminary Offsite Sewer Hydraulic Calculations
- APPENDIX III – Alta Drinkwater Final Sewer Capacity Report Case No. 42-DR-2016


## ***EXHIBITS***

- 1. *Vicinity Map***
- 2. *Aerial***
- 3. *Sewer Q-S 15-44***
- 4. *Preliminary Site Plan***

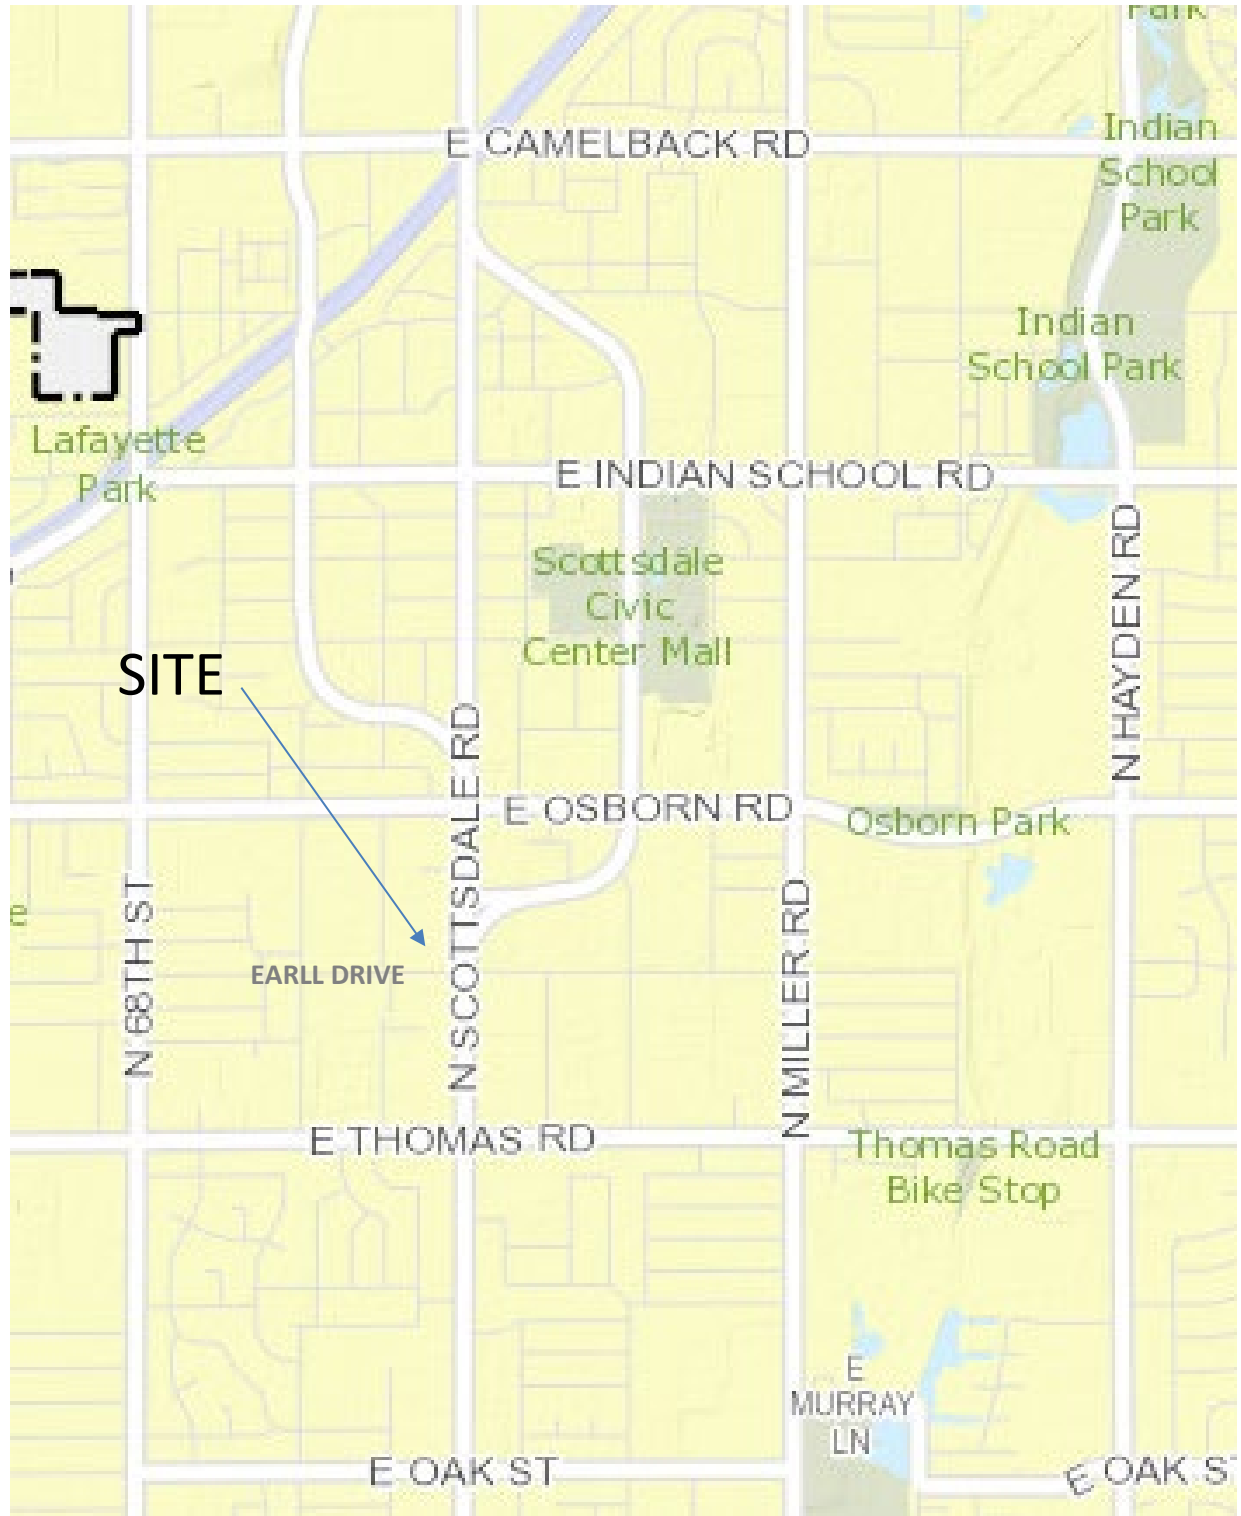

## EXHIBIT 1 – Vicinity Map

8280 E. Gelding Dr., Suite 101  
Scottsdale, AZ 85260

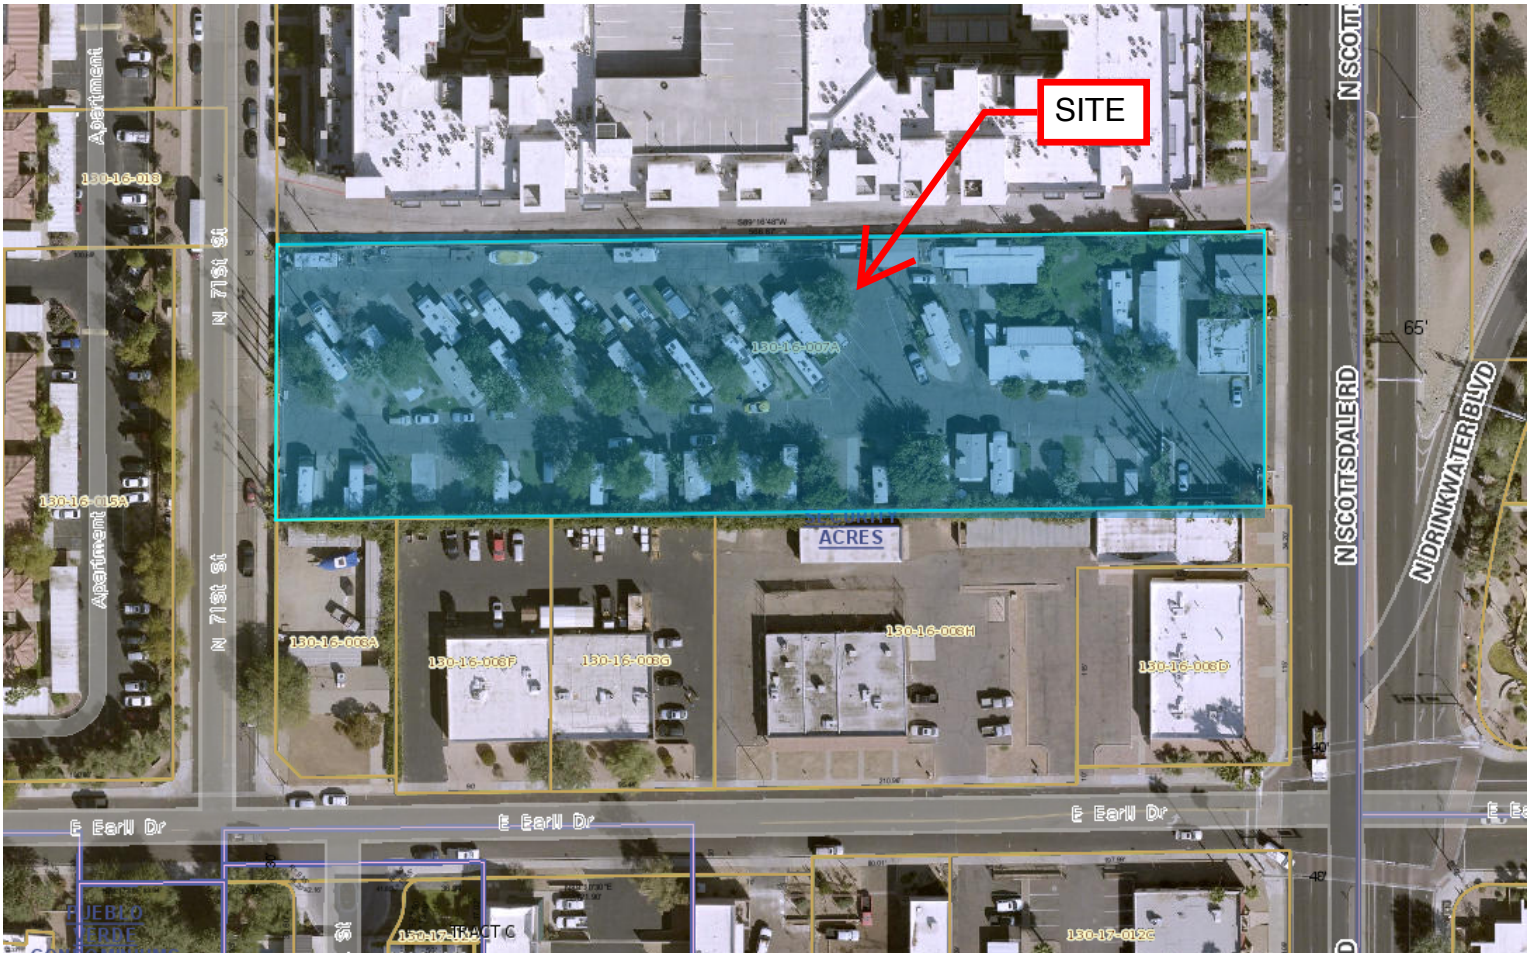


# EXHIBIT Aerial

8280 E. Gelding Dr., Suite 101  
Scottsdale, AZ 85260







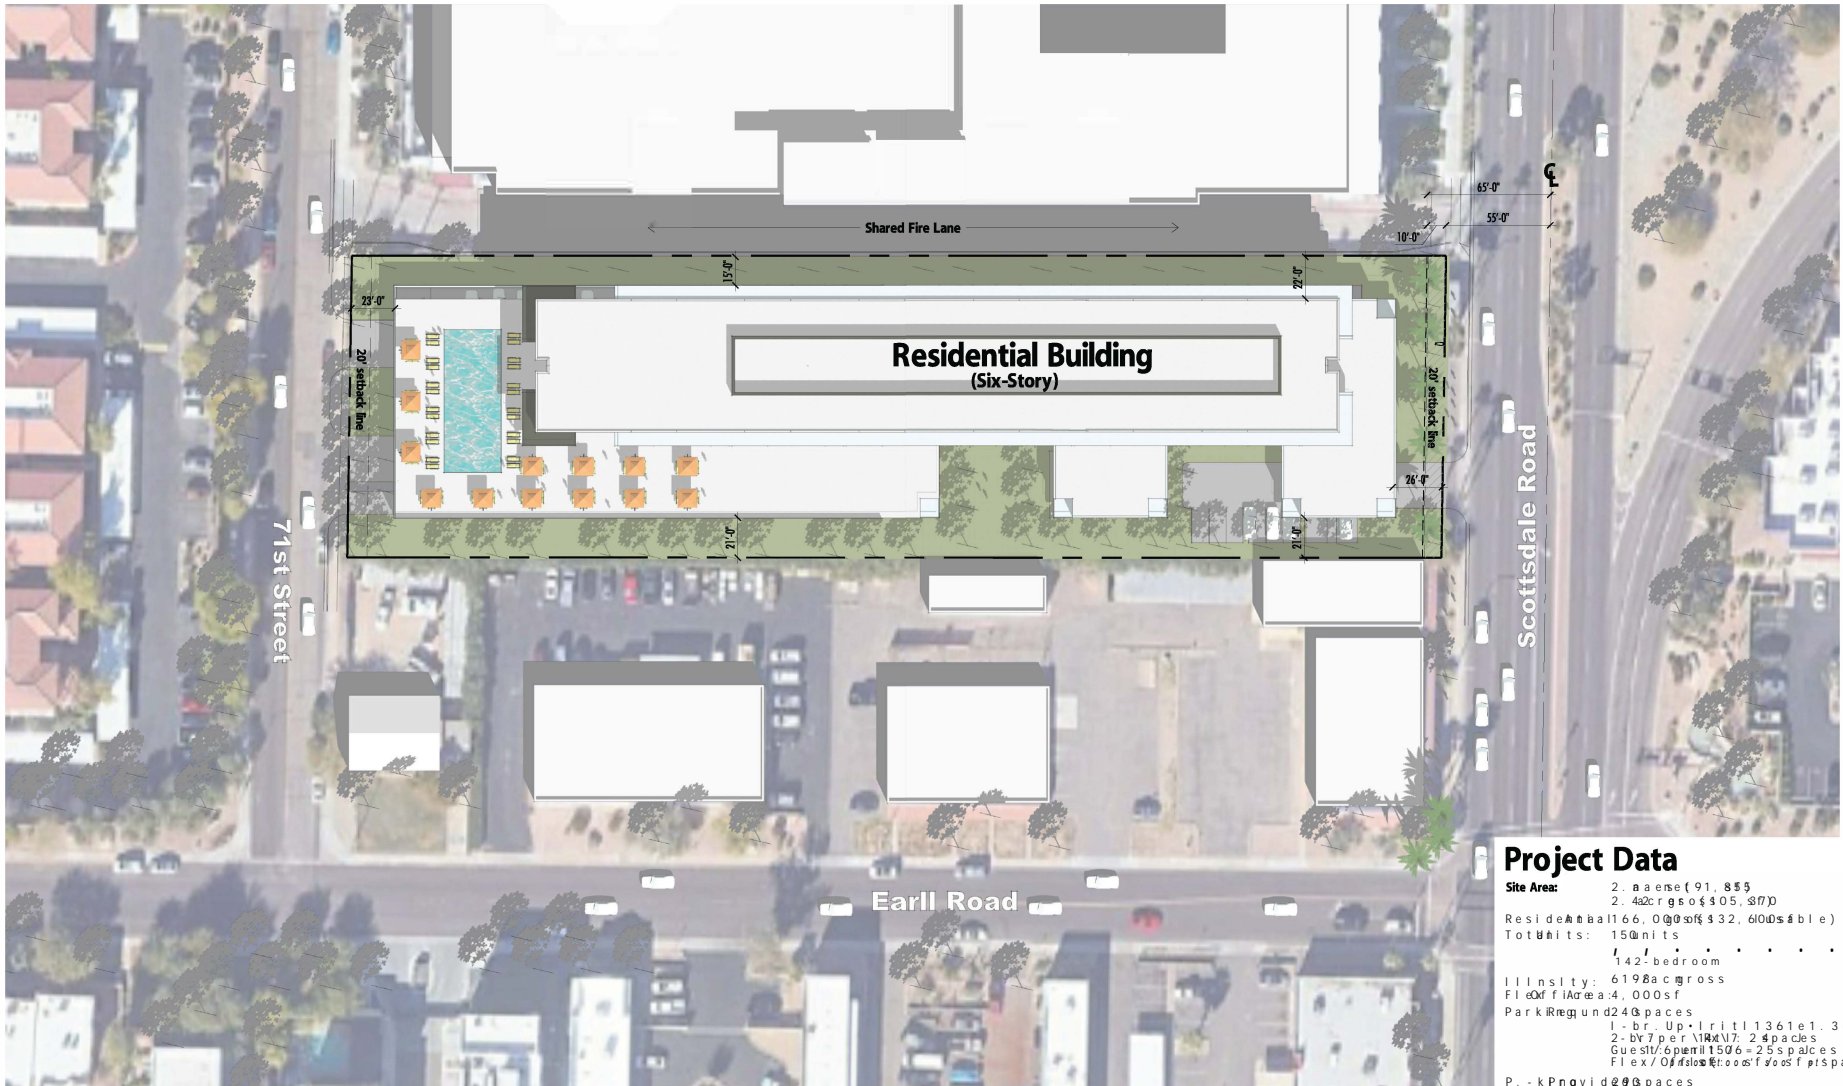

**Project Data**

Site Area:	2.8 acres (91,855 sq ft)
Residential Units:	166 units (332,600 sq ft)
Total Units:	150 units
Bedrooms:	142 bedrooms
Insulation:	6198 sq ft
Fireproof Area:	4,000 sq ft
Parking:	243 spaces
Pool:	1 pool
Guest Rooms:	25 spaces
Flex/Office:	25 spaces

Site Plan

32052C OTTSDALE - Lot 1 & 2, 71st Street, Scottsdale, AZ

10' 1311' 160' 111' 1120'

211307-22 DAVIS

Notice of Pre-qualified Offer: THESE DRAWINGS ARE THE EXCLUSIVE PROPERTY OF DAVIS CONSTRUCTION COMPANY, INC. NO PART OF THESE DRAWINGS IS TO BE REPRODUCED OR TRANSMITTED IN ANY FORM OR BY ANY MEANS, ELECTRONIC OR MECHANICAL, WITHOUT THE EXPRESS WRITTEN PERMISSION OF DAVIS CONSTRUCTION COMPANY, INC.

EXHIBIT  
Site Plan



## *APPENDICIES*

- I.*      Preliminary Service/ Utility Plan
  
- II.*     Service Pipe Hydraulics
  
- IIA.*   Offsite Sewer Pipe Hydraulics
  
- III.*    Alta Drinkwater Final Sewer Capacity Report Case No. 42-DR-2016



**CIVIL ENGINEER**  
SUSTAINABILITY ENGINEERING GROUP  
8280 E. GELDING DR., SUITE 101  
SCOTTSDALE, ARIZONA 85260  
PHONE: 480-588-7226  
ATTN: ALI FAKIH  
EMAIL: ALI@AZSEG.COM

**ARCHITECT:**  
DAVIS  
3033 N. CENTRAL AVE, SUITE 800  
PHOENIX, AZ 85012


**SURVEYOR**  
AW LAND SURVEYING, LLC  
P.O. BOX 2170  
CHANDLER, ARIZONA 85244  
PHONE: 480-244-7630  
ATTN: DANIEL ARMUJO  
EMAIL: ARMUJODARMUJO@AWLANDSURVEY.COM

**OWNER/DEVELOPER:**  
3202 SCOTTSDALE, LLC.  
3202 SCOTTSDALE, LLC.

# 3200 SCOTTSDALE PRELIMINARY UTILITY PLAN


# APPENDIX I

3202 N. SCOTTSDALE ROAD, SCOTTSDALE, AZ.  
A PORTION OF THE EAST HALF OF THE SOUTHEAST QUARTER OF SECTION 27, TOWNSHIP 2 NORTH, RANGE 4 EAST OF THE GILA AND SALT RIVER MERIDIAN, MARICOPA COUNTY, ARIZONA.


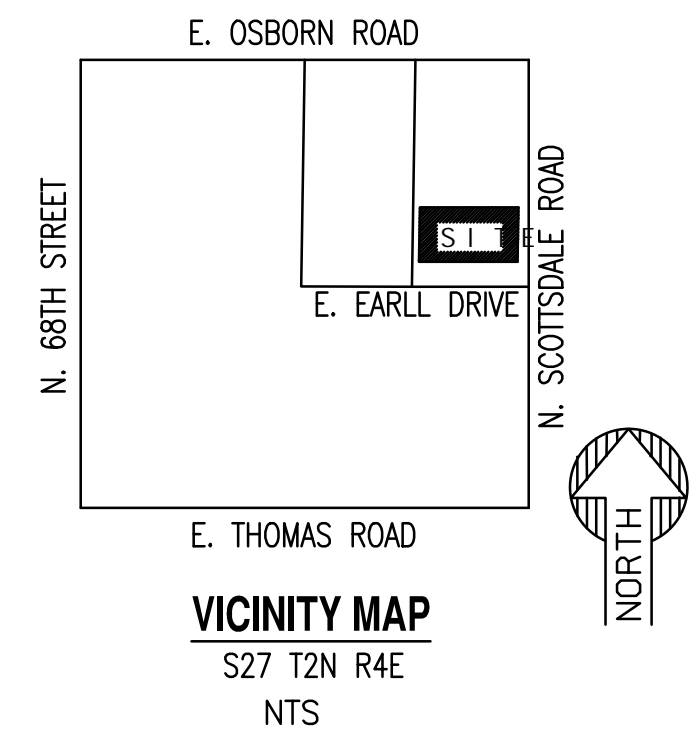


**ZONING:**  
EXISTING: C-3, HIGHWAY COMMERCIAL  
PROPOSED: D/DMU-2, DOWNTOWN MULTIPLE USE, TYPE 2

**PROPOSED UTILITY LEGEND:**

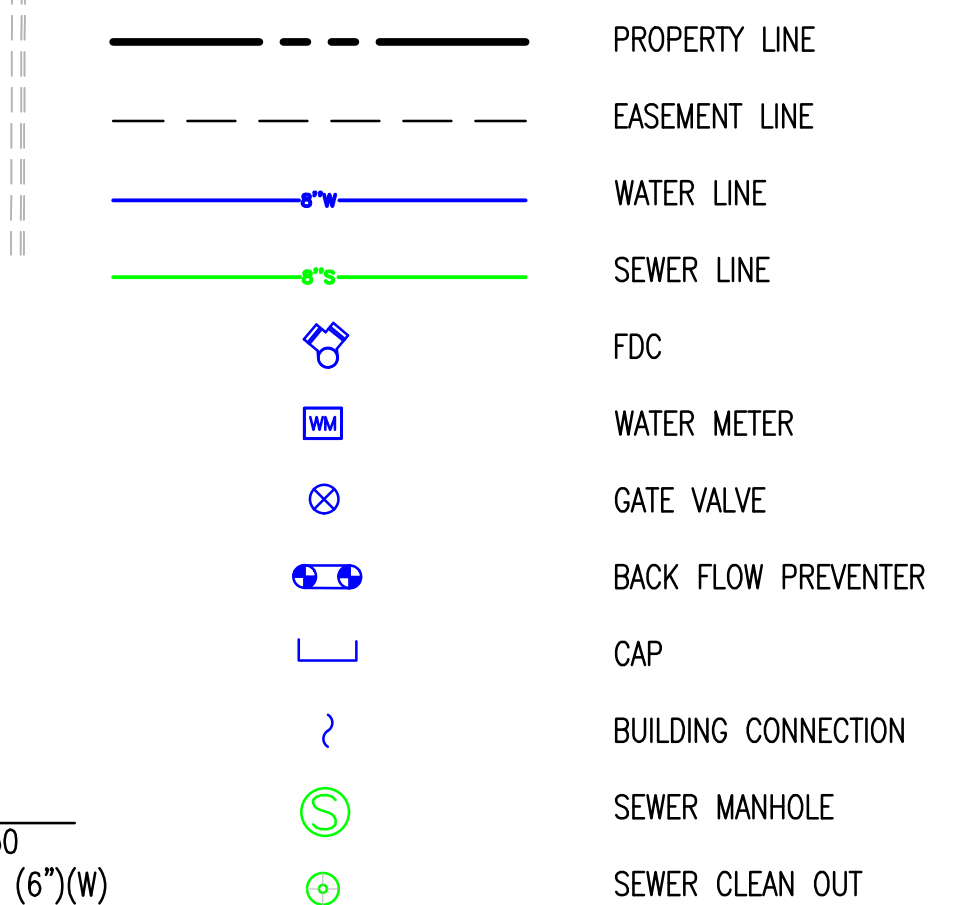

**EXISTING LEGEND**

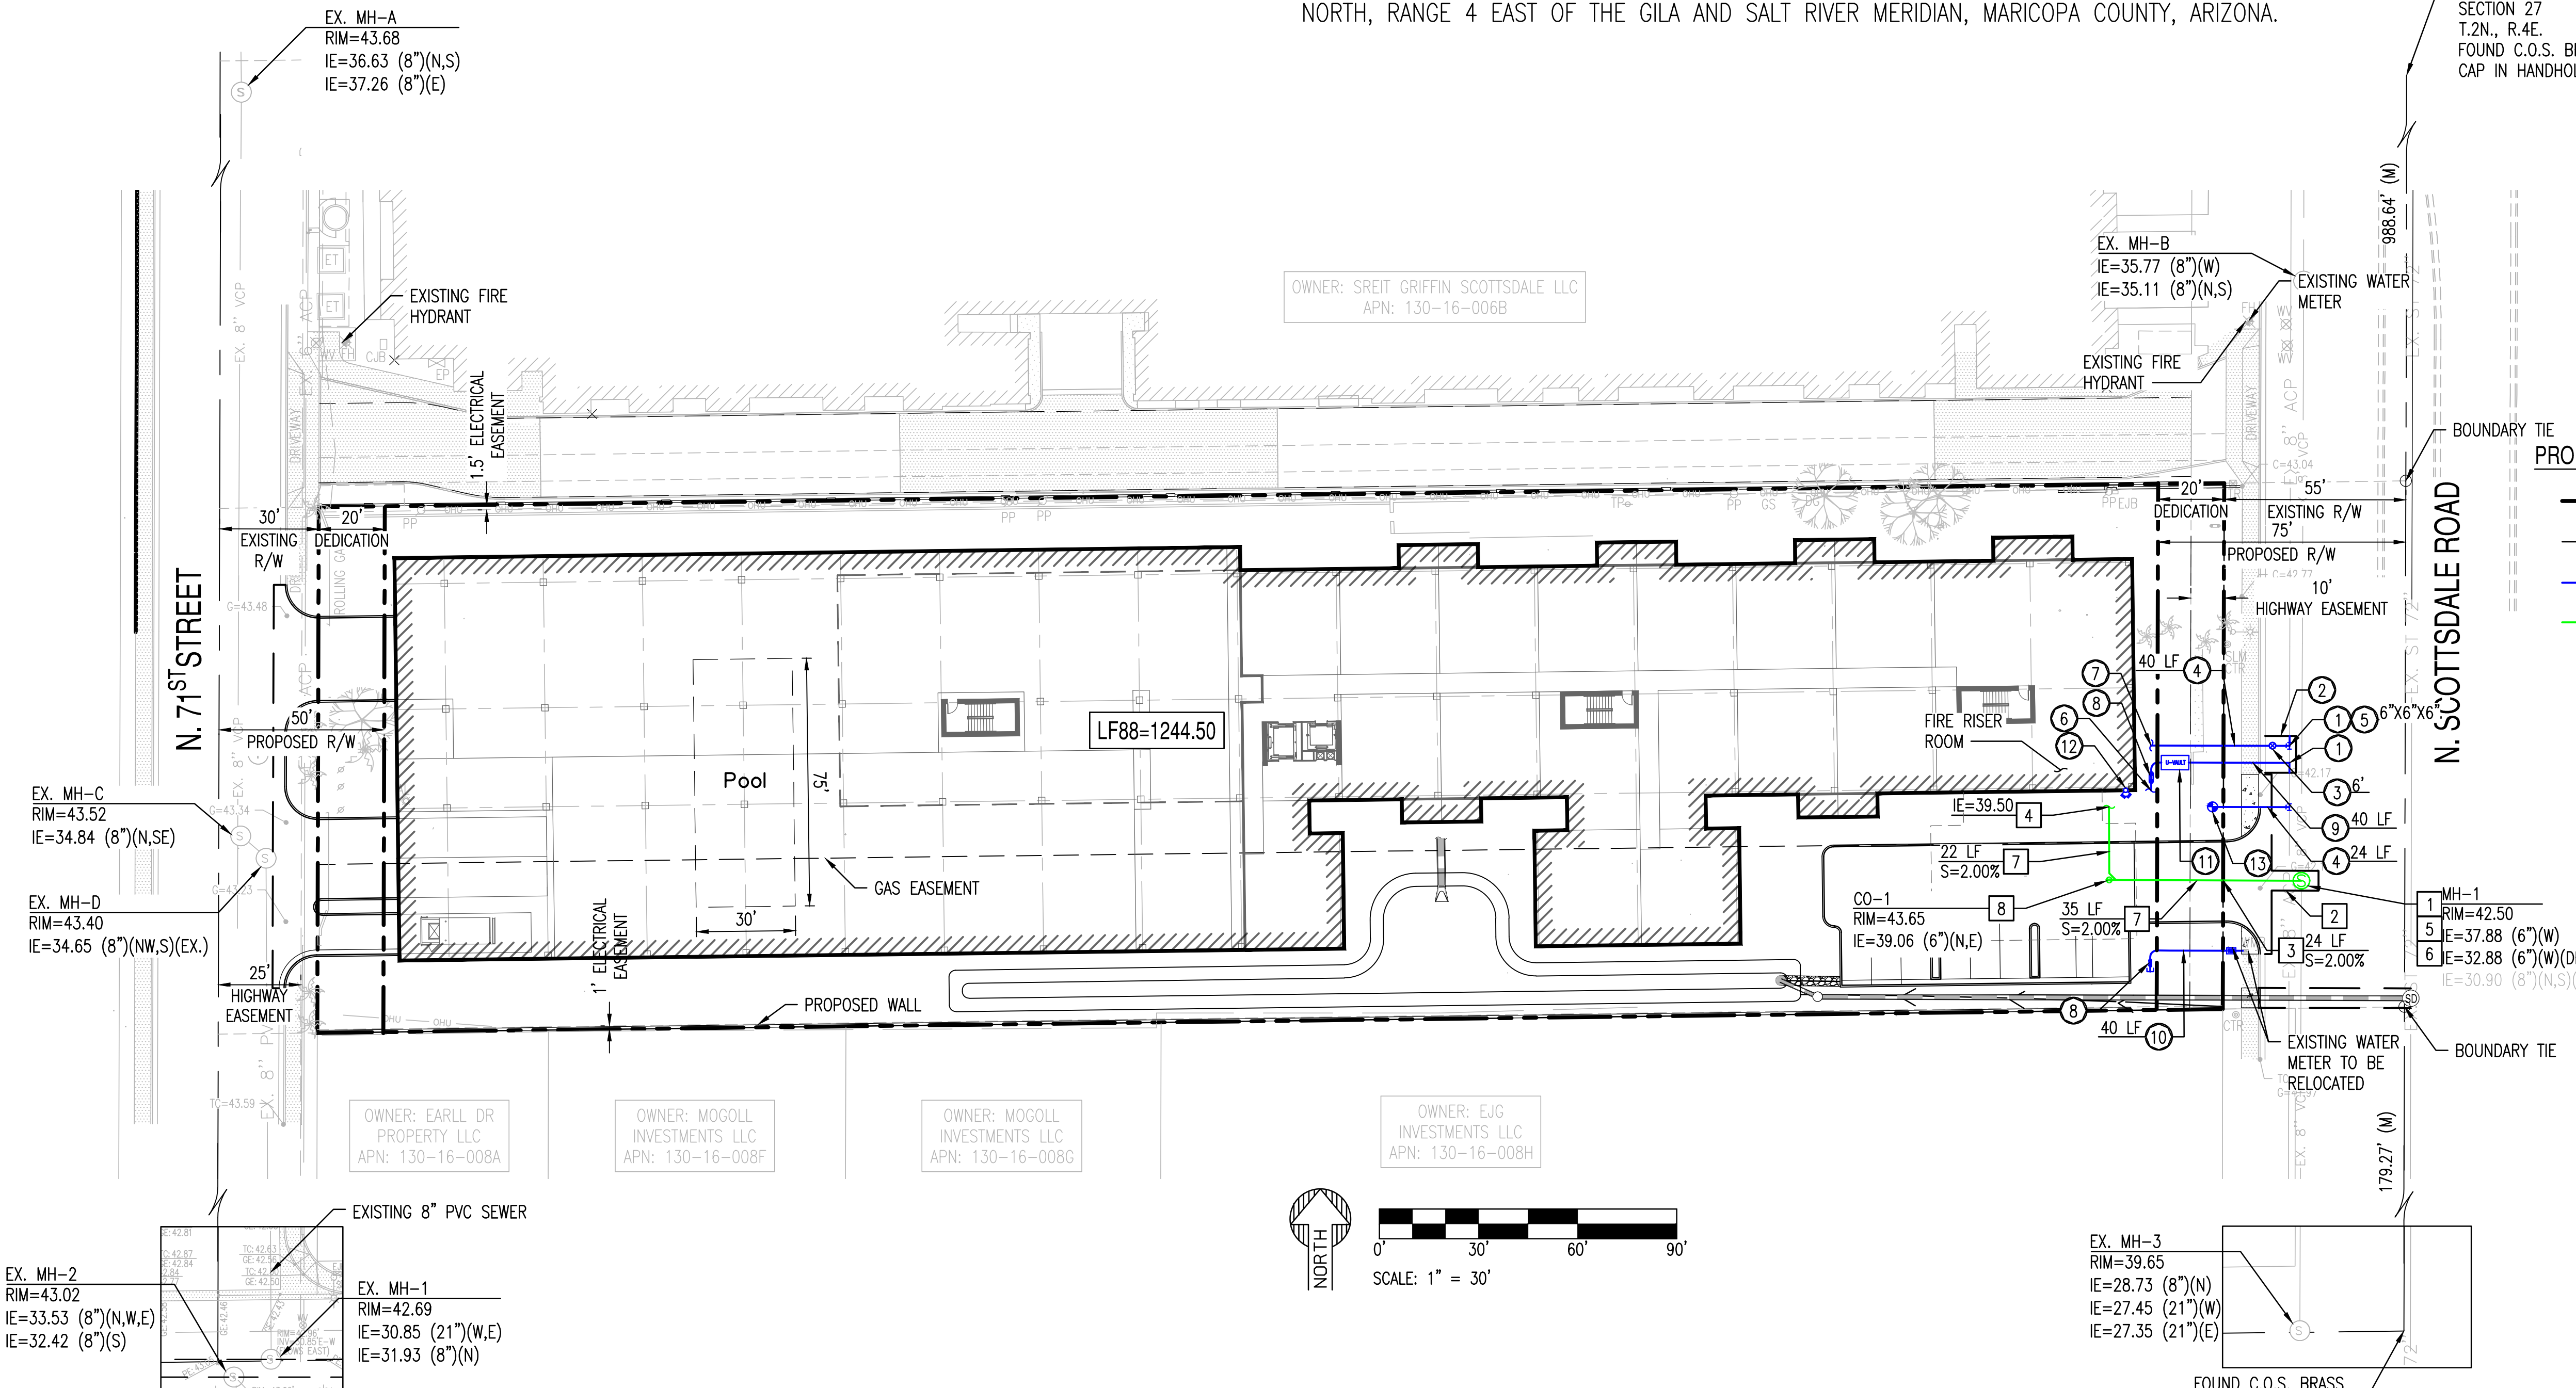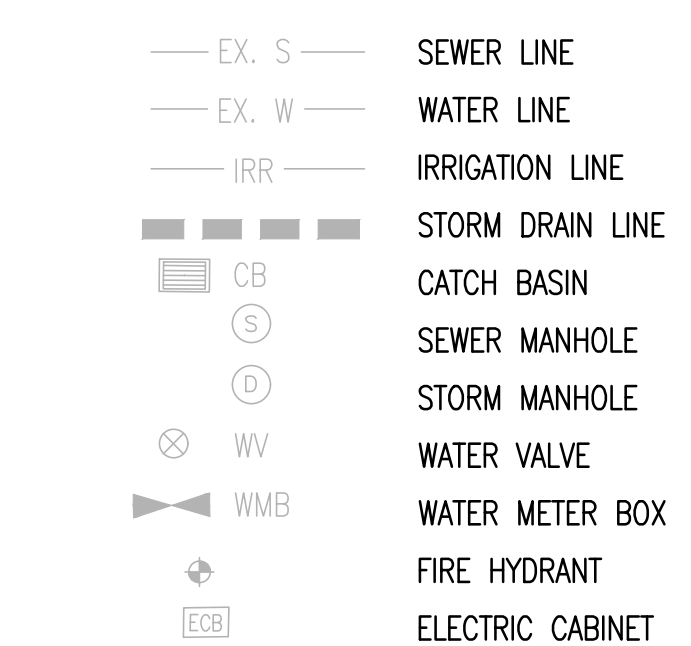

**C.O.S. GENERAL NOTES FOR PUBLIC WORKS CONSTRUCTION**

- ALL CONSTRUCTION IN THE PUBLIC RIGHTS-OF-WAY OR IN EASEMENTS GRANTED FOR PUBLIC USE MUST CONFORM TO THE LATEST MAG UNIFORM STANDARD SPECIFICATIONS AND UNIFORM STANDARD DETAILS FOR PUBLIC WORKS CONSTRUCTION AS AMENDED BY THE LATEST VERSION OF THE CITY OF SCOTTSDALE SUPPLEMENTAL STANDARD SPECIFICATIONS AND SUPPLEMENTAL STANDARD DETAILS. IF THERE IS A CONFLICT, THE CITY'S SUPPLEMENTAL STANDARD DETAILS WILL GOVERN.
- THE CITY ONLY APPROVES THE SCOPE, NOT THE DETAIL, OF ENGINEERING DESIGNS; THEREFORE, IF CONSTRUCTION QUANTITIES ARE SHOWN ON THESE PLANS, THEY ARE NOT VERIFIED BY THE CITY.
- THE APPROVAL OF PLANS IS VALID FOR SIX (6) MONTHS. IF A RIGHT-OF-WAY PERMIT FOR THE CONSTRUCTION HAS NOT BEEN ISSUED WITHIN SIX MONTHS, THE PLANS MUST BE RESUBMITTED TO THE CITY FOR REAPPROVAL.
- A PUBLIC WORKS INSPECTOR WILL INSPECT ALL WORKS WITHIN THE CITY RIGHTS-OF-WAY AND IN EASEMENTS. NOTIFY INSPECTION SERVICES 24 HOURS PRIOR TO BEGINNING CONSTRUCTION BY CALLING 480-312-5750.
- WHENEVER EXCAVATION IS NECESSARY, CALL THE BLUE STAKE CENTER, 811, TWO WORKING DAYS BEFORE EXCAVATION BEGINS. THE CENTER WILL SEE THAT THE LOCATION OF THE UNDERGROUND UTILITY LINES IS IDENTIFIED FOR THE PROJECT.
- RIGHT-OF-WAY PERMITS ARE REQUIRED FOR ALL WORK IN PUBLIC RIGHTS-OF-WAY AND EASEMENTS GRANTED FOR PUBLIC PURPOSES. A RIGHT-OF-WAY PERMIT WILL BE ISSUED BY THE CITY ONLY AFTER THE REGISTRANT HAS PAID A BASE FEE PLUS A FEE FOR INSPECTION SERVICES. COPIES OF ALL PERMITS MUST BE RETAINED ON-SITE AND BE AVAILABLE FOR INSPECTION AT ALL TIMES. FAILURE TO PRODUCE THE REQUIRED PERMITS WILL RESULT IN IMMEDIATE SUSPENSION OF ALL WORK UNTIL THE PROPER PERMIT DOCUMENTATION IS OBTAINED.
- ALL EXCAVATION AND GRADING THAT IS NOT IN THE PUBLIC RIGHTS-OF-WAY OR NOT IN EASEMENTS GRANTED FOR PUBLIC USE MUST CONFORM TO APPENDIX J, GRADING, OF THE LATEST EDITION OF THE INTERNATIONAL BUILDING CODE. A PERMIT FOR THIS GRADING MUST BE SECURED FROM THE CITY FOR A FEE ESTABLISHED BY THE CITY.

**NOTES FOR IMPROVEMENTS PLANS WHERE THERE IS EXISTING ACP OR PVC PIPE:**

ANY WATER LINE PROJECT THAT INVOLVES CONNECTING TO AN EXISTING ACP OR PVC PIPE REQUIRES SPECIAL ATTENTION. PER DSPM SECTION 6-1.408:

FITTINGS INSTALLED INTO ASBESTOS CEMENT PIPE (ACP) OR PVC PIPE WITHIN 6- FEET OF ANOTHER FITTING OR JOINT WILL REQUIRE THAT SECTION OF PIPE TO BE REMOVED AND REPLACED WITH DUCTILE IRON PIPE (DIP). EXISTING TEES, TAPPING SLEEVES AND RELATED APPURTENANCES THAT ARE NOT UTILIZED BY A DEVELOPMENT SHALL BE REMOVED BY THE CONTRACTOR. A MINIMUM 3-FOOT SECTION OF PIPE SHALL BE REMOVED, WITH NO LESS THAN 6 FEET REMAINING TO THE NEAREST JOINT. THE REMOVED PIPE SHALL BE REPLACED WITH DIP. WHEN MORE THAN 3- FEET OF EXISTING ACP OR PVC WATER LINES ARE EXPOSED DURING CONSTRUCTION AND THE BEDDING IS DISTURBED, THE WATER LINE MUST BE REPLACED WITH DIP (MINIMUM CLASS 350) WITH MECHANICAL JOINTS OR FLANGED JOINTS TO 3- FEET PAST THE SIDES OF THE EXPOSED CROSSING TRENCH. REFER TO MAG STANDARD DETAIL NO. 403-3. NO TAPPING SLEEVE AND VALVE SHALL BE USED ON ACP PIPE. VALVES WILL NEED TO BE CUT INTO ACP PIPE. DISPOSAL OF MATERIALS CONTAINING ASBESTOS AND/OR LEAD SHALL BE IN CONFORMANCE WITH ALL REGULATIONS, LAWS AND ORDINANCES.

**NOTE:**

- EXISTING MANHOLES RIMS AND INVERTS HAVE BEEN SET BASED ON QUARTER SECTION MAP QS# 15-44. DATED 07/04/2021. ELEVATIONS TO BE VERIFIED IN FIELD.
- EXISTING MANHOLES RIMS AND INVERTS HAVE BEEN SET BASED ON ALTA DRINKWATER UTILITY PLAN SHEET C4.00 AND C4.10. DATED 08/03/2018. ELEVATIONS TO BE VERIFIED IN FIELD.

**PRELIMINARY WATER KEY NOTES**

- CONNECTION TO EXISTING WATER LINE. REPLACE AT LEAST 3' OF ACP PIPE PER C.O.S. REQUIREMENTS.
- SAWCUT, REMOVE AND REPLACE EXISTING PAVEMENT.
- GATE VALVE WITH VALVE BOX AND COVER, SIZE PER PLAN.
- 6" DUCTILE IRON PIPE. LENGTH PER PLAN.
- INSTALL CUT-IN TEE, SIZE PER PLAN.
- DOMESTIC CONNECTION TO BUILDING.
- FIRE CONNECTION TO BUILDING.
- BACKFLOW PREVENTION, SIZE TO MATCH WATER METER SIZE.
- INSTALL 3" TYPE "K" COPPER DOMESTIC SERVICE CONNECTION. LENGTH PER PLAN.
- CONNECT TO EXISTING WATER METER AND INSTALL 1-1/2" TYPE "K" COPPER IRRIGATION SERVICE LINE. LENGTH PER PLAN.
- INSTALL 3" DOMESTIC SERVICE VAULT.
- INSTALL FIRE DEPARTMENT CONNECTION.
- FIRE HYDRANT.

**PRELIMINARY SEWER KEY NOTES**

- VERIFY EXISTING SEWER LOCATION PRIOR TO CONSTRUCTION.
- SAWCUT, REMOVE AND REPLACE EXISTING PAVEMENT, SIDEWALK AND CURB AND GUTTER.
- 6" PVC SEWER SERVICE CONNECTION PER MAG STD. DET. 440-3. LENGTH AND SLOPE PER PLAN.
- SEWER CONNECTION TO BUILDING.
- PROPOSED 5' SEWER MANHOLE.
- DROP SEWER CONNECTION PER MAG STD. DET. 426. TYPE "B". REFER TO DSPM SEC. 7-1.405 FOR MANHOLE LINING SPECIFICATIONS.
- 6" PVC SDR-35 SEWER LINE. SIZE, LENGTH AND SLOPE PER PLAN.
- SEWER CLEAN-OUT PER MAG STD. DET. 441.

PRELIMINARY NOT FOR CONSTRUCTION

SUSTAINABILITY ENGINEERING GROUP

SEG

LAND DEVELOPMENT SERVICES

PROJECT: 3200 SCOTTSDALE  
LOCATION: 3202 N. SCOTTSDALE ROAD, SCOTTSDALE, AZ.

DATE: 10/11/2022

ISSUED FOR: REZONING

REVISION NO.: DATE:

JOB NO.: 210708

SHEET TITLE: PRELIMINARY UTILITY PLAN

PAGE NO.: 1 OF 2  
SHEET NO.: C4.10

THIS DRAWING IS AN INSTRUMENT OF SERVICE AND THE PROPERTY OF SUSTAINABILITY ENGINEERING GROUP, AND SHALL REMAIN THEIR PROPERTY. THE USE OF THIS DRAWING SHALL BE RESTRICTED TO THE ORIGINAL SITE FOR WHICH IT IS PREPARED AND PUBLICATION THEREOF IS EXPRESSLY LIMITED TO SUCH USE.



### **6" Sewer Service @ 2.00% w/o pool backwash**

Project Description	
Friction Method	Manning Formula
Solve For	Normal Depth
Input Data	
Roughness Coefficient	0.013
Channel Slope	0.020 ft/ft
Diameter	6.0 in
Discharge	73.40 gpm
Results	
Normal Depth	1.9 in
Flow Area	0.1 ft <sup>2</sup>
Wetted Perimeter	0.6 ft
Hydraulic Radius	1.0 in
Top Width	0.46 ft
Critical Depth	2.4 in
Percent Full	30.8 %
Critical Slope	0.007 ft/ft
Velocity	3.18 ft/s
Velocity Head	0.16 ft
Specific Energy	0.31 ft
Froude Number	1.678
Maximum Discharge	383.10 gpm
Discharge Full	356.14 gpm
Slope Full	0.001 ft/ft
Flow Type	Supercritical

## **APPENDIX II – Pipe Hydraulics**

### **6" Sewer Service @ 2.00% w/ pool backwash**

Project Description	
Friction Method	Manning Formula
Solve For	Normal Depth
Input Data	
Roughness Coefficient	0.013
Channel Slope	0.020 ft/ft
Diameter	6.0 in
Discharge	307.40 gpm
Results	
Normal Depth	4.3 in
Flow Area	0.2 ft <sup>2</sup>
Wetted Perimeter	1.0 ft
Hydraulic Radius	1.8 in
Top Width	0.45 ft
Critical Depth	5.0 in
Percent Full	71.7 %
Critical Slope	0.014 ft/ft
Velocity	4.54 ft/s
Velocity Head	0.32 ft
Specific Energy	0.68 ft
Froude Number	1.385
Maximum Discharge	383.10 gpm
Discharge Full	356.14 gpm
Slope Full	0.015 ft/ft
Flow Type	Supercritical

## **APPENDIX II – Pipe Hydraulics**

### **Scottsdale Road 8" Sewer @ 1%, d/D= 0.65**

Project Description	
Friction Method	Manning Formula
Solve For	Discharge
Input Data	
Roughness Coefficient	0.013
Channel Slope	0.010 ft/ft
Normal Depth	5.2 in
Diameter	8.0 in
Results	
Discharge	410.23 gpm
Flow Area	0.2 ft <sup>2</sup>
Wetted Perimeter	1.3 ft
Hydraulic Radius	2.3 in
Top Width	0.64 ft
Critical Depth	5.4 in
Percent Full	65.0 %
Critical Slope	0.009 ft/ft
Velocity	3.81 ft/s
Velocity Head	0.23 ft
Specific Energy	0.66 ft
Froude Number	1.092
Maximum Discharge	583.40 gpm
Discharge Full	542.34 gpm
Slope Full	0.006 ft/ft
Flow Type	Supercritical

## **APPENDIX IIA – Pipe Hydraulics**

### **Scottsdale Road 8" Sewer @ 1% d/D= 0.8**

Project Description	
Friction Method	Manning
	Formula
Solve For	Discharge
Input Data	
Roughness Coefficient	0.013
Channel Slope	0.010 ft/ft
Normal Depth	6.4 in
Diameter	8.0 in
Results	
Discharge	530.12 gpm
Flow Area	0.3 ft <sup>2</sup>
Wetted Perimeter	1.5 ft
Hydraulic Radius	2.4 in
Top Width	0.53 ft
Critical Depth	6.2 in
Percent Full	80.0 %
Critical Slope	0.011 ft/ft
Velocity	3.95 ft/s
Velocity Head	0.24 ft
Specific Energy	0.78 ft
Froude Number	0.928
Maximum Discharge	583.40 gpm
Discharge Full	542.34 gpm
Slope Full	0.010 ft/ft
Flow Type	Subcritical

## **APPENDIX IIA – Pipe Hydraulics**

# FINAL SEWER CAPACITY REPORT

**ALTA DRINKWATER**  
**3220 N. Scottsdale Road**  
**Scottsdale, AZ**

**Prepared For:**



**8777 E. Via De Ventura**  
**Scottsdale, AZ 85258**  
**Phone: 480.607.0622**

**Prepared by:**




**EXPIRES 12-31-17**

## **Sustainability Engineering Group**

**8280 E. Gelding Drive, Suite 101**  
**Scottsdale, AZ 85260**  
**480.588.7226 [www.azSEG.com](http://www.azSEG.com)**

**Project Number: 160410**  
**Submittal Date: July 21, 2017**

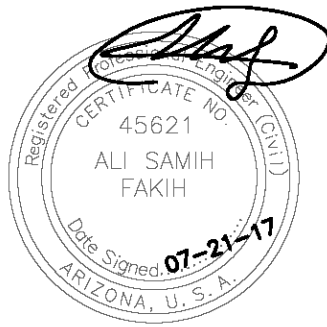

## TABLE OF CONTENTS:

### 1. INTRODUCTION

EXPIRES 12-31-17

1.1	SUMMARY OF PROPOSED DEVELOPMENT:.....	1
1.2	LEGAL DESCRIPTION:.....	1
1.3	EXISTING AND PROPOSED SITE ZONING AND LAND USES: .....	1
1.4	REFERENCES: .....	1

### 2. DESIGN DOCUMENTATION

2.1.	DESIGN COMPLIANCE: .....	1
------	--------------------------	---

### 3. EXISTING CONDITIONS

3.1.	EXISTING ZONING & LAND USE: .....	1
3.2.	EXISTING TOPOGRAPHY, VEGETATION AND LANDFORM FEATURES: .....	2
3.3.	EXISTING UTILITIES: .....	2

### 4. PROPOSED CONDITIONS

4.1.	SITE PLAN: .....	2
4.2.	PROPOSED SEWER SYSTEM: .....	2
4.3.	MAINTENANCE RESPONSIBILITIES: .....	2

### 5. SANITARY SYSTEM COMPUTATIONS

5.1.	SEWER FLOW DEMANDS: .....	3
5.2.	VARIANCE FROM STATED DESIGN FLOWS: .....	3
5.3.	SEWER SYSTEM ANALYSIS (Off Site): .....	3
5.4.	DEMAND FACTORS: .....	4
5.5.	SEWER CAPACITY CALCULATIONS: .....	4

### 6. SUMMARY

6.1	SUMMARY OF PROPOSED WATER IMPROVEMENTS: .....	5
6.2	PROJECT SCHEDULE: .....	5

### 7. SUPPORTING MAPS

7.1	Utility Plan .....	5
-----	--------------------	---

### 8 REFERENCES





## **LIST OF FIGURES:**

FIGURE 1	Vicinity Map
FIGURE 2	Aerial
FIGURE 3	FIRM
FIGURE 4	Quarter Section Sewer Map (15 44)
FIGURE 4A	Contribution Boundary

## **APPENDIX:**

APPENDIX I	Design Requirements
APPENDIX II	Calculations
APPENDIX III	Utility Plan
APPENDIX IV	Agave Old Town Apartments Sewer Report (excerpts)

## 1. INTRODUCTION

### 1.1 SUMMARY OF PROPOSED DEVELOPMENT:

Proposed development consists of a maximum of 277 apartment units in a four (4) story building complex that includes a clubhouse and parking garage. The purpose of this report is to provide an analysis of the impact that this development will have on the city's wastewater system.

### 1.2 LEGAL DESCRIPTION:

The project property consists of a parcel of land located on the west side of Scottsdale Road, across from the Drinkwater Boulevard intersection. It is further bound by 71<sup>st</sup> Street to the west, developed commercial property to the north, and a mobile home park to the south. It is located in a portion of Section 27, Township 2 North, Range 4 East of the Gila and Salt River Base and Meridian, Maricopa County,

Arizona Parcel ID numbers APN: 130 16 006A

Street address is 3220 N. Scottsdale Road

The legal description is:

Lot three (3), Block twenty nine (29), Security Acres Amended, according to the plat of record in the office of the County Recorder of Maricopa County, Arizona in Book 8 of Maps, page 59.

Except the east 22 feet thereof, and

Except the east 5 feet of the west 30 feet conveyed to the City of Scottsdale in instrument recorded June 7, 1983, document no. 83 217883.

Refer to **FIGURE 1 Vicinity Map** for the project's location with respect to major cross streets.

### 1.3 EXISTING AND PROPOSED SITE ZONING AND LAND USES:

The overall project parcel is zoned C 3 (Highway Commercial). Rezoning to D/DMU 2 PBD DO is proposed. Auto collision/repair facilities and a vacant car dealership currently exist on the property. The site will be totally demolished for the redevelopment into an apartment complex.

### 1.4 REFERENCES:

The project falls within Mixed Use Neighborhoods conceptual land use district of the City's General Plan and appears to be located in the Downtown Plan character area.

## 2. DESIGN DOCUMENTATION

### 2.1 DESIGN COMPLIANCE:

The analysis of the proposed and existing sewer system is done in compliance with Chapter 7 – Wastewater of the City of Scottsdale 2010 update of the Design Standards & Policies Manual (DS&PM). Design flow calculations for the on site system will be based on the recommendations in Section 7 1.403 of the DS&PM.

### 3. EXISTING CONDITIONS

#### 3.1 EXISTING ZONING & LAND USE:

Land ownership, as defined by ALTA/ACSM Land Title Survey by AW Land Surveying, LLC dated 04/13/16 includes 183,705.9 square feet or 4.217+/- acres of commercially developed land. City of Scottsdale zoning map designates this parcel as C 3.

#### 3.2 EXISTING TOPOGRAPHY, VEGETATION AND LANDFORM FEATURES:

This site is fully developed as a car dealership. The topography generally slopes from the west northwest to the southeast corner at approximately one half percent with a change in elevation of approximately three and one half (3.5) feet. Typical desert landscaping exists at the perimeter of the site. Refer to **FIGURE 2** for an aerial of the overall project existing conditions.

FIRM Map Number 04013C2235L dated October 16, 2013 indicates this site is designated as Zone "X". As such, it is defined as areas outside of the 0.2% annual chance of flooding. Refer to **FIGURE 3** for the FIRM.

#### 3.3 EXISTING UTILITIES:

**Sanitary Sewer: QS 15 44** City of Scottsdale

An 8" VCP sanitary sewer is available approximately six (6) feet east of the 71<sup>st</sup> Street centerline. A manhole is located off both the NW corner and SE corner of the subject site. Depth to invert is approximately 8'. Per the QS map, a service lead to this system exists approximately in the middle of the property.

An 8" VCP sanitary sewer is also available in Scottsdale Road approximately in the centerline of the road. Depth to invert is approximately 8.5'

Refer to **FIGURE 4** for the City quarter section map (**QS 15 44**)

### 4. PROPOSED CONDITIONS

#### 4.1 SITE PLAN:

The property is proposed to be re developed with new lot configurations into 277 apartment homes. Development will include a 24' wide paved access road along the southerly property line from Scottsdale Road to 71<sup>st</sup> Street. A 24' wide fire lane is also proposed along the northerly property line. This is conceptualized to be GrassPave type of reinforcement. An open courtyard is proposed in the westerly third of the units, with a parking structure near the center of the site, and an amenities / pool area and clubhouse in the easterly portion.

#### 4.2 PROPOSED SEWER SYSTEM:

Sewer service will consist of stubs from the east and west ends of the building to existing 8" sewers in 71<sup>st</sup> Street and Scottsdale Road respectively.



Refer to **APPENDIX III** for the Utility Plan.

**4.3 MAINTENANCE RESPONSIBILITIES:**

The on site sewer line for the proposed development will be private and maintained by the property owner. The off site sewer is a public system maintained by the City of Scottsdale.

**5. SANITARY SYSTEM COMPUTATIONS**

**5.1. SEWER FLOW DEMANDS:**

DS&PM, Chapter 7 – Wastewater specifies that for residential uses, sanitary sewer lines 8 to 12 inches in diameter will be designed using 100 gallons per capita per day (gpdpc) and a peaking factor of 4.

Per the developer, the average person per unit for this product has been trending at approximately 1.1 capita per dwelling unit (c/du). For the purposes of this report, an assumption of one (1) person per bedroom will be used.

Therefore the average proposed design flow is:

One Bedroom:	172 units x 1	= 172
Two Bedroom:	92 units x 2	= 184
Three Bedroom:	13 units x 3	= 39
	<b>TOTAL</b>	<b>= 395 persons / 277 units or 1.43 c/du</b>
		<b>= 143 gpdpc</b>

277 units x 1.43 persons/du x 100 gpdpc = **39,611 gpd (Average)**  
 Peak Flow: 39,611 gpd x 4 = **158,444 gpd (Peak)**

The existing commercial buildings total approximately 32,681 s.f. in area. Per the referenced manual, sewer demands are 0.5 per sq.ft. with a peaking factor of 3 for commercial use.

Therefore the average original design flow was:

32,681 s.f. x 0.5 = 16,341 gpd (Average)  
 Peak Flow: 16,341 gpd x 3 = 49,023 gpd (Peak)

This represents an increase of 23,270 gpd (average daily flow) or 109,421 gpd (peak) over the existing development contributions.

**5.2. VARIANCE FROM STATED DESIGN FLOWS:**

Stated design flows for the on site system will be used as recommended.

**5.3. SEWER SYSTEM ANALYSIS (Off Site):**

No off site contributions will be carried through the proposed on site system.

On site system will consist of a sewer service stub from the east and west end of the building directly to the existing sewers in 71<sup>st</sup> Street and Scottsdale Road as noted below.



The proposed Agave Old Town Apartments to the north include 365 units. These are split 143 units toward 71<sup>st</sup> street and 247 units toward Scottsdale Road. Note that a portion of the existing sanitary sewer in Angus Drive is be removed as a result of the Agave development. The sewer in 71<sup>st</sup> Street is being extended south to connect to the existing sewer adjacent to the subject parcel.

Refer to APPENDIX IV for excerpts from the Agave Old Town Apartments basis of design report.

At the request of the City of Scottsdale staff, the existing sanitary sewer systems in 71<sup>st</sup> Street(8"), Earll Drive(21"), and Scottsdale Road (8") have been analyzed. The flow parameters of these three sewers are shown in Appendix 2. The present flow rate of 0.729mgd in the 21" sewer at 71<sup>st</sup> Street and Earll Drive was provided from the City wastewater model by City staff. The pipe capacity at d/D of 0.7 was calculated to be 4.7mgd, shown in Appendix 2. Including both the Agave and Alta project's flows increased the flow rate in Earll Drive to 0.87 mgd. At this capacity, the d/D is calculated at 0.26, shown in Appendix 2. Additional wastewater contributions to the existing public sewers, based on the contribution boundary presented as FIGURE 4A, are summarized in Table 1 below as follows:

<b>Table 1: Sewer Demand Calculations (gpd)</b>					
	Units or s.f. com.	ADF (gpcu) or per s.f.	Avg. Day Flow (GPD)	Peaking Factor	Peak Hour (GPD)
<b>71st Street (DP 1 to DP 2)</b>	Point of tie in to 71st Street				
Baptist Church	24,500 s.f.	0.1	2,450	3	7,350
Aqave Apartments	118	140.0	16,520	4	66,080
ALTA Osborn Apartments*	143	143.0	20,449	4	81,796
Security Acres	92	250.0	23,000	4	92,000
Mobile Home Park (Assumed full)	40	250.0	10,000	4	40,000
MHP commercial	2,000 s.f.	0.5	1,000	3	3,000
Duplex	2	250.0	500	4	2,000
	<b>SUBTOTAL (DP 1 to DP 2)</b>		<b>73,919</b>		292,226
<b>Earll Drive 8" (DP 2 to DP 3)</b>	For information only				
Pueblo Condo's area (west)	36	250.0	9,000	4	36,000
Commercial	41,000 s.f.	0.5	20,500	3	61,500
	<b>SUBTOTAL (DP 2 to DP 3)</b>		<b>103,419</b>		97,500
<b>Scottsdale Road (DP 4 TO DP 3)</b>	Ties in at Earll Drive				
Aqave Apartments	247	140	34,580	4	138,320
Good Egg restaurant	7,000 s.f.	1.2	8,400	6	50,400
ALTA Osborn Apartments	134	143	19,162	4	76,648
	<b>SUBTOTAL (DP 4 to DP 3)</b>		<b>62,142</b>		265,368

#### 5.4. DEMAND FACTORS:

DS&PM requires a peak factor of 4 for the residential units. Refer to Section 5.1 above for calculations. Additionally, the following peak factors are used for off site contributions to the existing systems:

Commercial: PF=3

Restaurants: PF=6

#### 5.5. SEWER CAPACITY CALCULATIONS

Flowmaster calculations of the existing sewer capacities can be found in Appendix II. Based on the Peak Hour calculations shown above in Section 5.3, the following Table 2 is provided as a summary of the capacity of the existing sewers in 71st Street, Earll Drive, and Scottsdale Road.

Location	Diameter (inch)	Proposed Peak Flow (gpd)	Full Flow Capacity (gpd)	Peak Flow to Full Flow Capacity Ratio
71st Street (DP 1 to DP 2)	8	292,226	454,642	0.64
Scottsdale Road (DP 4 to DP 3)	8	265,368	576,171	0.46
Earll Drive (21")	Re: Section 5.3			

## 6. SUMMARY

### 6.1 SUMMARY OF PROPOSED IMPROVEMENTS:

The proposed wastewater improvement was designed based on the current City of Scottsdale's design standards and policies.

The average day and peak sewer flows discharging to 71<sup>st</sup> Street from ALTA Osborn apartments are estimated to be 20,449 gpd and 81,796 gpd respectively.

The average day and peak sewer flows discharging to Scottsdale Road from ALTA Osborn apartments are estimated to be 19,162 gpd and 76,648 gpd respectively.

The existing 8" sewer in 71<sup>st</sup> Street has a full flow capacity of 454,642 gpd and is adequately sized to accommodate the anticipated flows from the contributing developments (existing and proposed)

The existing 21" sewer in Earll has a capacity of 4.7mgd and is adequately sized to accommodate the anticipated flows from the contributing developments (existing and proposed)

The existing 8" sewer in Scottsdale Road has a full flow capacity of 576,171 gpd and is adequately sized to accommodate the anticipated flows from the contributing developments (existing and proposed)

### 6.2 PROJECT SCHEDULE:

As a residential apartment development the infrastructure and buildings are proposed to be constructed in a single phase.



## 7 SUPPORTING MAPS

### 7.1 UTILITY PLAN

Refer to **APPENDIX III** for a Preliminary Utility Plan

## 8 REFERENCES

1. *COS QS Sewer Plan number 15 44*
2. *City of Scottsdale Design Standards & Policies Manual, 2010 (Chapter 7 – Wastewater)*
3. *Wastewater Basis of Design Report for Agave Old Town Apartments prepared by Hilgart Wilson dated December 10, 2015.*





PROJECT  
LOCATION

3222 N Scottsdale Rd

FIGURE 1  
VICINITY MAP





E Angus Dr

PROJECT LOCATION

3220 N Scottsdale Rd

N Drinkwater Blvd

N 71st St

Apartment

N Scottsdale Rd

© 2016 Google



FIGURE 2  
AERIAL



1997

33°29'07.34" N 111°55'35.94" W elev 1246 ft eye alt 2336 ft



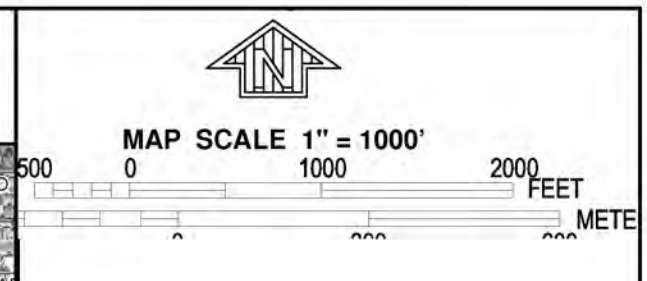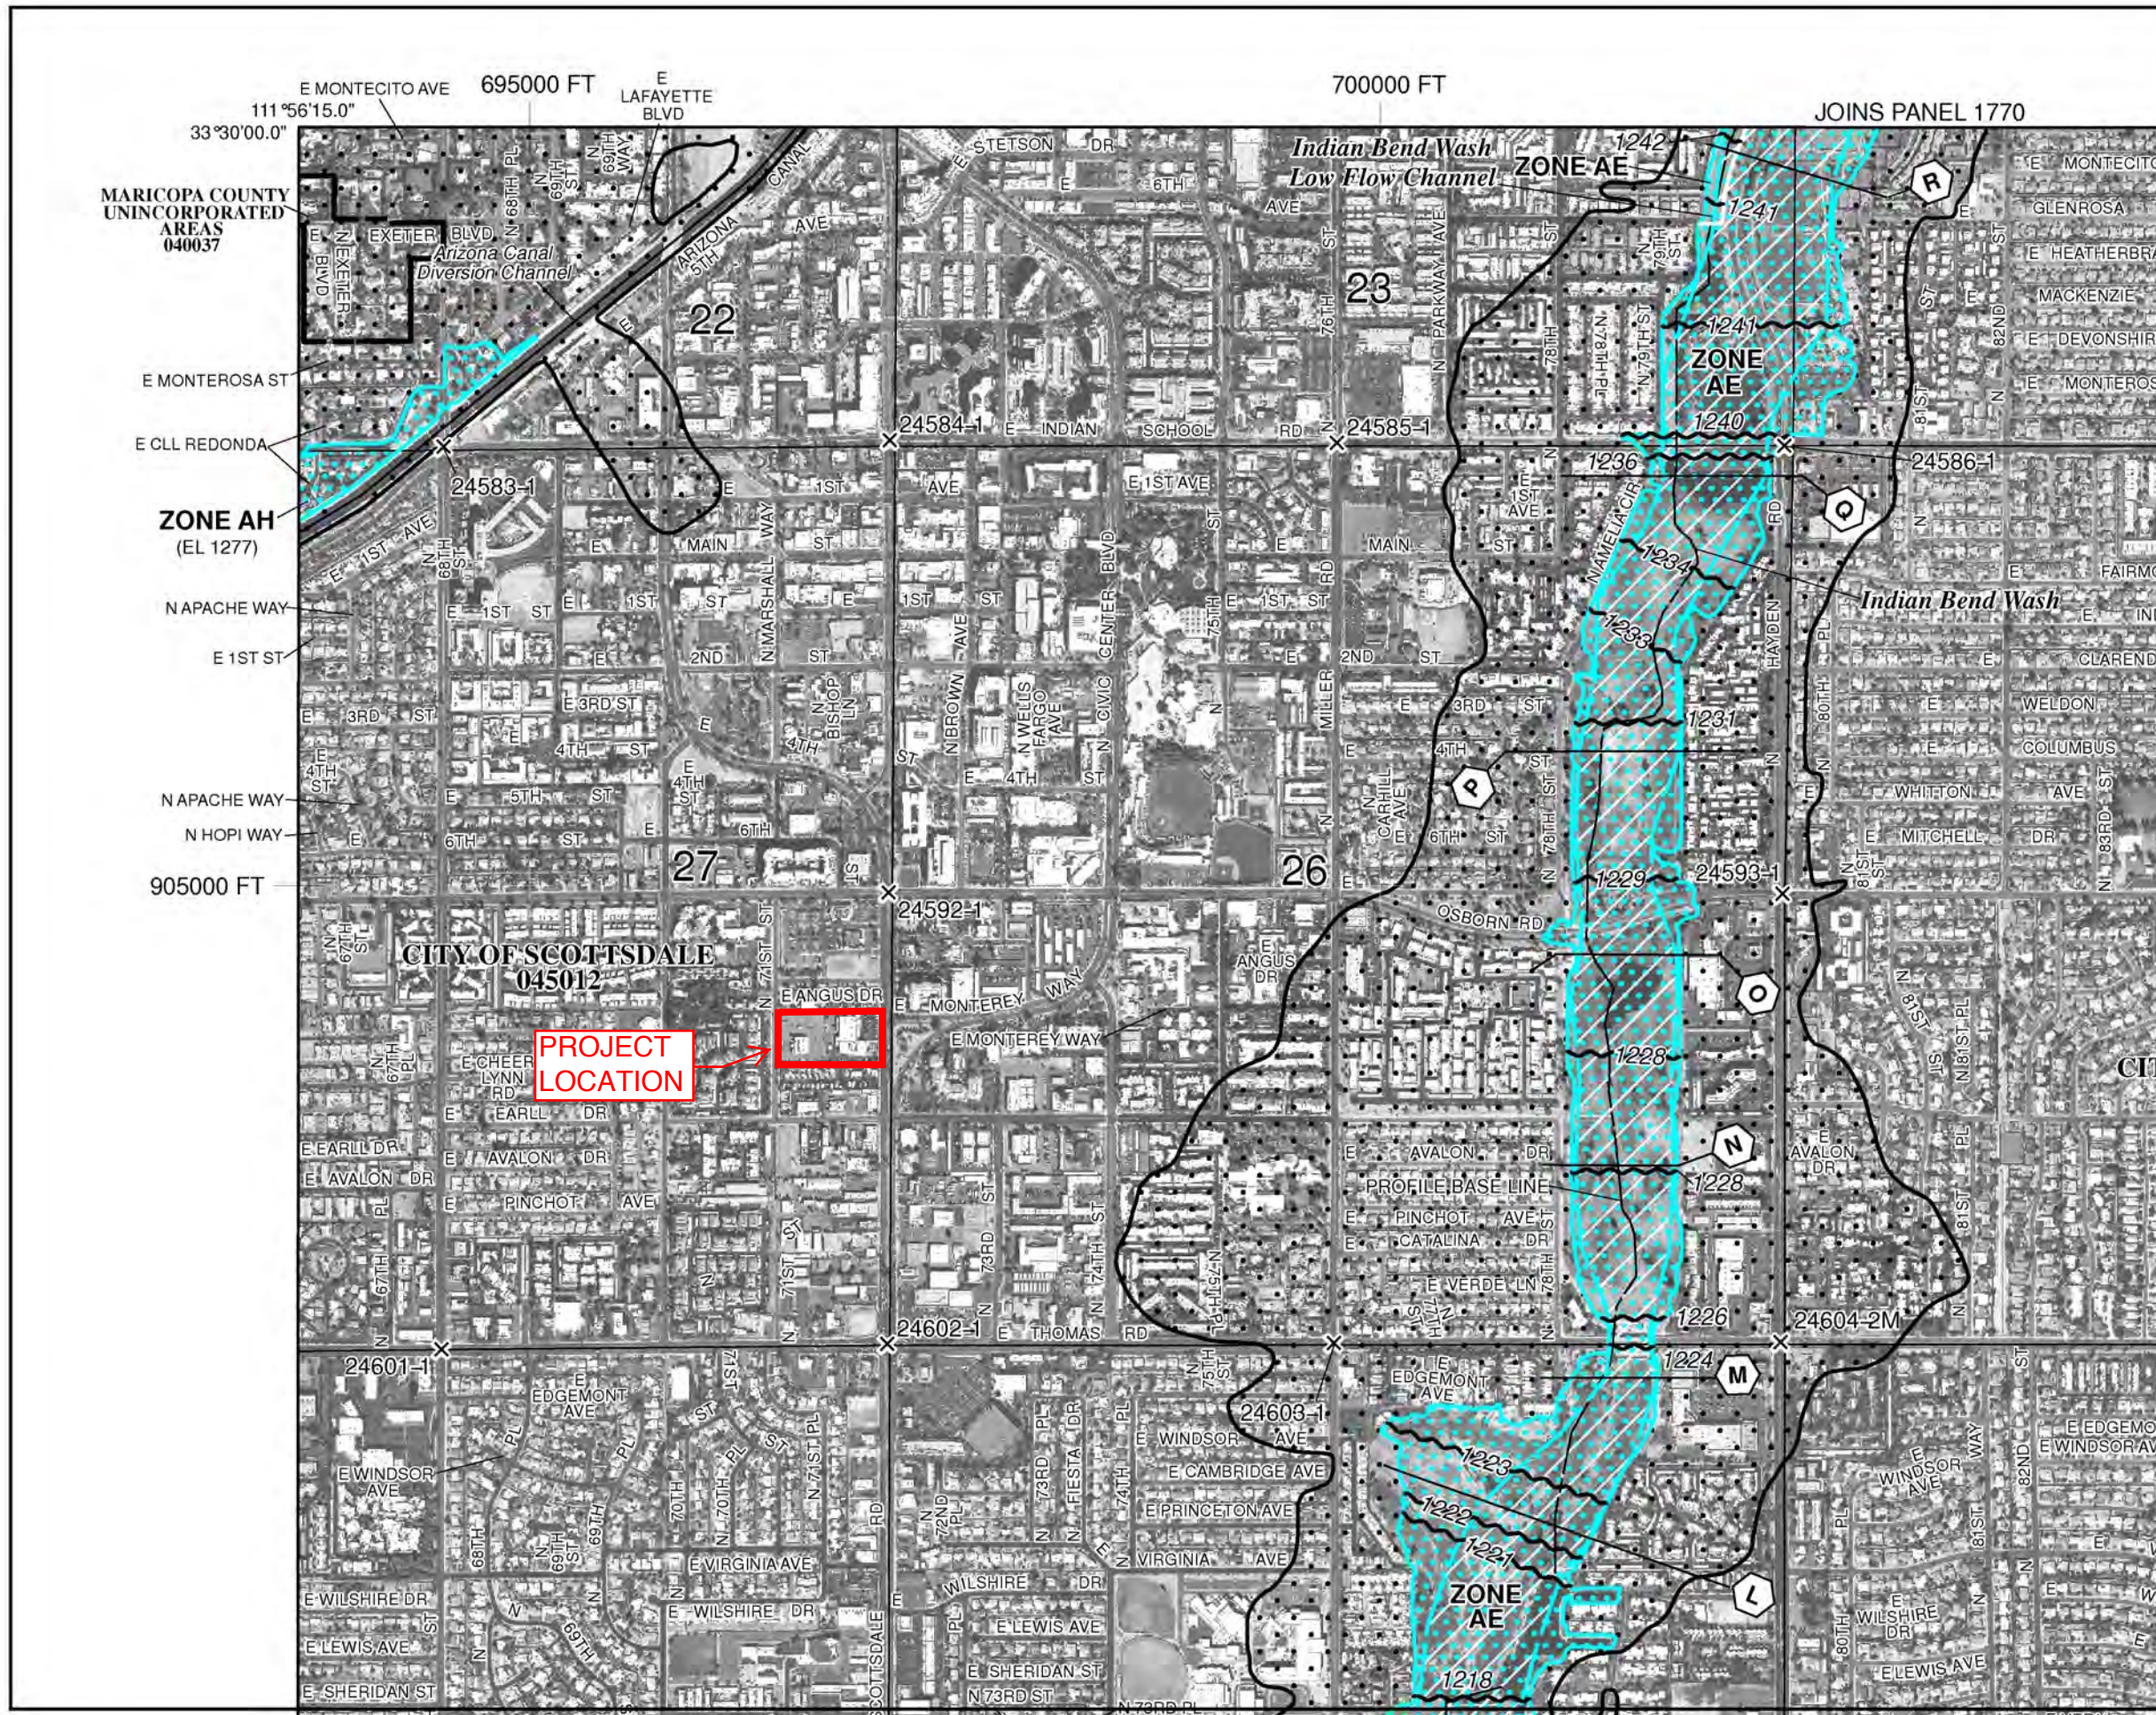

PANEL 2235L

**FIRM**  
FLOOD INSURANCE RATE MAP  
MARICOPA COUNTY,  
ARIZONA  
AND INCORPORATED AREAS

PANEL 2235 OF 4425  
(SEE MAP INDEX FOR FIRM PANEL LAYOUT)

**CONTAINS:**

COMMUNITY	NUMBER	PANEL	SUFFIX
MARICOPA COUNTY	040037	2235	L
MESA, CITY OF	040048	2235	L
SCOTTSDALE, CITY OF	045012	2235	L
TEMPE, CITY OF	040054	2235	L

Notice to User: The Map Number shown below should be used when placing map orders; the Community Number shown above should be used on insurance applications for the subject community.

**MAP NUMBER**  
04013C2235L

**MAP REVISED**  
OCTOBER 16, 2013

Federal Emergency Management Agency

**FIGURE 3**


This is an official copy of a portion of the above referenced flood map. It was extracted using F-MIT On-Line. This map does not reflect changes or amendments which may have been made subsequent to the date on the title block. For the latest product information about National Flood Insurance Program flood maps check the FEMA Flood Map Store at [www.msc.fema.gov](http://www.msc.fema.gov)







281-PA-2016 Sewer Basin

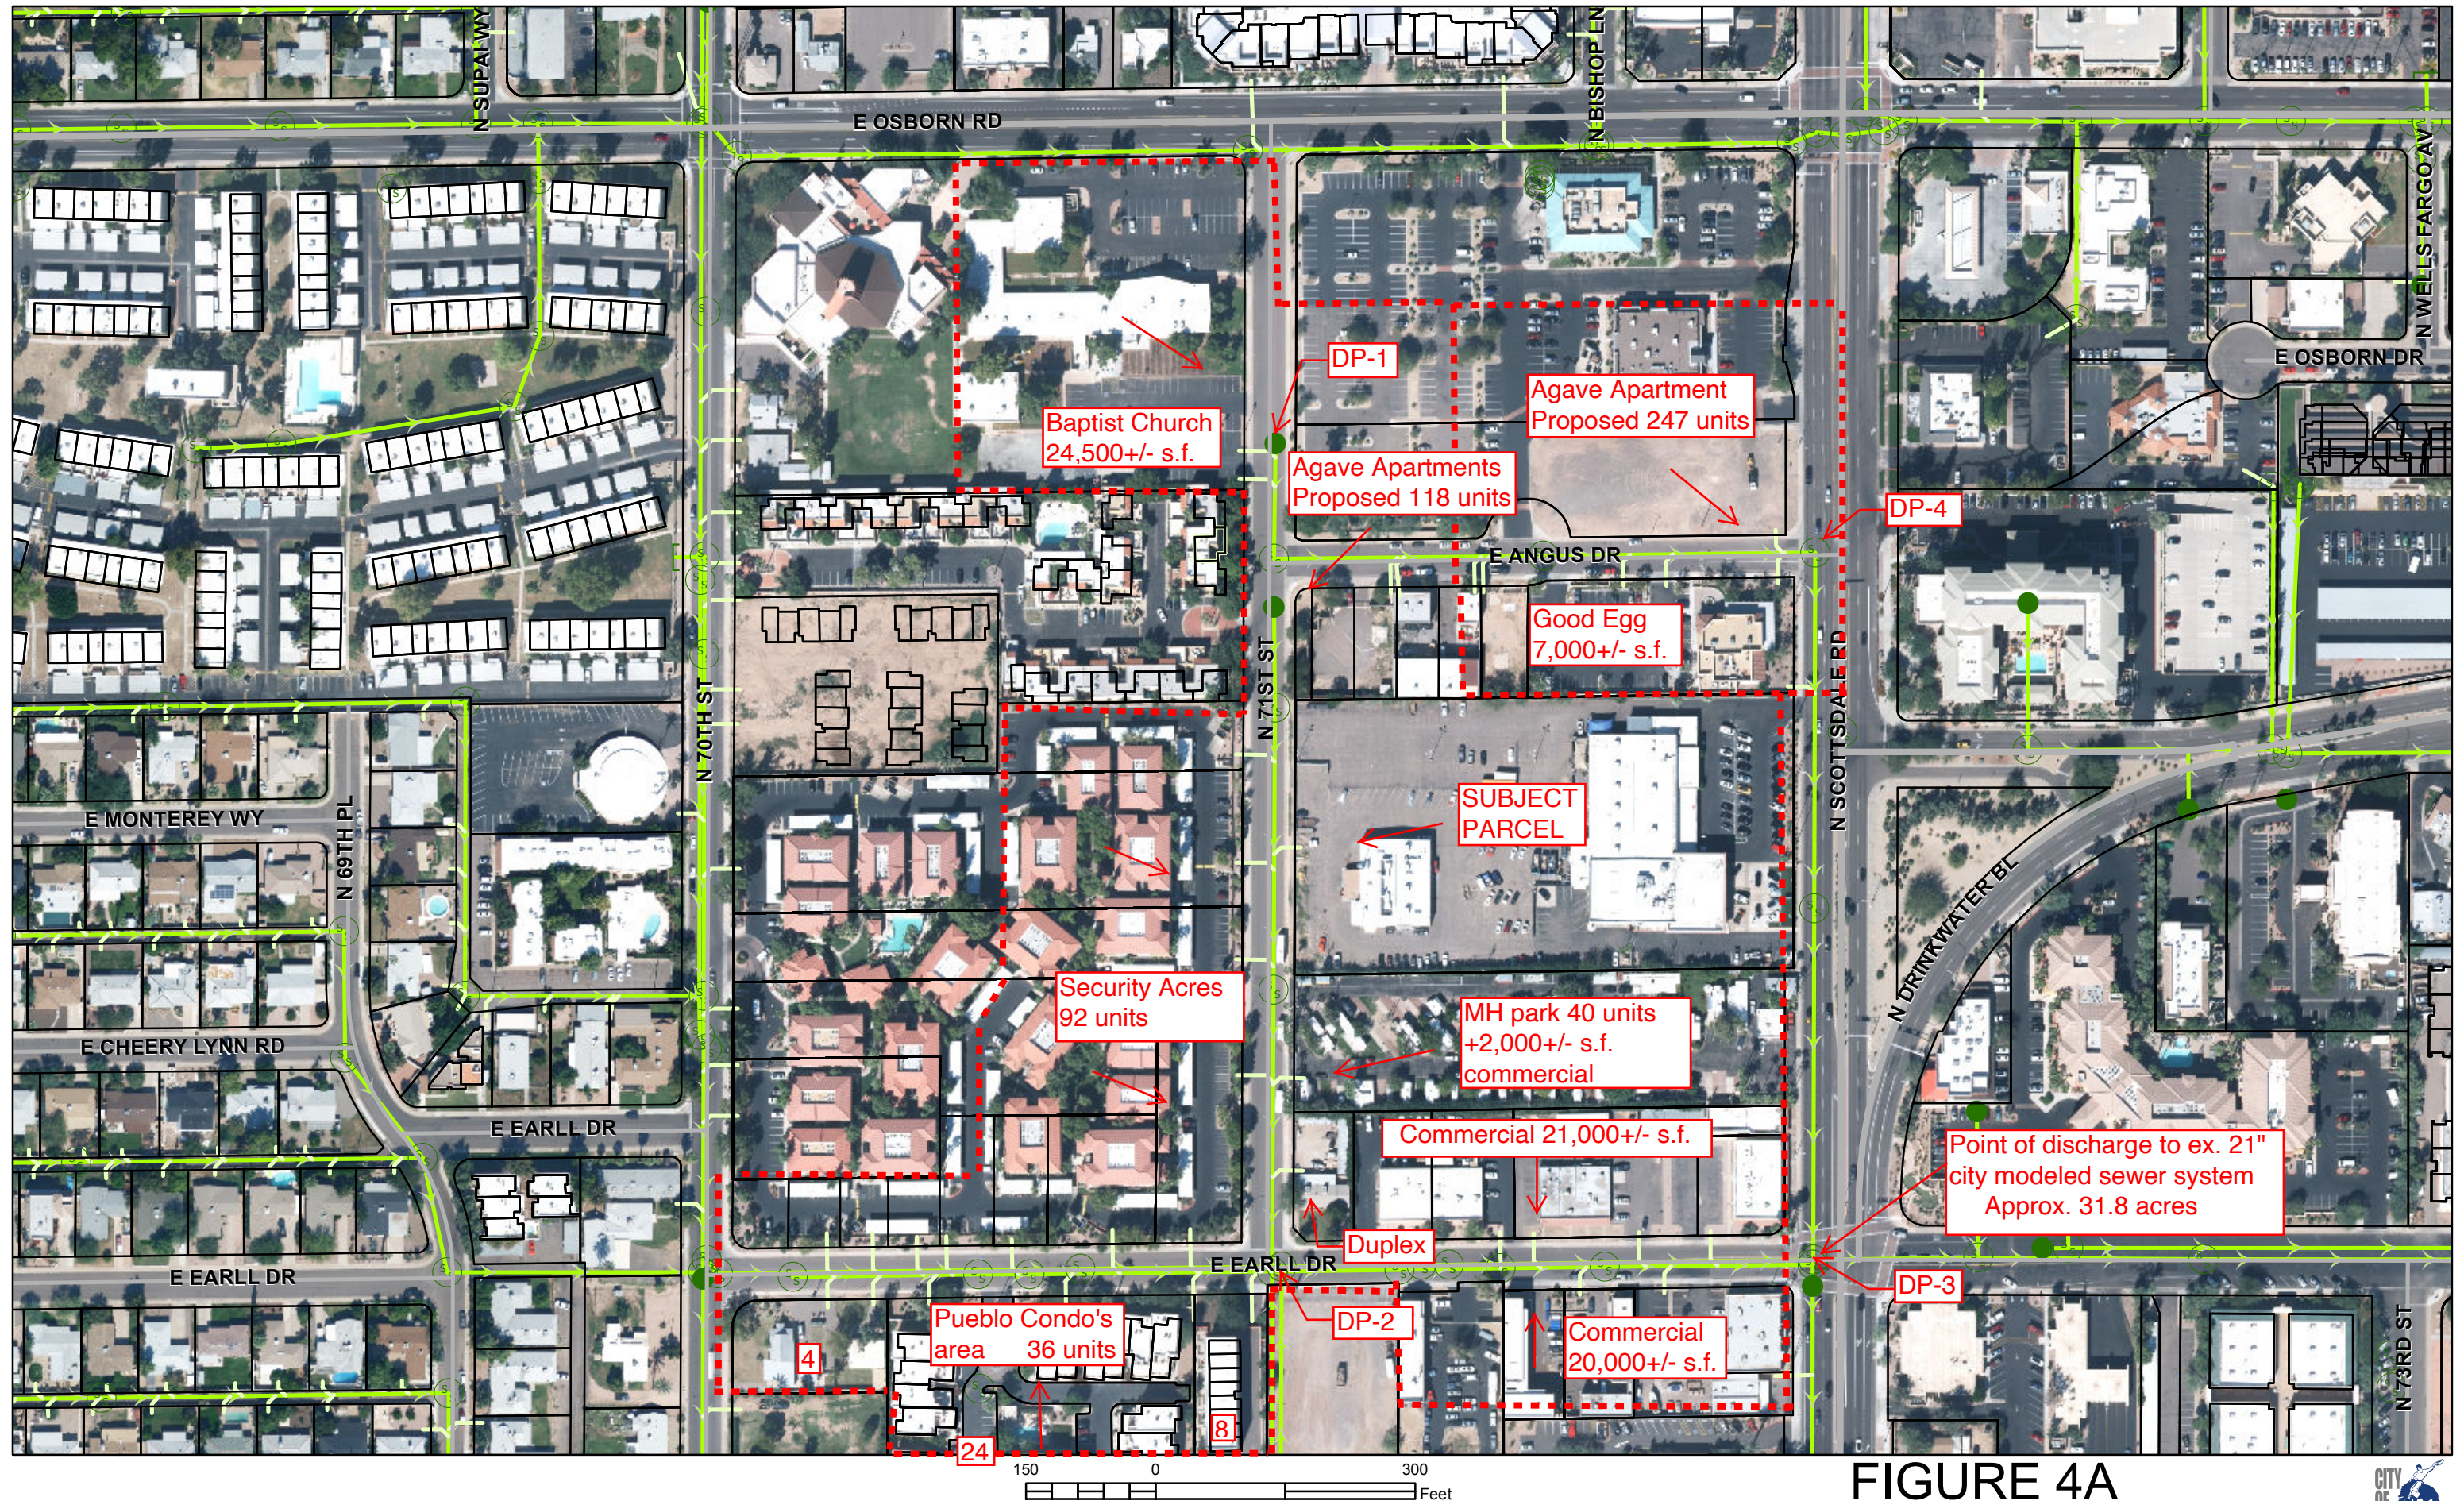

**FIGURE 4A**  
Contribution Boundary





"LEED®ing and Developing"

## *APPENDIX I*

# *Design Requirements*

8280 E. Gelding Dr., Suite 101  
Scottsdale, AZ 85260

4. The water line and sanitary sewer line will run parallel to each other, with 9 feet of separation to the pipes' centerline in order to maintain 6 feet of clearance at manholes.
5. Deflections in the sanitary sewer line shall be designed to nominal fitting angles within standard tolerances and will occur at the same locations where the water line is deflected.

See [Section 6-1.302](#) for related water system criteria.

## DESIGN FLOWS

7-1.403

### A. Residential

Sanitary sewer lines 8 to 12 inches in diameter will be designed using 100 gallons per capita per day (gpcpd) and a peaking factor of 4.

Sanitary sewer lines larger than 12 inches in diameter will be designed using 105 gpcpd and a peaking factor developed from "Harmon's Formula":

$$Q_{max} = Q_{avg} [1+14 / (4+P1/2)]$$

$$P = Population / 1,000$$

Residential densities are to assume 2.5 persons per dwelling unit, apartment or town home.

### B. Commercial and Industrial

Wastewater flows for uses other than those listed below shall be based upon known regional or accepted engineering reference sources approved by the Water Resources Department.

AVERAGE DAY SEWER DEMANDS		
Land Use	Demand	Peaking Factor
Commercial/Retail	0.5 per sq. ft.	3
Office	0.4 per sq. ft.	3
Restaurant	1.2 per sq. ft.	6
High Density Condominium	140 per room	4.5
Resort Hotel (includes site amenities)	380 per room	4.5
School: without cafeteria	30 per student	6
School: with cafeteria	50 per student	6
Cultural	0.1 per sq. ft.	3

FIGURE 7.1-2 AVERAGE DAY SEWER DEMAND IN GALLONS

## HYDRAULIC DESIGN

7-1.404

No public sanitary sewer lines will be less than 8 inches in diameter unless permission is received in writing from the Water Resources Department.

Sanitary sewer lines should be designed and constructed to give mean full flow velocities of not less than 2.5 fps, based upon Manning's Formula, using an "n" value of 0.013.

Conversely, to prevent abrasion and erosion of the pipe material, the maximum velocity will be limited to 10 fps at estimated peak flow. Where velocities exceed this maximum figure, the engineer will be required to submit a hydraulic analysis along with construction recommendations to the Water Resources Department for consideration. In no case will velocities greater than 15 fps be allowed.

Actual velocities will be analyzed under peak flow conditions for each reach of pipe.



"LEED®ing and Developing"

# *APPENDIX II*

## *Calculations*

8280 E. Gelding Dr., Suite 101  
Scottsdale, AZ 85260

SEWER DESIGN CALCULATIONS:

<b>Table 1: Sewer Demand Calculations (gpd)</b>					
	Units or s.f. com.	ADF (gpcu) or per s.f.	Avg. Day Flow (GPD)	Peaking Factor	Peak Hour (GPD)
<b>71st Street (DP 1 to DP 2)</b>	Point of tie in to 71st Street				
Baptist Church	24,500 s.f.	0.1	2,450	3	7,350
Aqave Apartments	118	140.0	16,520	4	66,080
ALTA Osborn Apartments*	143	143.0	20,449	4	81,796
Security Acres	92	250.0	23,000	4	92,000
Mobile Home Park (Assumed full)	40	250.0	10,000	4	40,000
MHP commercial	2,000 s.f.	0.5	1,000	3	3,000
Duplex	2	250.0	500	4	2,000
	<b>SUBTOTAL (DP 1 to DP 2)</b>		<b>73,919</b>		292,226
<b>Earll Drive 8" (DP 2 to DP 3)</b>	For information only				
Pueblo Condo's area (west)	36	250.0	9,000	4	36,000
Commercial	41,000 s.f.	0.5	20,500	3	61,500
	<b>SUBTOTAL (DP 2 to DP 3)</b>		<b>103,419</b>		97,500
<b>Scottsdale Road (DP 4 TO DP 3)</b>	Ties in at Earll Drive				
Aqave Apartments	247	140	34,580	4	138,320
Good Egg restaurant	7,000 s.f.	1.2	8,400	6	50,400
ALTA Osborn Apartments	134	143	19,162	4	76,648
	<b>SUBTOTAL (DP 4 to DP 3)</b>		<b>62,142</b>		265,368

<b>Table 2: Pipe Capacity of Existing Sewers</b>				
Location	Diameter (inch)	Proposed Peak Flow (gpd)	Full Flow Capacity (gpd)	Peak Flow to Full Flow Capacity Ratio
71st Street (DP 1 to DP 2)	8	292,226	454,642	0.64
Scottsdale Road (DP 4 to DP 3)	8	265,368	576,171	0.46
Earll Drive (21")	Re: Section 5.3			



---

## Worksheet for 8" Sewer in 71st Street @ 0.33%

---

### Project Description

Friction Method	Manning Formula
Solve For	Discharge

### Input Data

Roughness Coefficient	0.013	
Channel Slope	0.00330	ft/ft
Normal Depth	0.67	ft
Diameter	0.67	ft

### Results

Discharge	454642.75	gal/day
Flow Area	0.35	ft <sup>2</sup>
Wetted Perimeter	2.10	ft
Hydraulic Radius	0.17	ft
Top Width	0.00	ft
Critical Depth	0.40	ft
Percent Full	100.0	%
Critical Slope	0.00770	ft/ft
Velocity	2.00	ft/s
Velocity Head	0.06	ft
Specific Energy	0.73	ft
Froude Number	0.00	
Maximum Discharge	0.76	ft <sup>3</sup> /s
Discharge Full	0.70	ft <sup>3</sup> /s
Slope Full	0.00330	ft/ft
Flow Type	SubCritical	

### GVF Input Data

Downstream Depth	0.00	ft
Length	0.00	ft
Number Of Steps	0	

### GVF Output Data

Upstream Depth	0.00	ft
Profile Description		
Profile Headloss	0.00	ft
Average End Depth Over Rise	0.00	%
Normal Depth Over Rise	100.00	%
Downstream Velocity	Infinity	ft/s

---

## Worksheet for 8" Sewer in 71st Street @ 0.33%

---

### GVF Output Data

Upstream Velocity	Infinity	ft/s
Normal Depth	0.67	ft
Critical Depth	0.40	ft
Channel Slope	0.00330	ft/ft
Critical Slope	0.00770	ft/ft

## Worksheet for 8" sewer in Earll Drive @0.33%

### Project Description

Friction Method                      Manning Formula  
Solve For                                Discharge

### Input Data

Roughness Coefficient	0.013	
Channel Slope	0.00330	ft/ft
Normal Depth	0.67	ft
Diameter	0.67	ft

### Results

Discharge	0.70	ft <sup>3</sup> /s
Flow Area	0.35	ft <sup>2</sup>
Wetted Perimeter	2.10	ft
Hydraulic Radius	0.17	ft
Top Width	0.00	ft
Critical Depth	0.40	ft
Percent Full	100.0	%
Critical Slope	0.00770	ft/ft
Velocity	2.00	ft/s
Velocity Head	0.06	ft
Specific Energy	0.73	ft
Froude Number	0.00	
Maximum Discharge	0.76	ft <sup>3</sup> /s
Discharge Full	0.70	ft <sup>3</sup> /s
Slope Full	0.00330	ft/ft
Flow Type	SubCritical	

### GVF Input Data

Downstream Depth	0.00	ft
Length	0.00	ft
Number Of Steps	0	

### GVF Output Data

Upstream Depth	0.00	ft
Profile Description		
Profile Headloss	0.00	ft
Average End Depth Over Rise	0.00	%
Normal Depth Over Rise	100.00	%
Downstream Velocity	Infinity	ft/s



---

## Worksheet for 8" sewer in Earll Drive @0.33%

---

### GVF Output Data

Upstream Velocity	Infinity	ft/s
Normal Depth	0.67	ft
Critical Depth	0.40	ft
Channel Slope	0.00330	ft/ft
Critical Slope	0.00770	ft/ft

## Worksheet existing 8" sewer in Scottsdale Road

### Project Description

Friction Method                      Manning Formula  
Solve For                                Discharge

### Input Data

Roughness Coefficient                      0.013  
Channel Slope                                0.00530    ft/ft  
Normal Depth                                0.67    ft  
Diameter                                        0.67    ft

### Results

Discharge                                      576170.79    gal/day  
Flow Area                                      0.35    ft<sup>2</sup>  
Wetted Perimeter                            2.10    ft  
Hydraulic Radius                            0.17    ft  
Top Width                                      0.00    ft  
Critical Depth                                0.45    ft  
Percent Full                                  100.0    %  
Critical Slope                                0.00861    ft/ft  
Velocity                                        2.53    ft/s  
Velocity Head                                0.10    ft  
Specific Energy                               0.77    ft  
Froude Number                                0.00  
Maximum Discharge                        0.96    ft<sup>3</sup>/s  
Discharge Full                                0.89    ft<sup>3</sup>/s  
Slope Full                                      0.00530    ft/ft  
Flow Type                                      SubCritical

### GVF Input Data

Downstream Depth                        0.00    ft  
Length                                        0.00    ft  
Number Of Steps                            0

### GVF Output Data

Upstream Depth                            0.00    ft  
Profile Description  
Profile Headloss                            0.00    ft  
Average End Depth Over Rise            0.00    %  
Normal Depth Over Rise                100.00    %  
Downstream Velocity                        Infinity    ft/s

---

## Worksheet existing 8" sewer in Scottsdale Road

---

### GVF Output Data

Upstream Velocity	Infinity	ft/s
Normal Depth	0.67	ft
Critical Depth	0.45	ft
Channel Slope	0.00530	ft/ft
Critical Slope	0.00861	ft/ft



---

## Worksheet for 21" Sewer in Earll Drive @ dD = 0.70

---

### Project Description

Friction Method	Manning Formula
Solve For	Discharge

### Input Data

Roughness Coefficient	0.013	
Channel Slope	0.00300	ft/ft
Normal Depth	1.23	ft
Diameter	1.75	ft

### Results

Discharge	4695963.10	gal/day
Flow Area	1.80	ft <sup>2</sup>
Wetted Perimeter	3.47	ft
Hydraulic Radius	0.52	ft
Top Width	1.60	ft
Critical Depth	1.00	ft
Percent Full	70.0	%
Critical Slope	0.00547	ft/ft
Velocity	4.04	ft/s
Velocity Head	0.25	ft
Specific Energy	1.48	ft
Froude Number	0.67	
Maximum Discharge	9.34	ft <sup>3</sup> /s
Discharge Full	8.68	ft <sup>3</sup> /s
Slope Full	0.00210	ft/ft
Flow Type	SubCritical	

### GVF Input Data

Downstream Depth	0.00	ft
Length	0.00	ft
Number Of Steps	0	

### GVF Output Data

Upstream Depth	0.00	ft
Profile Description		
Profile Headloss	0.00	ft
Average End Depth Over Rise	0.00	%
Normal Depth Over Rise	70.00	%
Downstream Velocity	Infinity	ft/s

---

## Worksheet for 21" Sewer in Earll Drive @ dD = 0.70

---

### GVF Output Data

Upstream Velocity	Infinity	ft/s
Normal Depth	1.23	ft
Critical Depth	1.00	ft
Channel Slope	0.00300	ft/ft
Critical Slope	0.00547	ft/ft

## Worksheet for Proposed Flow in 8" Sewer in 71st Street

### Project Description

Friction Method	Manning Formula
Solve For	Normal Depth

### Input Data

Roughness Coefficient	0.013	
Channel Slope	0.00330	ft/ft
Diameter	0.67	ft
Discharge	292226.00	gal/day

### Results

Normal Depth	0.39	ft
Flow Area	0.21	ft <sup>2</sup>
Wetted Perimeter	1.16	ft
Hydraulic Radius	0.18	ft
Top Width	0.66	ft
Critical Depth	0.31	ft
Percent Full	58.3	%
Critical Slope	0.00683	ft/ft
Velocity	2.12	ft/s
Velocity Head	0.07	ft
Specific Energy	0.46	ft
Froude Number	0.66	
Maximum Discharge	0.76	ft <sup>3</sup> /s
Discharge Full	0.70	ft <sup>3</sup> /s
Slope Full	0.00136	ft/ft
Flow Type	SubCritical	

### GVF Input Data

Downstream Depth	0.00	ft
Length	0.00	ft
Number Of Steps	0	

### GVF Output Data

Upstream Depth	0.00	ft
Profile Description		
Profile Headloss	0.00	ft
Average End Depth Over Rise	0.00	%
Normal Depth Over Rise	58.31	%
Downstream Velocity	Infinity	ft/s

---

## Worksheet for Proposed Flow in 8" Sewer in 71st Street

---

### GVF Output Data

Upstream Velocity	Infinity	ft/s
Normal Depth	0.39	ft
Critical Depth	0.31	ft
Channel Slope	0.00330	ft/ft
Critical Slope	0.00683	ft/ft



## Worksheet for Proposed Flow in 21" Sewer in Earll Road

### Project Description

Friction Method	Manning Formula
Solve For	Normal Depth

### Input Data

Roughness Coefficient	0.013	
Channel Slope	0.00300	ft/ft
Diameter	1.75	ft
Discharge	876876.00	gal/day

### Results

Normal Depth	0.47	ft
Flow Area	0.52	ft <sup>2</sup>
Wetted Perimeter	1.90	ft
Hydraulic Radius	0.27	ft
Top Width	1.55	ft
Critical Depth	0.42	ft
Percent Full	26.7	%
Critical Slope	0.00470	ft/ft
Velocity	2.63	ft/s
Velocity Head	0.11	ft
Specific Energy	0.57	ft
Froude Number	0.80	
Maximum Discharge	9.34	ft <sup>3</sup> /s
Discharge Full	8.68	ft <sup>3</sup> /s
Slope Full	0.00007	ft/ft
Flow Type	SubCritical	

### GVF Input Data

Downstream Depth	0.00	ft
Length	0.00	ft
Number Of Steps	0	

### GVF Output Data

Upstream Depth	0.00	ft
Profile Description		
Profile Headloss	0.00	ft
Average End Depth Over Rise	0.00	%
Normal Depth Over Rise	26.73	%
Downstream Velocity	Infinity	ft/s

---

## Worksheet for Proposed Flow in 21" Sewer in Earll Road

---

### GVF Output Data

Upstream Velocity	Infinity	ft/s
Normal Depth	0.47	ft
Critical Depth	0.42	ft
Channel Slope	0.00300	ft/ft
Critical Slope	0.00470	ft/ft

## Worksheet for Proposed Flow in 8" Sewer in Scottsdale Road

### Project Description

Friction Method	Manning Formula
Solve For	Normal Depth

### Input Data

Roughness Coefficient	0.013	
Channel Slope	0.00530	ft/ft
Diameter	0.67	ft
Discharge	265368.00	gal/day

### Results

Normal Depth	0.32	ft
Flow Area	0.17	ft <sup>2</sup>
Wetted Perimeter	1.02	ft
Hydraulic Radius	0.16	ft
Top Width	0.67	ft
Critical Depth	0.30	ft
Percent Full	47.7	%
Critical Slope	0.00674	ft/ft
Velocity	2.48	ft/s
Velocity Head	0.10	ft
Specific Energy	0.41	ft
Froude Number	0.88	
Maximum Discharge	0.96	ft <sup>3</sup> /s
Discharge Full	0.89	ft <sup>3</sup> /s
Slope Full	0.00112	ft/ft
Flow Type	SubCritical	

### GVF Input Data

Downstream Depth	0.00	ft
Length	0.00	ft
Number Of Steps	0	

### GVF Output Data

Upstream Depth	0.00	ft
Profile Description		
Profile Headloss	0.00	ft
Average End Depth Over Rise	0.00	%
Normal Depth Over Rise	47.65	%
Downstream Velocity	Infinity	ft/s

---

## Worksheet for Proposed Flow in 8" Sewer in Scottsdale Road

---

### GVF Output Data

Upstream Velocity	Infinity	ft/s
Normal Depth	0.32	ft
Critical Depth	0.30	ft
Channel Slope	0.00530	ft/ft
Critical Slope	0.00674	ft/ft





*"LEED®ing and Developing Smart Projects"*

## *APPENDIX III*

### *Utility Plan*

8280 E. Gelding Dr., Suite 101  
Scottsdale, AZ 85260




**PROPERTY OWNER**  
 DAVID L. CHAPMAN TRUST  
 6601 E. MCDOWELL RD  
 SCOTTSDALE, ARIZONA 85257

**CIVIL ENGINEER**  
 SUSTAINABILITY ENGINEERING GROUP  
 8280 E. GELDING DR, SUITE 101  
 SCOTTSDALE, ARIZONA 85260  
 PHONE 480-588-7226  
 ATTN: ALI FAKIH

# ALTA DRINKWATER UTILITY PLAN

3234 N SCOTTSDALE RD, SCOTTSDALE ARIZONA 85251

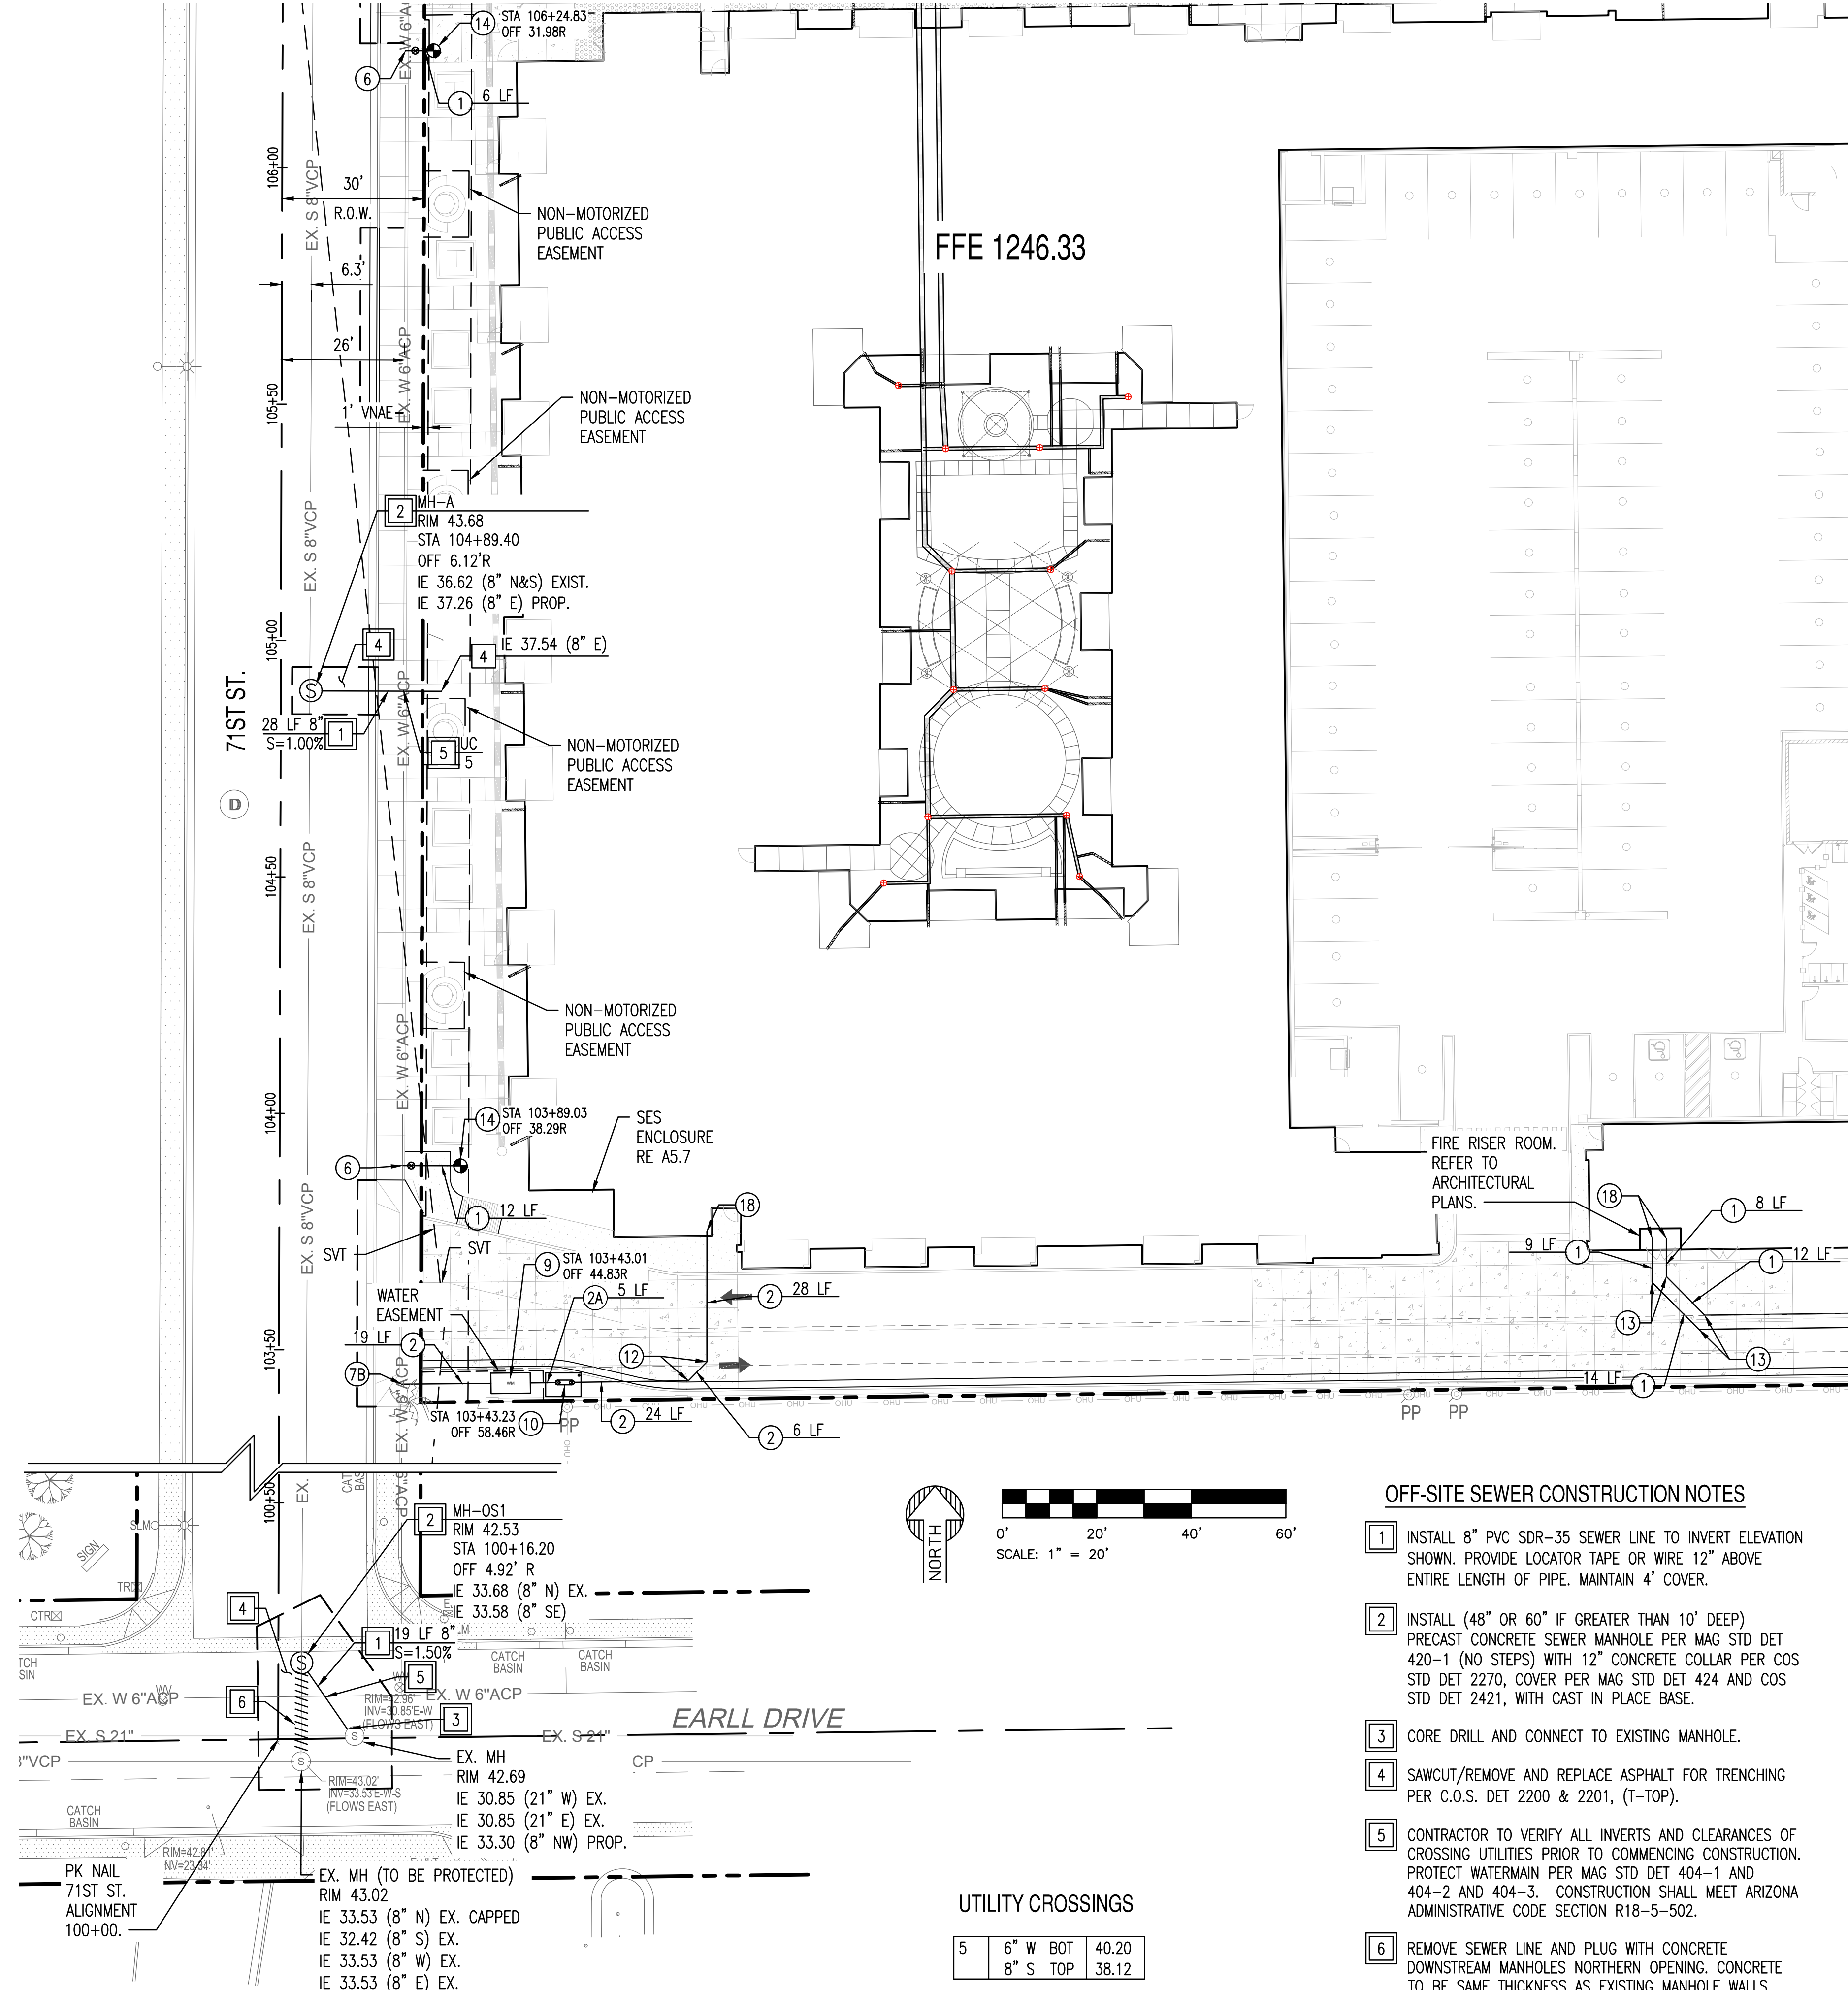

### UTILITY NOTES

- REFER TO SHEET CO.10 FOR ADDITIONAL GENERAL NOTES.
- PROTECT AND MAINTAIN CROSSINGS OF OTHER UTILITY LINES.
- PROPER COORDINATION WITH THE RESPECTIVE UTILITY COMPANIES SHALL BE PERFORMED BY THE CONTRACTOR TO INSURE THAT ALL UTILITY COMPANY, LOCAL MUNICIPALITY, AND LOCAL COUNTY STANDARDS FOR MATERIALS AND CONSTRUCTION METHODS ARE MET.
- ALL WATER MAINS, WATER SERVICES, AND SANITARY SEWER LATERALS SHALL CONFORM TO THE DEPARTMENT OF ENVIRONMENTAL PROTECTION, APPLICABLE COUNTY AND LOCAL DEPARTMENTS, AND APPROPRIATE UTILITY COMPANY SPECIFICATIONS.
- CONTRACTOR TO PROVIDE SLEEVES UNDER FOOTINGS OR THROUGH FOUNDATIONS FOR UTILITY CONNECTIONS.
- CONTRACTOR SHALL PROVIDE ALL BENDS, FITTINGS, ADAPTERS, ETC. AS REQUIRED FOR PIPE CONNECTIONS TO BUILDING SUB-OUTS, INCLUDING ROOF/FOOTING DRAIN CONNECTIONS TO ROOF LEADERS AND TO STORM DRAINAGE SYSTEM.
- ALL UTILITY CONSTRUCTION IS SUBJECT TO INSPECTION PRIOR TO APPROVAL FOR BACKFILL, IN ACCORDANCE WITH THE APPROPRIATE UTILITY COMPANY, LOCAL MUNICIPALITY, AND/OR LOCAL COUNTY REQUIREMENTS.
- UTILITY CONNECTION DESIGN AS REFLECTED ON THE PLAN MAY CHANGE SUBJECT TO UTILITY COMPANY AND LOCAL AGENCY REVIEW.
- CAP STUBS AND PROVIDE FIELD MARKERS.
- FOR PIPE INSTALLATION, PROVIDE TRENCH EXCAVATION, BEDDING AND BACKFILLING, AND COMPACTION PER MAG SPECIFICATION SECTION 601. REFER TO CITY OF SCOTTSDALE STANDARD DETAIL 2201 & 2202 FOR DETAIL.
- BEDDING MATERIAL TO BE IN ACCORDANCE WITH MAG SECTION 702.2 AND TABLE 702-1.
- FOR HDPE PIPE INSTALLATION, PROVIDE TRENCH EXCAVATION, BEDDING AND BACKFILLING, AND COMPACTION PER MAG SPECIFICATION SECTION 603.
- PROTECT CROSSING OF OTHER UTILITIES. MAINTAIN MINIMUM SEPARATION BETWEEN UTILITIES PER CITY OF SCOTTSDALE STANDARD DETAIL 2372.
- ALL JOINTS FOR D.I.P. WATER MAINS AND SEWER MAINS TO BE RESTRAINED WITH MEGA LUG JOINTS PER MAG STANDARD DETAIL 303-1 AND 303-2 UNLESS OTHERWISE NOTED.
- ALL PRODUCTS USED ON THIS SITE SHALL CONFORM TO ANSI/NSF STANDARDS 60 AND 61 IN ACCORDANCE WITH REGULATORY CITATION R18-4-213.
- PROVIDE ANCHOR BLOCKS FOR VERTICAL BENDS PER MAG STANDARD DETAIL 381.
- PROVIDE WARNING TAPE ABOVE UTILITIES PER CITY OF SCOTTSDALE REQUIREMENTS.
- PROVIDE 5' MINIMUM COVER FOR SANITARY LEADS AT LOT LINES.
- PROVIDE 3' MINIMUM COVER FOR WATER SERVICE LEADS AT LOT LINES.
- MAINTAIN SANITARY SEWER SEPARATION/PROTECTION FROM WATER AND UTILITIES PER CITY OF SCOTTSDALE STANDARD DETAIL 2401.

### PROPOSED LEGEND

- PROPERTY LINE
- SAWCUT LINE
- 6"W WATER LINE
- 6"S SEWER LINE
- WATER METER VAULT
- WATER METER BOX
- WATER BACKFLOW PREVENTER
- WATER VALVE
- FIRE HYDRANT
- FIRE DEPARTMENT CONNECTION
- ⊙ SEWER MANHOLE

### OFF-SITE SEWER CONSTRUCTION NOTES

- INSTALL 8" PVC SDR-35 SEWER LINE TO INVERT ELEVATION SHOWN. PROVIDE LOCATOR TAPE OR WIRE 12" ABOVE ENTIRE LENGTH OF PIPE. MAINTAIN 4' COVER.
- INSTALL (48" OR 60" IF GREATER THAN 10' DEEP) PRECAST CONCRETE SEWER MANHOLE PER MAG STD DET 420-1 (NO STEPS) WITH 12" CONCRETE COLLAR PER COS STD DET 2270, COVER PER MAG STD DET 424 AND COS STD DET 2421, WITH CAST IN PLACE BASE.
- CORE DRILL AND CONNECT TO EXISTING MANHOLE.
- SAWCUT/REMOVE AND REPLACE ASPHALT FOR TRENCHING PER C.O.S. DET 2200 & 2201, (T-TOP).
- CONTRACTOR TO VERIFY ALL INVERTS AND CLEARANCES OF CROSSING UTILITIES PRIOR TO COMMENCING CONSTRUCTION. PROTECT WATERMAIN PER MAG STD DET 404-1 AND 404-2 AND 404-3. CONSTRUCTION SHALL MEET ARIZONA ADMINISTRATIVE CODE SECTION R18-5-502.
- REMOVE SEWER LINE AND PLUG WITH CONCRETE. DOWNSTREAM MANHOLES NORTHERN OPENING. CONCRETE TO BE SAME THICKNESS AS EXISTING MANHOLE WALLS.

### SEWER CONSTRUCTION NOTES

- INSTALL 8" PVC SDR-35 SEWER LINE TO INVERT ELEVATION SHOWN. PROVIDE LOCATOR TAPE OR WIRE 12" ABOVE ENTIRE LENGTH OF PIPE. MAINTAIN 4' COVER.
- INSTALL (48" OR 60" IF GREATER THAN 10' DEEP) PRECAST CONCRETE SEWER MANHOLE PER MAG STD DET 420-1 (NO STEPS) WITH 12" CONCRETE COLLAR PER COS STD DET 2270, COVER PER MAG STD DET 424 AND COS STD DET 2421, WITH CAST IN PLACE BASE.
- CONTRACTOR TO VERIFY ALL INVERTS AND CLEARANCES OF CROSSING UTILITIES PRIOR TO COMMENCING CONSTRUCTION. PROTECT WATERMAIN PER MAG STD DET 404-1 AND 404-2 AND 404-3. CONSTRUCTION SHALL MEET ARIZONA ADMINISTRATIVE CODE SECTION R18-5-502.
- CONNECTION TO BUILDING. REFER TO PLUMBING PLANS FOR CONTINUATION.
- SAWCUT/REMOVE AND REPLACE ASPHALT FOR TRENCHING PER C.O.S. DET 2200 & 2201, (T-TOP).
- CONCRETE ENCASE EXISTING SEWER LINE TO PROTECT PER MAG STD DET 404-3.

### WATER LINE CONSTRUCTION NOTES:

- FURNISH & INSTALL 6" DUCTILE IRON PIPE CLASS 350 WITH POLYETHYLENE WRAPPING. LENGTH PER PLAN. MEGA LUG RESTRAINED JOINT PER MAG STD DET 303-1 & 303-2.
- FURNISH & INSTALL 4" DUCTILE IRON PIPE CLASS 350 WITH POLYETHYLENE WRAPPING. LENGTH PER PLAN. MEGA LUG RESTRAINED JOINT PER MAG STD DET 303-1 & 303-2.
- FURNISH & INSTALL 3" DUCTILE IRON PIPE CLASS 350 WITH POLYETHYLENE WRAPPING. LENGTH PER PLAN. MEGA LUG RESTRAINED JOINT PER MAG STD DET 303-1 & 303-2.
- FURNISH & INSTALL 1" COPPER TYPE "K" WATER SERVICE LINE CONNECTION PER COS STD DET 2330.
- FURNISH & INSTALL 8"x6" TAPPING SLEEVE, VALVE, BOX, & COVER PER M.A.G. STD DET 340 AND 391-1 TYPE 'c' WITH LOCKING LID. MEGA LUG RESTRAINED JOINT PER M.A.G. STD DET 303-1 & 303-2.
- FURNISH & INSTALL 6"x6" CUT-IN TEE. MEGA LUG RESTRAINED JOINT PER M.A.G. STD DET 303-1 & 303-2.
- FURNISH & INSTALL 8"x4" TAPPING SLEEVE, VALVE, BOX, & COVER PER M.A.G. STD DET 340 AND 391-1 TYPE 'c' WITH LOCKING LID. MEGA LUG RESTRAINED JOINT PER M.A.G. STD DET 303-1 & 303-2.
- FURNISH & INSTALL 6"x4" TAPPING SLEEVE, VALVE, BOX, & COVER PER M.A.G. STD DET 340 AND 391-1 TYPE 'c' WITH LOCKING LID. MEGA LUG RESTRAINED JOINT PER M.A.G. STD DET 303-1 & 303-2.
- FURNISH & INSTALL 3" VAULT AND COMPOUND METER PER C.O.S. DET 2345-2. MEGA LUG RESTRAINED JOINT PER M.A.G. STD DET 303-1 & 303-2.
- FURNISH & INSTALL 3" DOUBLE CHECK VALVE BACKFLOW PREVENTION ASSEMBLY PER C.O.S. DET 2351. MEGA LUG RESTRAINED JOINT PER M.A.G. STD DET 303-1 & 303-2. GUARD POSTS PER C.O.S. DET 2356. 4"x3" REDUCER ON DOWNSTREAM SIDE. PROVIDE SCREENED ENCLOSURE WITH 24" CLEAR AROUND THE ASSEMBLY.
- FURNISH & INSTALL 1" DOUBLE CHECK VALVE BACKFLOW PREVENTION ASSEMBLY PER C.O.S. DET 2352. MEGA LUG RESTRAINED JOINT PER M.A.G. STD DET 303-1 & 303-2.
- FURNISH & INSTALL 4" 45° BEND. PROVIDE ELECTRONIC MARKER PER C.O.S. STD DET 2397. MEGA LUG RESTRAINED JOINTS PER M.A.G. STD DET 303-1 & 303-2.
- FURNISH & INSTALL 6" 45° BEND. PROVIDE ELECTRONIC MARKER PER C.O.S. STD DET 2397. MEGA LUG RESTRAINED JOINTS PER M.A.G. STD DET 303-1 & 303-2.
- FURNISH & INSTALL FIRE HYDRANT (INCLUDING 6" GATE VALVE, BOX, & COVER) PER M.A.G. STD DET 360-1. PROVIDE PAVEMENT (PM) MARKER PER C.O.S. DET 2363. NOZZLE TO BE 1' FROM SIDEWALK. MEGA LUG RESTRAINED JOINT PER M.A.G. STD DET 303-1 & 303-2.
- FURNISH & INSTALL 6" GATE VALVE, BOX, & COVER PER M.A.G. STD DET 340 & 391-1 WITH 40" DIA. CONCRETE COLLAR. MEGA LUG RESTRAINED JOINTS PER M.A.G. STD DET 303-1 & 303-2.
- SAWCUT/REMOVE AND REPLACE ASPHALT FOR TRENCHING PER C.O.S. DET 2200 & 2201, (T-TOP).
- FURNISH & INSTALL REMOTE F.D.C. PER C.O.S. STD DET 2367.
- REFER TO ARCHITECTURAL PLANS FOR PLUMBING CONTINUATION.
- 45" CONC PIPE IN SCOTTSDALE ROAD IS ABANDONED. REMOVE SECTION OF PIPE FOR CROSSING AND PLUG ENDS WITH BRICK AND MORTAR PER MAG STD DET 427 FOR DRAIN LINE PLUGS.
- CONSTRUCT VERTICAL REALIGNMENT OF WATERMAIN C.O.S. STD DET 2370. PROTECT WATERMAIN PER MAG STD DET 404-1 AND 404-2 AND 404-3. CONSTRUCTION SHALL MEET ARIZONA ADMINISTRATIVE CODE SECTION R18-5-502.

### UTILITY CROSSINGS

5	6" W BOT	40.20
	8" S TOP	38.12

SUSTAINABILITY  
 ENGINEERING  
 GROUP



EXPIRES 12-31-17  
 PREPARED UNDER THE DIRECT  
 SUPERVISION OF ALI FAKIH, P.E.  
 ARIZONA REGISTRATION NO. 45621  
 FOR AND ON BEHALF OF  
 SUSTAINABILITY ENGINEERING GROUP,  
 LLC.

**ALTA DRINKWATER**  
 Apartment Homes  
 3234 NORTH SCOTTSDALE ROAD SCOTTSDALE, ARIZONA 85251  
**WOOD PARTNERS**  
 8777 E. Via De Ventura Suite 201, Scottsdale, AZ. 85258  
 PHONE: 480-607-0822

THIRD CITY  
 SUBMITTAL  
 07/14/2017  
 REVISIONS:  
 SCALE:  
 SHEET NO.


UTILITY PLAN

C4.00




NOTE TO CONTRACTOR:  
 THIS SET OF DRAWINGS AND DOCUMENTS IS INTENDED AS A SET OF GUIDELINES FOR THE PROJECT AND ARE INTENDED TO BE USED IN CONJUNCTION WITH A SET OF CONTRACT SPECIFICATIONS TO BE SUPPLIED BY OWNER. THESE DRAWINGS MUST BE READ TO INCORPORATE ALL APPLICABLE FEDERAL, STATE AND LOCAL CODES AND REGULATIONS. THE CONTRACTOR SHALL BE RESPONSIBLE FOR VERIFYING THE ACCURACY OF ALL INFORMATION AND FOR OBTAINING ALL NECESSARY PERMITS AND APPROVALS. THE CONTRACTOR SHALL BE RESPONSIBLE FOR VERIFYING THE ACCURACY OF ALL INFORMATION AND FOR OBTAINING ALL NECESSARY PERMITS AND APPROVALS. THE CONTRACTOR SHALL BE RESPONSIBLE FOR VERIFYING THE ACCURACY OF ALL INFORMATION AND FOR OBTAINING ALL NECESSARY PERMITS AND APPROVALS.



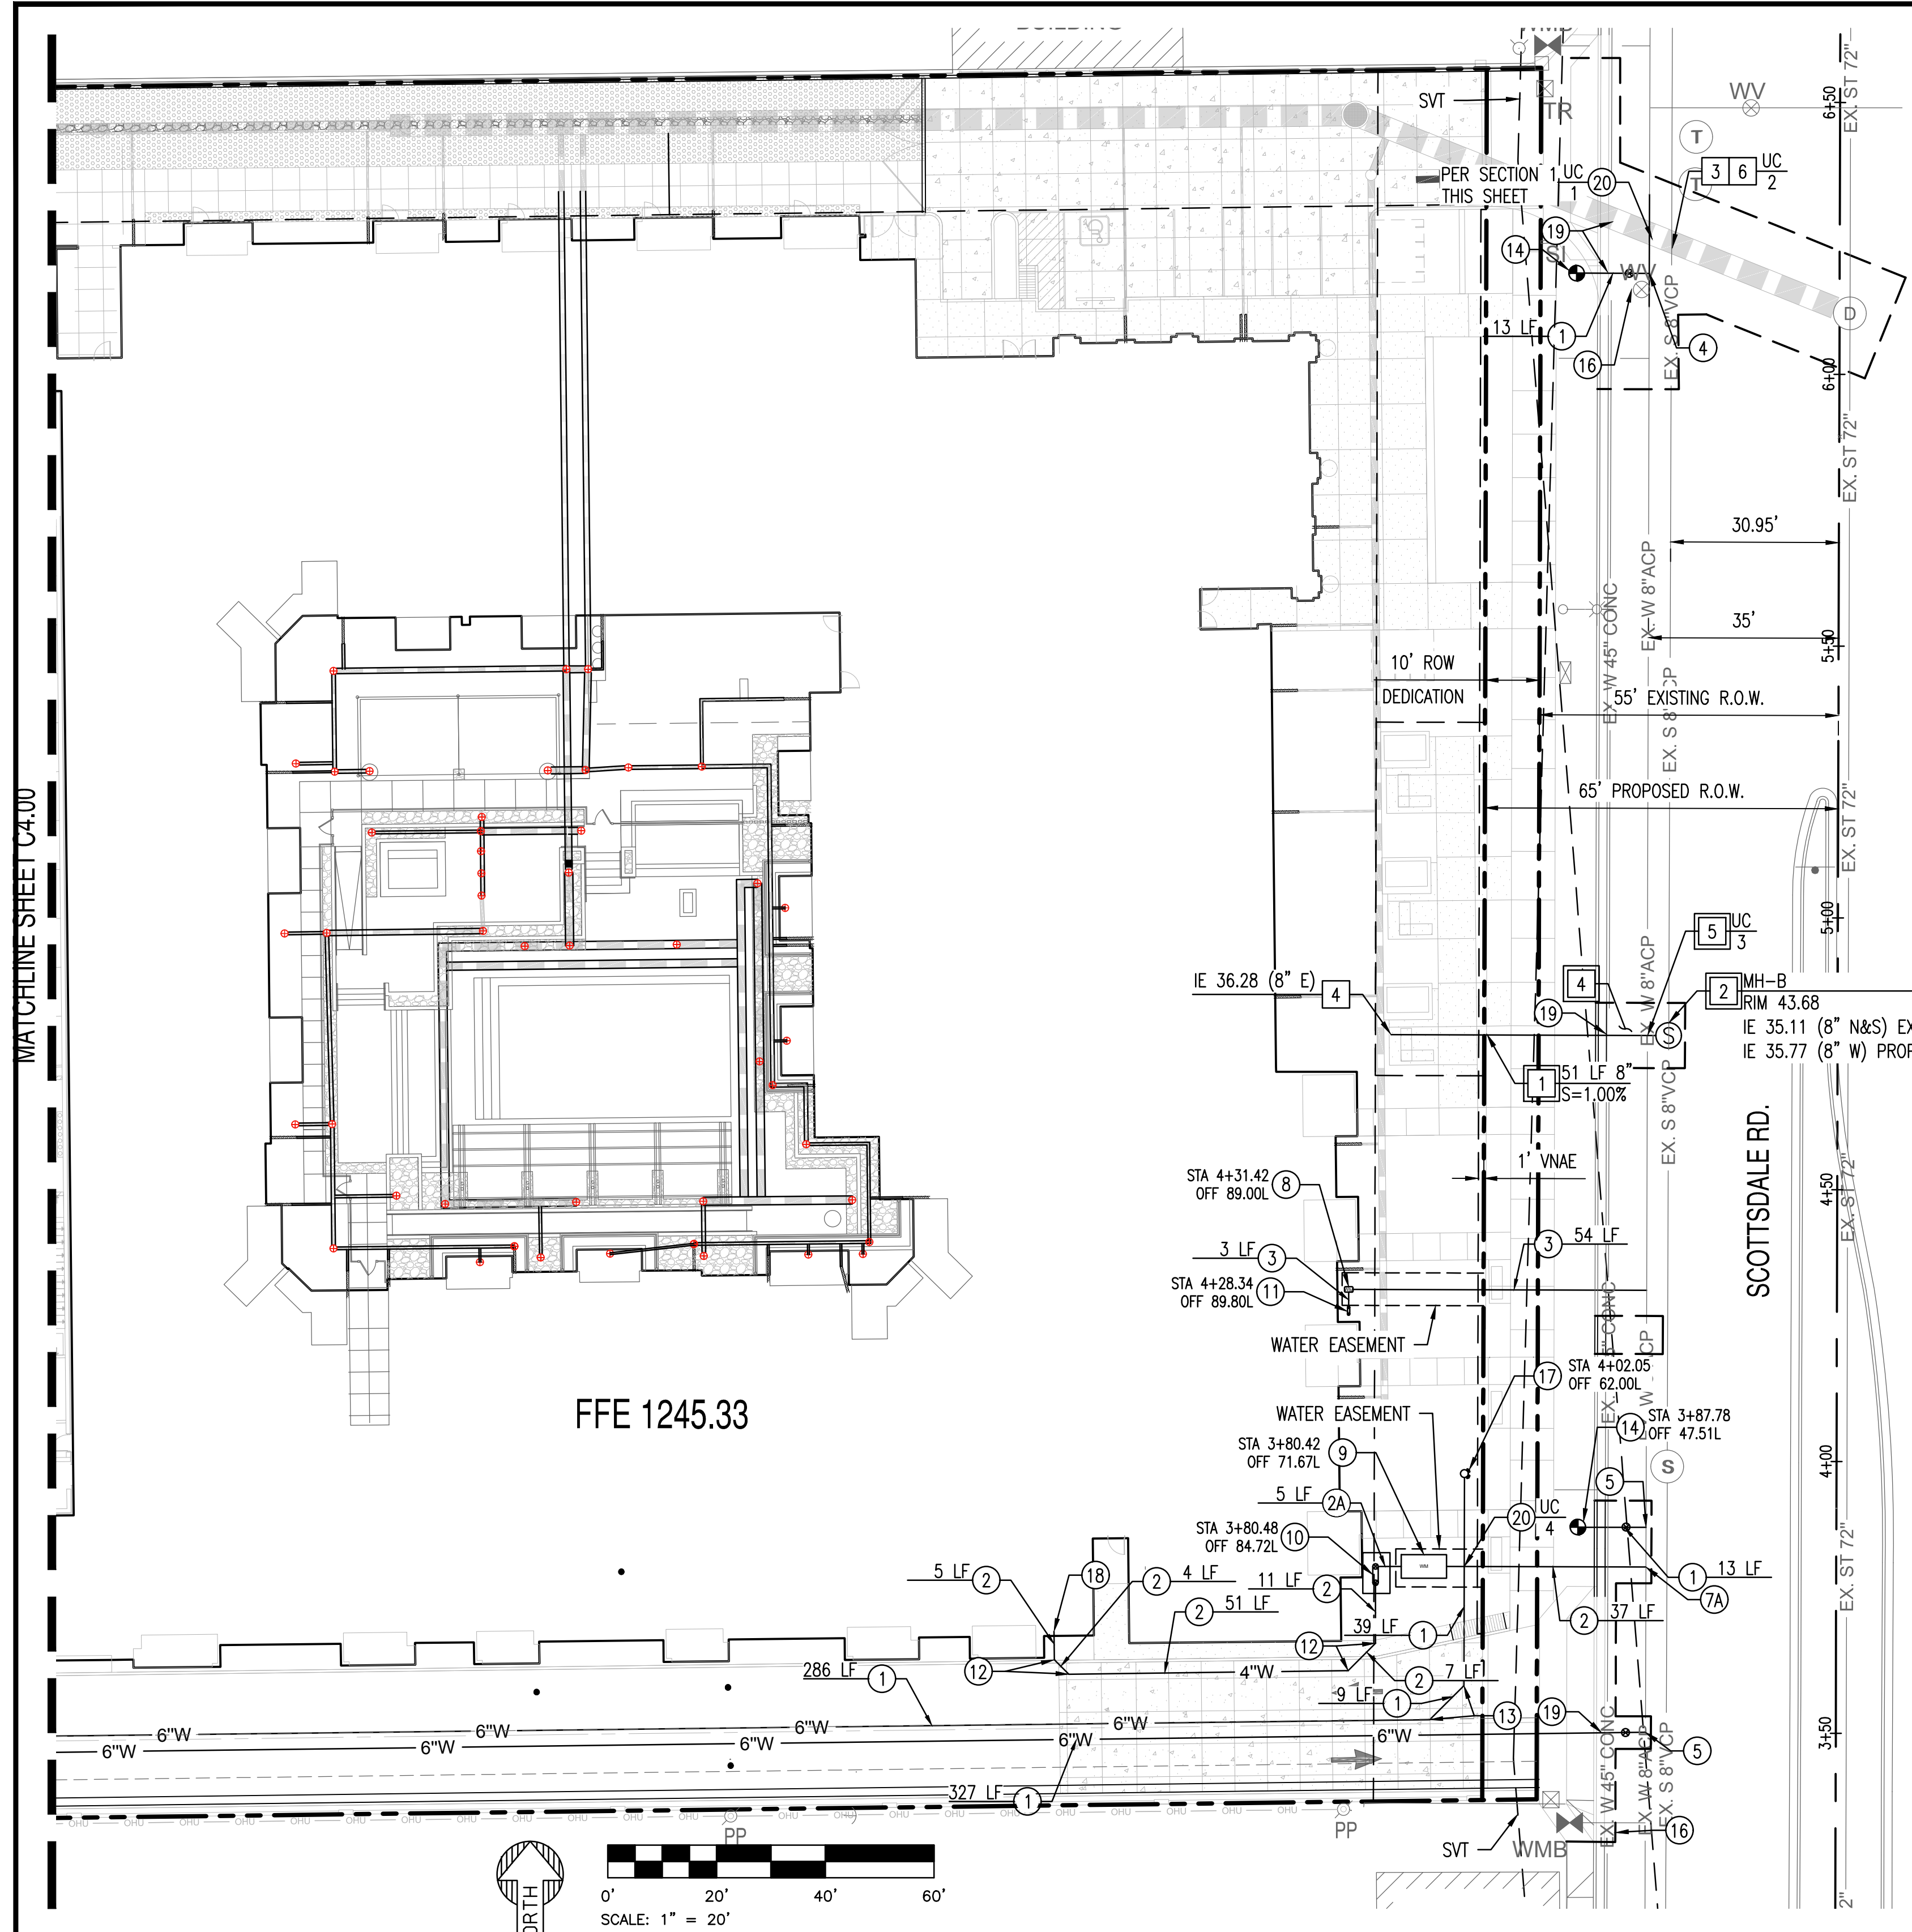

MATCHLINE SHEET C4.00

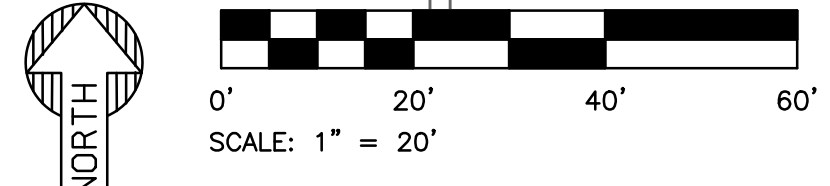

**PROPOSED LEGEND**

- PROPERTY LINE
- - - SAWCUT LINE
- 6"W WATER LINE
- 6"S SEWER LINE
- WATER METER VAULT
- WATER METER BOX
- ◐ WATER BACKFLOW PREVENTER
- WATER VALVE
- FIRE HYDRANT
- FIRE DEPARTMENT CONNECTION
- ⊙ SEWER MANHOLE

**UTILITY CROSSINGS**

NO.	DESCRIPTION	ELEVATION
1	48" ST BOT	37.23
	8" W TOP	34.77
2	48" ST BOT	37.21
	8" S TOP	36.34
3	8" W BOT	38.75*
	8" S TOP	36.48*
4	4" W BOT	40.50
	6" W TOP	40.00

\* PIPE LOCATIONS ARE BASED ON POT-HOLE EXPLORATION PREFORMED ON 2/13/2017 BY SAFE SITE UTILITY SERVICES, LLC.

**SEWER CONSTRUCTION NOTES:**


- 1 INSTALL 8" PVC SDR-35 SEWER LINE TO INVERT ELEVATION SHOWN. PROVIDE LOCATOR TAPE OR WIRE 12" ABOVE ENTIRE LENGTH OF PIPE. MAINTAIN 4' COVER.
- 2 INSTALL (48" OR 60" IF GREATER THAN 10' DEEP) PRECAST CONCRETE SEWER MANHOLE PER MAG STD DET 420-1 (NO STEPS) WITH 12" CONCRETE COLLAR PER COS STD DET 2270, COVER PER MAG STD DET 424 AND COS STD DET 2421, WITH CAST IN PLACE BASE.
- 3 CONTRACTOR TO VERIFY ALL INVERTS AND CLEARANCES OF CROSSING UTILITIES PRIOR TO COMMENCING CONSTRUCTION. PROTECT WATERMAIN PER MAG STD DET 404-1 AND 404-2 AND 404-3. CONSTRUCTION SHALL MEET ARIZONA ADMINISTRATIVE CODE SECTION R18-5-502.
- 4 CONNECTION TO BUILDING. REFER TO PLUMBING PLANS FOR CONTINUATION.
- 5 SAWCUT/REMOVE AND REPLACE ASPHALT FOR TRENCHING PER C.O.S. DET 2200 & 2201, (T-TOP).
- 6 CONCRETE ENCASE EXISTING SEWER LINE TO PROTECT PER MAG STD DET 404-3.

**OFF-SITE SEWER CONSTRUCTION NOTES:**

- 1 INSTALL 8" PVC SDR-35 SEWER LINE TO INVERT ELEVATION SHOWN. PROVIDE LOCATOR TAPE OR WIRE 12" ABOVE ENTIRE LENGTH OF PIPE. MAINTAIN 4' COVER.
- 2 INSTALL (48" OR 60" IF GREATER THAN 10' DEEP) PRECAST CONCRETE SEWER MANHOLE PER MAG STD DET 420-1 (NO STEPS) WITH 12" CONCRETE COLLAR PER COS STD DET 2270, COVER PER MAG STD DET 424 AND COS STD DET 2421, WITH CAST IN PLACE BASE.
- 3 CORE DRILL AND CONNECT TO EXISTING MANHOLE.
- 4 SAWCUT/REMOVE AND REPLACE ASPHALT FOR TRENCHING PER C.O.S. DET 2200 & 2201, (T-TOP).
- 5 CONTRACTOR TO VERIFY ALL INVERTS AND CLEARANCES OF CROSSING UTILITIES PRIOR TO COMMENCING CONSTRUCTION. PROTECT WATERMAIN PER MAG STD DET 404-1 AND 404-2 AND 404-3. CONSTRUCTION SHALL MEET ARIZONA ADMINISTRATIVE CODE SECTION R18-5-502.
- 6 REMOVE SEWER LINE AND PLUG WITH CONCRETE DOWNSTREAM MANHOLES NORTHERN OPENING. CONCRETE TO BE SAME THICKNESS AS EXISTING MANHOLE WALLS.

**WATER LINE CONSTRUCTION NOTES:**

- 1 FURNISH & INSTALL 6" DUCTILE IRON PIPE CLASS 350 WITH POLYETHYLENE WRAPPING. LENGTH PER PLAN. MEGA LUG RESTRAINED JOINT PER MAG STD DET 303-1 & 303-2.
- 2 FURNISH & INSTALL 4" DUCTILE IRON PIPE CLASS 350 WITH POLYETHYLENE WRAPPING. LENGTH PER PLAN. MEGA LUG RESTRAINED JOINT PER MAG STD DET 303-1 & 303-2.
- 2A FURNISH & INSTALL 3" DUCTILE IRON PIPE CLASS 350 WITH POLYETHYLENE WRAPPING. LENGTH PER PLAN. MEGA LUG RESTRAINED JOINT PER MAG STD DET 303-1 & 303-2.
- 3 FURNISH & INSTALL 1" COPPER TYPE "K" WATER SERVICE LINE CONNECTION PER COS STD DET 2330.
- 4 FURNISH & INSTALL 8"x6" TEE. MEGA LUG RESTRAINED JOINT PER M.A.G. STD DET 303-1 & 303-2.
- 5 FURNISH & INSTALL 8"x6" TAPPING SLEEVE, VALVE, BOX, & COVER PER M.A.G. STD DET 340 AND 391-1 TYPE 'C' WITH LOCKING LID. MEGA LUG RESTRAINED JOINT PER M.A.G. STD DET 303-1 & 303-2.
- 6 FURNISH & INSTALL 6"x6" CUT-IN TEE. MEGA LUG RESTRAINED JOINT PER M.A.G. STD DET 303-1 & 303-2.
- 7A FURNISH & INSTALL 8"x4" TAPPING SLEEVE, VALVE, BOX, & COVER PER M.A.G. STD DET 340 AND 391-1 TYPE 'C' WITH LOCKING LID. MEGA LUG RESTRAINED JOINT PER M.A.G. STD DET 303-1 & 303-2.
- 7B FURNISH & INSTALL 6"x4" TAPPING SLEEVE, VALVE, BOX, & COVER PER M.A.G. STD DET 340 AND 391-1 TYPE 'C' WITH LOCKING LID. MEGA LUG RESTRAINED JOINT PER M.A.G. STD DET 303-1 & 303-2.
- 8 FURNISH & INSTALL CONCRETE WATER METER BOX #1 PER M.A.G. STD DET 320 WITH LID PER M.A.G. STD DET 310 WITHIN 3' OF PROPERTY LINE. 1" WATER METER TO BE INSTALLED BY CITY FORCES.
- 9 FURNISH & INSTALL 3" VAULT AND COMPOUND METER PER C.O.S. DET 2345-2. MEGA LUG RESTRAINED JOINT PER M.A.G. STD DET 303-1 & 303-2.
- 10 FURNISH & INSTALL 3" DOUBLE CHECK VALVE BACKFLOW PREVENTION ASSEMBLY PER C.O.S. DET 2351. MEGA LUG RESTRAINED JOINT PER M.A.G. STD DET 303-1 & 303-2. GUARD POSTS PER C.O.S. DET 2356. 4"x3" REDUCER ON DOWNSTREAM SIDE. PROVIDE SCREENED ENCLOSURE WITH 24" CLEAR AROUND THE ASSEMBLY.
- 11 FURNISH & INSTALL 1" DOUBLE CHECK VALVE BACKFLOW PREVENTION ASSEMBLY PER C.O.S. DET 2352. MEGA LUG RESTRAINED JOINT PER M.A.G. STD DET 303-1 & 303-2.
- 12 FURNISH & INSTALL 4" 45° BEND. PROVIDE ELECTRONIC MARKER PER C.O.S. STD DET 2397. MEGA LUG RESTRAINED JOINTS PER M.A.G. STD DET 303-1 & 303-2.
- 13 FURNISH & INSTALL 6" 45° BEND. PROVIDE ELECTRONIC MARKER PER C.O.S. STD DET 2397. MEGA LUG RESTRAINED JOINTS PER M.A.G. STD DET 303-1 & 303-2.
- 14 FURNISH & INSTALL FIRE HYDRANT (INCLUDING 6" GATE VALVE, BOX, & COVER) PER M.A.G. STD DET 360-1. PROVIDE PAVEMENT (PM) MARKER PER C.O.S. DET 2363. NOZZLE TO BE 1' FROM SIDEWALK. MEGA LUG RESTRAINED JOINT PER M.A.G. STD DET 303-1 & 303-2.
- 15 FURNISH & INSTALL 6" GATE VALVE, BOX, & COVER PER M.A.G. STD DET 340 & 391-1 WITH 40" DIA. CONCRETE COLLAR. MEGA LUG RESTRAINED JOINTS PER M.A.G. STD DET 303-1 & 33-2.
- 16 SAWCUT/REMOVE AND REPLACE ASPHALT FOR TRENCHING PER C.O.S. DET 2200 & 2201, (T-TOP).
- 17 FURNISH & INSTALL REMOTE F.D.C. PER C.O.S. STD DET 2367.
- 18 REFER TO ARCHITECTURAL PLANS FOR PLUMBING CONTINUATION.
- 19 45" CONC PIPE IN SCOTTSDALE ROAD IS ABANDONED. REMOVE SECTION OF PIPE FOR CROSSING AND PLUG ENDS WITH BRICK AND MORTAR PER MAG STD DET 427 FOR DRAIN LINE PLUGS.
- 20 CONSTRUCT VERTICAL REALIGNMENT OF WATERMAIN C.O.S. STD DET 2370. PROTECT WATERMAIN PER MAG STD DET 404-1 AND 404-2 AND 404-3. CONSTRUCTION SHALL MEET ARIZONA ADMINISTRATIVE CODE SECTION R18-5-502.

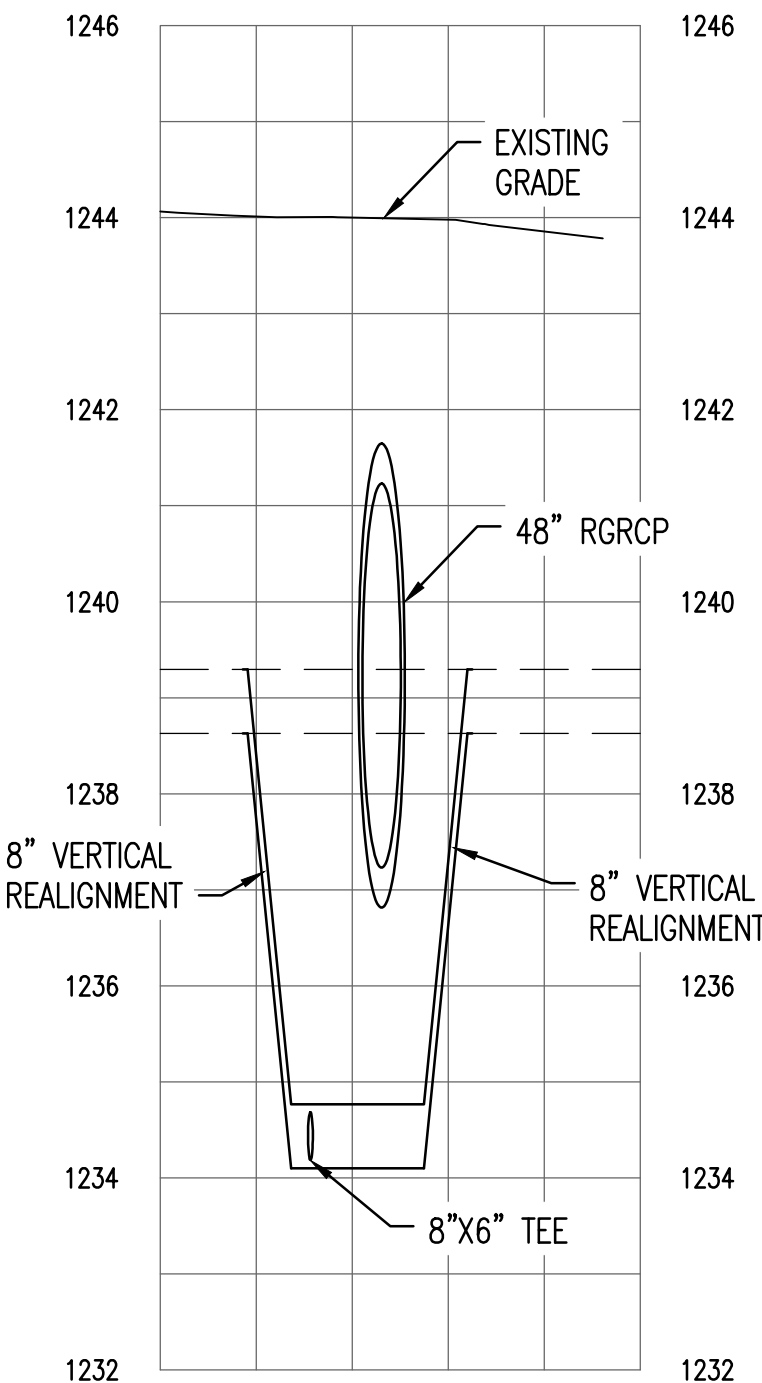

SECTION 1  
SCALE: HORIZ 1"=20'  
VERT 1"=2'



NOTE TO CONTRACTOR:  
THIS SET OF DRAWINGS AND DOCUMENTS IS INTENDED AS A SET OF GUIDELINES FOR THE PROJECT AND ARE INTENDED TO BE USED IN CONJUNCTION WITH A SET OF CONSTRUCTION SPECIFICATIONS TO BE SUPPLIED BY OWNER. THEY MUST BE READ TO INCORPORATE ALL APPLICABLE FEDERAL, STATE AND LOCAL CODES AND REGULATIONS. THE CONTRACTOR SHALL BE RESPONSIBLE FOR VERIFYING THE ACCURACY OF ALL INFORMATION AND FOR OBTAINING ALL NECESSARY PERMITS AND APPROVALS. THE CONTRACTOR SHALL BE RESPONSIBLE FOR OBTAINING ALL NECESSARY PERMITS AND APPROVALS. THE CONTRACTOR SHALL BE RESPONSIBLE FOR OBTAINING ALL NECESSARY PERMITS AND APPROVALS. THE CONTRACTOR SHALL BE RESPONSIBLE FOR OBTAINING ALL NECESSARY PERMITS AND APPROVALS.

SUSTAINABILITY ENGINEERING GROUP

SEG

8280 E GELDING DR #101, SCOTTSDALE, ARIZONA 85260  
WWW.AZSEEG.COM TEL: 480.888.7228

ALTA DRINKWATER

Apartment Homes

3234 NORTH SCOTTSDALE ROAD SCOTTSDALE, ARIZONA 85251

WOOD PARTNERS

8777 E. Via De Ventura Suite 201, Scottsdale, AZ. 85258  
PHONE: 480-607-0822

THIRD CITY SUBMITTAL  
07/14/2017

REVISIONS:


JOB NO: 15-054  
SCALE:  
SHEET NO.





"LEED®ing and Developing"

## *APPENDIX IV*

# *Agave Old Town Apartments Sewer Report (excerpts)*

8280 E. Gelding Dr., Suite 101  
Scottsdale, AZ 85260

12/11/15

WASTEWATER BASIS OF DESIGN REPORT  
FOR

**AGAVE OLD TOWN  
APARTMENTS**

SWC OF OSBORN ROAD AND SCOTTSDALE ROAD  
SCOTTSDALE, ARIZONA

Accepted for


City of Scottsdale  
Water Resources Administration  
9379 E. San Salvador  
Scottsdale, AZ 85258

Prepared For:  
JLB PARTNERS  
9237 E. Via De Ventura, Suite 215  
Scottsdale, AZ 85258  
Phone: (480) 800-3072  
Contact: Ryan Kleinau

Douqmanh  
12.22.2015

Prepared By:  
HILGARTWILSON  
2141 E. Highland Ave., Suite 250  
Phoenix, AZ 85016  
Phone: (602) 490-0535  
Fax: (602) 325-0161

REVISIONS:  
Initial Issue - September 25, 2015  
Revised Per City of Scottsdale Comments - December 10, 2015

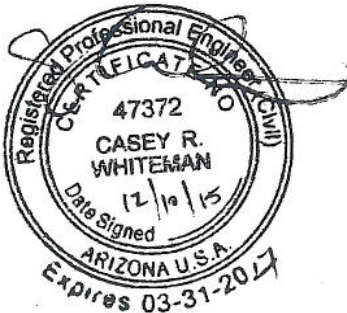

48

Sewer

6929-15-1-51-6769



**WASTEWATER BASIS OF DESIGN REPORT  
FOR  
AGAVE OLD TOWN APARTMENTS**

**TABLE OF CONTENTS**

<b>1.0</b>	<b>INTRODUCTION .....</b>	<b>1</b>
1.1	GENERAL DESCRIPTION .....	1
1.2	PURPOSE .....	1
<b>2.0</b>	<b>DESIGN CRITERIA .....</b>	<b>2</b>
<b>3.0</b>	<b>PROJECTED WASTEWATER FLOWS.....</b>	<b>2</b>
<b>4.0</b>	<b>WASTEWATER SYSTEM .....</b>	<b>2</b>
4.1	EXISTING WASTEWATER SYSTEM INFRASTRUCTURE.....	2
4.2	PROPOSED WASTEWATER SYSTEM INFRASTRUCTURE.....	3
<b>5.0</b>	<b>PIPE CAPACITY ANALYSIS .....</b>	<b>3</b>
<b>6.0</b>	<b>CONCLUSIONS .....</b>	<b>3</b>
<b>7.0</b>	<b>REFERENCES .....</b>	<b>3</b>

**APPENDICES**

- A. Figures
- B. Sewer Capacity Calculations

**FIGURES**

- 1. Wastewater Exhibit

**TABLES**

1.	Building Breakdown .....	1
2.	Design Criteria.....	2
3.	Proposed Wastewater Flow Summary .....	2
4.	Pipe Capacity of Existing Sewer in 71 <sup>st</sup> Street .....	3

## 1.0 INTRODUCTION

### 1.1 GENERAL DESCRIPTION

Agave Old Town Apartments (Project) is a proposed multi-family development in the southeast quarter of Section 27 in Township 2 North, Range 4 East of the Gila and Salt River Base Line and Meridian in Scottsdale, Arizona in Maricopa County. Figure 1 in **Appendix A** provides a Vicinity Map for the Project.

Encompassing approximately 8.85 gross acres ( 7.10 net), the Project includes four multiple-story multi-family residences with a total of 365 units, a fitness/clubroom area, parking structure, sidewalks, driveways and landscaped areas. The total building area of the Project is anticipated to be greater than 449,107 square feet, excluding the parking garages. A breakdown of the proposed building is presented in Table 1. See **Appendix A** for the Architectural Site Plan A1.1 for the Agave Residences Layout.

Building	Building Area (ft <sup>2</sup> )	Dwelling Units
Building Area 1	135,107	112
Building Area 2	87,781	72
Building Area 3	114,154	92
Building Area 4	112,065	89
Building Area 5 Parking Garage	205,093	0
<b>Total</b>		<b>365</b>
<b>Notes:</b> 1. Rounding may affect total values.		

The Project is located on the southwest corner of Osborn Road and Scottsdale Road. The site is generally bound by an existing commercial development to the north, Scottsdale Road to the east, Angus Drive and commercial developments to the south and 71<sup>st</sup> Street to the west.

The site is currently occupied by a portion of Angus Drive, a vacant lot and two commercial developments with surface parking areas. These buildings and their respective sewer taps are intended to be removed as part of this project.

### 1.2 PURPOSE

The purpose of this wastewater basis of design report is to evaluate the existing and proposed wastewater system infrastructure for the Project and confirm design flows under average day and peak flow conditions.

## 2.0 DESIGN CRITERIA

The design criteria used in this Study for determining flow are based on the 2010 City of Scottsdale *Design Standards & Policies Manual*. A summary of the design criteria is shown in **Table 2** below.

Design Criteria	Criteria	Units
Average Day Unit Wastewater Flow		
Multi-Family Residential		140 gpd/unit
Peaking Factors		
Multi-Family Residential		4.0 times average day
Roughness Coefficient		
Manning's n		0.013

## 3.0 PROJECTED WASTEWATER FLOWS

The projected wastewater flows for the Project are based on the dwelling units described in **Table 2** and the design criteria detailed in **Section 2.0**. The collective average day and peak flows for the Project are anticipated to be 51,100 gallons per day (gpd) and 229,950 gpd, respectively. A summary of the projected wastewater flows is provided in **Table 3**.

Discharge Location	Average Day Flow (gpd)	Peaking Factor	Peak Flow (gpd)
To 71st Street	16,520	4.0	66,080
To Angus Drive / Scottsdale Road	34,580	4.0	138,320
Totals	51,100		204,400

## 4.0 WASTEWATER SYSTEM

### 4.1 EXISTING WASTEWATER SYSTEM INFRASTRUCTURE

The wastewater distribution system in the vicinity of the Project is very well established. A 12-inch sewer line exists along Osborn Road north of the Project that flows east to Scottsdale Road. Two 8-inch lines exist along 71<sup>st</sup> Street, both with a southerly direction flow. About 133 feet of 8-inch sewer line, along 71<sup>st</sup> Street, bends to the east on Angus Drive and connects to a sewer manhole located at the intersection of Scottsdale Road and Angus Drive. From this manhole the existing 8-inch sewer line continues along Scottsdale Road to the south. The second sewer line is located to the south of the intersection between 71<sup>st</sup> Street and Angus Drive. This sewer line continues to the south and connects to an existing 8-inch sewer line along Earll Drive. The existing 8-inch sewer main terminates east of 70<sup>th</sup> street so the tributary area is relatively and further analysis is not warranted.



## 4.2 PROPOSED WASTEWATER SYSTEM INFRASTRUCTURE

Since a portion of the existing 8-inch sewer main along Angus Road will be removed, a connection between the two 8-inch sewer mains along 71<sup>st</sup> Street will be made to reroute wastewater that currently flows to the east along Angus Road, to the south along 71<sup>st</sup> Street.

Two 8-inch services are proposed to connect to the sewer main along 71<sup>st</sup> Street and three 8-inch sewer services are proposed to connect to the sewer main along Angus Road, as shown in Figures 2 and 4, Appendix A.

## 5.0 PIPE CAPACITY ANALYSIS

The evaluations of the sewer lines in Angus Road and 71<sup>st</sup> street are provided in this report to confirm that there is available capacity for the Project estimated demands. A summary of the pipe capacity calculations is presented in Table 4. Related calculations are found in Appendix B.

Location	Diameter (inch)	Proposed Peak Flow (gpd)	Full Flow Capacity (gpd)	Peak Flow to Full Flow Capacity Ratio
71 <sup>st</sup> Street	8	66,080	449,897	0.15
Angus Drive	8	138,320	456,663	0.30
Scottsdale Road	8	138,320	570,157	0.24

## 6.0 CONCLUSIONS

This report analyzes the performance of the wastewater system. The system, as designed, meets the design parameters outlined within this report. The specific conclusions from this report are:

- The average day and peak sewer flows discharging to 71<sup>st</sup> Street are estimated to be 16,520 gpd, and 66,080 gpd, respectively.
- The existing sewer line in 71<sup>st</sup> Street has a capacity of 449,897 gpd and is adequately sized to accommodate the anticipated flows from Agave Old Town Apartments.
- The average day and peak sewer flows discharging to Angus Drive / Scottsdale Rd. are estimated to be 34,580 gpd, and 138,320 gpd, respectively.
- The existing sewer line in Angus Drive has a capacity of 445,663 gpd and is adequately sized to accommodate the anticipated flows from Agave Old Town Apartments.
- The existing sewer in Scottsdale Rd. has a capacity of 570,157 gpd and is adequately sized to accommodate the anticipated flows from Agave Old Town Apartments.

## 7.0 REFERENCES

City of Scottsdale. (2010). *Design Standards & Policies Manual*.

*AT Scottsdale + EARL ALL goes into the 21"*

*APPENDIX B*

*SEWER CAPACITY CALCULATIONS*

# Sewer Capacity Calculation

Project: Agave Old Town Apartments  
 Prepared By: JLB  
 September 2015



## Design Wastewater Flows

Combined Sewer Flows to 71st Street		
Number of Units	118	Multi-Family
Average Daily Flow in Gallons per Dwelling Unit	140	per Table 7.1-2 of City of Scottsdale Design Standards & Policies, Section 7, January 2010.
Average Daily Flow:	16,520	gpd
Combined Sewer Flows to Scottsdale Road		
Number of Units	247	Multi-Family
Average Daily Flow in Gallons per Dwelling Unit	140	per Table 7.1-2 of City of Scottsdale Design Standards & Policies, Section 7, January 2010.
Average Daily Flow:	34,580	gpd
Average Daily Flow Summary		
Flow to 71 <sup>st</sup> Street	16,520	gpd
Flows to Angus Dr. / Scottsdale Road	34,580	gpd
Total Average Daily Flow	51,100	gpd
Peaking Factor:	4.00	per Table 7.1-2 of City of Scottsdale Design Standards & Policies, Section 7, January 2010.
Peak Daily Flow Calculations		
Flow to 71 <sup>st</sup> Street	66,080	gpd
Flows to Angus Dr. / Scottsdale Road	138,320	gpd
Total Peak Daily Flow	204,400	gpd

## Capacity of Existing and Proposed Sewer Alignments

### 8" Sewer Main flowing South Along 71st Street

Sewer Segments:	8" @ 0.48%	Existing North Segment
	8" @ 1.94%	Proposed Connector Segment
Limiting Sewer Segment	8" @ 0.33%	Existing South Segment
Sewer Size (D):	8	in.
Manning's n-value (n):	0.013	
Minimum Required Slope of Sewer based on 2.0 ft/sec Velocity	0.0033	
Slope of Existing Sewer (S):	0.0033	ft/ft
Hydraulic Radius (R):	0.167	ft R=D/4 (full pipe)
Manning's Equation:	$V = (1.486/n) * R^{(2/3)} * S^{(1/2)}$	
Velocity In Proposed Sewer Pipe (V, full pipe):	2.0	ft/s minimum
Mannings Equation solved for Capacity (Q)	$Q = (1.49/n) * A * R^{(2/3)} * S^{(1/2)}$	
Proposed Sewer Pipe Capacity:	0.696	cfs
	449,897	gpd*
Proposed Peak Sewer Flows to 71st Street:	0.102	cfs
	66,080	gpd*

\*The pipe capacity is greater than the total peak daily flow, therefore adequate capacity is available.

### Remaining 8" East Segment (West Piece Demo'd) Flowing East Along Angus Dr to Scottsdale Rd

Sewer Segments:	8" @ 0.34%	Remaining East Segment
Sewer Size (D):	8	in.
Manning's n-value (n):	0.013	
Minimum Required Slope of Sewer based on 2.0 ft/sec Velocity	0.0033	
Slope of Existing Sewer (S):	0.0034	ft/ft
Hydraulic Radius (R):	0.167	ft R=D/4 (full pipe)
Manning's Equation:	$V = (1.486/n) * R^{(2/3)} * S^{(1/2)}$	
Velocity In Proposed Sewer Pipe (V, full pipe):	2.0	ft/s minimum
Mannings Equation solved for Capacity (Q)	$Q = (1.49/n) * A * R^{(2/3)} * S^{(1/2)}$	
Proposed Sewer Pipe Capacity:	0.707	cfs
	456,663	gpd*
Proposed Peak Sewer Flows To Angus Dr:	0.214	cfs
	138,320	gpd*

\*The pipe capacity is greater than the total peak daily flow, therefore adequate capacity is available.

### Existing 8" VCP Flowing South Along Scottsdale Road from Angus Drive

Sewer Segments:	8" @ 0.53%	
Sewer Size (D):	8	in.
Manning's n-value (n):	0.013	
Minimum Required Slope of Sewer based on 2.0 ft/sec Velocity	0.0033	
Slope of Existing Sewer (S):	0.0053	ft/ft
Hydraulic Radius (R):	0.167	ft R=D/4 (full pipe)
Manning's Equation:	$V = (1.486/n) * R^{(2/3)} * S^{(1/2)}$	
Velocity In Proposed Sewer Pipe (V, full pipe):	2.5	ft/s minimum
Mannings Equation solved for Capacity (Q)	$Q = (1.49/n) * A * R^{(2/3)} * S^{(1/2)}$	
Existing Sewer Pipe Capacity:	0.882	cfs
	570,157	gpd*
Proposed Peak Sewer Flows To Scottsdale Rd:	0.214	cfs
	138,320	gpd*

\*The pipe capacity is greater than the total peak daily flow, therefore adequate capacity is available.